



1			2			3			4					
TAG	SIGN	NAME	TAG	SIGN	NAME	TAG	SIGN	NAME	TAG	SIGN	NAME	TAG	SIGN	NAME
PS-001		Pneumatic ball valve	PS-002		Manual ball valve	PS-003		Rupture disk	PS-004		Air pressure regulator	PS-005		Centrifugal pump
PS-006		Pneumatic diaphragm valve	PS-007		Manual diaphragm valve	PS-008		View window with light	PS-009		Air treatment device	PS-010		Self-priming pump
PS-011		Steam trap	PS-012		Check valve	PS-013		View window	PS-014		Load cell	PS-015		Diaphragm pump
PS-016		Pneumatic bottom valve	PS-017		Manual bottom valve	PS-018		Pipe view mirror	PS-019		Syringes sampling device	PS-020		Peristaltic pump
PS-021		Pneumatic sampling valve(single port)	PS-022		Manual sampling valve(single port)	PS-023		Vessel sight glass	PS-024		Electric heater	PS-025		Meltering pump
PS-026		Pneumatic sampling valve(double port)	PS-027		Manual sampling valve(double port)	PS-028		Sanitary hose	PS-029		Electric heater for vent filter	PS-030		Twin lobe pump
PS-031		Pneumatic butterfly valve	PS-032		Manual butterfly valve	PS-033		Y-type strainer	PS-034		Air filter housing	PS-035		Rotary vane vacuum pump
PS-036		Pneumatic diaphragm proportional control valve	PS-037		Steam pressure regulator valve	PS-038		Static spray ball	PS-039		Air filter housing	PS-040		Water ring vacuum pump
PS-041		Pneumatic angle seat proportional control valve	PS-042		Safety valve	PS-043		Dynamic spray ball	PS-044		Liquid filter housing	PS-045		Vacuum pump
PS-046		Air breaker	PS-047		Clamping-type sampling valve	PS-048		Static mixer	PS-049		Liquid filter core	PS-050		Fan
PS-051		Temperature transmitter	PS-052		Flowrate transmitter	PS-053		pH meter	PS-054		Dissolved oxygen meter	PS-055		Carbon dioxide concentration meter
PS-056		Temperature gauge	PS-057		Pressure transmitter	PS-058		Conductivity meter	PS-059		Integrity tester	PS-060		Proximity switch
PS-061		Temperature switch	PS-062		Pressure gauge	PS-063		Flow direction	PS-064		Level transmitter	PS-065		Position feedback device
PS-066		Pressure switch	PS-067		Level gauge	PS-068		TOD meter	PS-069		Level switch	PS-070		Pneumatic ball valve
PS-071		Flow direction	PS-072		30 rule requirement	PS-073		30 rule requirement	PS-074		Revision mark	PS-075		Revision mark

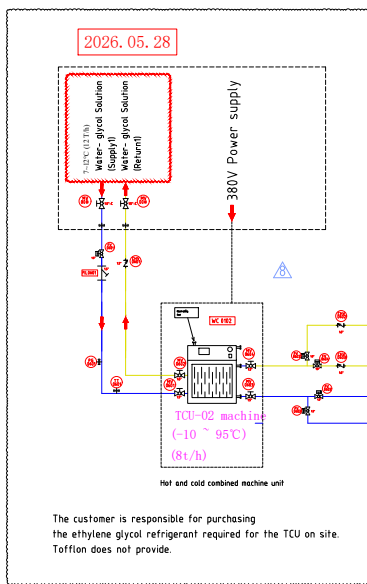

6	7	8
06	△	The integrity check of the terminal filter is conducted at the C level.
06	△	Integrity inspection of the terminal filter exhaust gas discharge into T04 tank during
06	△	The inlet pipe of the buffer tank is connected in parallel with the spray pipe, and the valves are adjusted.
07	△	T05Buffer tank with jacket design added
07	△	The liquid delivery pipeline from P3 tank to T05 buffer tank has been equipped with a jacket design.
08	△	1.Add TCU-02. 2.Revise TCU-01 to supply refrigerant separately to each tank.
08	△	3.TCU-01 adds a condenser tank

7	8
REV	ZONE
03	Update drawing: Added a set hot and cold combined machine and valve
04	Update drawing: A new air filter added to the R1, R2, and R3 vessels, which is used for sterilization filtration of nitrogen and compressed air
05	Update drawing: The P1 tank is fixed and does not need to be moved
05	Add one self-priming pump
05	Add the fixed pipeline from P1 to P2

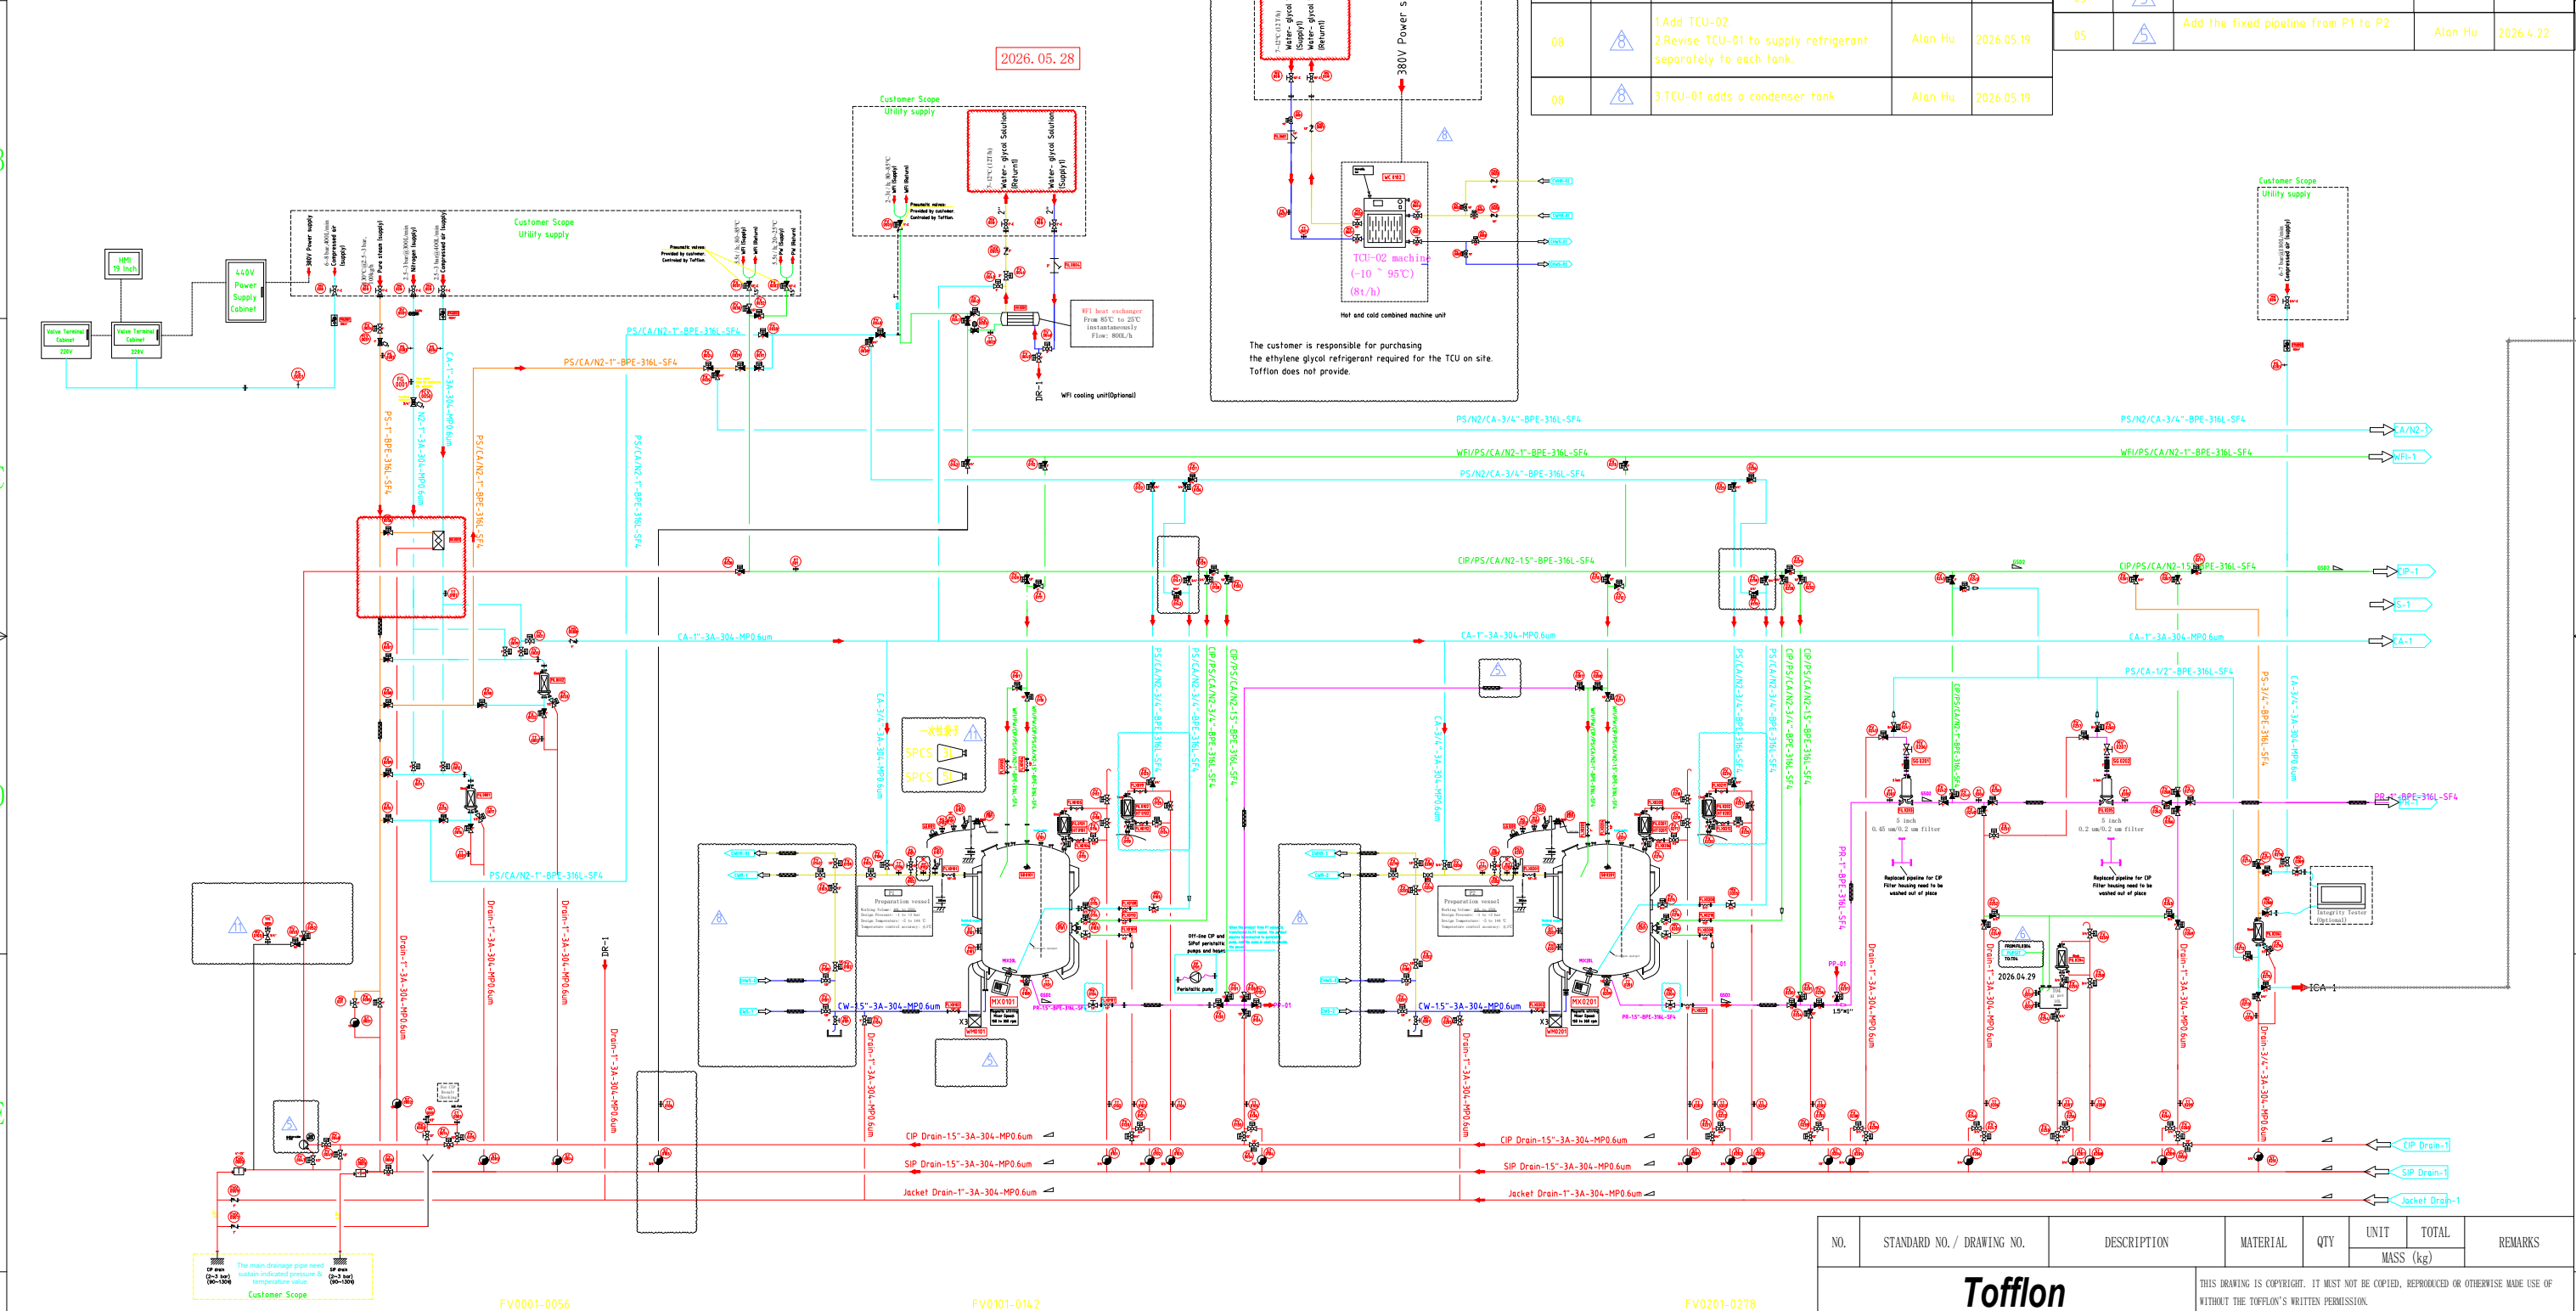

NO.	STANDARD NO. / DRAWING NO.	DESCRIPTION	MATERIAL	QTY	UNIT	TOTAL	REMARKS
					MASS (kg)		
Tofflon			THIS DRAWING IS COPYRIGHT. IT MUST NOT BE COPIED, REPRODUCED OR OTHERWISE MADE USE OF WITHOUT THE TOFFLON'S WRITTEN PERMISSION.				
TITLE: Solution preparation system APLS-250L				SHEET: 01 OF: 02		SIZE: A3	
				DWG: 2026-012Pc-P&ID		REV: 02	
CUSTOMER: Promomed Biokhimik				PROJECT NUMBER: 2026-012Pc			
DESIGNED: Alan Hu	DATE: 2026.06.15	MASS: NA		TOLERANCED UNLESS OTHERWISE NOTED			
CHECKED: Dong Wang	DATE: 2026.06.15	SCALE:		MACHINING WELDING SHEET METAL			
APPROVED: Ziyi Feng	DATE: 2026.06.15	MATERIAL:		GB/T 1804-m GB/T 1184-K GB/T 19804-B GB/T 19804-F GB/T 15055-m			