


# Single Line Diagram of electrical system at Hafed Corporate Office, Sector-5, Panchkula

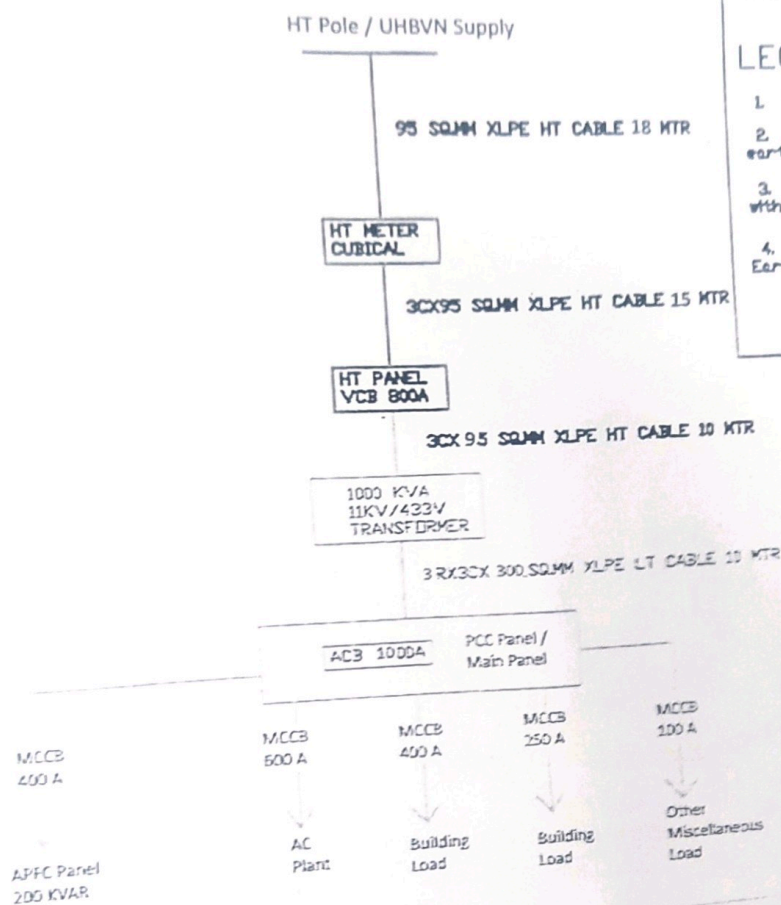

## LEGENDS:

1. Transformer Installed at Solid Ground
2. Transformer Neutral earth with 2 no copper earthing with copper strip 50x5 mm
3. Transformer body earth with 2 no GI earthing with GI strip 50x5 mm
4. VCB Panel, PCC Panel, APFC Panel Earthing with GI strip 40x6 mm

Sanctioned Load - 1123.5 kW  
Contract Demand - 537.22 kW

Mand  
(JELE)

SD/LE