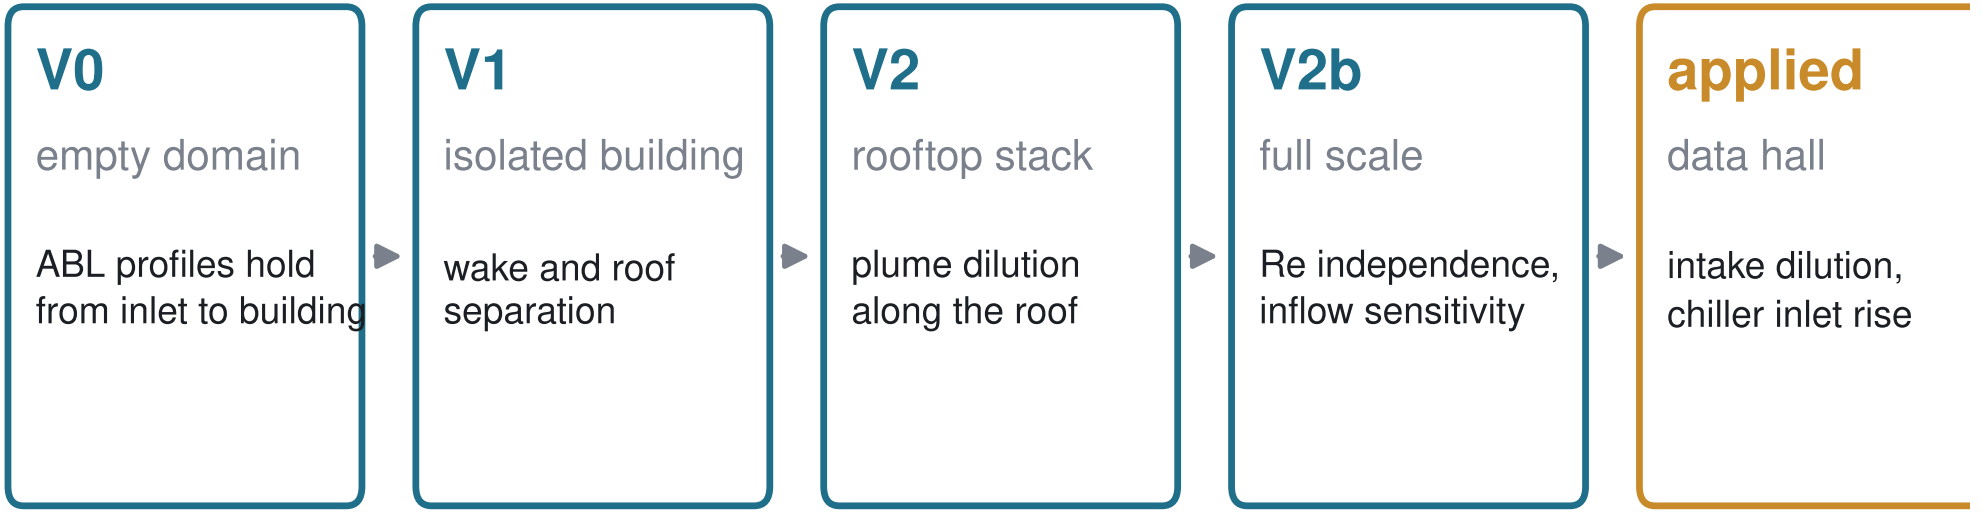
V0
empty domain
ABL profiles hold from inlet to building
V1
isolated building
wake and roof separation
V2
rooftop stack
plume dilution along the roof
V2b
full scale
Re independence, inflow sensitivity
applied
data hall
intake dilution, chiller inlet rise
against
analytical profiles
met
against
AIJ Case H wind tunnel
velocity 0.60 (0.66) not met, grid-independent
against
IRSST R-848 wind tunnel
M = 1 met
M = 3 not met (jet)
against
V2 at 1:200
met, 3 %
inflow effect –40 %
against
acceptance limits (decision 0011)
8-case matrix