


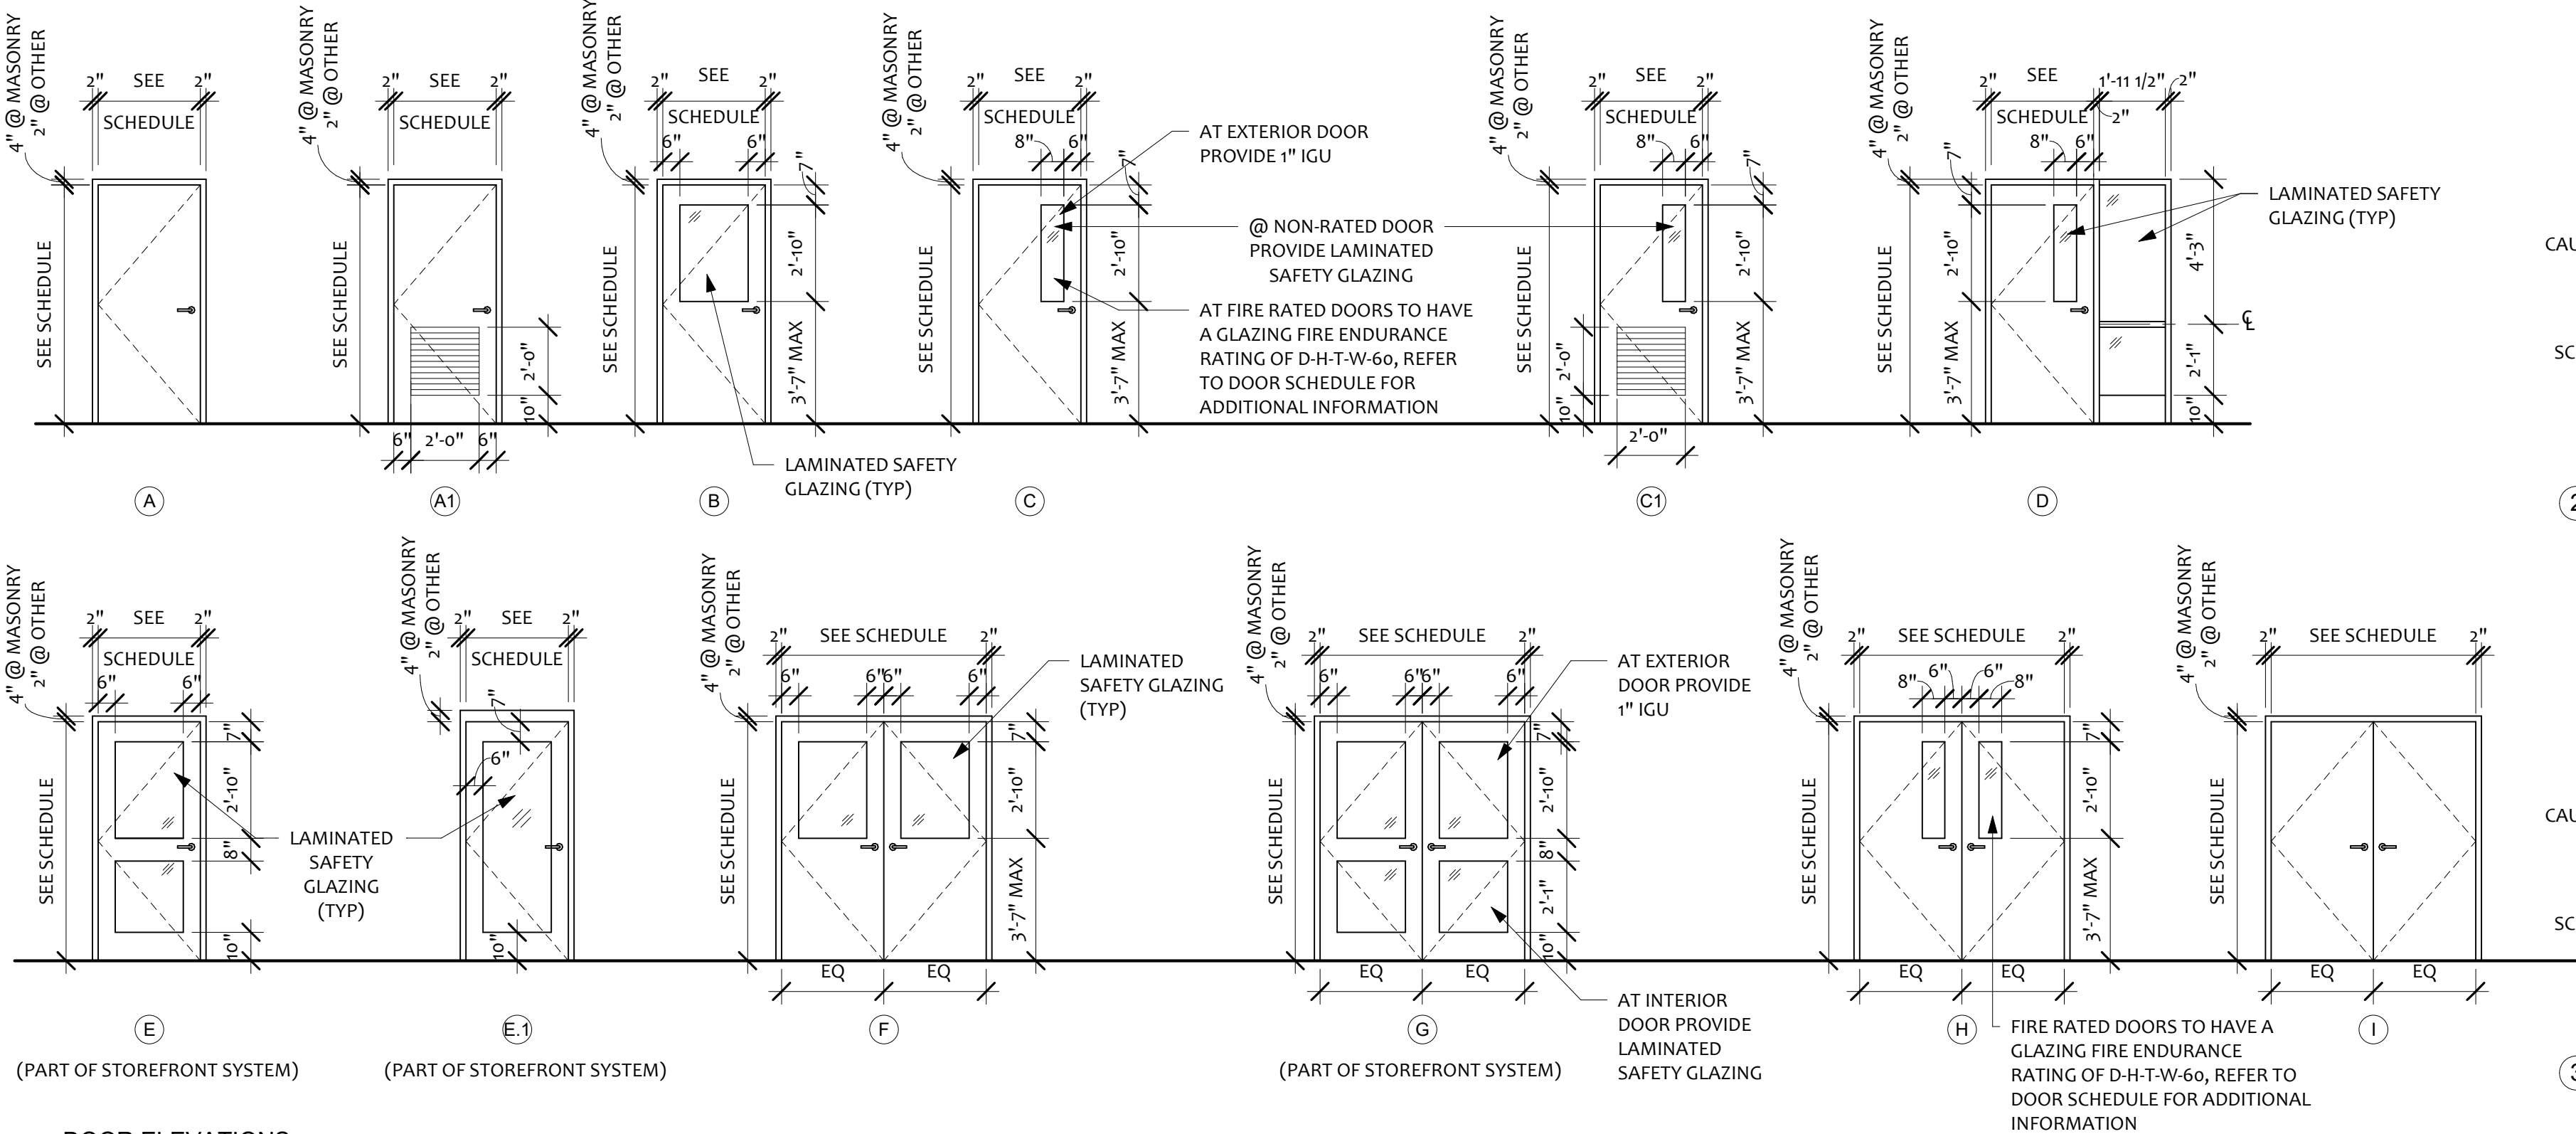

1 DOOR ELEVATIONS
1/4" = 1'-0"

ABBREVIATIONS


PT = PAINT
ST = STAIN
HM = HOLLOW METAL
SCW = SOLID CORE WOOD
ER = EXISTING TO REMAIN
AL = ALUMINUM
GL = GLAZING
AFRP = ALUMINUM DOOR WITH
FIBERGLASS REINFORCED PLASTIC
FACE SHEET

GENERAL DOOR NOTES

- REFER TO SPECIFICATIONS FOR HARDWARE SET.
- REFER TO CONSTRUCTION PLAN FOR HAND OF DOOR.
- HM FRAMES TO BE PRIMED, PREPPED, AND PAINTED. COLOR TO BE TBD.
- IN NEW MASONRY WALLS, PROVIDE (1) TEE ANCHOR FOR EACH 30" OF JAMB, BUT NO LESS THAN (3) JAMB ANCHORS ON EACH SIDE, REGARDLESS OF JAMB LENGTH.
- PROVIDE CUT OUTS, REINFORCEMENTS, ANCHORS, AND FASTENERS FOR ALL HARDWARE IN ALL DOORS AND FRAMES AS PER MANUFACTURER'S SPECIFICATIONS.
- CONTRACTOR TO PROVIDING KEYING TO MATCH EXISTING BUILDING STANDARD. COORDINATE WITH OWNER.
- CLEARANCE UNDER THE BOTTOM OF A DOOR SHALL BE A MAX OF 3/4" U.N.O.
- CLEARANCE UNDER BOTTOM OF FIRE RATED SWING DOORS SHALL NOT EXCEED 3/8" ABOVE RAISED NONCOMBUSTIBLE SILLS AND NOT MORE THAN 3/4" ABOVE FLOOR WHERE THERE IS NO RAISED, NONCOMBUSTIBLE SILL.
- VERIFY ALL EXISTING OPENING DIMENSIONS IN FIELD.
- ALL HARDWARE TO BE ADA COMPLIANT, COORDINATE ALL DOOR HARDWARE WITH OWNER TO MATCH BUILDING STANDARD.
- PROVIDE SILL ON ALL DOORS AS REQUIRED. ROOM NAMES AND NUMBER SHALL BE COORDINATED IN FIELD WITH ARCHITECT/OWNER. SEE SPECIFICATIONS FOR MORE INFO.


DOOR SCHEDULE

	DOOR No.	ROOM	DOOR TYPE	FRAME TYPE	WIDTH	HEIGHT	ELEVATION	HARDWARE SET	FIRE RATING	COMMENTS
FIRST FLOOR										
FIRST FLOOR	100A	SECURE VESTIBULE	AFRP/GL	AL	6'-0"	7'-0"	G	SET 1.0		CARD READER, PART OF STOREFRONT SYSTEM
FIRST FLOOR	100B	SECURE VESTIBULE	AFRP/GL	AL	6'-0"	7'-0"	G	SET 2.0		CARD READER, PART OF STOREFRONT SYSTEM
FIRST FLOOR	100C	VESTIBULE/LOBBY	SWC/GL	HM	6'-0"	7'-0"	G	SET 7.0		CARD READER, PART OF STOREFRONT SYSTEM
FIRST FLOOR	100D	CORRIDOR	SWC/GL	HM	7'-0"	7'-0"	H	SET 13.0	60 MIN	MAGNETIC HOLD OPEN, GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60
FIRST FLOOR	100E	CORRIDOR	SWC/GL	HM	3'-0"	7'-0"	C	SET 11.0	60 MIN	MAGNETIC HOLD GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60
FIRST FLOOR	100F	CORRIDOR	SWC/GL	HM	7'-0"	7'-0"	H	SET 14.0	60 MIN	MAGNETIC HOLD GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60
FIRST FLOOR	100G	CORRIDOR	SWC/GL	HM	7'-0"	7'-0"	H	SET 14.0	60 MIN	MAGNETIC HOLD OPEN, GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60
FIRST FLOOR	100H	VESTIBULE	SWC/GL	HM	3'-0"	7'-0"	C	SET 5.0		CARD READER
FIRST FLOOR	100H.1	VESTIBULE	AFRP/GL	HM	2'-10"	7'-0"	C	SET 6.0	60 MIN	CARD READER, PART OF STOREFRONT SYSTEM
FIRST FLOOR	100I	VESTIBULE/LOBBY	SCW	HM	3'-0"	7'-0"	A	SET 24.0	60 MIN	
FIRST FLOOR	100J	VESTIBULE/LOBBY	SWC/GL	HM	3'-0"	7'-0"	C	SET 31.0		
FIRST FLOOR	100K	STAIR #1	SWC/GL	HM	3'-0"	7'-0"	C	SET 31.0	60 MIN	GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60
FIRST FLOOR	101	MAIN OFFICE	SWC/GL	HM	3'-0"	7'-0"	D	SET 15.0		
FIRST FLOOR	101A	SUPERVISOR OF INSTRUCTION	SWC/GL	HM	3'-0"	7'-0"	D	SET 17.0		
FIRST FLOOR	101B	SUPERVISOR OF BCBA	SWC/GL	HM	3'-0"	7'-0"	D	SET 17.0		
FIRST FLOOR	101C	PRINCIPAL'S OFFICE	SWC/GL	HM	3'-0"	7'-0"	D	SET 17.0		
FIRST FLOOR	101D	CONFERENCE ROOM	SWC/GL	HM	3'-0"	7'-0"	E.1	SET 17.0		
FIRST FLOOR	102	FACULTY DINING/WORK RM.	SWC/GL	HM	3'-0"	7'-0"	C	SET 16.0		
FIRST FLOOR	103	SOCIAL WORK OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 15.0		
FIRST FLOOR	103A	CL.	SCW	HM	3'-0"	7'-0"	A	SET 19.0		
FIRST FLOOR	104	SLP SUITE	SWC/GL	HM	3'-0"	7'-0"	C	SET 15.0		
FIRST FLOOR	104A	OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 17.0		
FIRST FLOOR	104B	OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 17.0		
FIRST FLOOR	104C	OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 17.0		
FIRST FLOOR	105A	CAFETERIA	SWC/GL	HM	3'-0"	7'-0"	C1	SET 21.0		
FIRST FLOOR	105B	CAFETERIA	SCW	HM	3'-0"	7'-0"	A	SET 22.0		
FIRST FLOOR	105D	CAFETERIA	SWC/GL	HM	6'-0"	7'-0"	F	SET 23.0		
FIRST FLOOR	105E	CAFETERIA	AFRP/GL	AL	3'-7"	7'-0"	C	SET 3.0		GC TO COORDINATE DOOR WIDTH WITH EXISTING STOREFRONT CONDITION AND MULLION SPACING, TYP.
FIRST FLOOR	106	ART CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 15.0		
FIRST FLOOR	107	MOTOR RM.	SWC/GL	HM	3'-0"	7'-0"	B	SET 15.0		
FIRST FLOOR	108	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 15.0		
FIRST FLOOR	109	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
FIRST FLOOR	110	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
FIRST FLOOR	111	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
FIRST FLOOR	112	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 15.0		
FIRST FLOOR	113A	SWEET SHOP	SWC/GL	HM	3'-0"	7'-0"	E	SET 8.0		CARD READER
FIRST FLOOR	113B	SWEET SHOP	SWC/GL	HM	3'-0"	7'-0"	C	SET 9.0		CARD READER
FIRST FLOOR	114	CORRIDOR	SCW	HM	3'-0"	7'-0"	A	SET 24.0		
FIRST FLOOR	115	SHOWER RM.	SCW	HM	3'-0"	7'-0"	A	SET 26.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
FIRST FLOOR	116	NURSE'S OFFICE/LAB	SWC/GL	HM	3'-0"	7'-0"	C	SET 16.0		

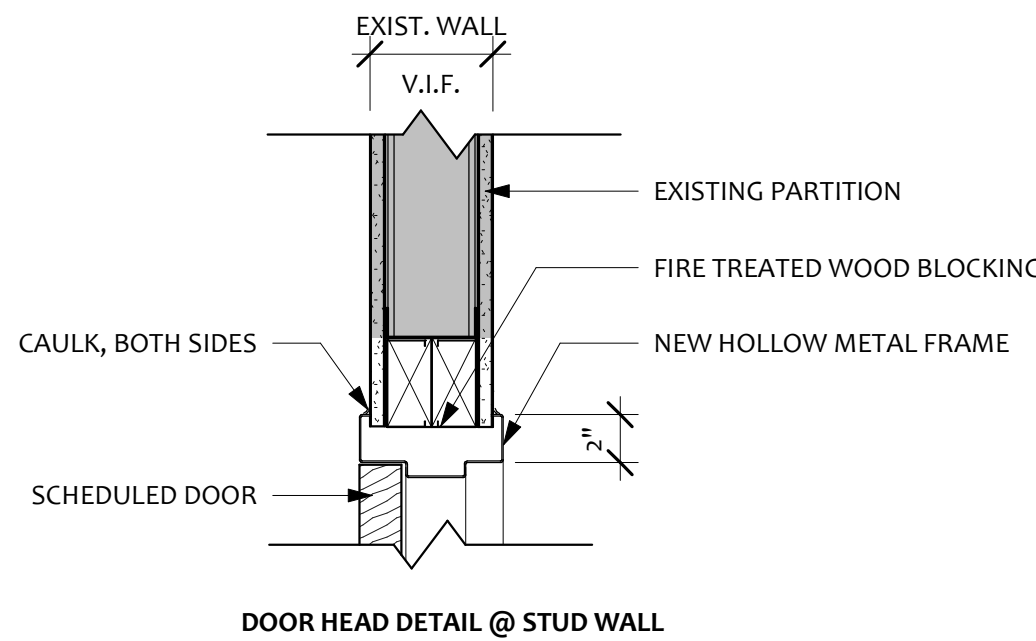


DOOR HEAD DETAIL @ STUD WALL

2 TYP. HM FRAME AT EXIST. WALL
1 1/2" = 1'-0"

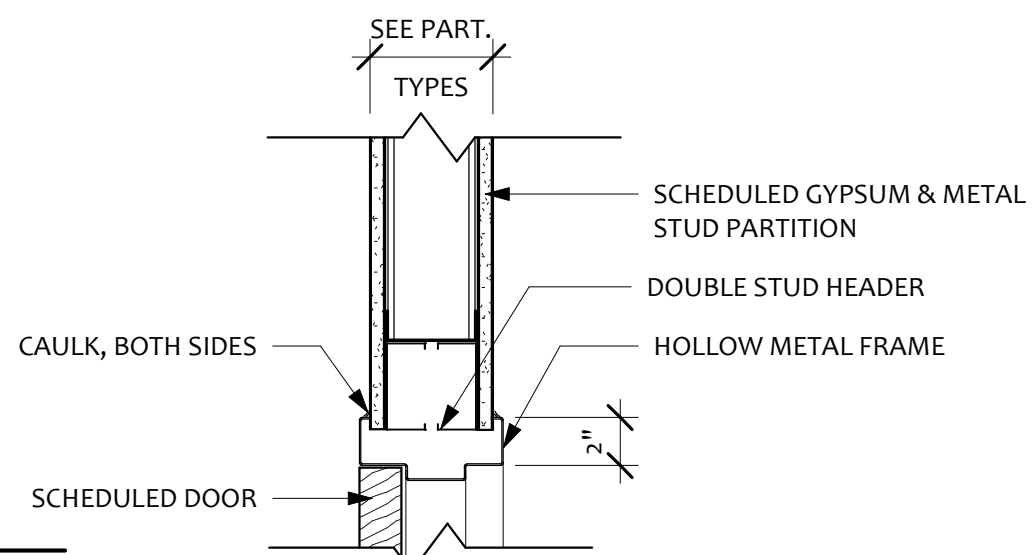


DOOR HEAD DETAIL @ STUD WALL

3 TYP. HM FRAME AT NEW STUD WALL
1 1/2" = 1'-0"

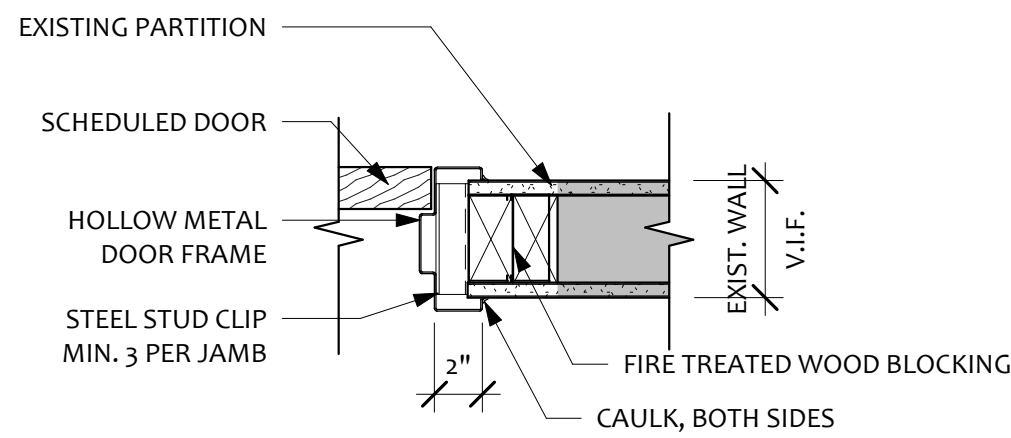

DOOR JAMB DETAIL @ STUD WALL

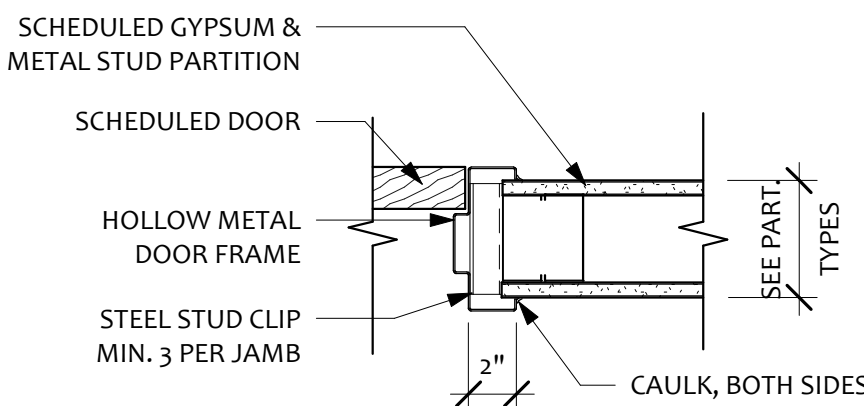

DOOR JAMB DETAIL @ STUD WALL

DOOR SCHEDULE

	DOOR No.	ROOM	DOOR TYPE	FRAME TYPE	WIDTH	HEIGHT	ELEVATION	HARDWARE SET	FIRE RATING	COMMENTS
FIRST FLOOR	116A	NURSE'S TL.	SCW	HM	3'-0"	7'-0"	A	SET 28.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
FIRST FLOOR	118	OT/PT OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 15.0		
FIRST FLOOR	119	STG.	SCW	HM	3'-0"	7'-0"	A	SET 24.0		
FIRST FLOOR	120	FAC. TL.	SCW	HM	3'-0"	7'-0"	A	SET 29.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
FIRST FLOOR	121	FAC. TL.	SCW	HM	3'-0"	7'-0"	A	SET 29.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
FIRST FLOOR	122	B. TOILETS	SCW	HM	3'-0"	7'-0"	A	SET 30.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
FIRST FLOOR	123	JAN. CL.	SCW	HM	3'-0"	7'-0"	A1	SET 24.0		
FIRST FLOOR	124	G. TOILETS	SCW	HM	3'-0"	7'-0"	A	SET 30.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
FIRST FLOOR	125	SPRINKLER RM.	SCW	HM	3'-0"	7'-0"	A	SET 24.0		
FIRST FLOOR	126	MECH/ELEC. RM.	SCW	HM	3'-0"	7'-0"	A	SET 31.0	60 MIN	
FIRST FLOOR	126A	IT. CL.	SCW	HM	3'-0"	7'-0"	A1	SET 25.0		
SECOND FL.										
SECOND FL.	200A	CORRIDOR	SWC/GL	HM	6'-0"	7'-0"	F	SET 23.0		
SECOND FL.	200B	CORRIDOR	SWC/GL	HM	6'-0"	7'-0"	F	SET 32.0		
SECOND FL.	200C	STAIR #2	SWC/GL	HM	3'-0"	7'-0"	C	SET 11.0	60 MIN	GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60, CARD READER
SECOND FL.	200D	CORRIDOR	SWC/GL	HM	5'-8"	7'-0"	G	SET 2.0		REMOVABLE MULLION, CARD READER, DOOR ASSEMBLY TO FILL GAP BETWEEN (2) EXISTING WALLS ENSURE (1) DOOR LEAF IS 3'-0" WIDE MIN.
SECOND FL.	200E	ELEC. RM.	SCW	HM	3'-0"	7'-0"	A	SET 39.0	60 MIN	
SECOND FL.	200F	LOBBY	SWC/GL	HM	3'-0"	7'-0"	C	SET 31.0		GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60
SECOND FL.	200G	STAIR #1	SWC/GL	HM	3'-0"	7'-0"	C	SET 31.0	60 MIN	GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60
SECOND FL.	201	ADL APARTMENT	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
SECOND FL.	203	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
SECOND FL.	204	VOCATIONAL LAB	SWC/GL	HM	3'-0"	7'-0"	B	SET 15.0		
SECOND FL.	205	SENSORY RM.	SWC/GL	HM	3'-0"	7'-0"	C	SET 16.0		
SECOND FL.	206	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
SECOND FL.	207	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 15.0		
SECOND FL.	208	BCBA OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 15.0		
SECOND FL.	209	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 15.0		
SECOND FL.	210	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
SECOND FL.	211	FACULTY RM.	SWC/GL	HM	3'-0"	7'-0"	C	SET 16.0		
SECOND FL.	212	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
SECOND FL.	213	FAC. TL.	SCW	HM	3'-0"	7'-0"	A	SET 29.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
SECOND FL.	214	FAC. TL.	SCW	HM	3'-0"	7'-0"	A	SET 29.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
SECOND FL.	215	OBSERVATION RM.	SWC/GL	HM	3'-0"	7'-0"	C	SET 15.0		
SECOND FL.	215A	SECLUSION RM.	SWC/GL	HM	3'-0"	7'-0"	C	SET 34.0		
SECOND FL.	216	CONFERENCE RM.	SWC/GL	HM	3'-0"	7'-0"	C	SET 16.0		
SECOND FL.	217	CONFERENCE RM.	SWC/GL	HM	3'-0"	7'-0"	C	SET 16.0		
SECOND FL.	218	SHOWER RM.	SCW	HM	3'-0"	7'-0"	A	SET 26.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
SECOND FL.	219	MAIN OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 16.0		
SECOND FL.	219A	OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 17.0		
SECOND FL.	219B	OFFICE	SWC/GL	HM	3'-0"	7'-0"	C	SET 17.0		
SECOND FL.	220	STUDENT TL.	SCW	HM	3'-0"	7'-0"	A	SET 27.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
SECOND FL.	221	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
SECOND FL.	222	STUDENT TL.	SCW	HM	3'-0"	7'-0"	A	SET 27.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
SECOND FL.	223	FITNESS RM.	SWC/GL	HM	6'-0"	7'-0"	F	SET 4.0		PART OF STOREFRONT SYSTEM
SECOND FL.	223A	STG.	SCW	HM	3'-0"	7'-0"	A	SET 24.0		
SECOND FL.	224	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
SECOND FL.	225	CLASSROOM	SWC/GL	HM	3'-0"	7'-0"	B	SET 16.0		
SECOND FL.	226	B. TL.	SCW	HM	3'-0"	7'-0"	A	SET 30.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
SECOND FL.	227	JAN. CL.	SCW	HM	3'-0"	7'-0"	A1	SET 24.0		
SECOND FL.	228	G. TL.	SCW	HM	3'-0"	7'-0"	A	SET 30.0		ALL TOILET AND SHOWER ROOMS TO HAVE 3/4" UNDERCUT
THIRD FL.										
THIRD FL.	300D	STAIR #2	SWC/GL	HM	3'-0"	7'-0"	C	SET 11.0	60 MIN	GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60, CARD READER
THIRD FL.	300E	CORRIDOR	SWC/GL	HM	3'-0"	7'-0"	C	SET 11.0		CARD READER
THIRD FL.	301A	CORRIDOR	SWC/GL	HM	3'-0"	7'-0"	C	SET 12.0		CARD READER
THIRD FL.	301B	ELEC. RM.	SCW	HM	3'-0"	7'-0"	A	SET 12.0	60 MIN	
THIRD FL.	301C	LOBBY	SWC/GL	HM	3'-0"	7'-0"	C	SET 31.0		
THIRD FL.	301D	STAIR #1	SWC/GL	HM	3'-0"	7'-0"	C	SET 31.0	60 MIN	GLAZING TO HAVE A FIRE ENDURANCE RATING OF D-H-T-W-60
THIRD FL.	301E	LOBBY	SWC/GL	HM	3'-0"	7'-0"	C	SET 11.0		CARD READER