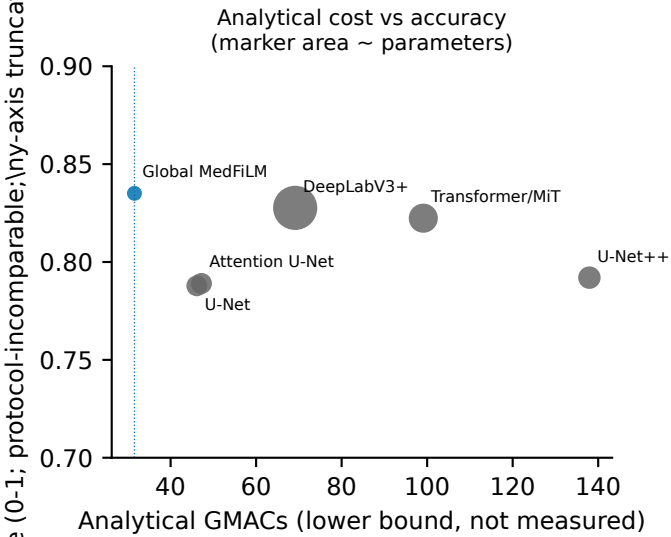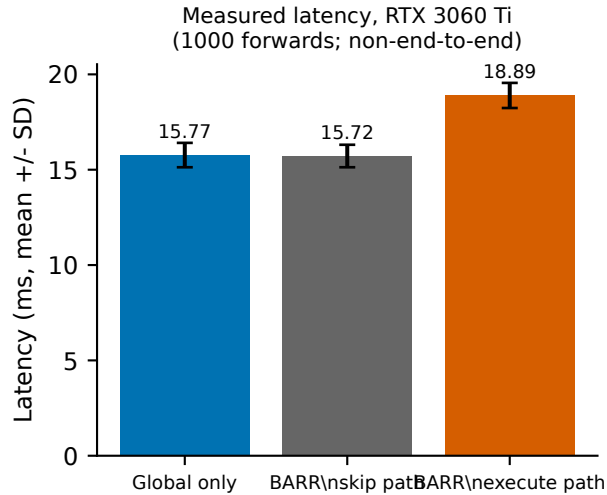Figure 10. Accuracy versus computational cost: analytical and measured quantities kept separate