


Typical
The condensate sensors at the take off for the first chilled beam served or adjacent to the take off if space is not permitted. Expose the CHW pipe insulation for 100mm and strap the sensor. To be installed as per the condensate sensor manufacturers specification.

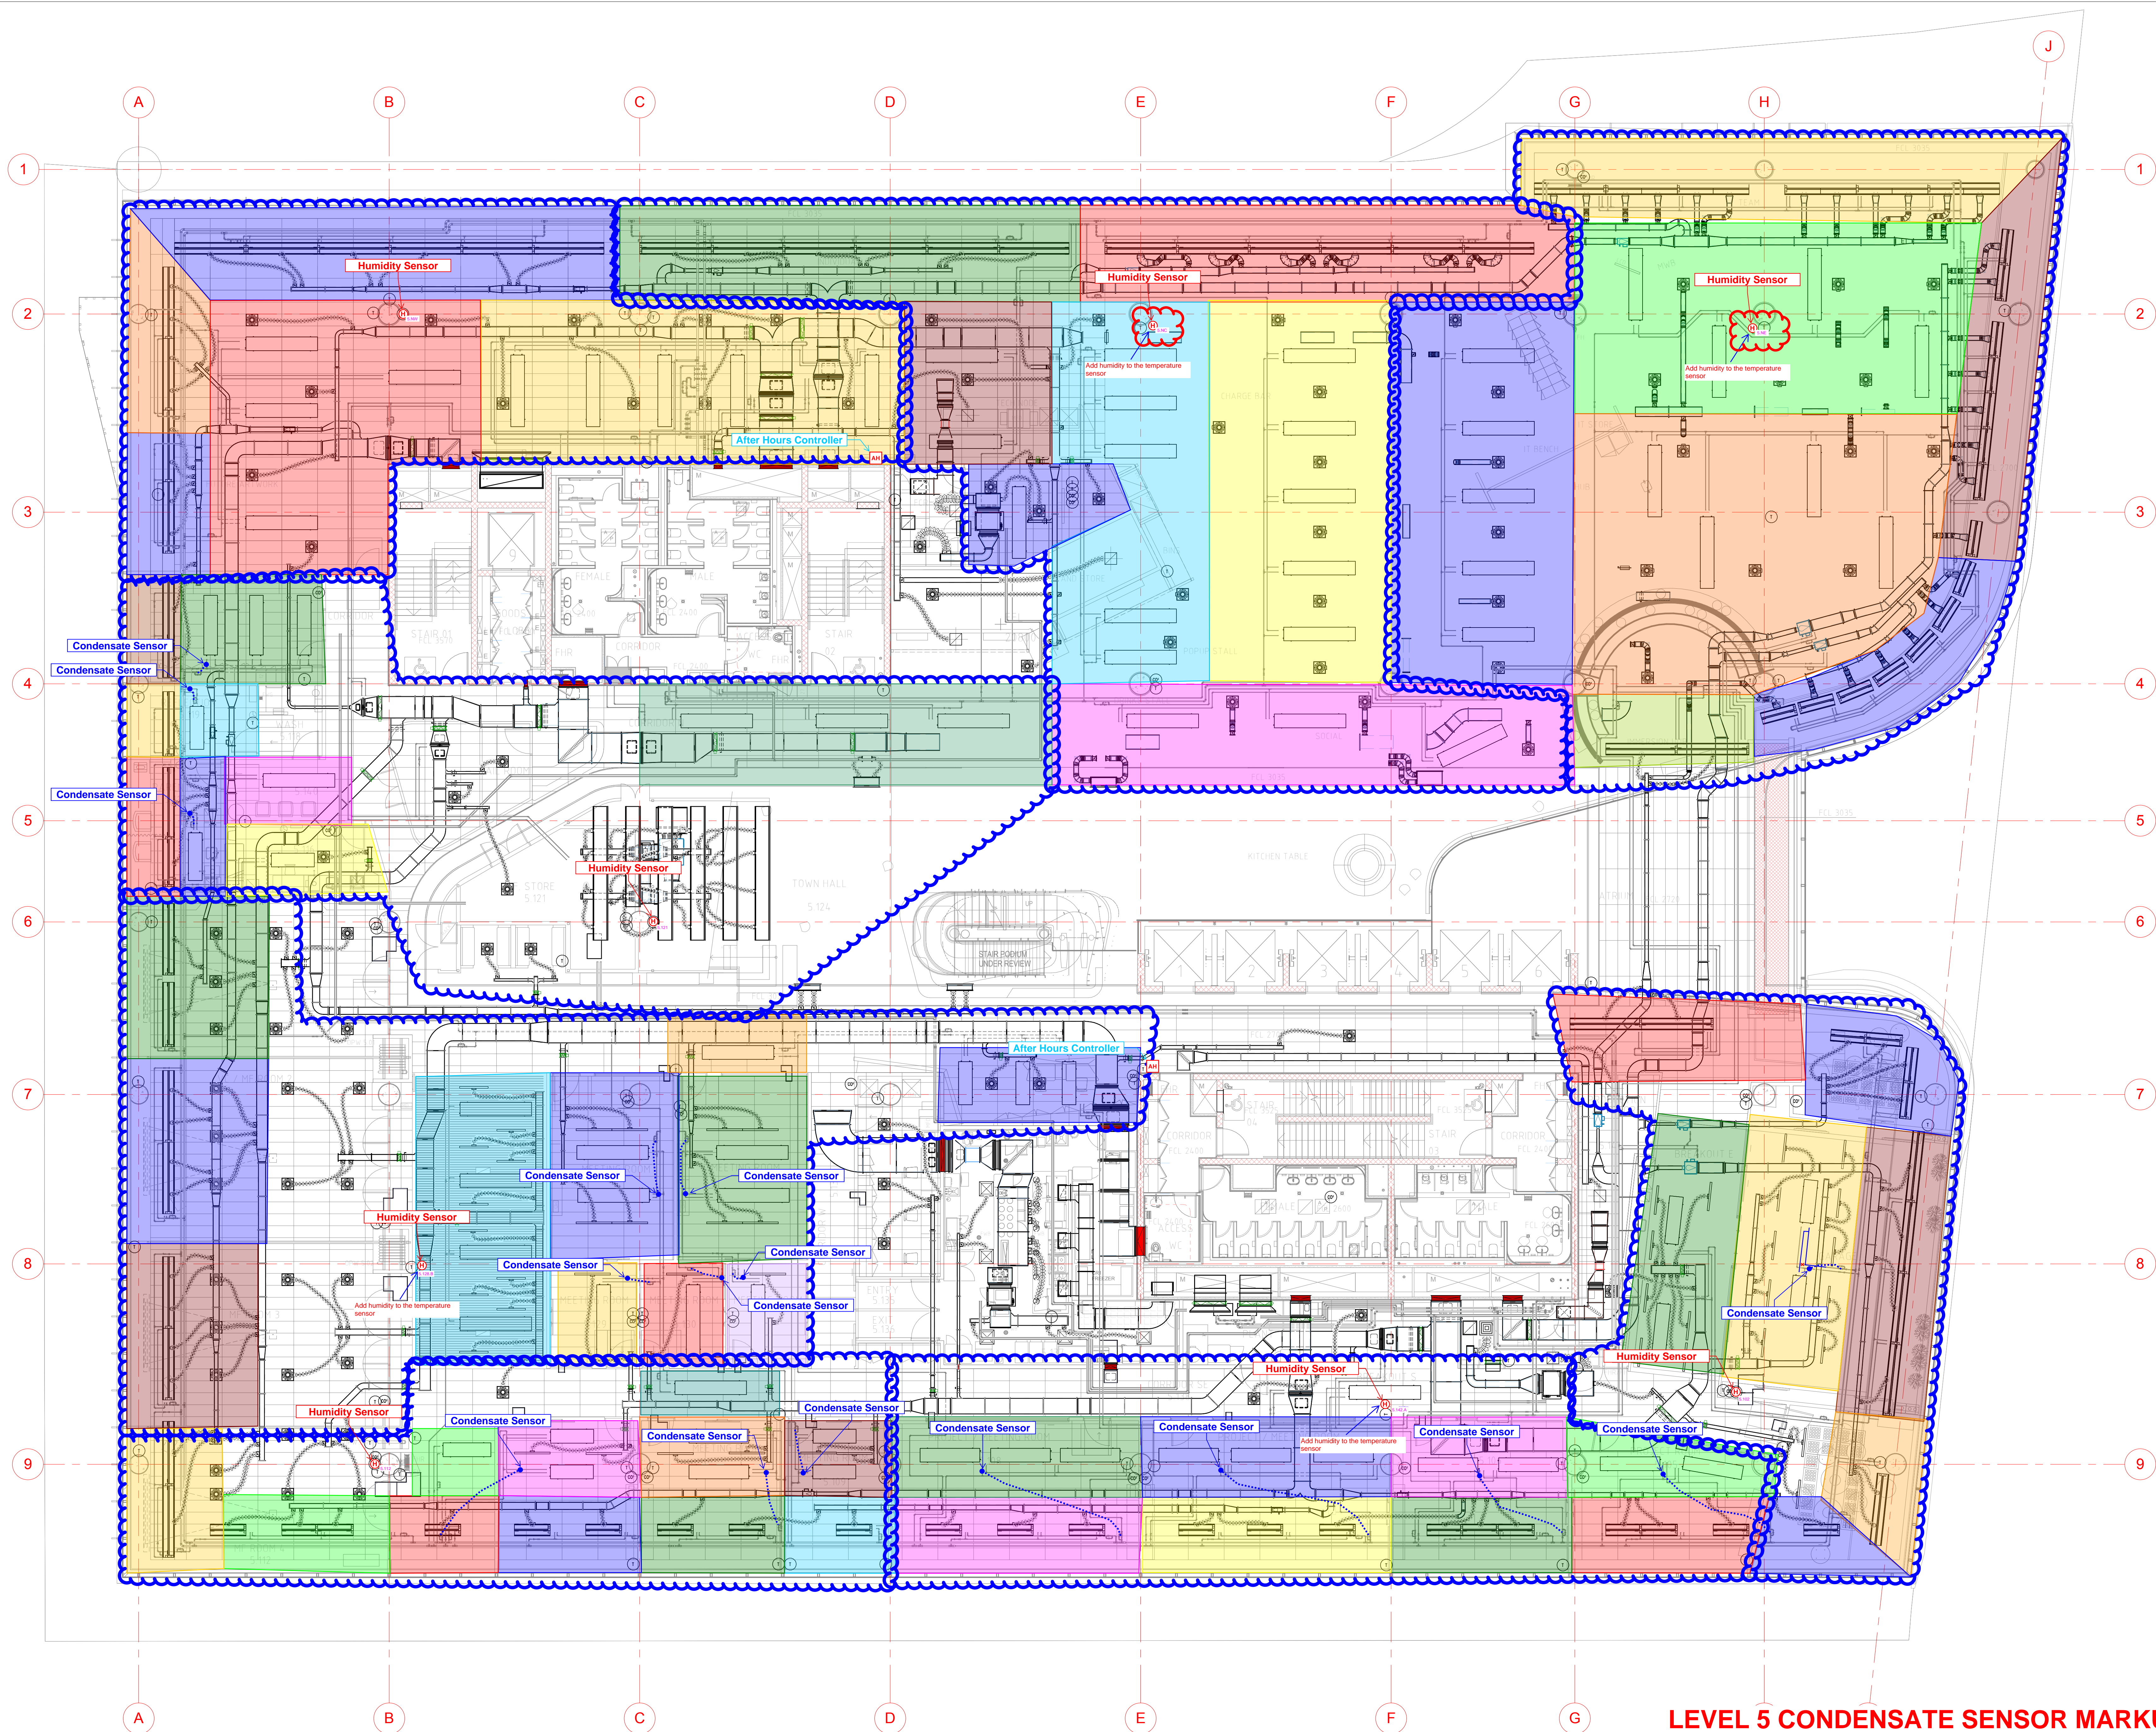

LEVEL 5 CONDENSATE SENSOR MARKUP
AGC-8532-SK-LEVEL 5 CONDENSATE SENSOR
MARKUP-161101
Rev 3 - NM - 05/10/2016
Rev 4 - NM - 20/10/2016
Rev 5 - NM -27/10/2016
Rev 6 - NM