


MR Test

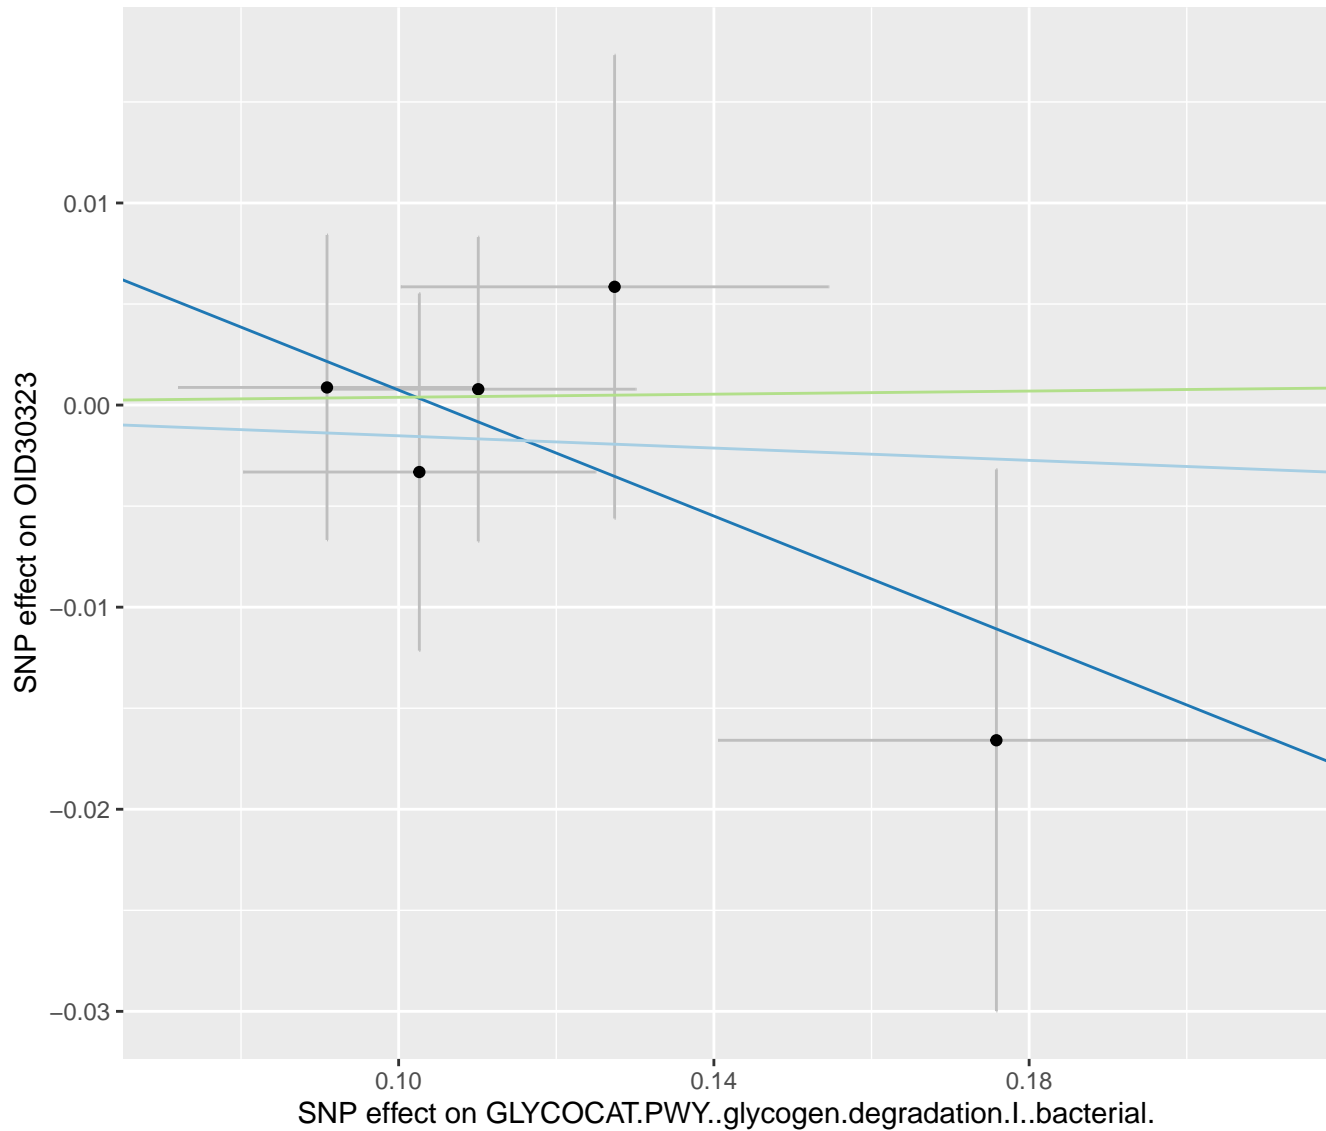

rs115001375

rs35296932

rs2056101

rs59657730

rs41474647

All

-0.10

-0.05

0.00

0.05

MR leave-one-out sensitivity analysis for
'GLYCOCAT.PWY..glycogen.degradation.l..bacterial.' on 'OID30323'

