
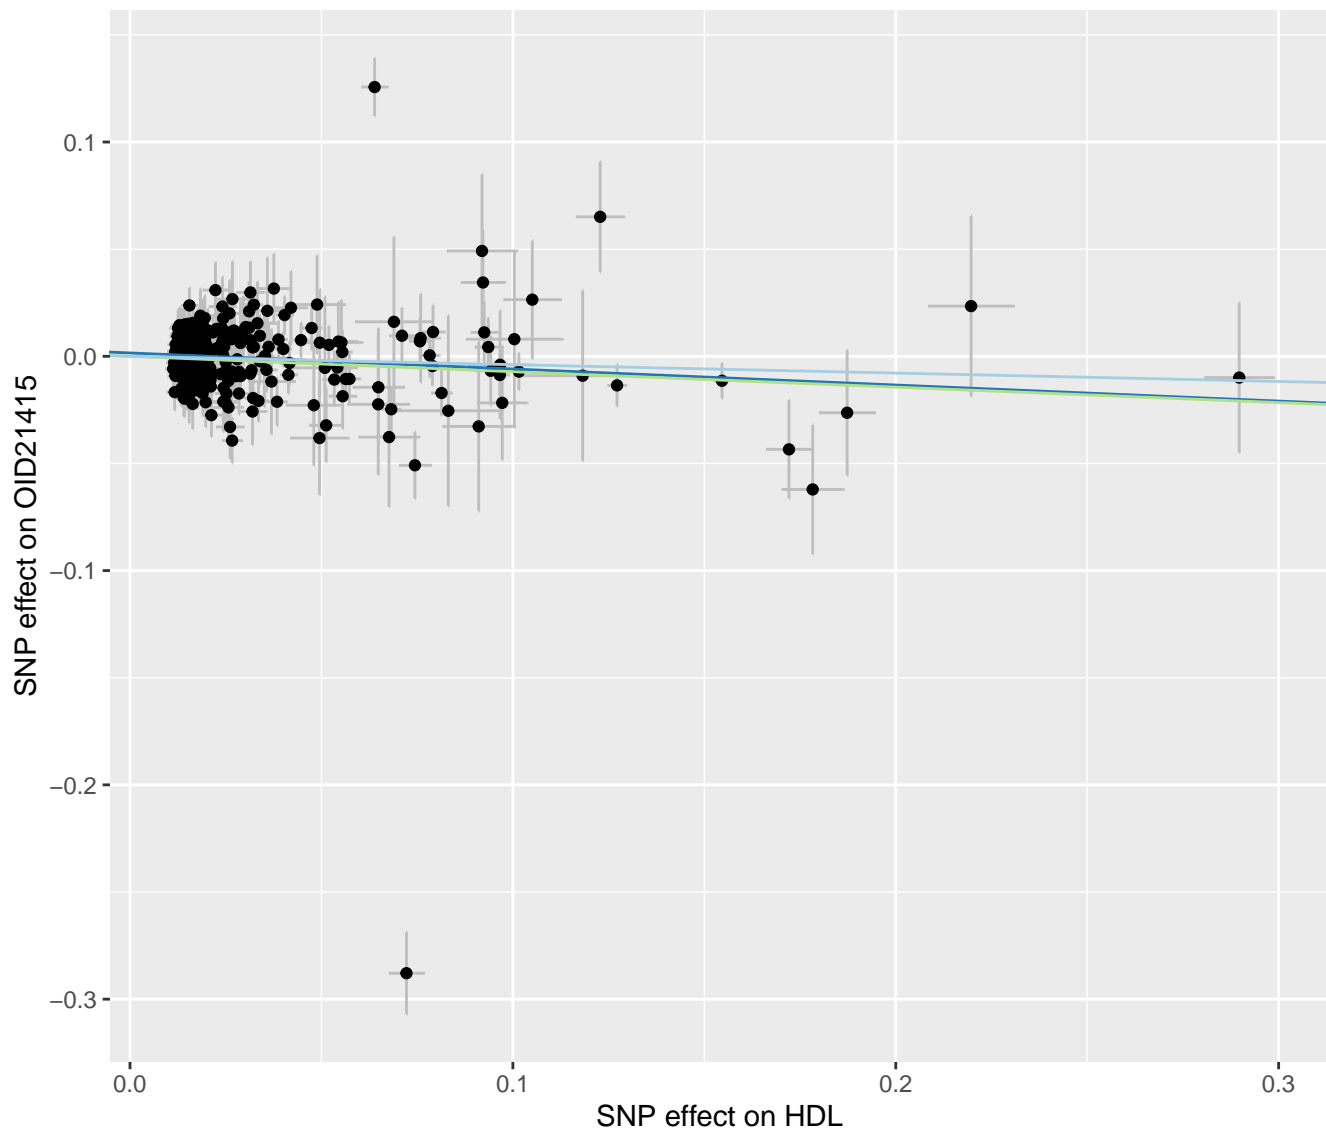


# MR Test



-0.08

-0.04

0.00

MR leave-one-out sensitivity analysis for  
'HDL' on 'OID21415'

