


MR Test

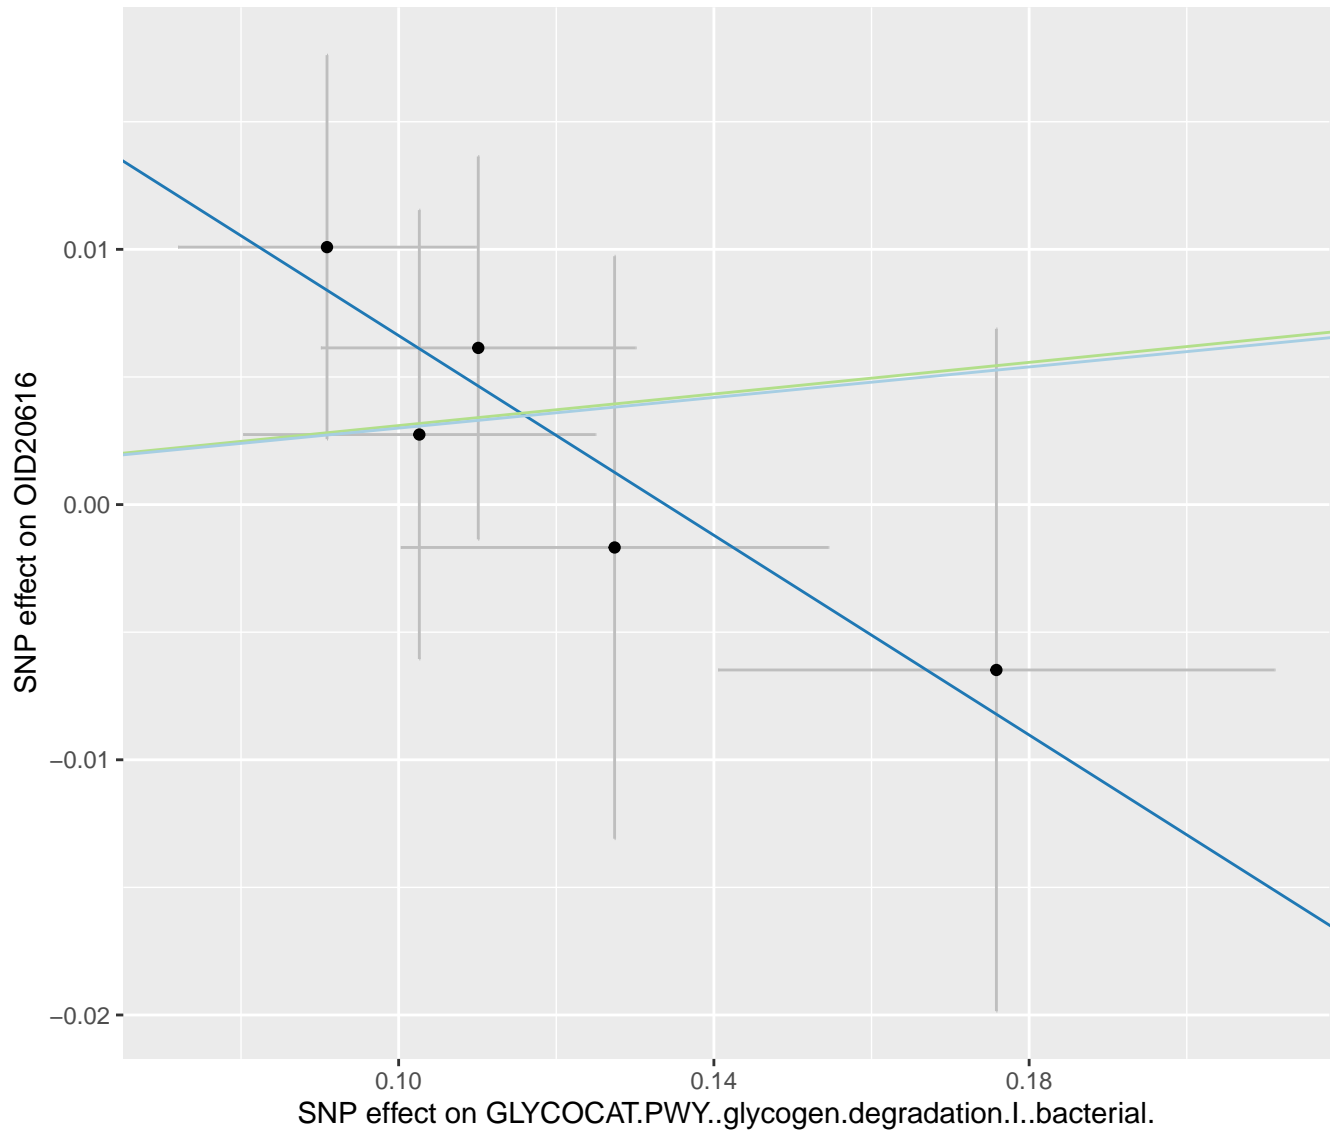

rs115001375

rs41474647

rs35296932

rs59657730

rs2056101

All

-0.05

0.00

0.05

0.10

MR leave-one-out sensitivity analysis for
'GLYCOCAT.PWY.glycogen.degradation.l..bacterial.' on 'OID20616'

