Company Name	**K.L.E Institute of Technology Hubballi**	**Project Title**	**Assignment 02**
Group/Team Name	**Civil Dept.**	**Subtitle**	
Designer	**ISPatil**	**Job Number**	**02**
Date	**05 /06 /2016**	**Method**	**Limit State Design (No Earthquake Load)**

Design Conclusion	
Endplate	**Pass**
Endplate	
Connection Properties	
Connection	
Connection Title	Flexible Endplate
Connection Type	Shear Connection
Connection Category	
Connectivity	Column flange-Beam web
Beam Connection	Welded
Column Connection	Bolted
Loading (Factored Load)	
Shear Force (kN)	160
Components	
Column Section	ISSC 250
Material	Fe 410
Beam Section	ISMB 400
Material	Fe 410
Hole	STD
Plate Section	300X200X12
Thickness (mm)	12
Width (mm)	200
Depth (mm)	300
Hole	STD
Weld	
Type	Double Fillet
Size (mm)	10
Bolts	
Type	HSFG
Grade	8.8
Diameter (mm)	20

Bolt Numbers	4
Columns (Vertical Lines)	2
Bolts Per Column	2
Gauge (mm)	0
Pitch (mm)	226
End Distance (mm)	37
Edge Distance (mm)	37
Assembly	
Column-Beam Clearance (mm)	12

Company Name	K.L.E Institute of Technology Hubballi	Project Title	Assignment 02
Group/Team Name	Civil Dept.	Subtitle	
Designer	ISPatil	Job Number	02
Date	05 /06 /2016	Method	Limit State Design (No Earthquake Load)

Design Check			
Check	**Required**	**Provided**	**Remark**
Bolt shear capacity (kN)		V_{dsb} = ((800.0*0.6126*20*20)/(√3*1.25*1000) = 52.694 [cl. 10.3.3]	
Bolt bearing capacity (kN)		V_{dpb} = (2.5*0.508*20*12.0*410)/(1.25*1000) = 99.974 [cl. 10.3.4]	
Bolt capacity (kN)		Min (52.694, 99.974) = 52.694	**Pass**
Critical bolt shear (kN)	≤ 52.694	45.797	**Pass**
No. of bolts		4	
No.of column(s)	≤ 2	2	
No. of bolts per column per side of end plate		2	
Bolt pitch (mm)	≥ 2.5*20 = 50, ≤ Min(32*8.9, 300) = 285 [cl. 10.2.2]	226	**Pass**
Bolt gauge (mm)	≥ 2.5*20 = 50, ≤ Min(32*8.9, 300) = 285 [cl. 10.2.2]	0	
End distance (mm)	≥ 1.7*22.0 = 37.4, ≤ 12*8.9 = 106.8 [cl. 10.2.4]	37	**Pass**
Edge distance (mm)	≥ 1.7*22.0 = 37.4, ≤ 12*8.9 = 106.8 [cl. 10.2.4]	37	**Pass**
Block shear capacity (kN)	≥ 160	V_{db} = 387 [cl. 6.4.1]	
Plate thickness (mm)	≥ 8	12	**Pass**
	≥ 0.6*400.0=240.0, ≤		

Plate height (mm)	400.0-16.0-14.0-16.0-14.0-10=330.0 [cl. 10.2.4, Insdag Detailing Manual, 2002]	300	**Pass**
Plate Width (mm)	≥ 174, ≤ 250.0	200	**Pass**
Effective weld length (mm)		300-2*10 = 280	
Weld strength (kN/mm)	0.286	f_v =(0.7*10*410)/(√3*1.25*1000) = 1.326 [cl. 10.5.7]	**Pass**

Company Name	K.L.E Institute of Technology Hubballi	Project Title	Assignment 02
Group/Team Name	Civil Dept.	Subtitle	
Designer	ISPatil	Job Number	02
Date	05 /06 /2016	Method	Limit State Design (No Earthquake Load)

Views	
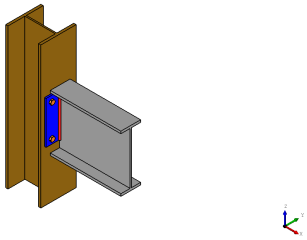	

Company Name	K.L.E Institute of Technology Hubballi	Project Title	Assignment 02
Group/Team Name	Civil Dept.	Subtitle	
Designer	ISPatil	Job Number	02
Date	05 /06 /2016	Metdod	Limit State Design (No Earthquake Load)

Additional Comments	Second Assignment Day 1