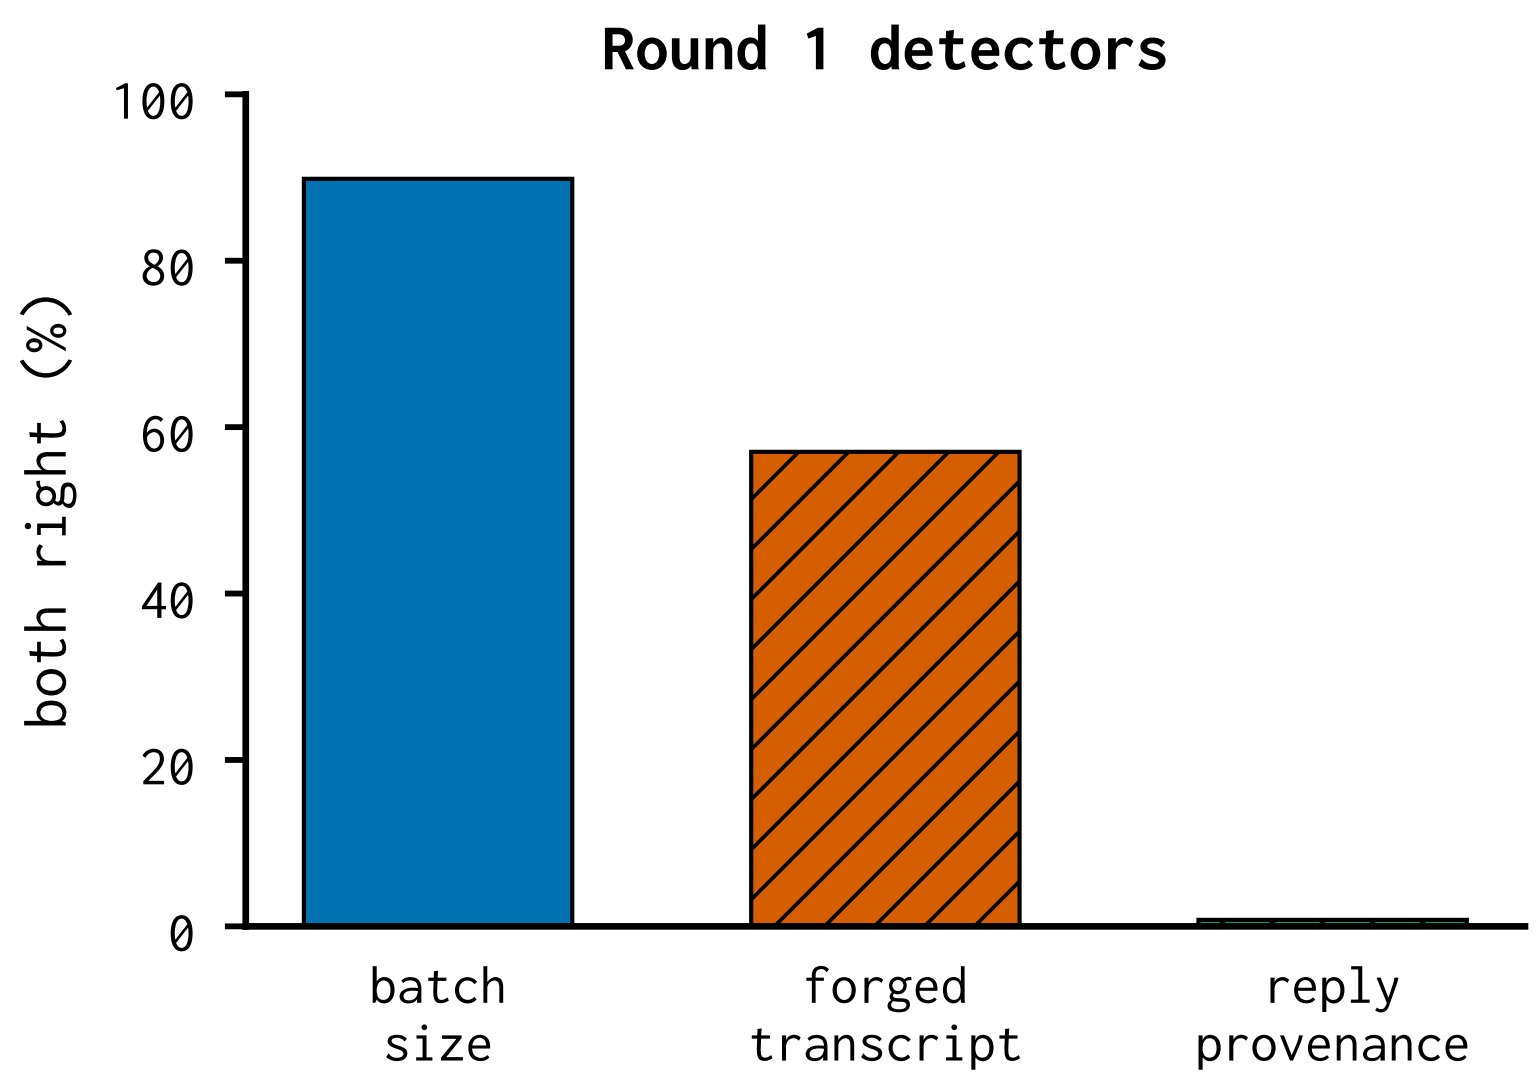
Round 1 detectors
both right (%)
100
80
60
40
20
0
batch size
forged transcript
reply provenance