



AquaSmart AI System

Comprehensive Water Quality Analysis Report

Target: Pond 2 | Date: 2026-02-14

Data Source: (LIVE SENSOR DATA)


1. AI Executive Summary

CRITICAL: The system detected unsafe conditions. High Ammonia or Low Oxygen levels were recorded. Immediate corrective action (Aeration/Water Exchange) is recommended.

2. Key Statistics

Temperature	Min: 24.1 C	Max: 30.1 C	Avg: 28.0 C
Acidity (pH)	Min: 6.9	Max: 8.1	Avg: 7.4
Ammonia (NH3)	Min: 0.1 mg/L	Max: 2.8 mg/L	Avg: 0.9 mg/L
Oxygen (DO)	Min: 4.4 mg/L	Max: 8.3 mg/L	Avg: 6.1 mg/L

3. Visual Trends Analysis

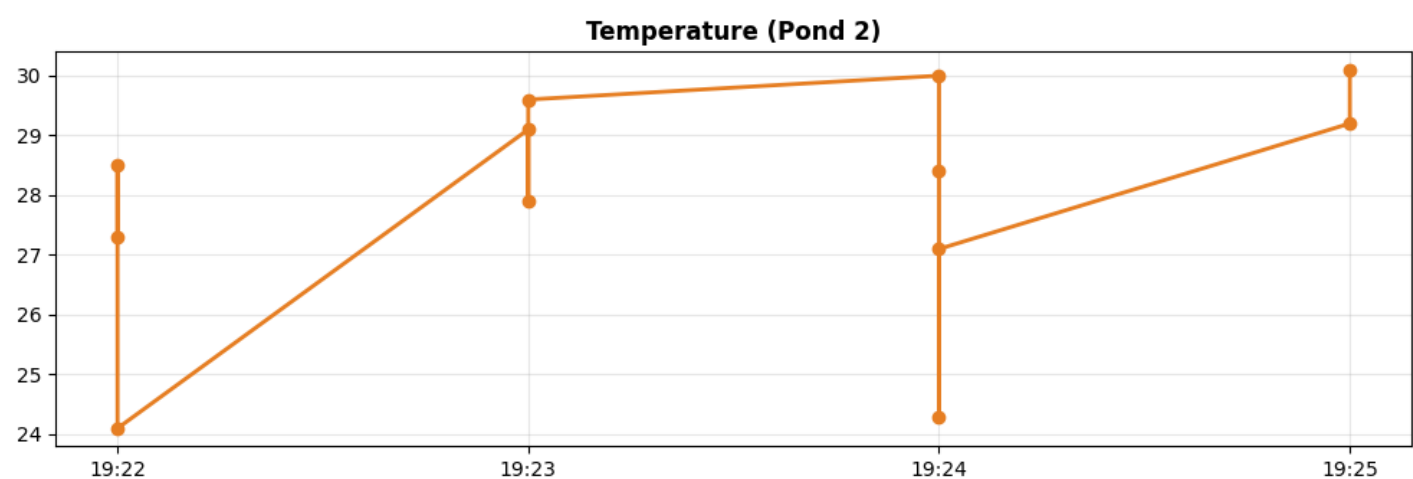





AquaSmart AI System

Comprehensive Water Quality Analysis Report


pH Level (Pond 2)

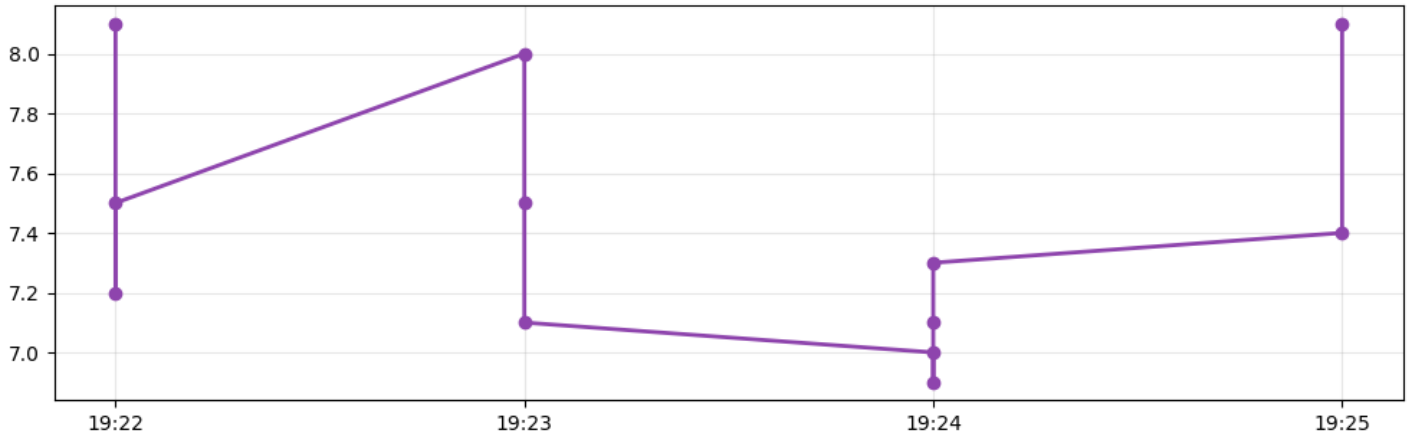

Ammonia (Pond 2)

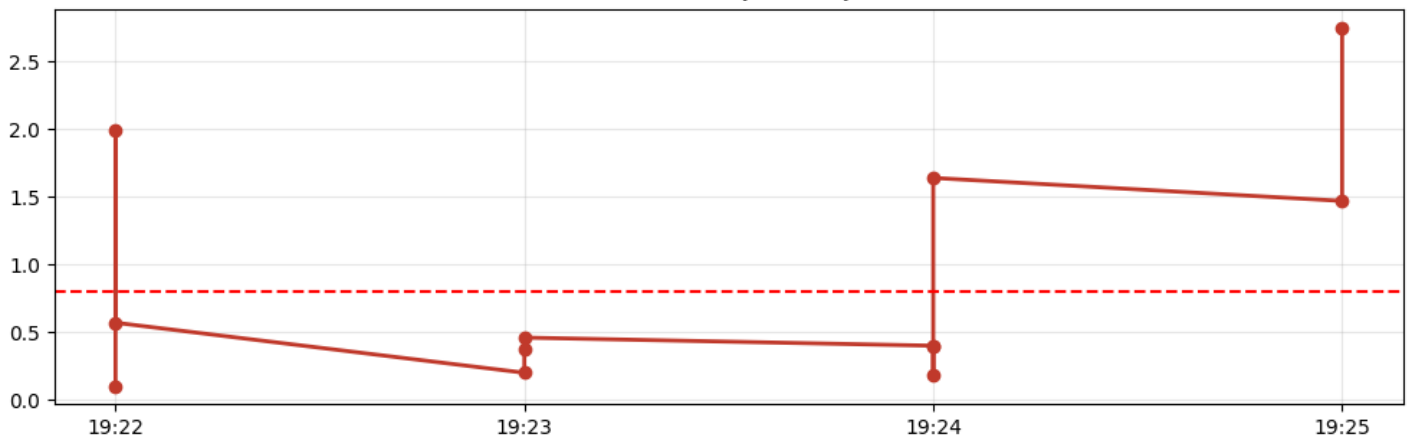

Dissolved Oxygen (Pond 2)

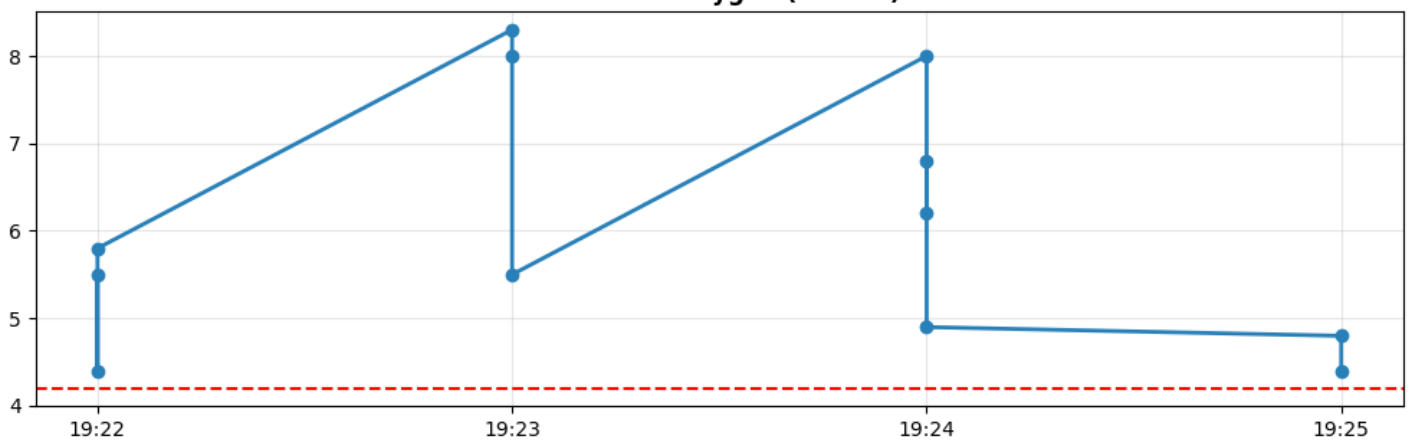



AquaSmart AI System

Comprehensive Water Quality Analysis Report

4. Detailed Hourly Logs

Time	Temp	pH	NH3	DO	AI Status
19:22	27.3	8.1	0.1	5.5	Safe
19:22	28.5	7.2	1.99	4.4	Danger
19:22	24.1	7.5	0.57	5.8	Danger
19:23	29.1	8.0	0.2	8.3	Safe
19:23	27.9	7.5	0.38	8.0	Safe
19:23	29.6	7.1	0.46	5.5	Safe
19:24	30.0	7.0	0.4	8.0	Safe
19:24	28.4	6.9	0.4	6.2	Safe
19:24	24.3	7.1	0.18	6.8	Safe
19:24	27.1	7.3	1.64	4.9	Danger
19:25	29.2	7.4	1.47	4.8	Danger
19:25	30.1	8.1	2.75	4.4	Pending...