



# AquaSmart AI System

Comprehensive Water Quality Analysis Report

Target: Pond 3 | Date: 2026-02-20

Data Source: (LIVE SENSOR DATA)


## 1. AI Executive Summary

CRITICAL: The system detected unsafe conditions. High Ammonia or Low Oxygen levels were recorded. Immediate corrective action (Aeration/Water Exchange) is recommended.

## 2. Key Statistics

|               |               |               |               |
|---------------|---------------|---------------|---------------|
| Temperature   | Min: 24.8 C   | Max: 30.7 C   | Avg: 27.0 C   |
| Acidity (pH)  | Min: 7.0      | Max: 8.1      | Avg: 7.6      |
| Ammonia (NH3) | Min: 0.0 mg/L | Max: 0.6 mg/L | Avg: 0.3 mg/L |
| Oxygen (DO)   | Min: 5.3 mg/L | Max: 8.4 mg/L | Avg: 7.0 mg/L |

## 3. Visual Trends Analysis

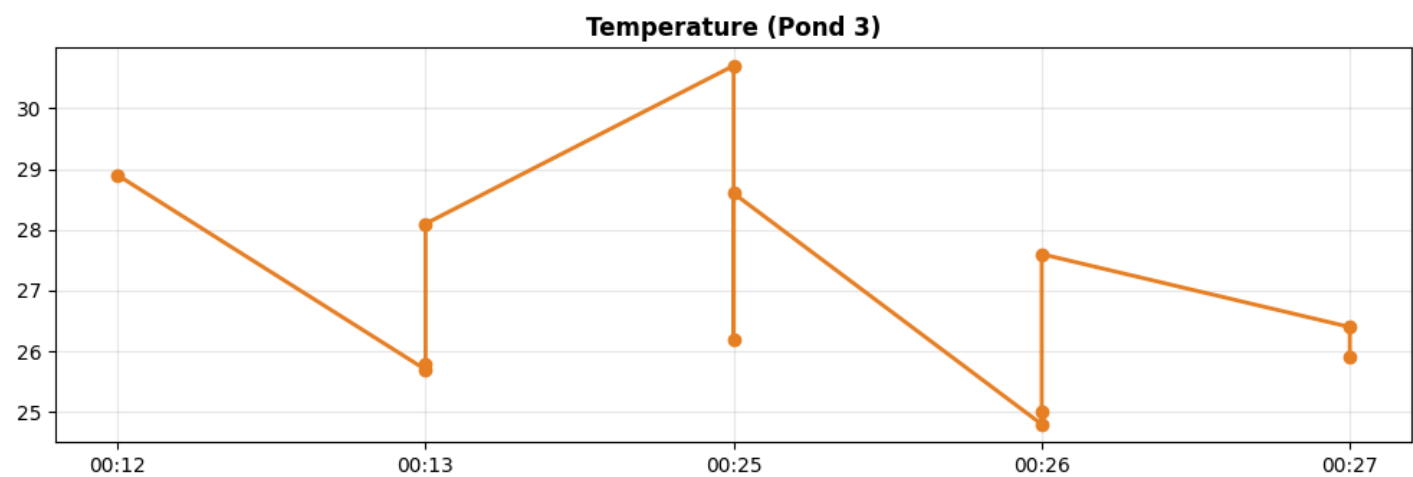





# AquaSmart AI System

Comprehensive Water Quality Analysis Report


**pH Level (Pond 3)**

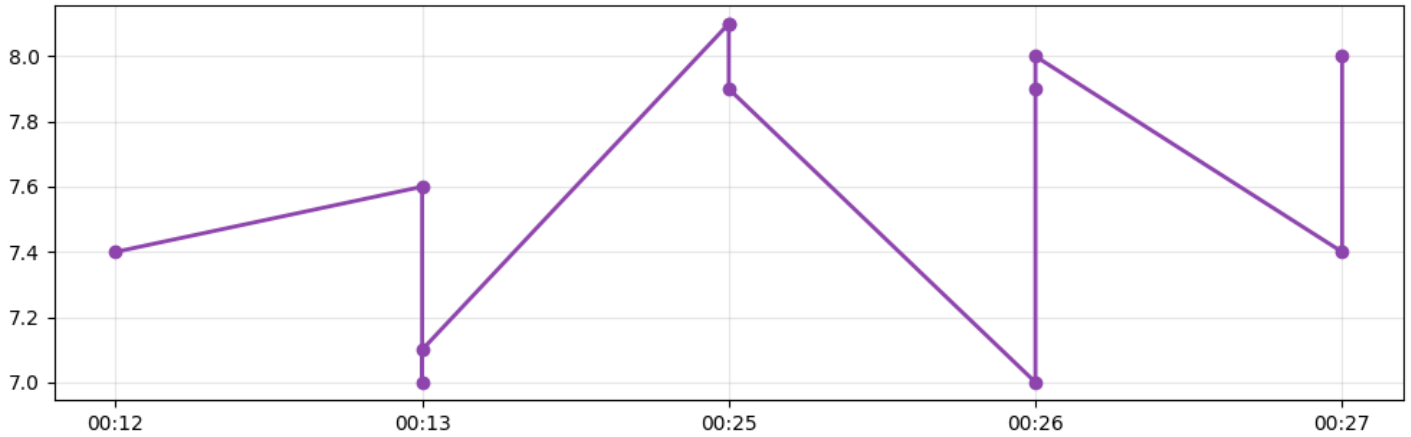

**Ammonia (Pond 3)**

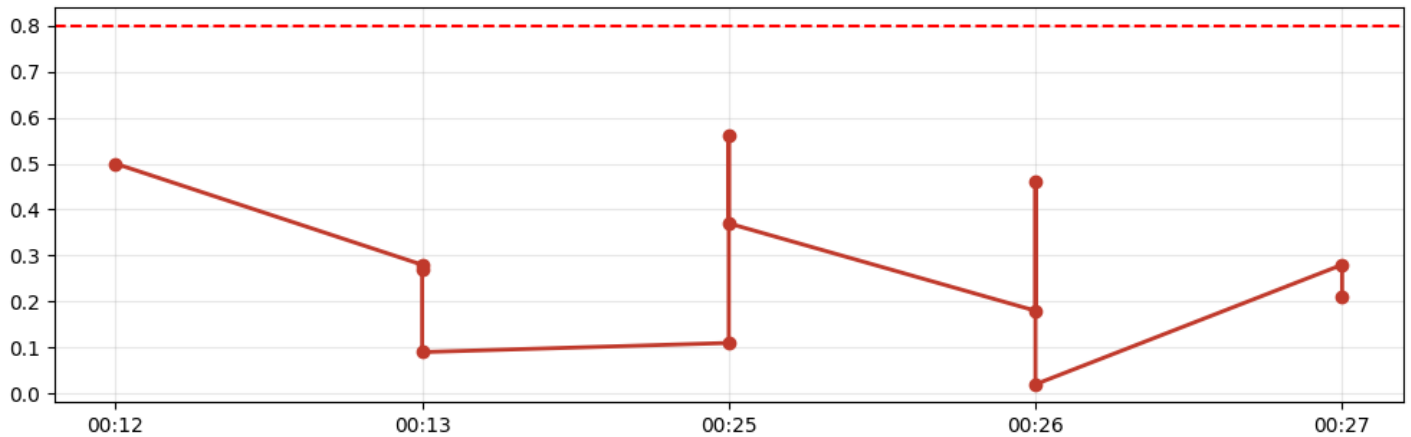

**Dissolved Oxygen (Pond 3)**

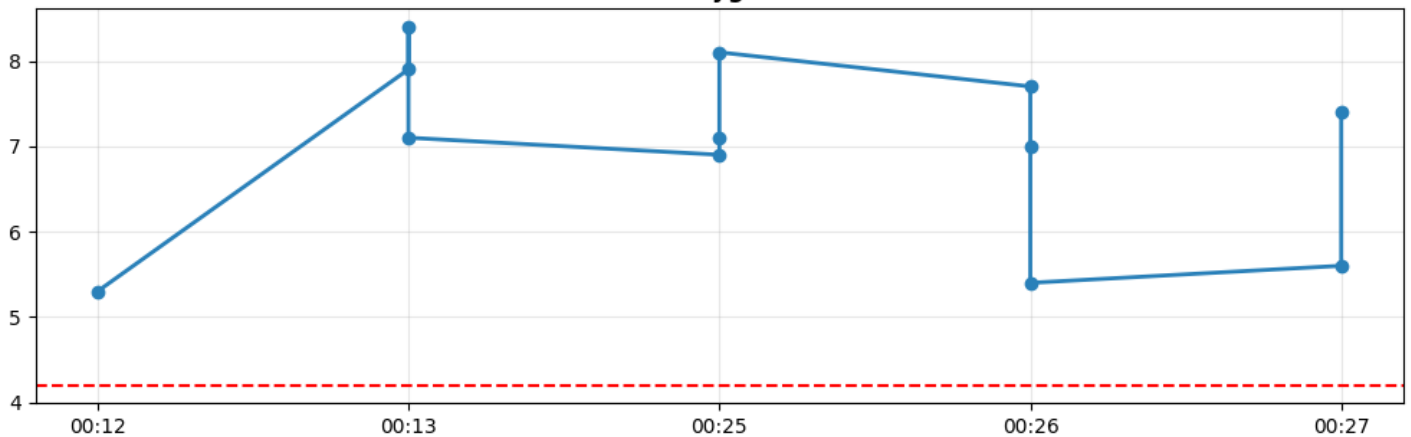



# AquaSmart AI System

Comprehensive Water Quality Analysis Report

## 4. Detailed Hourly Logs

| Time  | Temp | pH  | NH3  | DO  | AI Status  |
|-------|------|-----|------|-----|------------|
| 00:12 | 28.9 | 7.4 | 0.5  | 5.3 | Safe       |
| 00:13 | 25.7 | 7.6 | 0.28 | 7.9 | Safe       |
| 00:13 | 25.8 | 7.0 | 0.27 | 8.4 | Safe       |
| 00:13 | 28.1 | 7.1 | 0.09 | 7.1 | Pending... |
| 00:25 | 30.7 | 8.1 | 0.11 | 6.9 | Safe       |
| 00:25 | 26.2 | 8.1 | 0.56 | 7.1 | Danger     |
| 00:25 | 28.6 | 7.9 | 0.37 | 8.1 | Safe       |
| 00:26 | 24.8 | 7.0 | 0.18 | 7.7 | Safe       |
| 00:26 | 25.0 | 7.9 | 0.46 | 7.0 | Safe       |
| 00:26 | 27.6 | 8.0 | 0.02 | 5.4 | Safe       |
| 00:27 | 26.4 | 7.4 | 0.28 | 5.6 | Safe       |
| 00:27 | 25.9 | 8.0 | 0.21 | 7.4 | Safe       |