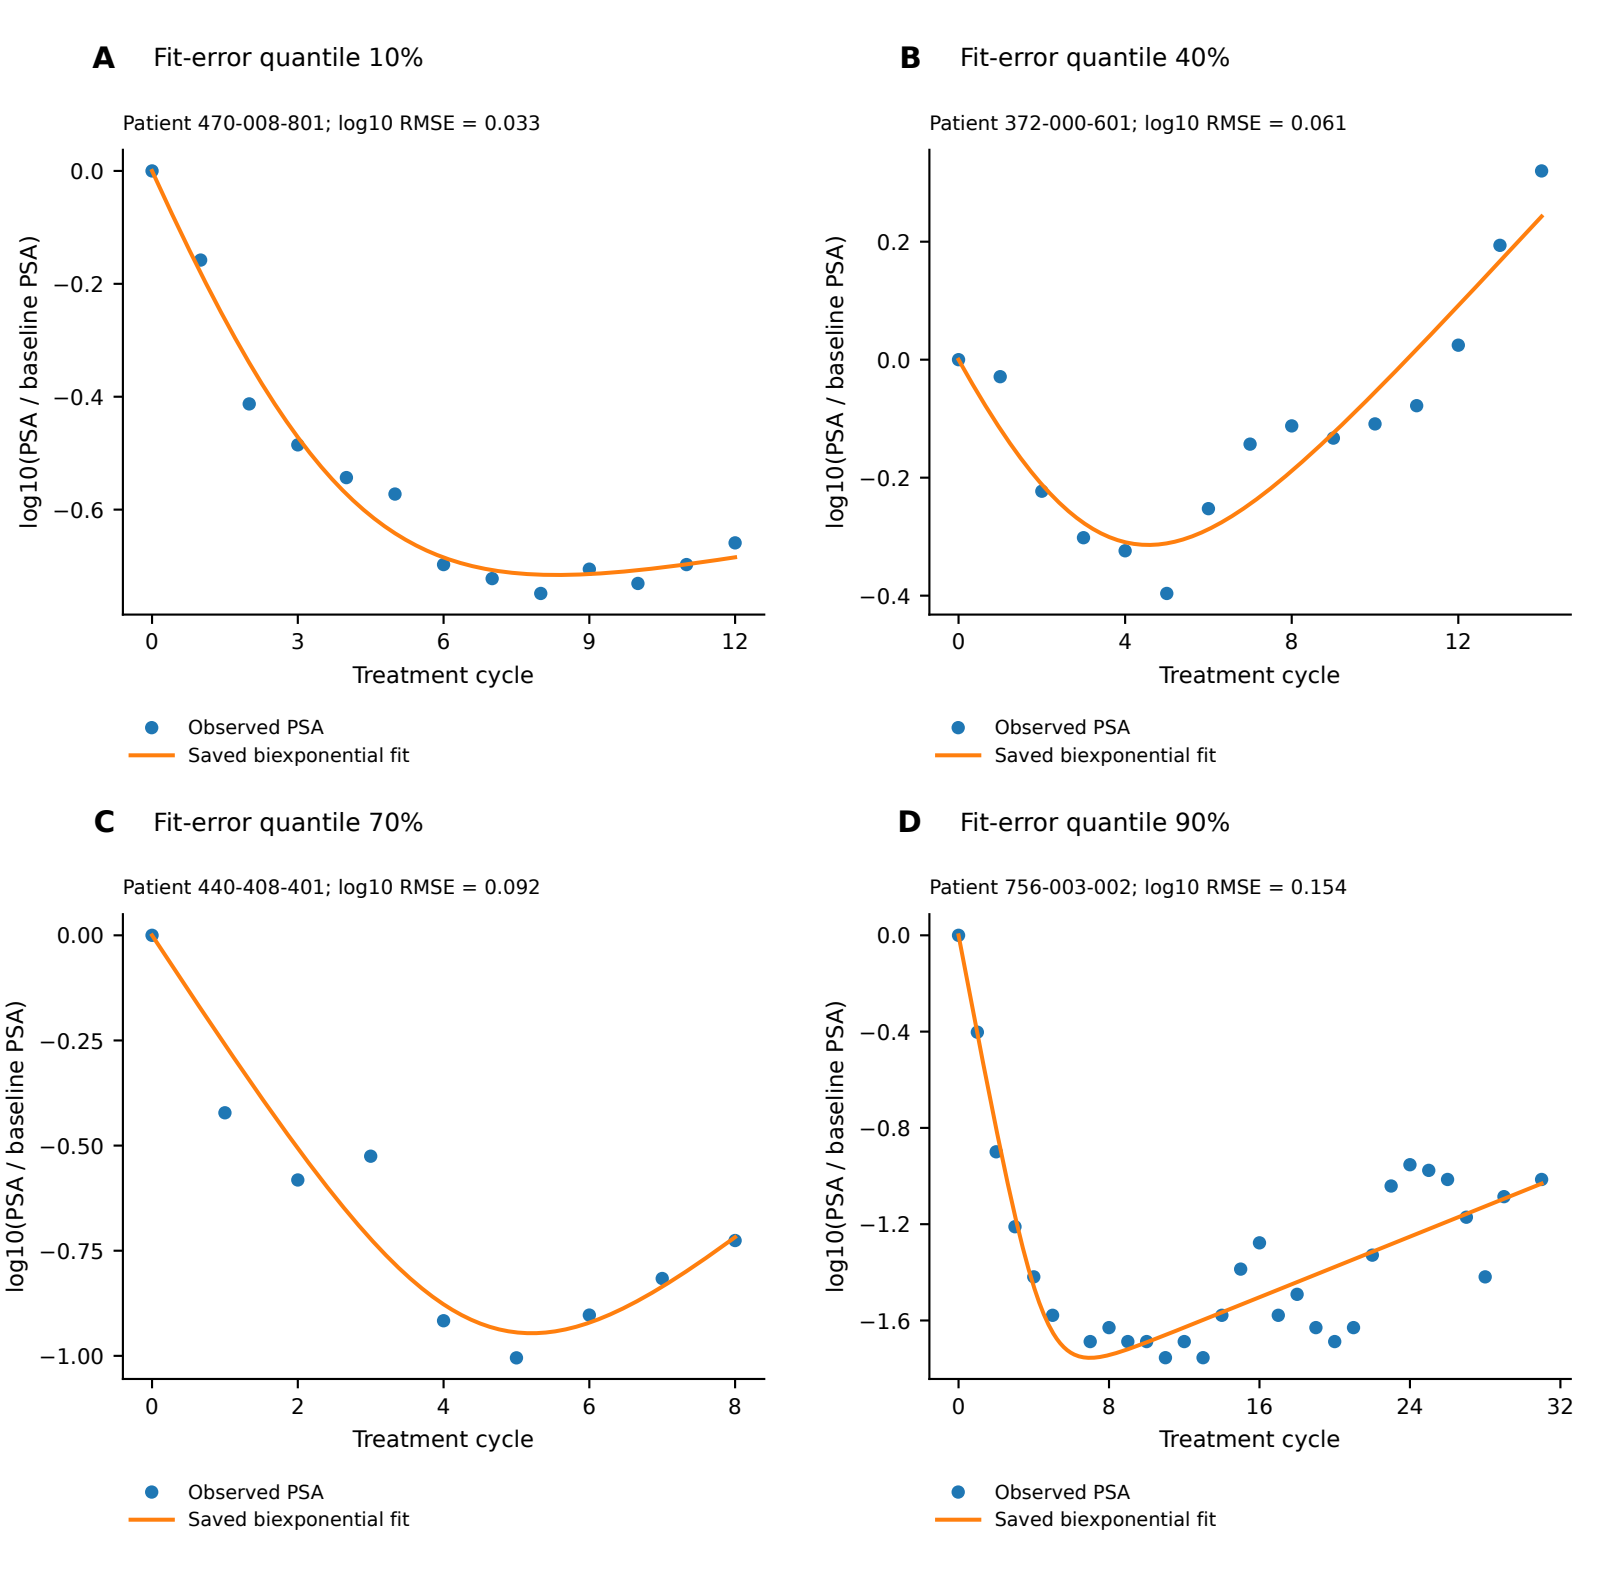
A
Fit-error quantile 10%
Patient 470-008-801; log10 RMSE = 0.033
log10(PSA / baseline PSA)
Treatment cycle
Observed PSA
Saved biexponential fit
B
Fit-error quantile 40%
Patient 372-000-601; log10 RMSE = 0.061
log10(PSA / baseline PSA)
Treatment cycle
Observed PSA
Saved biexponential fit
C
Fit-error quantile 70%
Patient 440-408-401; log10 RMSE = 0.092
log10(PSA / baseline PSA)
Treatment cycle
Observed PSA
Saved biexponential fit
D
Fit-error quantile 90%
Patient 756-003-002; log10 RMSE = 0.154
log10(PSA / baseline PSA)
Treatment cycle
Observed PSA
Saved biexponential fit