


Negative-control panel

Each outcome should sit at 1 if the design is specific. Point size is total events.

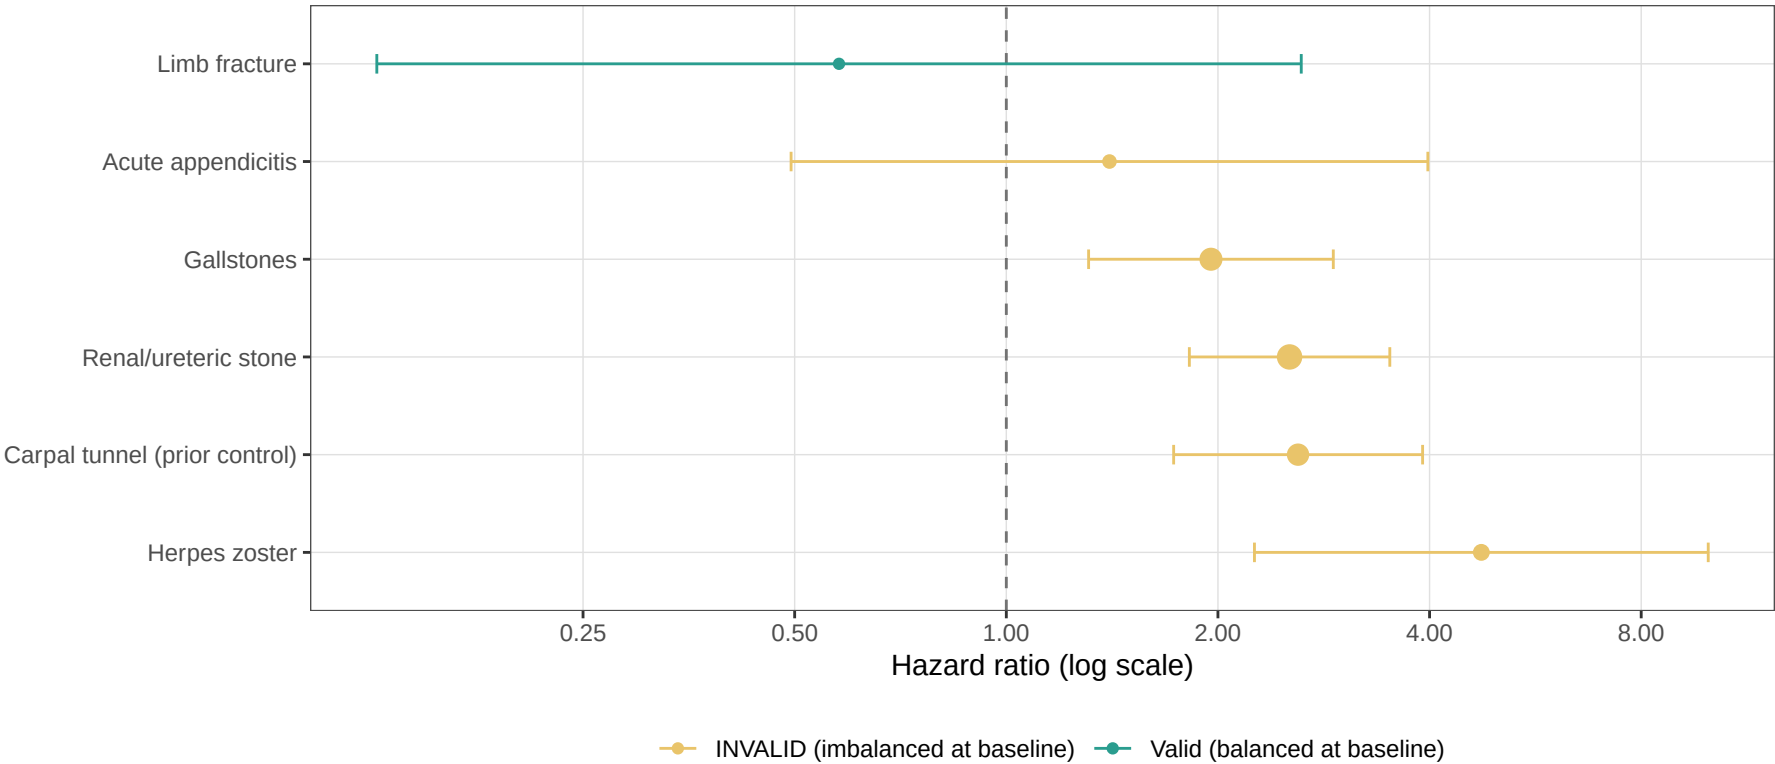

Controls that fail the baseline-balance test cannot inform specificity and are excluded from calibration. The seizure estimate is calibrated against the valid controls only.