
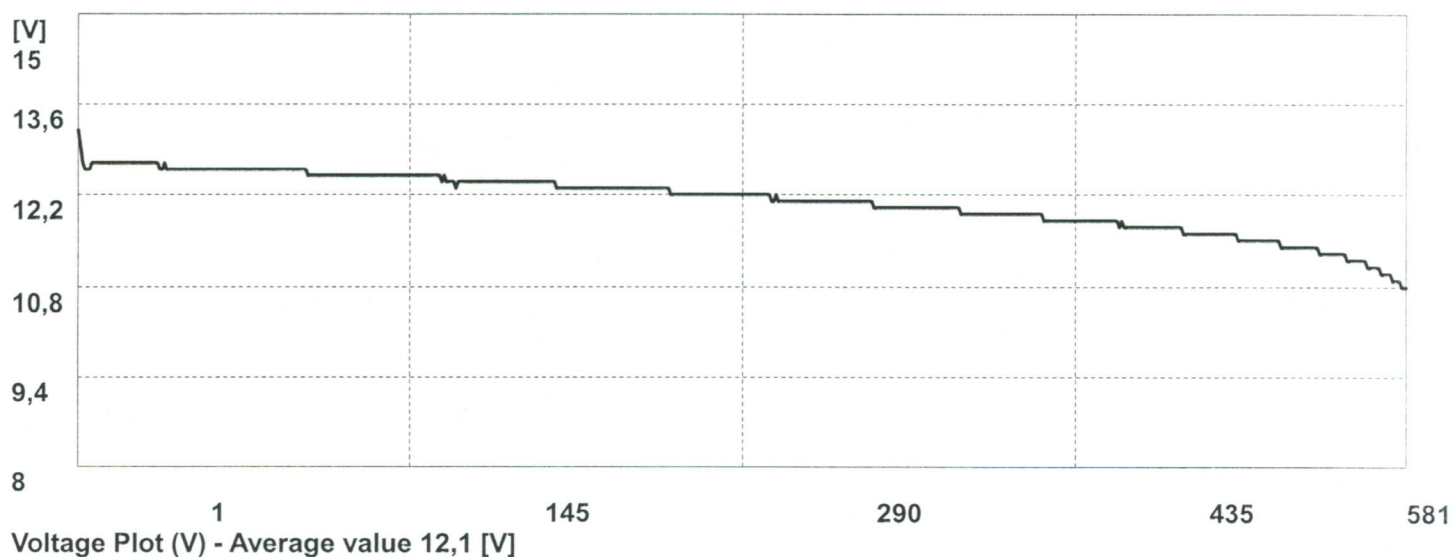


DISCHARGE DATE :
OPERATOR :
COMPANY :
BATTERY TYPE :
NOM. VOLTAGE :
CAPACITY :
NOTES :

DISCHARGE TEST REPORT
29\11\2018 09:27:00 [Version 1.7]
service
Akk-man
A12-150A

150 [Ah] / CAPACITY OBTAINED 96,66666 %
A12-150A_180901_HBR11DJV1

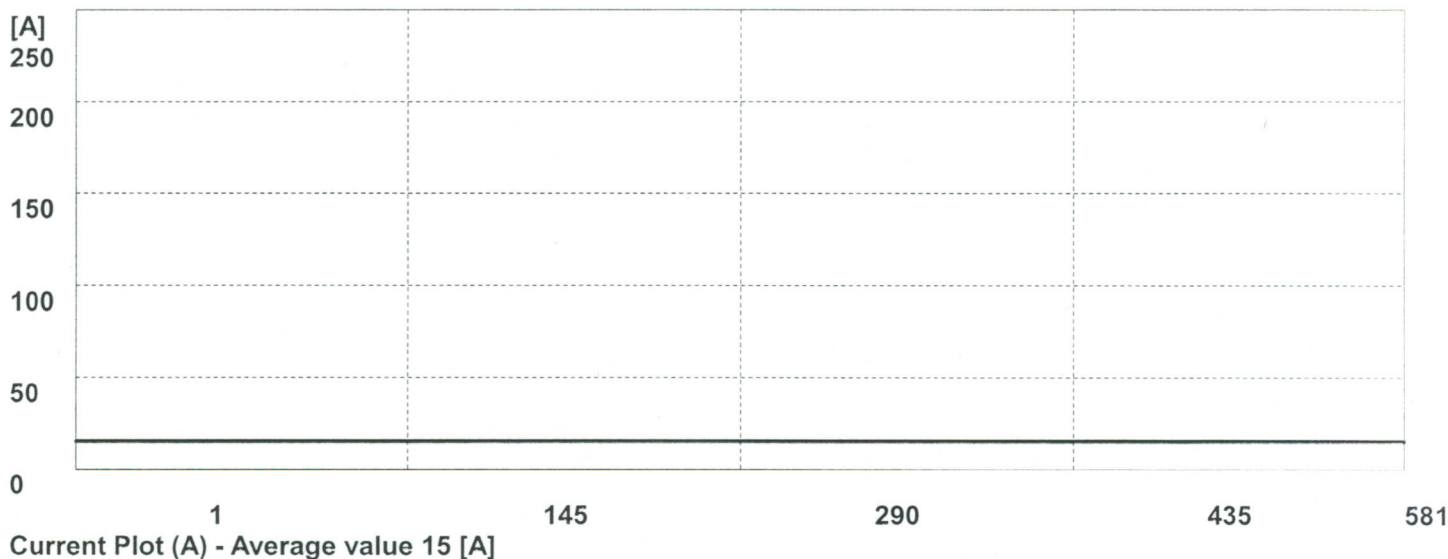

FINAL RESULTS

Discharge total time	09:41:00 [min]
Battery initial voltage	13,2 [V]
Battery final voltage	10,8 [V]
Discharge minimum current	15 [A]
Discharge average current	15 [A]
Discharge maximum current	15 [A]
Total amperehours discharged	145 [Ah]
Total energy discharged	1757,8 [Wh]

Signature _____