
## ARUP/NKIL6556/SK/0274 TYPICAL DETAILS FOR BEAM CAST-IN PIPE SLEEVE ARRANGEMENT 2019.07.11

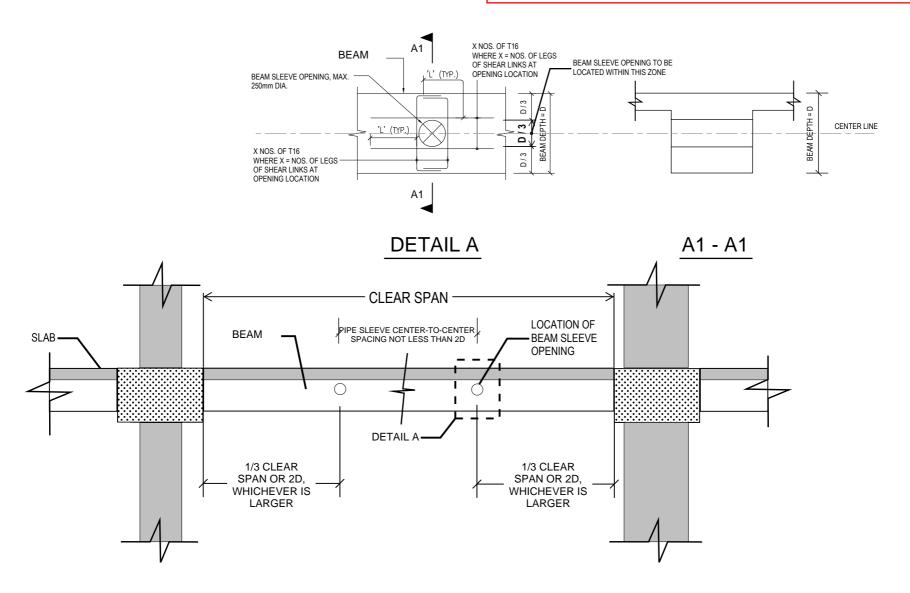

## NOTES:

- 1. BEAM OPENING TO BE MAX. 250mm OR D/3 IN DIAMETER, WHICHEVER IS SMALLER, SUBJECT TO CBWD APPROVAL.
- 2. BEAM OPENING TO BE LOCATED AT 1/3 CLEAR SPAN OR 2D, WHICHEVER IS LARGER, FROM EDGE OF SUPPORT, SUBJECT TO CBWD APPROVAL.
- 3. MAX. 2 NOS. OF BEAM SLEEVE OPENINGS IS ALLOWED.
- 3. FOR CASE NOT COVERED BY THIS DRAWING, CASE BY CASE REVIEW IS REQUIRED.
- 4. REINFORCEMENT IN DETAIL A REFERS TO ADDITIONAL REINFORCEMENT AT BEAM OPENING. BEAM REINFORCEMENT REFER TO CORRESPONDING R.C. DRAWINGS.
- 5. "L" IN DETAIL A REFER TO TENSION ANCHORAGE LENGTH AS SPECIFIED IN GENERAL NOTES.