


Shaded = Hosted Equipment

The Shapes used in this drawing are under subscription to the NSOC and CANNOT be used in other drawings or distributed outside the NSOC as a Visio file format. This means no copying and pasting these shapes into your own drawings. Doing so will violate license agreements agreed to by the NSOC.



APC Rack 42 U, Model AR3350

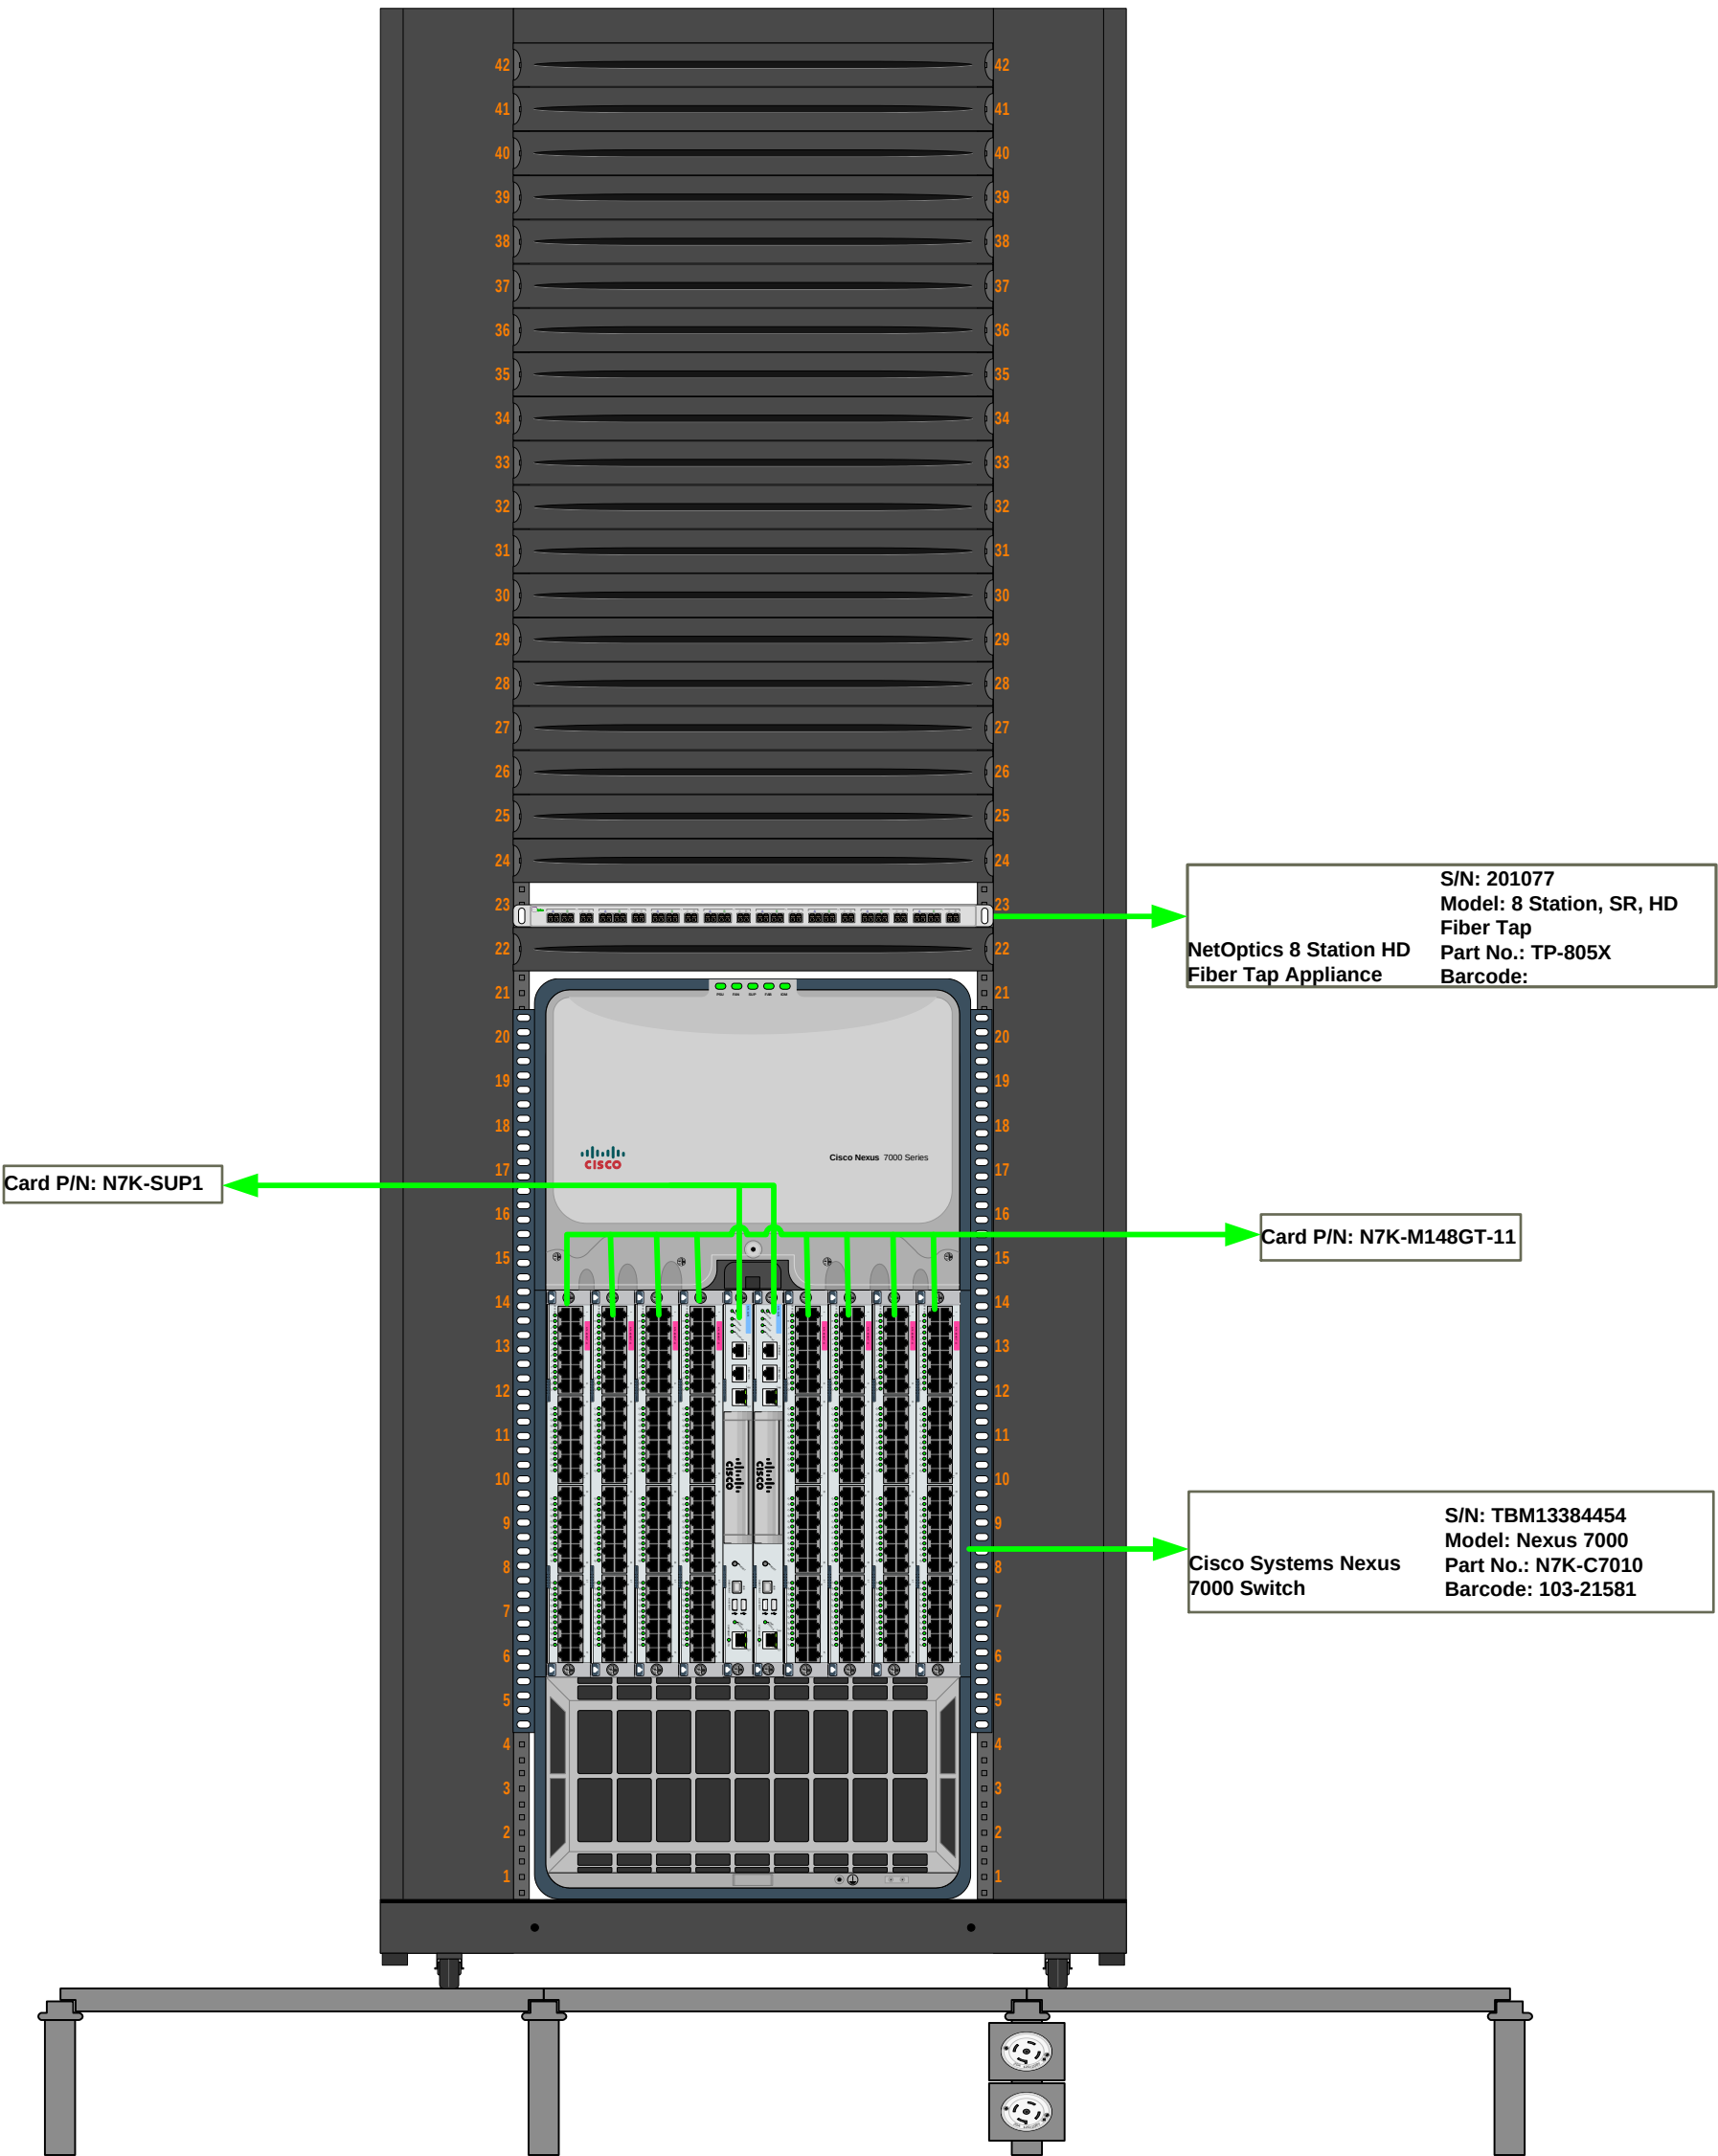

VA NSOC Department of Veterans Affairs Martinsburg, WV	Drawn By Brian Faircloth, KM Team	Revised May 10, 2013	Drawing Title GWXX	Description Contents of Rack XXX
--	--------------------------------------	-------------------------	-----------------------	-------------------------------------

GW
Rack Elevation
GW XX

NOTE:

The Shapes used in this drawing are under subscription to the NSOC and CANNOT be used in other drawings or distributed outside the NSOC as a Visio file format. This means no copying and pasting these shapes into your own drawings. Doing so will violate license agreements agreed to by the NSOC.




Shaded = Hosted Equipment

APC AP7941 Switched Rack PDU
S/N: ZA0746016930
Model: Switched Rack PDU
Part No.: AP7941
Barcode: 103-21344

APC AP7941 Switched Rack PDU
S/N: ZA0944013441
Model: Switched Rack PDU
Part No.: AP7941
Barcode: 103-21339

APC Rack 42 U, Model AR3350

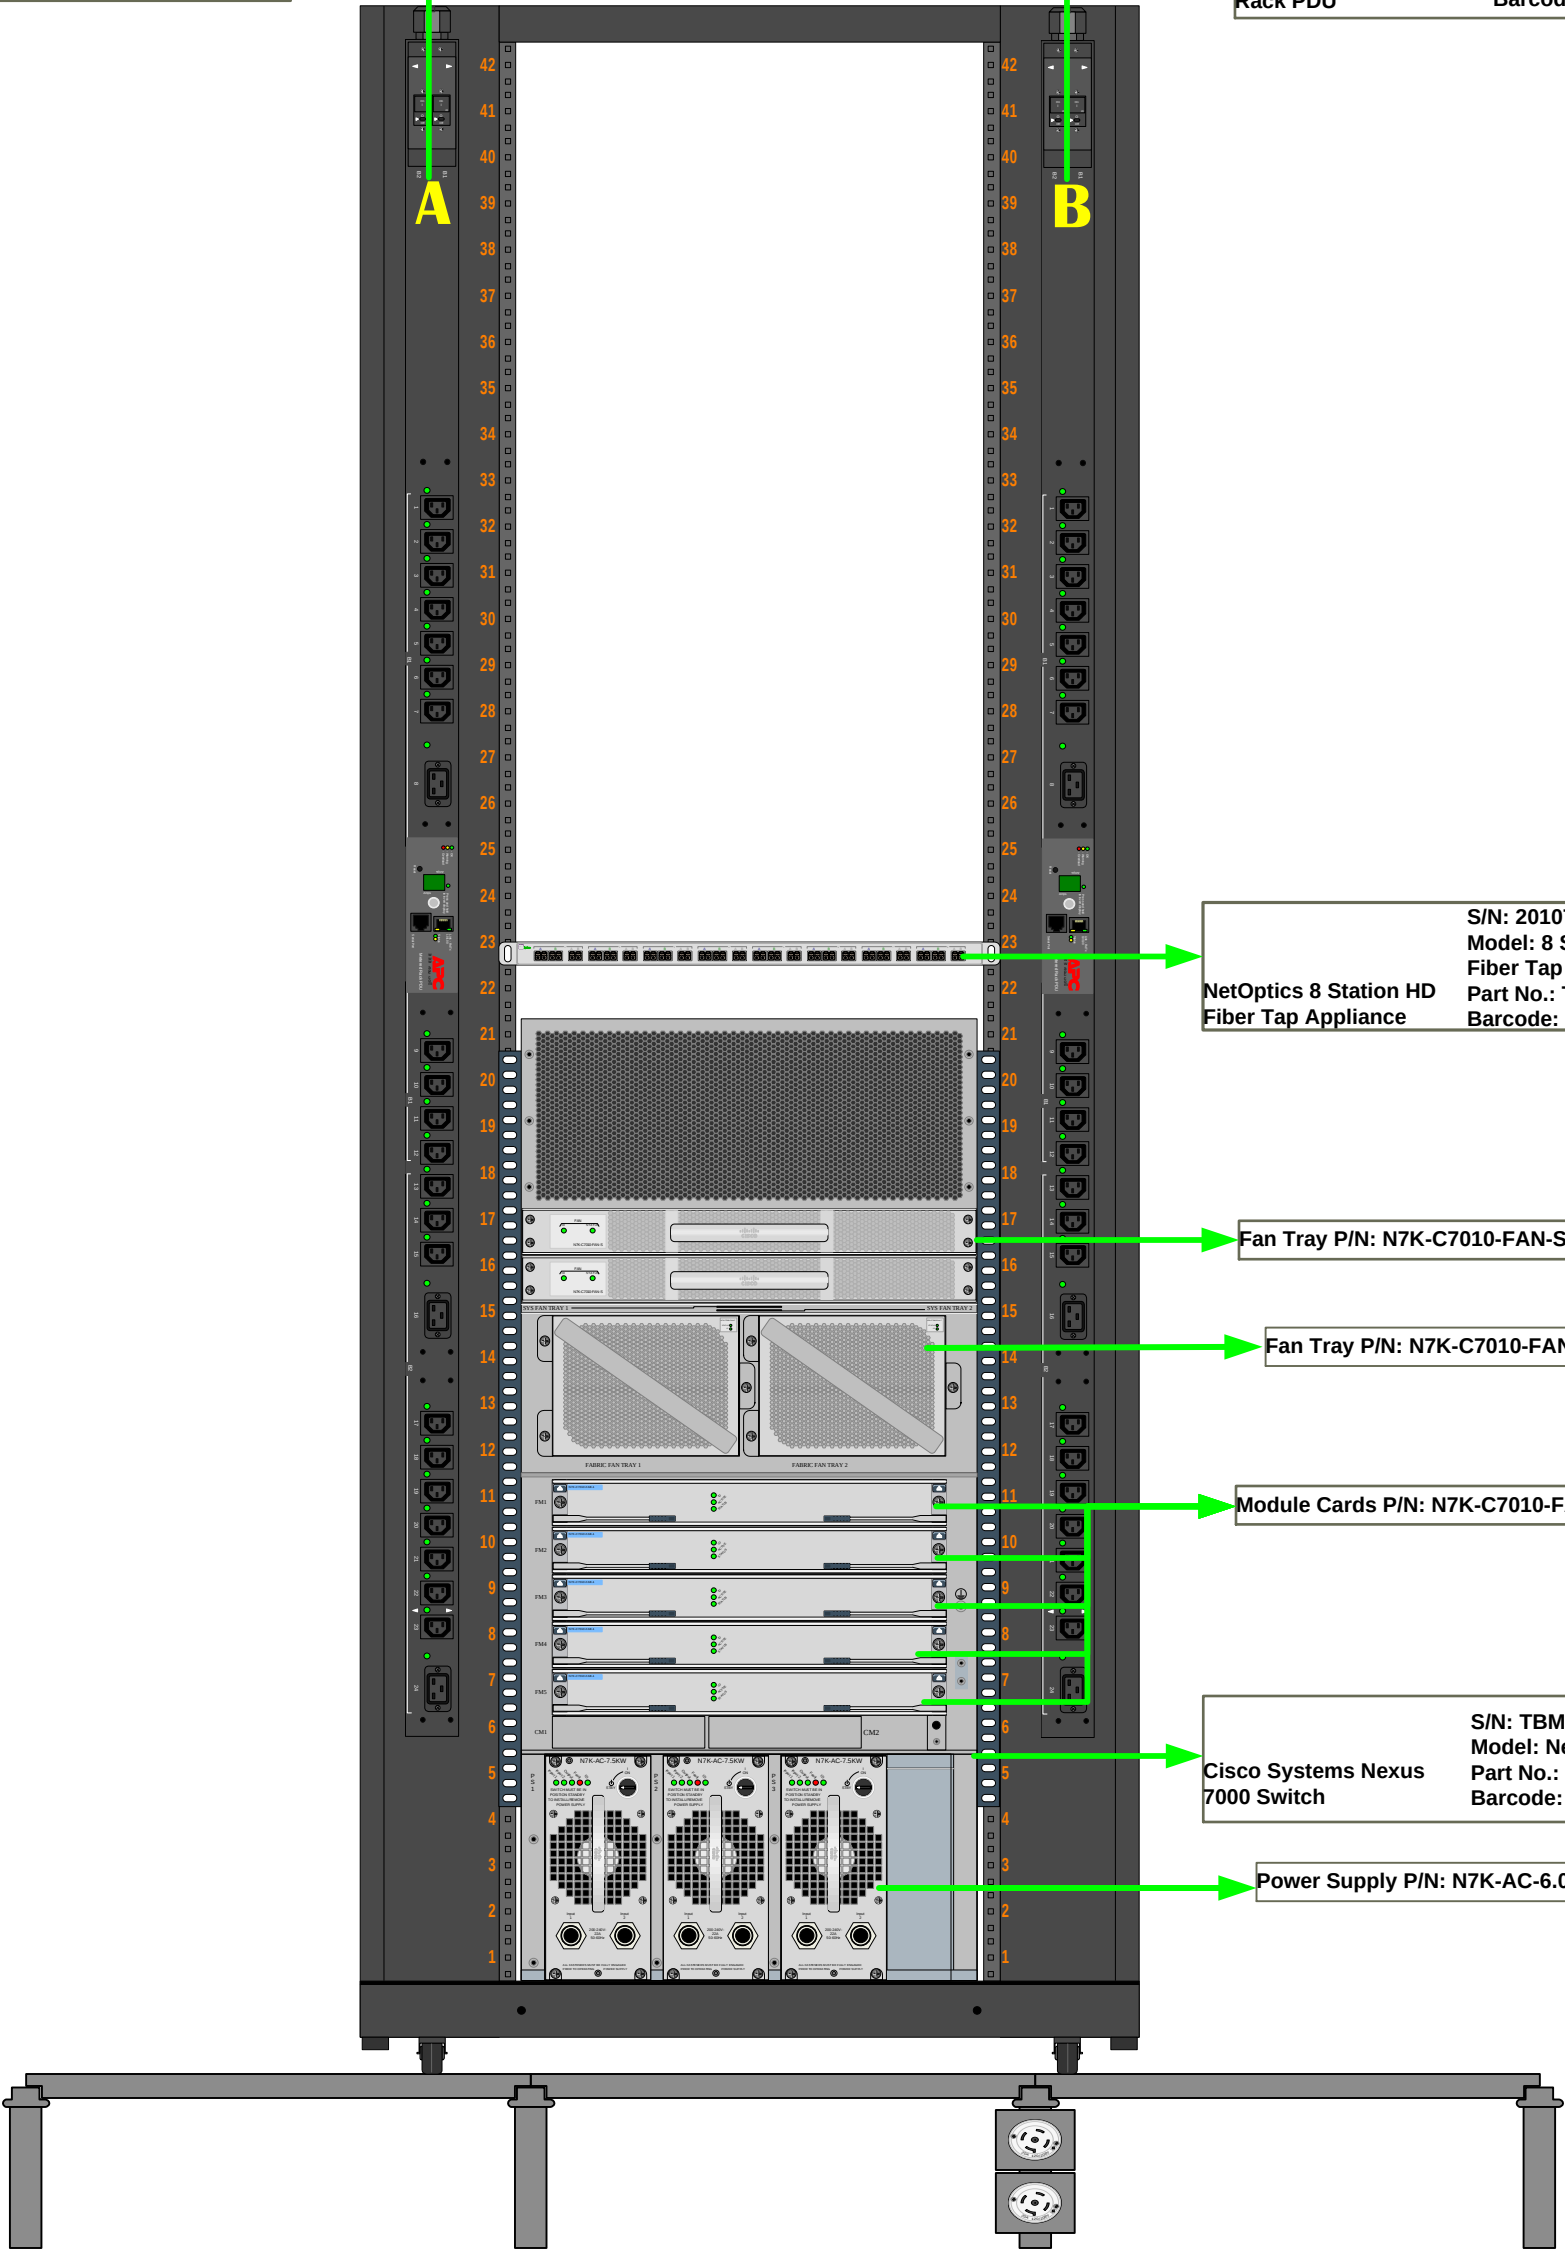

NetOptics 8 Station HD Fiber Tap Appliance
S/N: 201077
Model: 8 Station, SR, HD
Part No.: TP-805X
Barcode:

Fan Tray P/N: N7K-C7010-FAN-S

Fan Tray P/N: N7K-C7010-FAN-F

Module Cards P/N: N7K-C7010-FAB-1

Cisco Systems Nexus 7000 Switch
S/N: TBM13384454
Model: Nexus 7000
Part No.: N7K-C7010
Barcode: 103-21581

Power Supply P/N: N7K-AC-6.0KW

VA NSOC Department of Veterans Affairs Martinsburg, WV	Drawn By Brian Faircloth, KM Team	Revised May 10, 2013	Drawing Title GWWest-RackXX	Description Contents of Rack XXXX
--	--------------------------------------	-------------------------	--------------------------------	--------------------------------------