

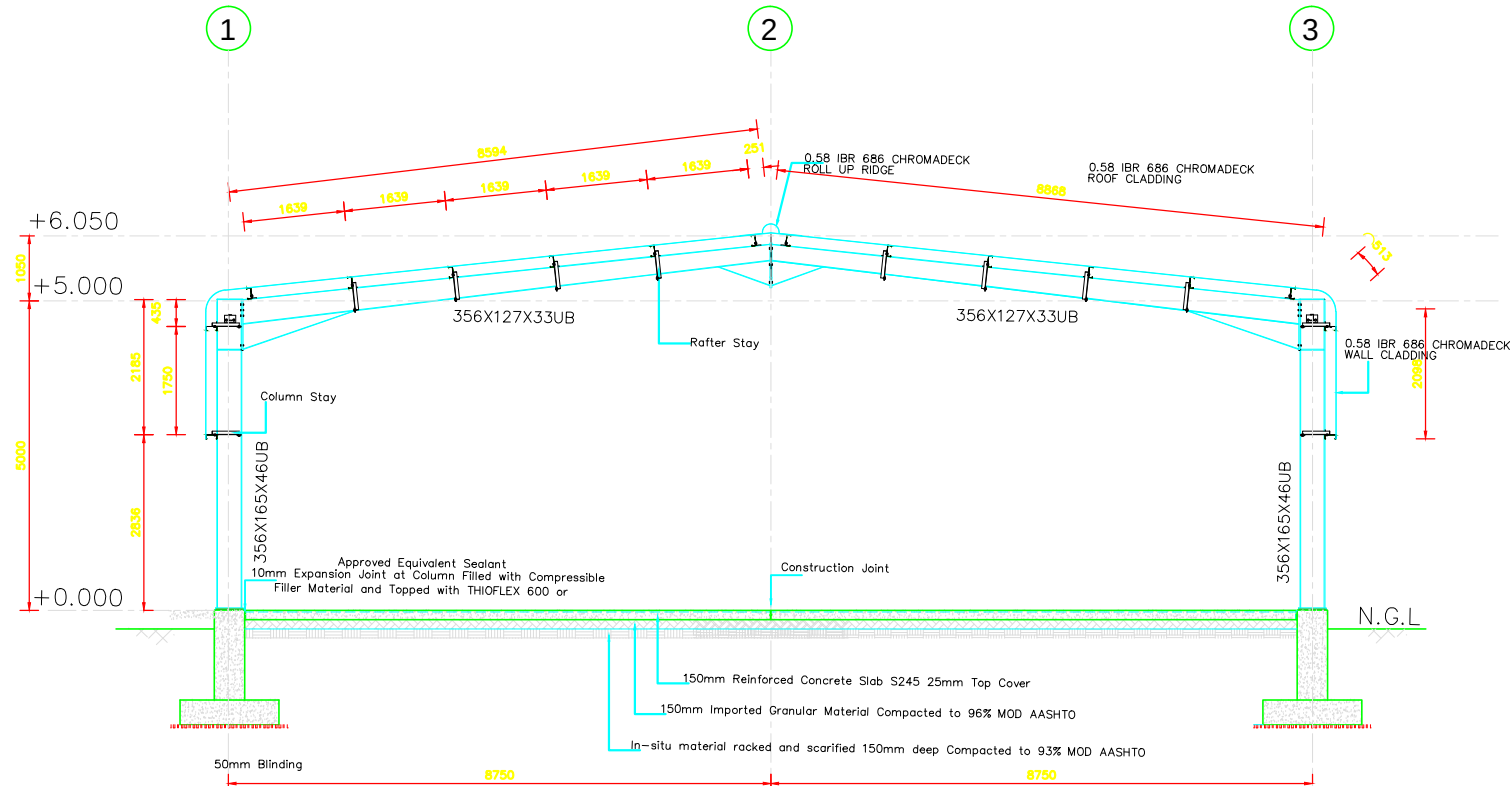



Welds grd E 35 - Plates S 275
Beam 356x127 UB 33 [S275]
Haunch 356x127 UB 33 [S275]
Column 305x160 UB 46 [S275]
Sill/rafter 15mm THK



End-Plate 731 x 103 x 20 mm (19 kg)
6 No. M20 Grade 8.8 Bolts in 22 mm holes



Welds grd E 35 - Plates S 275
Beam 356x127 UB 33 [S275]
Haunch 356x127 UB 33 [S275]



End-Plate 731 x 140 x 20 mm (16 kg)
4 No. M20 Grade 8.8 Bolts in 22 mm holes

EAVE HAUNCH DETAIL

SCALE 1:25

APEX HAUNCH DETAIL

SCALE 1:25

GENERAL NOTES:

- SURFACE TREATMENT AND COATINGS SHALL:
WIREBRUSH OR SAND BLAST AND PRIME THE SURFACES WITH ZINC PHOSPHATE PRIME 75µm (DRY THICKNESS)
- STRUCTURAL STEELWORK:
STRUCTURAL STEEL GRADE S275 UNLESS OTHERWISE NOTED, ALL FITTINGS GRADE S275
- ROUND HOLES FOR FASTENERS OR PINS SHALL EITHER BE DRILLED, PUNCHED, ROUND HOLES FOR FASTENERS OR PINS SHALL EITHER BE DRILLED, PUNCHED, PLASMA-CUT, OR LASER CUT.
- ALL BOLTS ARE FULLY THREADED 60mm LONG CLASS 8.8 NON PRELOADED BOLTS EXCEPT FOR PURLINS AND SIDE RAILS WHERE CLASS 4.8 MAY BE USED
- HOLE SIZES SHALL BE AS FOLLOWS:
BOLT DIAMETER (d) ≤ 24mm: d + 2mm
BOLT DIAMETER (d) > 24mm: d + 3mm
HOLDING DOWN BOLTS: d + 6mm
- CONNECTED COMPONENTS SHALL BE DRAWN TOGETHER SUCH THAT THEY ACHIEVE FIRM CONTACT. RESIDUAL GAPS BETWEEN CONTACT FACES ARE PERMITTED EXCEPT WHERE FULL CONTACT IS REQUIRED IN THE PROJECT SPECIFICATION.
- EACH PART OF THE STRUCTURE SHALL BE ALIGNED AS SOON AS PRACTICABLE AFTER IT HAS BEEN ERECTED. PERMANENT CONNECTIONS SHALL NOT BE MADE BETWEEN MEMBERS UNTIL A SUFFICIENT PORTION OF THE STRUCTURE HAS BEEN ALIGNED, LEVELLED, PLUMBED AND TEMPORARILY CONNECTED TO ENSURE THAT MEMBERS ARE NOT DISPLACED DURING SUBSEQUENT ERECTION OR AN ALIGNMENT OF THE REMAINDER OF THE STRUCTURE.
- THROUGHOUT ERECTION OF THE STRUCTURE, THE STEELWORK SHALL BE SECURELY BOLTED OR FASTENED IN ORDER TO ENSURE IT CAN ADEQUATELY WITHSTAND ALL LOADING LIABLE TO BE ENCOUNTERED DURING ERECTION.
- ANY TEMPORARY BRACING SHALL BE LEFT IN POSITION UNTIL ERECTION IS SUFFICIENTLY ADVANCED TO LEAVE THE REMAINING STRUCTURE IN A STABLE AND SAFE CONDITION.
- MORTAR UNDER BASE PLATES SHALL BE 1:1 CEMENT/SAND GROUT, DRY PACKED, 20mm THICKNESS
- DESIGN HAS BEEN CARRIED OUT IN ACCORDANCE WITH BS8110, BS5399, BS5950, BS8004 AS APPLICABLE
- THE WORKS WILL BE INSPECTED FROM TIME TO TIME BY THE CONSULTING ENGINEER TO ASCERTAIN WHETHER THE CONTRACTOR IS CARRYING OUT THE WORK IN GENERAL CONFORMITY WITH THE ENGINEERING DRAWINGS AND SPECIFICATIONS. SUCH INSPECTIONS ARE NOT CARRIED OUT FOR THE BENEFIT OF THE CONTRACTOR, AND DO NOT RELIEVE HIM OF THE RESPONSIBILITY FOR THE PROPER CONSTRUCTION OF THE WORKS IN ACCORDANCE WITH THE ENGINEERING DRAWINGS, DOCUMENTS AND GOOD BUILDING PRACTICE
- THE ONUS RESTS WITH THE CONTRACTOR TO NOTIFY THE ENGINEER TO INSPECT THE WORKS BEFORE ANY CONCRETE IS CAST OR ANY STEEL IS ERECTED. NO CERTIFICATE OF STABILITY WILL BE ISSUED UNLESS THE ENGINEER HAS PERFORMED SUCH INSPECTIONS