

LEGEND

	AXIS NUMBER
	SLAB THICKNESS IN mm
	TOP OF CONCRETE LEVEL IN PLAN
	LEVEL IN ELEVATION
	SECTION MARK (WHERE SECTION IS SHOWN ON A DIFFERENT DRAWING)
	SECTION MARK (WHERE SECTION IS SHOWN ON THE SAME DRAWING)
	ELEVATION MARK (WHERE ELEVATION IS SHOWN ON A DIFFERENT DRAWING)

ELEVATION

1:50
DRAWING NO. WHERE ELEVATION MARK IS CALLED UP

SECTION

1:50
DRAWING NO. WHERE SECTION MARK IS CALLED UP

B DETAIL

1:50
DRAWING NO. WHERE DETAIL MARK IS CALLED UP

C DETAIL

1:50

SUB-TITLE FOR ELEVATION


NOTES:

1. IF A DETAIL, SECTION ETC., IS SHOWN ON THE SAME DRAWING AS THE DETAIL MARK THEN "-" IS USED INSTEAD OF DRAWING No.
2. IF A DETAIL, SECTION ETC., IS CALLED UP ON A SMALL NUMBER OF DRAWINGS, THEN THOSE DRAWING Nos. ARE ADDED TO THE DETAIL SUB-TITLE AS SHOWN BELOW:

B DETAIL

1:50

3. IF A DETAIL APPLIES TO MANY DRAWINGS THEN A GENERAL DETAIL SYMBOL IS USED.

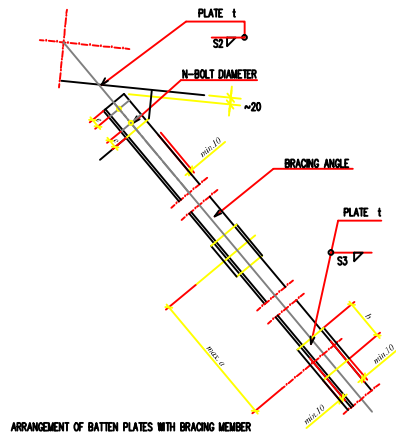


ARRANGEMENT OF BATTEN PLATES WITH BRACING MEMBER

TYP. DETAIL OF BOLTS IN BRACING MEMBERS

GENERAL CONNECTION

PROFILE	L	PLATE t	max. a	b	S1	S2	S3	BOLTS
L60x6	120	10	LENGTH/2	90	6	6	6	2M12/10.9

- THE NUMBER OF FIELDS (a) SHALL BE NOT LESS THAN 2.
- t = THICKNESS OF GUSSET PLATE & BATTEN PLATE.
- MINIMUM DISTANCE BETWEEN BOLT = 3 BOLT DIM.
- MINIMUM EDGE DISTANCE (e) FOR BOLT = 2 BOLT DIM.



SINGLE ANGLE BRACING

TYP. DETAIL OF HORIZONTAL BRACING

00 TYPICAL DETAIL FOR BRACING MEMBERS

SCALE 1:10

NOTES:

- 1-All dimensions are expressed in millimeters
- 2-All levels are expressed in meters
- 3-Mild steel 37 is to be used. Yield stress should not be less than 2400 kg/cm² & steel S2 is to be used. Yield stress should not be less than 3600 kg/cm² "REVIEW COLABEAMS TABLES (ST-104,105)"
- 4-Welding class is "good weld". Minimum weld thickness of fillet welds is the greater of 4 mm or Minimum Plate thickness to be welded in the joint unless specified in the drawings
 - Minimum weld thickness of butt welds=the smaller thickness of the plates to be joined
 - Minimum weld length = 50 mm
- 5-High strength bolts M20(grade 10.9) are required for all connections of main structure.
- 6-Ordinary bolts (4.8) 12mm diameter, may be used for purlin and bracing connections.
- 7-All members of horizontal bracing are single angles 60x60x6
- 8-All members of vertical bracing are two angles 100X100X6 Indicated in the drawing

DESIGNATION OF WELDINGS										BOLTS									
SYMBOL	DETAIL	SYMBOL	DETAIL	a	b	c	d	e	f	BOLT	M 12	M 16	M 20	M 24	M 27				
				10	7	5	10	7	5	10	14	18	22	28	30				
				11	8	5	11	8	5	11	15	19	23	29	31				
				12	9	5	12	9	5	12	16	20	24	30	32				
				13	10	5.5	13	10	5.5	13	17	21	25	31	33				
				14	11	6	14	11	6	14	18	22	26	32	34				
				15	12	6.5	15	12	6.5	15	19	23	27	33	35				
				16	13	7	16	13	7	16	20	24	28	34	36				
				17	14	7.5	17	14	7.5	17	21	25	29	35	37				
				18	15	8	18	15	8	18	22	26	30	36	38				
				19	16	8.5	19	16	8.5	19	23	27	31	37	39				
				20	17	9	20	17	9	20	24	28	32	38	40				
				21	18	9.5	21	18	9.5	21	25	29	33	39	41				
				22	19	10	22	19	10	22	26	30	34	40	42				
				23	20	10.5	23	20	10.5	23	27	31	35	41	43				
				24	21	11	24	21	11	24	28	32	36	42	44				
				25	22	11.5	25	22	11.5	25	29	33	37	43	45				
				26	23	12	26	23	12	26	30	34	38	44	46				
				27	24	12.5	27	24	12.5	27	31	35	39	45	47				
				28	25	13	28	25	13	28	32	36	40	46	48				
				29	26	13.5	29	26	13.5	29	33	37	41	47	49				
				30	27	14	30	27	14	30	34	38	42	48	50				
				31	28	14.5	31	28	14.5	31	35	39	43	49	51				
				32	29	15	32	29	15	32	36	40	44	50	52				
				33	30	15.5	33	30	15.5	33	37	41	45	51	53				
				34	31	16	34	31	16	34	38	42	46	52	54				
				35	32	16.5	35	32	16.5	35	39	43	47	53	55				
				36	33	17	36	33	17	36	40	44	48	54	56				
				37	34	17.5	37	34	17.5	37	41	45	49	55	57				
				38	35	18	38	35	18	38	42	46	50	56	58				
				39	36	18.5	39	36	18.5	39	43	47	51	57	59				
				40	37	19	40	37	19	40	44	48	52	58	60				
				41	38	19.5	41	38	19.5	41	45	49	53	59	61				
				42	39	20	42	39	20	42	46	50	54	60	62				