


Simulation Results

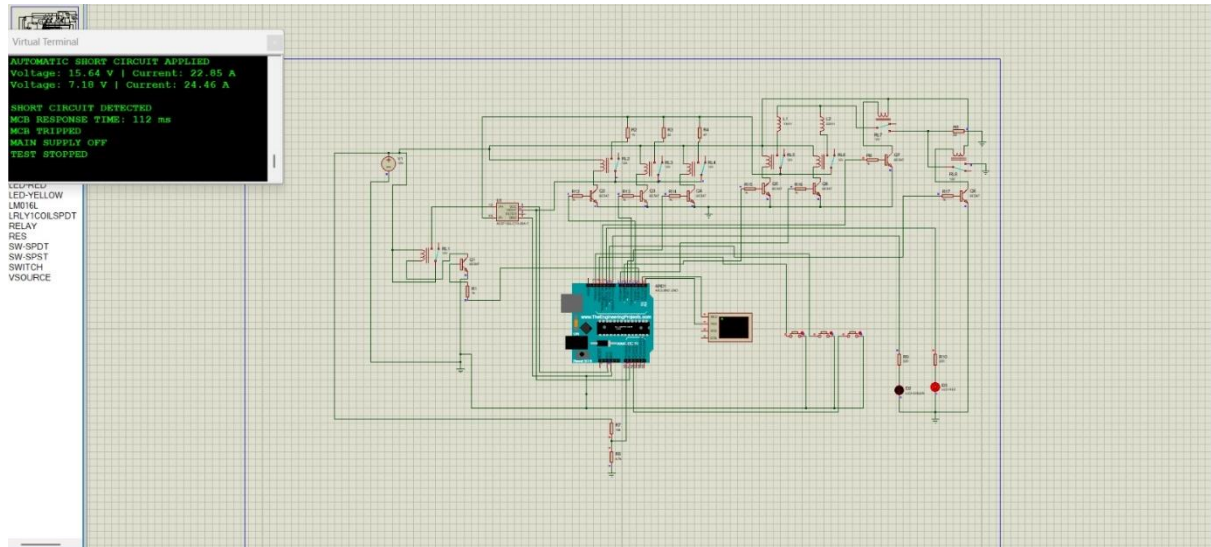

VIRTUAL TERMINAL

AUTOMATIC SHORT CIRCUIT APPLIED
Voltage: 15.64 V | Current: 22.85 A
Voltage: 7.18 V | Current: 24.46 A

SHORT CIRCUIT DETECTED
MCB RESPONSE TIME: 112 ms
MCB TRIPPED
MAIN SUPPLY OFF
TEST STOPPED

VIRTUAL TERMINAL

AUTOMATED MCB TEST SYSTEM
12 V PROTEUS DEMONSTRATION
SYSTEM READY

=====

TEST STARTED
MAIN SUPPLY ON
NORMAL LOAD APPLIED
SHORT CIRCUIT WILL BE APPLIED AUTOMATICA