


LEWIE
FIRE PROTECTION

Ambit 20T

Flow Test Results

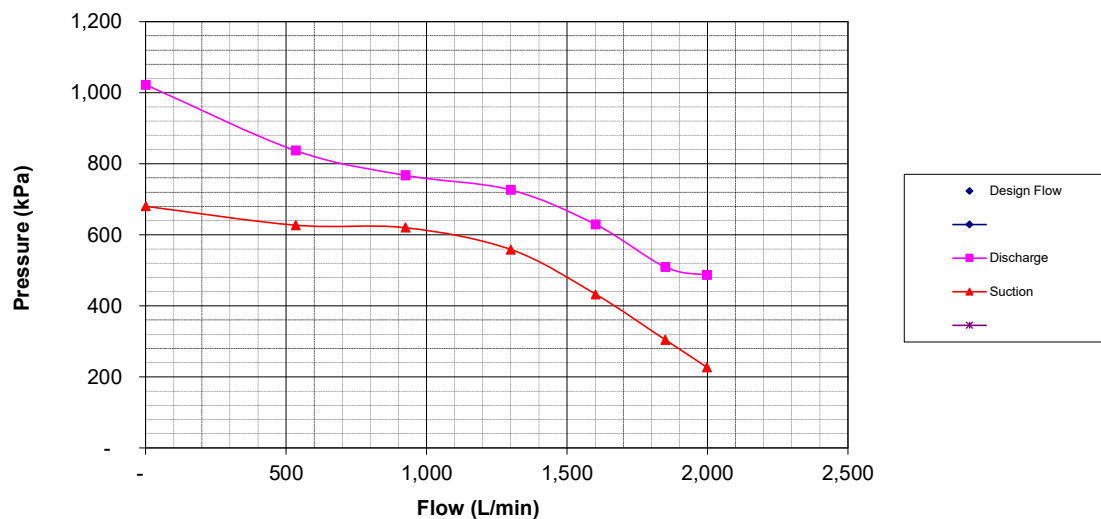

Result: ☐ PASS ☐ FAIL