
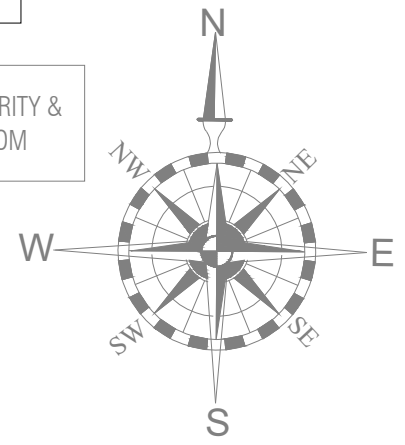


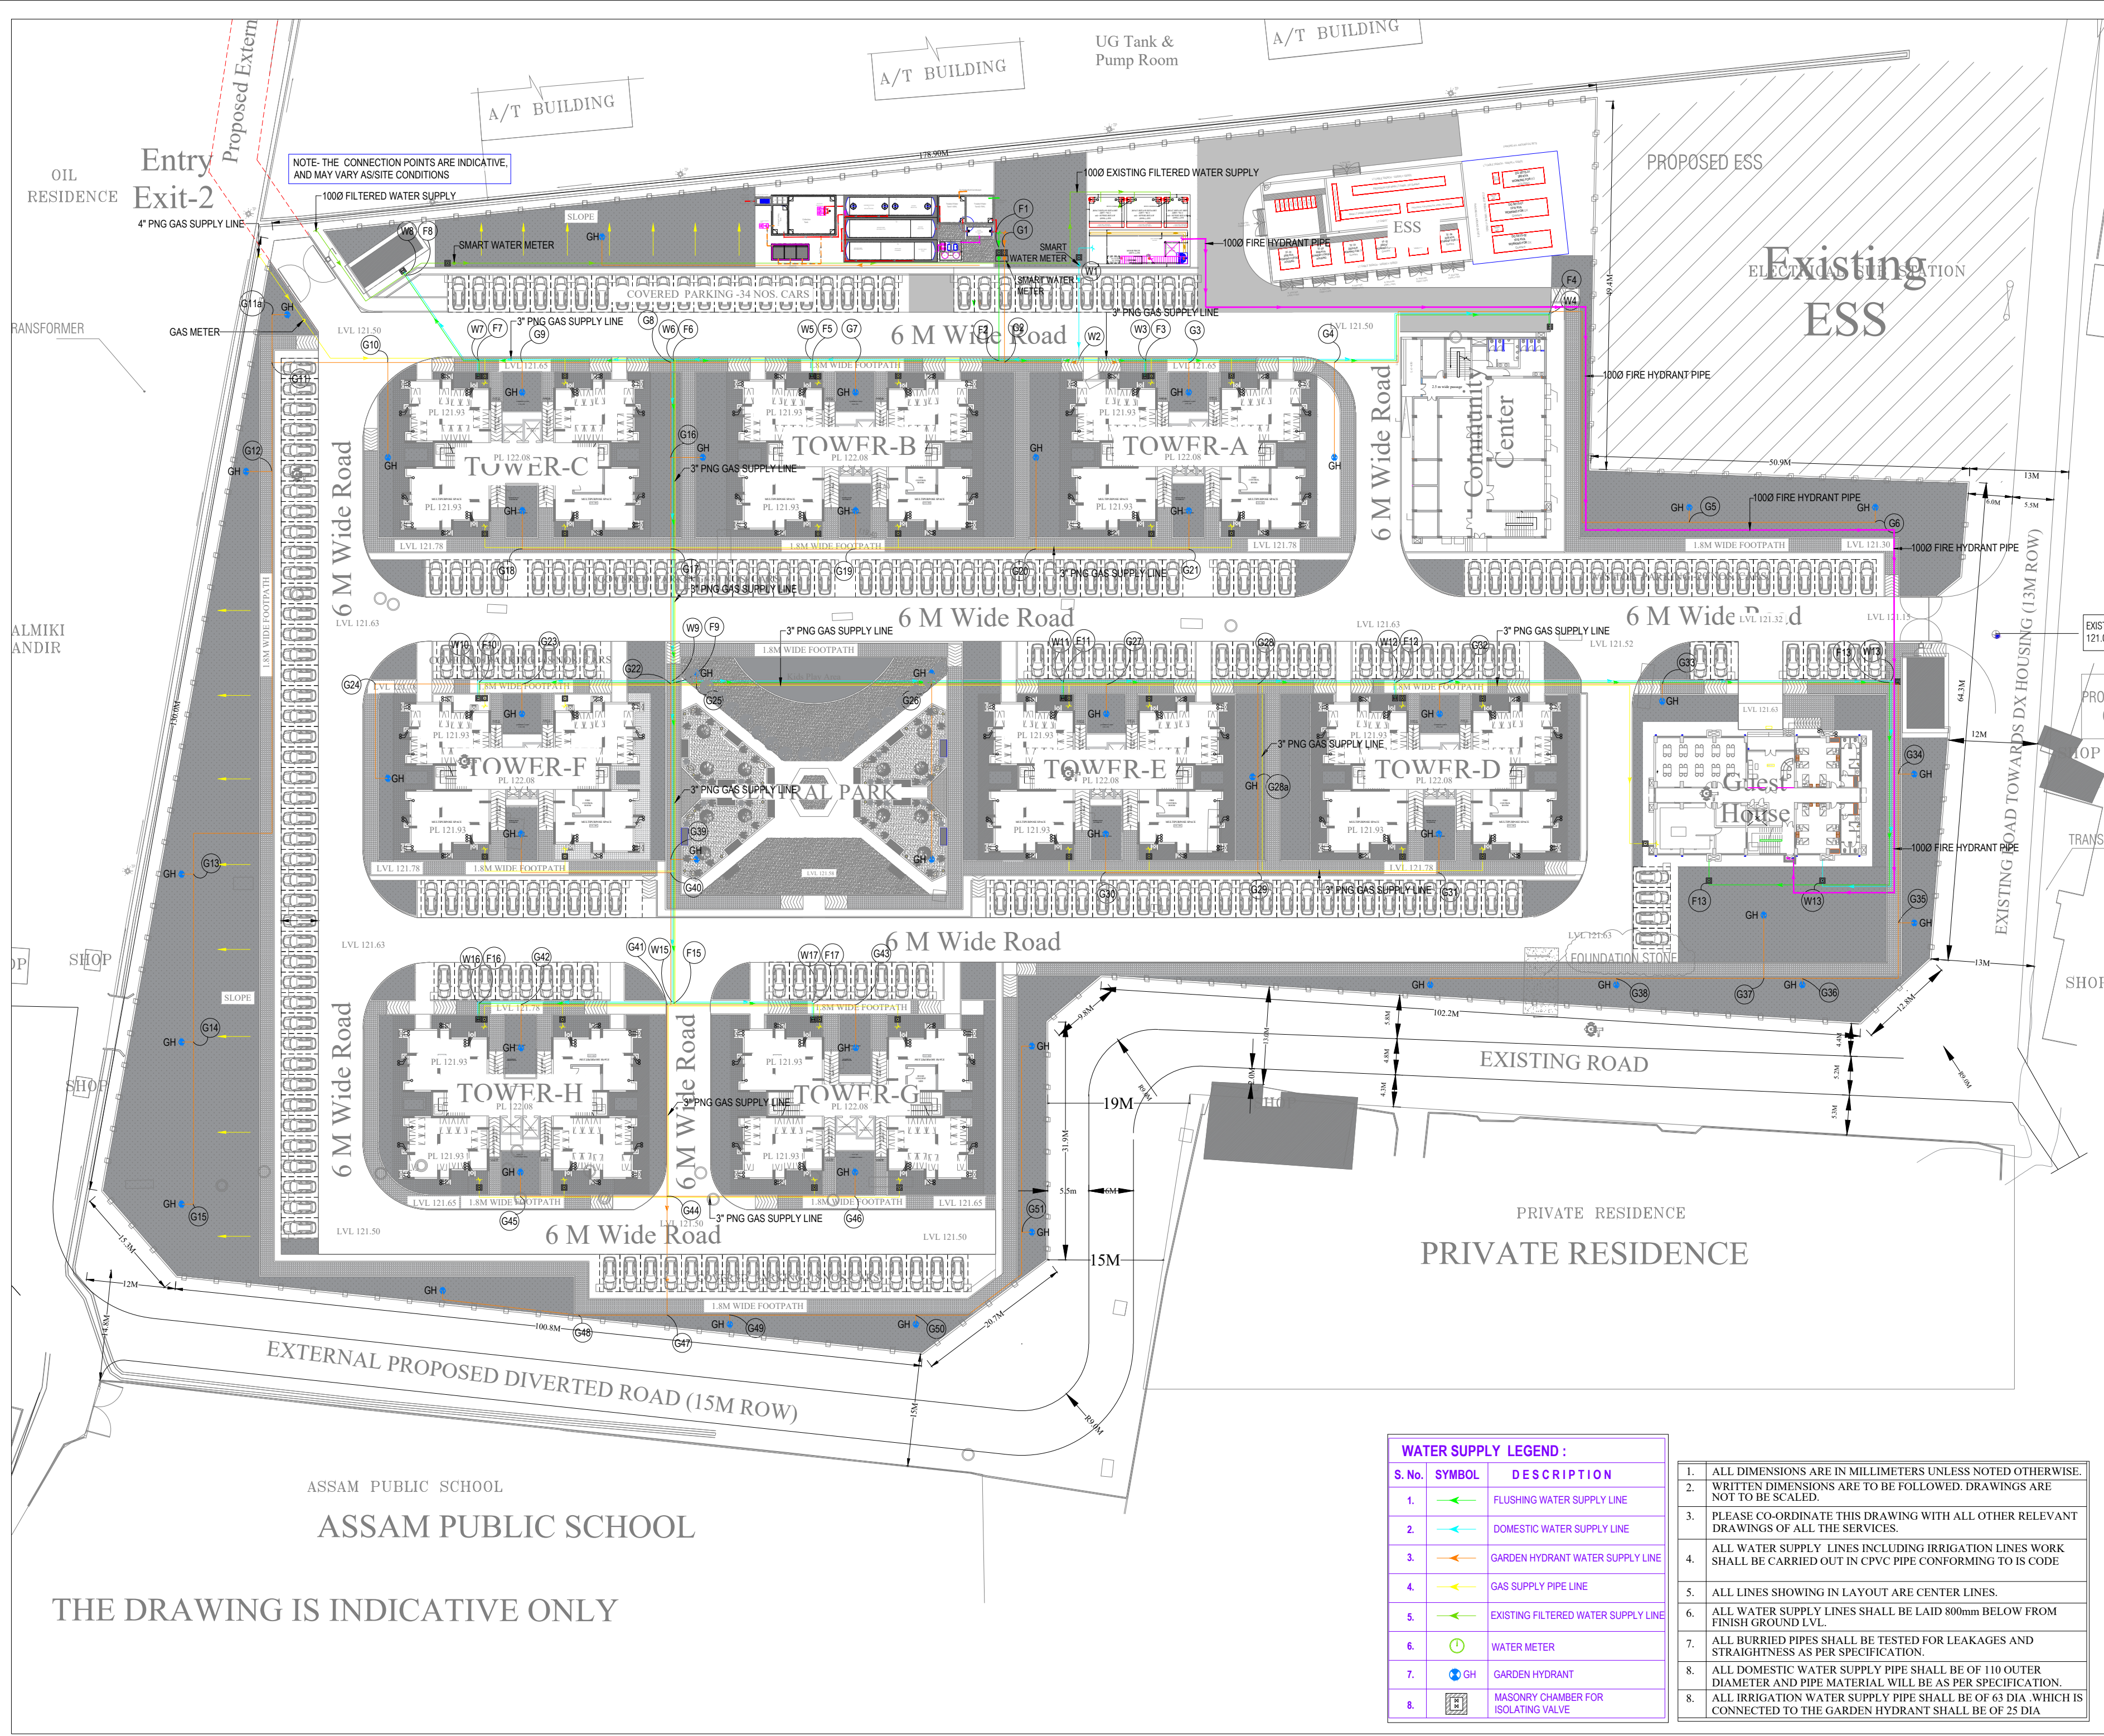

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWING, TENDER DOCUMENT.
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS, THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.
 6. WATER SUPPLY AND GAS LINE CONNECTIONS SHALL BE MADE FROM THE NEAREST AVAILABLE SOURCE POINTS AT SITE, AS PER ACTUAL CONDITIONS AND IN COORDINATION WITH LOCAL UTILITY AUTHORITIES.

TENDER DRAWING		
CLIENT	 OIL INDIA LIMITED (A Govt. of India Enterprise)	
CONSULTANT	 RITES THE INFRASTRUCTURE PEOPLE (A Govt. of India Enterprise)	
MEP CONSULTANT	PKV CONSULTING ENGINEERS (P) LTD.  815 - C DDA FLATS EAST OF LONI ROAD DELHI - 110093 email:-info@pkv.co.in	
JOB TITLE	BQ WORKMEN GROUP HOUSING COMPLEX AT DULIAJAN ASSAM	
DRAWING TITLE	EXTERNAL PLUMBING SERVICES DUAL PLUMBING, GAS SUPPLY & FIRE LAYOUT	
SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/DR/TEN/404

WATER SUPPLY LEGEND :		
S.No.	SYMBOL	DESCRIPTION
1.		FLUSHING WATER SUPPLY LINE
2.		DOMESTIC WATER SUPPLY LINE
3.		GARDEN HYDRANT WATER SUPPLY LINE
4.		GAS SUPPLY PIPE LINE
5.		EXISTING FILTERED WATER SUPPLY LINE
6.		WATER METER
7.		GARDEN HYDRANT
8.		MASONRY CHAMBER FOR ISOLATING VALVE


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. PLEASE CO-ORDINATE THIS DRAWING WITH ALL OTHER RELEVANT DRAWINGS OF ALL THE SERVICES.
4. ALL WATER SUPPLY LINES INCLUDING IRRIGATION LINES WORK SHALL BE CARRIED OUT IN CPVC PIPE CONFORMING TO IS CODE
5. ALL LINES SHOWING IN LAYOUT ARE CENTER LINES.
6. ALL WATER SUPPLY LINES SHALL BE LAID 800mm BELOW FROM FINISH GROUND LVL.
7. ALL BURRIED PIPES SHALL BE TESTED FOR LEAKAGES AND STRAIGHTNESS AS PER SPECIFICATION.
8. ALL DOMESTIC WATER SUPPLY PIPE SHALL BE OF 110 OUTER DIAMETER AND PIPE MATERIAL WILL BE AS PER SPECIFICATION.
8. ALL IRRIGATION WATER SUPPLY PIPE SHALL BE OF 63 DIA. WHICH IS CONNECTED TO THE GARDEN HYDRANT SHALL BE OF 25 DIA

THE DRAWING IS INDICATIVE ONLY


Design of Drainage System for (BQ HOUSHING DESIGN)													Schedule of Manhole	
S.No.	Line No.		Length(m)	Open Drain With Cover	Close Conduit		FGL/Road Level(m)		Invert Level(m)		Depth of Line(m)		S.No.	Manhole Nos.
				Slope (1 in)	Pipe Dia	Slope (1 in)	Start	End	Start	End	Start	End		
1	R1	R2	50.0	450.00			121.30	121.63	121.00	120.89	0.300	0.741	1	R1
2	R2	R3	20.0	450.00			121.63	121.63	120.89	120.84	0.741	0.786	2	R2
3	D1	R3	1.0		200	200	121.63	121.63	120.98	120.98	0.650	0.655	3	D1
4	R3	R4	11.0	450.00			121.63	121.63	120.84	120.82	0.786	0.810	4	R3
5	D2	D3	13.0		200	200	121.63	121.63	120.98	120.92	0.650	0.715	5	D2
6	D3	R4	2.6		200	200	121.63	121.63	120.92	120.90	0.715	0.728	6	D3
7	R4	R4a	38.0	450.00			121.63	121.63	120.82	120.74	0.810	0.894	7	R4
8	D4	D5	13.0		200	200	121.63	121.63	120.98	120.92	0.650	0.715	8	D4
9	D5	R4a	2.6		200	200	121.63	121.63	120.92	120.90	0.715	0.728	9	D5
10	R4a	R4b	7.0	450.00			121.63	121.63	120.74	120.72	0.894	0.910	10	R4a
11	D6	D7	13.0		200	200	121.63	121.63	120.98	120.92	0.650	0.715	11	D6
12	D7	R4b	2.6		200	200	121.63	121.63	120.92	120.90	0.715	0.728	12	D7
13	R4b	R5	38.0	450.00			121.63	121.63	120.72	120.64	0.910	0.994	13	R4b
14	D8	D9	13.0		200	200	121.63	121.63	120.98	120.92	0.650	0.715	14	D8
15	D9	R5	2.6		200	200	121.63	121.63	120.92	120.90	0.715	0.728	15	D9
16	R5	R6	7.0	450.00			121.63	121.63	120.64	120.62	0.994	1.010	16	R5
17	D10	D11	13.0		200	200	121.63	121.63	120.98	120.92	0.650	0.715	17	D10
18	D11	R6	2.6		200	200	121.63	121.63	120.92	120.90	0.715	0.728	18	D11
19	R6	R6a	38.0	450.00			121.63	121.63	120.62	120.54	1.010	1.094	19	R6
20	D12	D13	13.0		200	200	121.63	121.63	120.98	120.92	0.650	0.715	20	D12
21	D13	R6a	2.6		200	200	121.63	121.63	120.92	120.90	0.715	0.728	21	D13
22	R6a	R8	14.0	450.00			121.63	121.63	120.54	120.50	1.094	1.126	22	R6a
23	R7	R8	32.0	450.00			121.63	121.63	120.50	120.43	1.126	1.197	23	R7
24	R8	RWH1	6.0	600.00			121.63	121.63	120.43	120.42	1.197	1.207	24	R8
25	RWH1	OF	5.0	600.00			121.63	121.63	121.12	121.12	0.507	0.515	25	RWH1
26	R9	R11	27.0	450.00			121.63	121.63	121.33	121.27	0.300	0.360	26	R9
27	R10	R11	13	450.00			121.63	121.63	121.27	121.24	0.360	0.389	27	R10
28	R11	RWH2	5	450.00			121.63	121.63	121.24	121.23	0.389	0.400	28	R11
29	RWH2	OF	8	450.00			121.63	121.63	121.23	121.21	0.400	0.418	29	RWH2
30	R12	R13	30	225.00			121.63	121.50	121.33	121.20	0.300	0.303	30	R12
31	R13	R14	17	450.00			121.50	121.50	121.20	121.16	0.303	0.341	31	R13
32	R14	R15	5.5	450.00			121.50	121.50	121.16	121.15	0.341	0.353	32	R14
33	R15	R16	41	450.00			121.50	121.50	121.15	121.06	0.353	0.444	33	R15
34	R16	R18	36.5	450.00			121.50	121.50	121.06	120.97	0.444	0.526	34	R16
35	R17	R17a	5	450.00			121.50	121.50	121.20	121.19	0.300	0.311	35	R17
36	D14	R17a	1		200	200	121.50	121.50	120.85	120.85	0.650	0.655	36	D14
37	R17a	R18	36	450.00			121.50	121.50	120.55	120.47	0.955	1.035	37	R17a
38	R18	RWH3	6.5	450.00			121.50	121.50	120.47	120.45	1.035	1.049	38	R18
39	RWH3	OF	5	400.00			121.50	121.50	120.85	120.84	0.649	0.662	39	RWH3
40	D15	D16	18		200	200	121.63	121.63	120.98	120.89	0.650	0.740	40	D15
41	D16	D17	11.5		200	200	121.63	121.63	120.89	120.83	0.740	0.798	41	D16
42	D17	R19a	9		200	200	121.63	121.63	120.83	120.79	0.798	0.843	42	D17
43	R19	R19a	2	450.00			121.63	121.63	120.49	120.48	1.143	1.147	43	R19
44	R19a	R20	23	450.00			121.63	121.63	120.48	120.43	1.147	1.198	44	R19a
45	D18	D19	16		200	200	121.63	121.63	120.98	120.90	0.650	0.730	45	D18
46	D19	D20	14.5		200	200	121.63	121.63	120.90	120.83	0.730	0.803	46	D19
47	D20	R20	8		200	200	121.63	121.63	120.83	120.79	0.803	0.843	47	D20
48	R20	R20a	38	450.00			121.63	121.63	120.43	120.35	1.198	1.283	48	R20
49	D21	D22	12		200	200	121.63	121.63	120.98	120.92	0.650	0.710	49	D21
50	D22	R20a	3.5		200	200	121.63	121.63	120.92	120.90	0.710	0.728	50	D22
51	R20a	R20b	7	450.00			121.63	121.63	120.35	120.33	1.283	1.298	51	R20a
52	D23	D24	12		200	200	121.63	121.63	120.98	120.92	0.650	0.710	52	D23
53	D24	R20b	3.5		200	200	121.63	121.63	120.92	120.90	0.710	0.728	53	D24
54	R20b	R21	38	450.00			121.63	121.63	120.33	120.25	1.298	1.383	54	R20b
55	D25	D26	12		200	200	121.63	121.63	120.98	120.92	0.650	0.710	55	D25
56	D26	R21	3.5		200	200	121.63	121.63	120.92	120.90	0.710	0.728	56	D26
57	R21	R22	13	450.00			121.63	121.63	120.25	120.22	1.383	1.411	57	R21
58	R22	R23	13	450.00			121.63	121.63	120.22	120.19	1.411	1.440	58	R22
59	R23	R24	13	450.00			121.63	121.63	120.19	120.16	1.440	1.469	59	R23
60	R24	R24a	13	450.00			121.63	121.63	120.16	120.13	1.469	1.498	60	R24
61	D27	D28	12		200	200	121.63	121.63	120.98	120.92	0.650	0.710	61	D27
62	D28	R24a	3.5		200	200	121.63	121.63	120.92	120.90	0.710	0.728	62	D28
63	R24a	R24b	38	600.00			121.63	121.63	120.13	120.07	1.498	1.561	63	R24a
64	D29	D30	12		200	200	121.63	121.63	120.98	120.92	0.650	0.710	64	D29
65	D30	R24b	3.5		200	200	121.63	121.63	120.92	120.90	0.710	0.728	65	D30
66	R24b	R25	14	600.00			121.63	121.63	120.07	120.05	1.561	1.585	66	R24b
67	R25	RWH4	5	600.00			121.63	121.63	120.05	120.04	1.585	1.593	67	R25
68	RWH4	OF	12	600.00			121.63	121.63	121.09	121.07	0.543	0.563	68	RWH4
69	R27	R28	9	450.00			121.63	121.63	121.33	121.31	0.300	0.320	69	R27
70	R28	R28a	21	450.00			121.63	121.63	121.31	121.26	0.320	0.367	70	R28
71	R28a	R29	18	135.00			121.63	121.50	121.26	121.13	0.367	0.370	71	R28a
72	R29	R30	41	450.00			121.50	121.50	121.13	121.04	0.370	0.461	72	R29
73	D31	D32	12		200	200	121.50	121.50	120.85	120.79	0.650	0.710	73	D31
74	D32	D34	7		200	200	121.50	121.50	120.79	120.76	0.710	0.745	74	D32
75	D33	D34	12		200	200	121.50	121.50	120.76	120.70	0.745	0.805	75	D33
76	D34	R30	16		200	200	121.50	121.50	120.70	120.62	0.805	0.885	76	D34
77	R30	R30a	30	450.00			121.50	121.50	120.32	120.25	1.185	1.252	77	R30
78	R30a	R31	29	450.00			121.50	121.50	120.25	120.18	1.252	1.316	78	R30a
79	R31	RWH5	3	450.00			121.50	121.50	120.18	120.18	1.316	1.323	79	R31
80	RWH5	OF	17	450.00			121.50	121.50	120.18	120.14	1.323	1.361	80	RWH5
81	R31a	R31b	20	450.00			121.50	121.63	121.20	121.16	0.300	0.474	81	R31a
82	D35	R31b	14		200	200	121.63	121.63	120.98	120.91	0.650	0.720	82	D35
83	R31b	R32	8.5	450.00			121.63	121.63	120.61	120.59	1.020	1.039	83	R31b
84	R32c	R32	22	450.00			121.63	121.63	121.33	121.28	0.300	0.349	84	R32c
85	R32	RWH6	5	450.00			121.63	121.63	120.59	120.58	1.039	1.050	85	R32
86	RWH6	OF	16.5	450.00			121.63	121.63	121.18	121.14	0.450	0.487		

DESIGN CHART SHOWING OF SEWERAGE SYSTEM													S.No.	Manhole Nos.
S.No.	Line No.	Length	Pipe Size(m)	Slope (1 in)	Finish Ground Surface Level(m)	Invert Level(m)	Depth(m)							
1.	S1	S2	9.5	150	200	121.65	121.65	120.950	120.903	0.700	0.748	1	S1	
2.	S2	S4	23.00	150	200	121.65	121.66	120.903	120.788	0.748	0.872	2	S2	
3.	S3	S4	9.00	150	200	121.66	121.66	120.960	120.915	0.700	0.745	3	S3	
4.	S4	S5	6.00	150	200	121.66	121.66	120.788	120.758	0.872	0.902	4	S4	
5.	S5	S6	18.00	150	200	121.66	121.66	120.758	120.668	0.902	0.992	5	S5	
6.	S6	S11	16.50	150	200	121.66	121.66	120.668	120.585	0.992	1.075	6	S6	
7.	S7	S8	9.00	150	200	121.65	121.65	120.950	120.905	0.700	0.745	7	S7	
8.	S8	S10	22.00	150	200	121.65	121.66	120.905	120.795	0.745	0.865	8	S8	
9.	S9	S11	9.50	150	200	121.66	121.66	120.960	120.913	0.700	0.748	9	S9	
10.	S10	S16	12.00	150	200	121.66	121.66	120.795	120.770	0.865	0.890	10	S10	
11.	S11	S12	9.50	150	200	121.66	121.66	120.585	120.525	1.075	1.135	11	S11	
12.	S12	S13	9.50	150	200	121.65	121.65	120.950	120.903	0.700	0.748	12	S12	
13.	S13	S15	22.00	150	200	121.65	121.66	120.903	120.793	0.748	0.867	13	S13	
14.	S14	S15	9.00	150	200	121.66	121.66	120.960	120.915	0.700	0.745	14	S14	
15.	S15	S16	5.00	150	200	121.66	121.66	120.793	120.768	0.867	0.892	15	S15	
16.	S16	S17	17.00	150	200	121.66	121.66	120.525	120.440	1.135	1.220	16	S16	
17.	S17	S22	17.00	150	200	121.66	121.66	120.440	120.350	1.220	1.305	17	S17	
18.	S18	S19	9.00	150	200	121.65	121.65	120.950	120.905	0.700	0.745	18	S18	
19.	S19	S21	22.00	150	200	121.65	121.66	120.905	120.795	0.745	0.865	19	S19	
20.	S20	S21	9.50	150	200	121.66	121.66	120.960	120.913	0.700	0.748	20	S20	
21.	S21	S22	5.00	150	200	121.66	121.66	120.585	120.525	0.865	0.890	21	S21	
22.	S22	S24	7.00	150	200	121.66	121.66	120.350	120.275	1.510	1.570	22	S22	
23.	S23	S24	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	23	S23	
24.	S24	S25	2.00	150	200	121.78	121.78	121.035	121.025	0.745	0.755	24	S24	
25.	S25	S32	27.00	150	200	121.78	121.66	120.270	120.135	1.510	1.525	25	S25	
26.	S26	S27	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	26	S26	
27.	S27	S29	23.00	150	200	121.78	121.66	121.035	120.920	0.745	0.740	27	S27	
28.	S28	S29	9.00	150	200	121.66	121.66	120.960	120.915	0.700	0.745	28	S28	
29.	S29	S30	4.00	150	200	121.66	121.66	120.915	120.895	0.745	0.765	29	S29	
30.	S30	S31	17.50	150	200	121.66	121.66	120.895	120.808	0.765	0.853	30	S30	
31.	S31	S32	21.00	150	200	121.66	121.66	120.808	120.703	0.853	0.958	31	S31	
32.	S32A	S32B	9.50	150	200	121.66	121.66	120.960	120.913	0.700	0.748	32	S32A	
33.	S32B	S32	5.00	150	200	121.66	121.66	120.913	120.888	0.748	0.773	33	S32B	
34.	S32	S35	16.00	150	200	121.66	121.78	120.135	120.055	1.525	1.725	34	S32	
35.	S33	S34	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	35	S33	
36.	S34	S35	2.00	150	200	121.78	121.78	121.035	121.025	0.745	0.755	36	S34	
37.	S35	S36	20.00	150	200	121.78	121.78	120.055	119.955	1.725	1.825	37	S35	
38.	S36	S39	9.00	150	200	121.78	121.78	119.955	119.910	1.825	1.870	38	S36	
39.	S37	S39	9.50	150	200	121.65	121.78	120.950	120.903	0.700	0.877	39	S37	
40.	S38	S39	4.00	150	200	121.65	121.78	120.950	120.930	0.700	0.850	40	S38	
41.	S39	S44	29.00	150	200	121.78	121.65	119.910	119.765	1.870	1.885	41	S39	
42.	S40	S41	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	42	S40	
43.	S41	S43	23.00	150	200	121.78	121.65	121.035	120.920	0.745	0.730	43	S41	
44.	S42	S43	9.00	150	200	121.65	121.65	120.950	120.905	0.700	0.745	44	S42	
45.	S43	S44	2.00	150	200	121.65	121.65	120.905	120.895	0.745	0.755	45	S43	
46.	S44	S49	80.00	150	200	121.78	121.65	119.765	119.715	1.885	1.935	46	S44	
47.	S45	S46	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	47	S45	
48.	S46	S48	23.00	150	200	121.78	121.65	121.035	120.920	0.745	0.730	48	S46	
49.	S47	S48	9.50	150	200	121.65	121.65	120.950	120.903	0.700	0.748	49	S47	
50.	S48	S49	1.50	150	200	121.65	121.65	120.903	120.895	0.748	0.755	50	S48	
51.	S49	S100	5.00	150	200	121.65	121.65	119.715	119.690	1.935	1.960	51	S49	
52.	S50	S51	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	52	S50	
53.	S51	S53	23.00	150	200	121.78	121.66	121.035	120.920	0.745	0.740	53	S51	
54.	S52	S53	9.50	150	200	121.66	121.66	120.960	120.913	0.700	0.748	54	S52	
55.	S53	S54	4.00	150	200	121.66	121.66	120.913	120.893	0.748	0.767	55	S53	
56.	S54	S55	18.00	150	200	121.66	121.66	120.893	120.803	0.767	0.858	56	S54	
57.	S55	S60	15.00	150	200	121.66	121.66	120.803	120.728	0.858	0.933	57	S55	
58.	S56	S57	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	58	S56	
59.	S57	S59	23.00	150	200	121.78	121.66	121.035	120.920	0.745	0.740	59	S57	
60.	S58	S59	9.00	150	200	121.66	121.66	120.960	120.915	0.700	0.740	60	S58	
61.	S59	S60	4.00	150	200	121.66	121.66	120.915	120.895	0.745	0.765	61	S59	
62.	S60	S65	12.00	150	200	121.66	121.66	120.728	120.668	0.933	0.993	62	S60	
63.	S61	S62	9.50	150	200	121.78	121.78	121.080	121.033	0.700	0.748	63	S61	
64.	S62	S64	23.00	150	200	121.78	121.66	121.033	120.918	0.748	0.742	64	S62	
65.	S63	S64	9.50	150	200	121.66	121.66	120.960	120.913	0.700	0.748	65	S63	
66.	S64	S65	4.00	150	200	121.66	121.66	120.913	120.893	0.748	0.767	66	S64	
67.	S65	S79	18.00	150	200	121.66	121.66	120.668	120.578	0.993	1.083	67	S65	
68.	S66	S67	7.00	150	200	121.78	121.78	121.080	121.045	0.700	0.735	68	S66	
69.	S67	S68	5.00	150	200	121.66	121.66	120.903	120.900	0.745	0.750	69	S67	
70.	S68	S69	10.00	150	200	121.78	121.78	120.970	120.920	0.850	0.860	70	S68	
71.	S69	S70	10.00	150	200	121.78	121.66	120.920	120.870	0.860	0.790	71	S69	
72.	S70	S70A	3.50	150	200	121.66	121.66	120.870	120.853	0.790	0.807	72	S70	
73.	S70A	S74	7.50	150	200	121.66	121.66	120.853	120.815	0.807	0.845	73	S70A	
74.	S71	S72	7.00	150	200	121.66	121.66	120.960	120.925	0.700	0.735	74	S71	
75.	S72	S73	15.00	150	200	121.66	121.66	120.925	120.850	0.735	0.810	75	S72	
76.	S73	S74	10.00	150	200	121.66	121.66	120.850	120.800	0.810	0.860	76	S73	
77.	S74	S75	7.00	150	200	121.66	121.66	120.800	120.765	0.860	0.895	77	S74	
78.	S75	S78	12.00	150	200	121.66	121.66	120.765	120.705	0.895	0.955	78	S75	
79.	S75A	S75B	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	79	S75A	
80.	S76B	S77	23.00	150	200	121.78	121.66	121.035	120.920	0.745	0.740	80	S75B	
81.	S76	S77	9.00	150	200	121.66	121.66	120.960	120.915	0.700	0.740	81	S76	
82.	S77	S78	4.00	150	200	121.66	121.66	120.915	120.895	0.745	0.765	82	S77	
83.	S78	S79	15.00	150	200	121.66	121.66	120.705	120.630	0.955	1.030	83	S78	
84.	S79	S82	20.00	150	200	121.66	121.78	120.578	120.478	1.083	1.303	84	S79	
85.	S80	S81	9.00	150	200	121.78	121.78	121.080	121.035	0.700	0.745	85	S80	
86.	S81	S82	3.00	150	200	121.78	121.78	121.035	121.020	0.745	0.760	86	S81	
87.	S82	S83	20.00	150	200	121.78	121.65	120.478	120.378	1.303	1.275	87	S82	
88.	S83	S85	5.00	150	200	121.65	121.65	120.378	120.353	1.275	1.290	88	S83	
89.	S84	S85	8.00	150	200	121.53	121.53	120.830	120.790	0.700	0.748	89	S84	
90.	S85	S86	10.00	150	200	121.53	121.53	120.790	120.740	0.740	0.790	90	S85	
91.	S86	S88	12.50	150	200	121.53	121.65	120.740	120.678	0.790	0.973	91	S86	
92.	S87	S89	9.00	150	200	121.65	121.65	120.905	120.905	0.700	0.745	92	S87	
93.	S88	S89	2.00	150	200	121.65	121.65	120.905	120.895	0.745	0.755	93	S88	
94.	S89	S94	34.00	150	200	121.65	121.65	120.333	120.183	1.298	1.468	94	S89	
95.	S90	S91	9.00	15										


SEWERAGE MANHOLE DETAILS

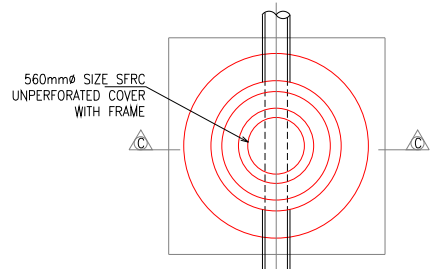


CIRCULAR MANHOLE 910 DIA FOR SEWERAGE SYSTEM
TYPE-A - DEPTH 0.901m TO 1.650m

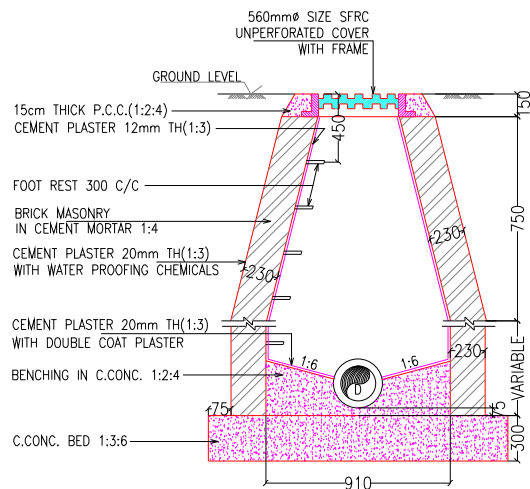


D= DIA OF PIPE
SECTION C-C

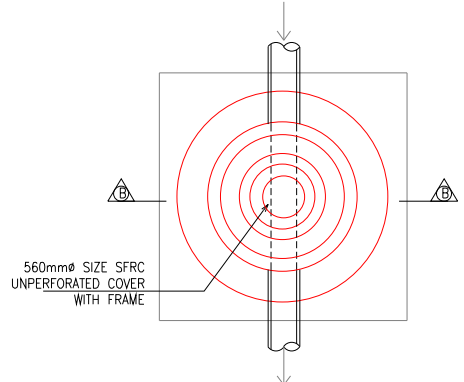


CIRCULAR MANHOLE 1220 DIA FOR SEWERAGE SYSTEM WITH
TYPE-B - DEPTH 1.651m TO 2.300m

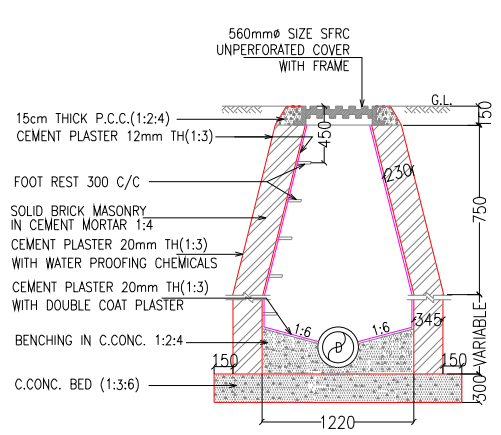


D= DIA OF PIPE
SECTION B-B

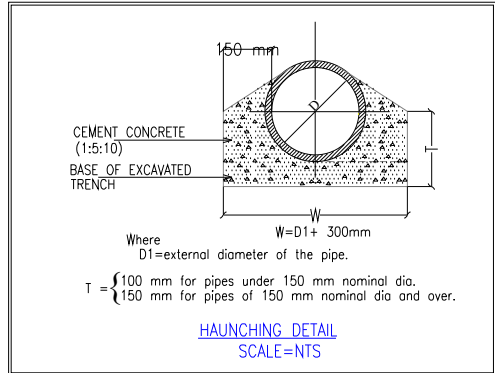


HAUNCHING DETAIL
SCALE=NTS

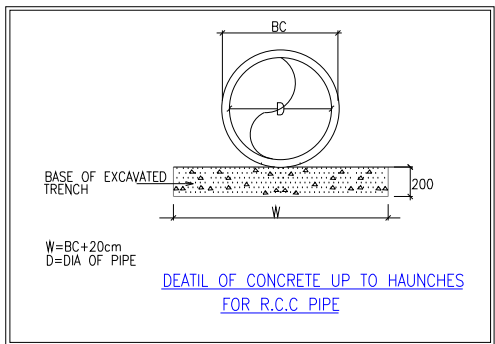

DETAIL OF CONCRETE UP TO HAUNCHES
FOR R.C.C. PIPE

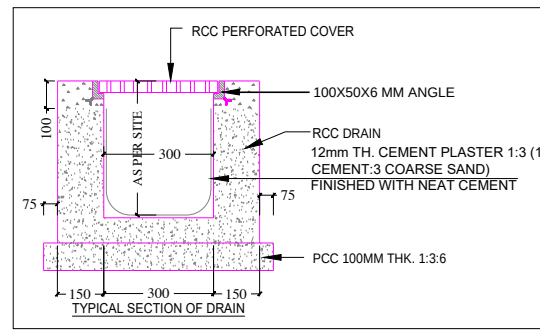


RCC DRAIN SECTION

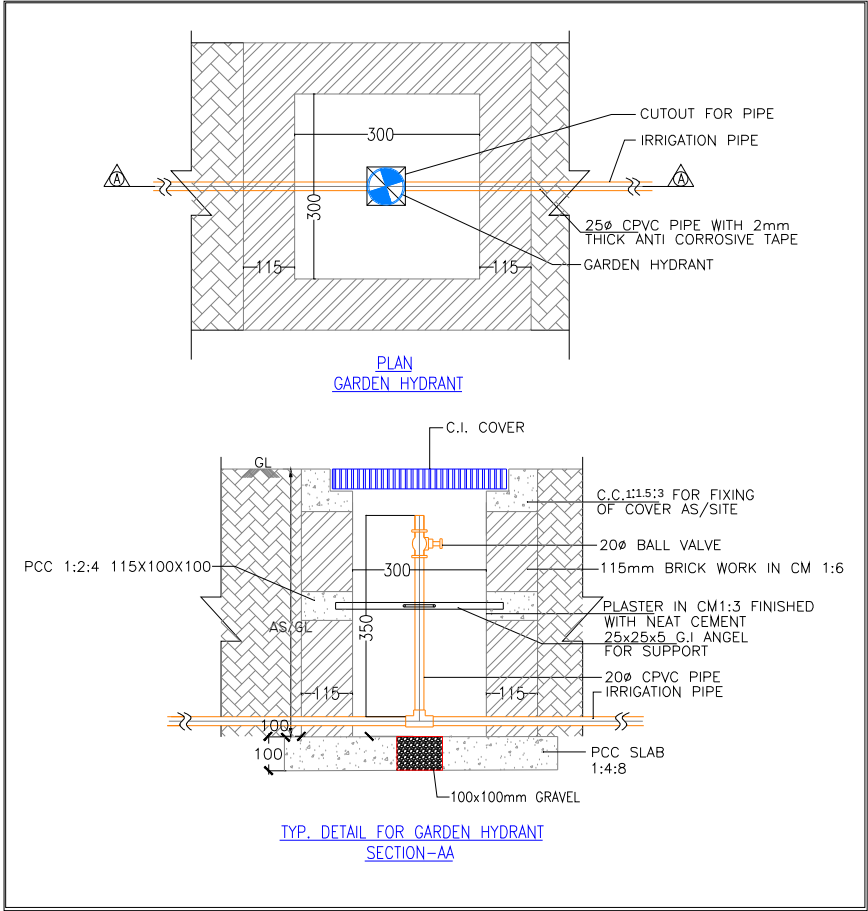


PLAN
GARDEN HYDRANT


TYP. DETAIL FOR GARDEN HYDRANT
SECTION-AA

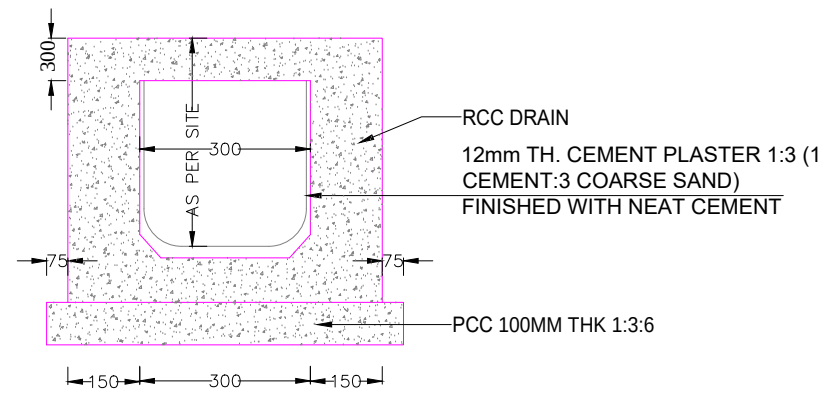


RCC DRAIN SECTION AT ROAD CROSSING

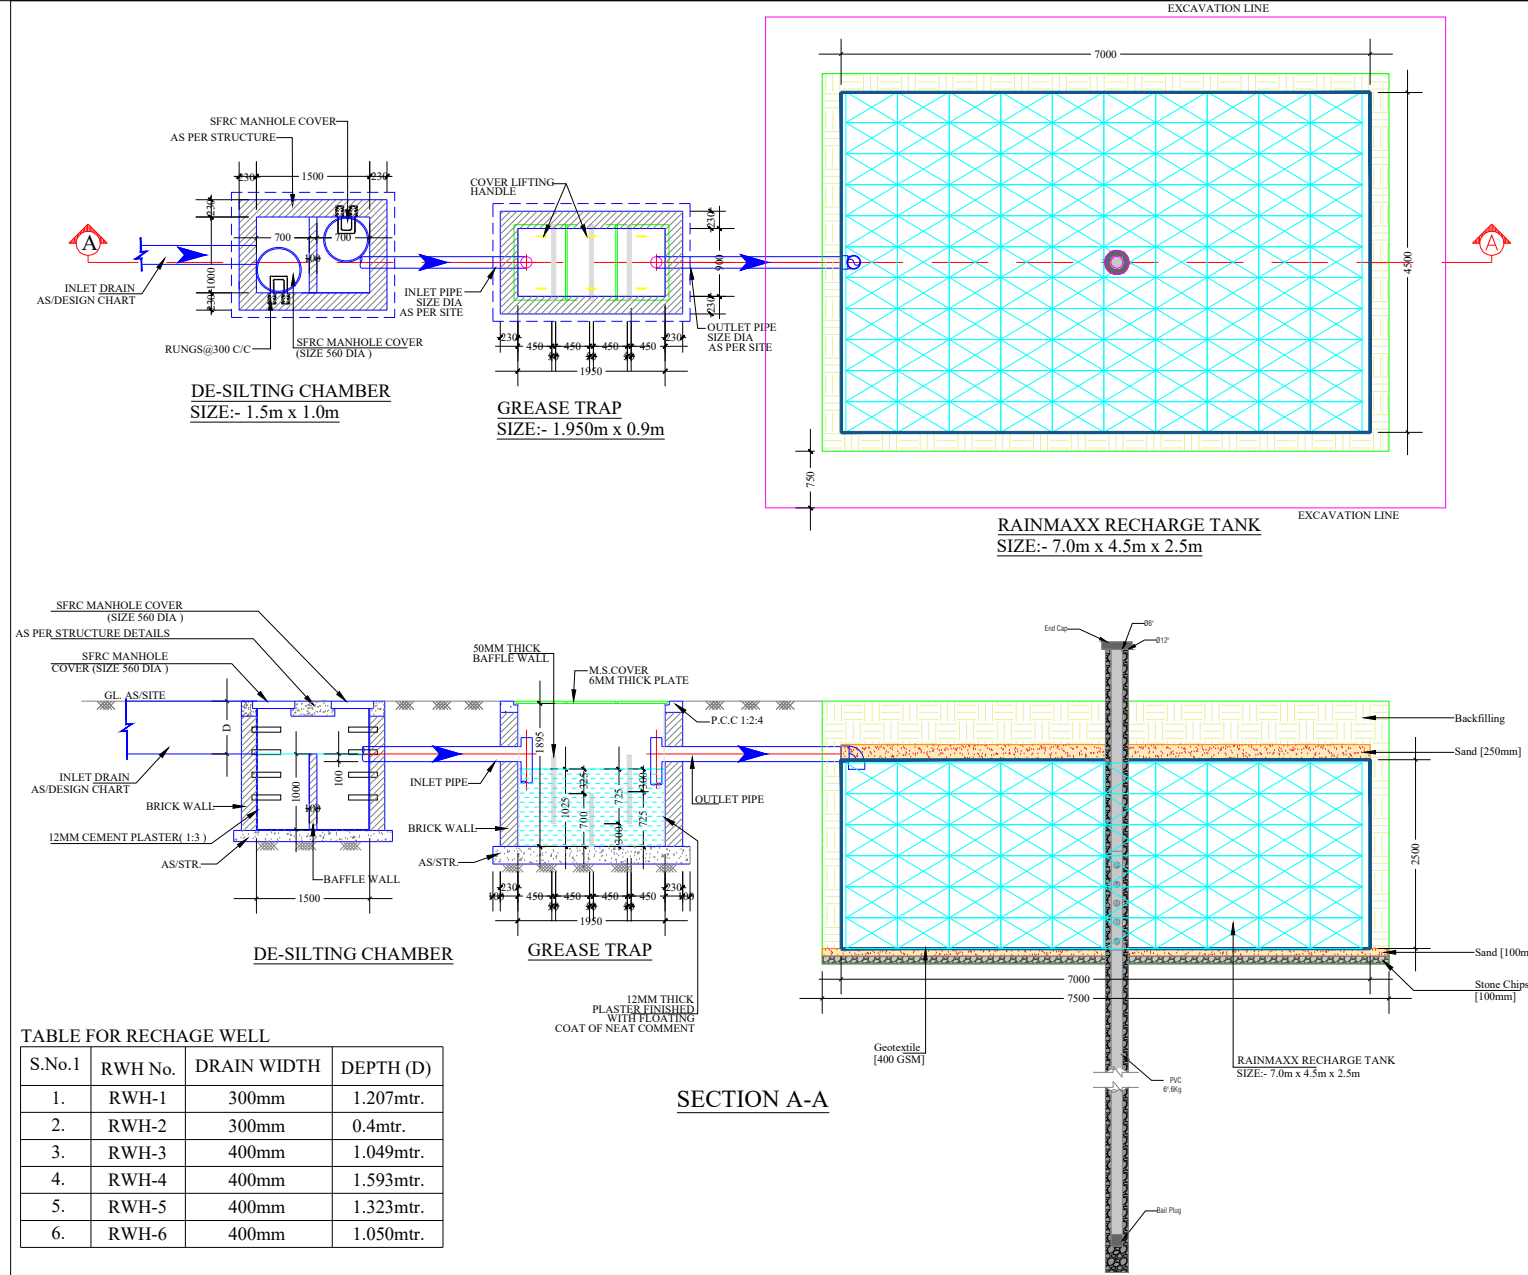


SECTION A-A

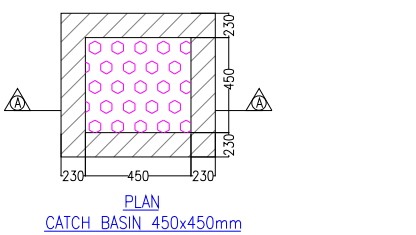


CATCH BASIN 450x450mm

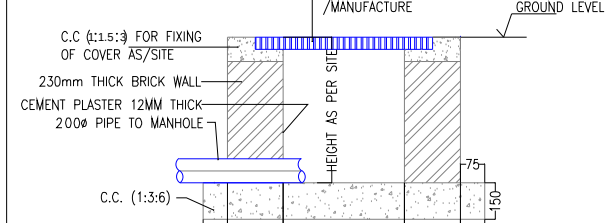


SECTION A-A
TYPICAL DETAIL OF CATCH BASIN

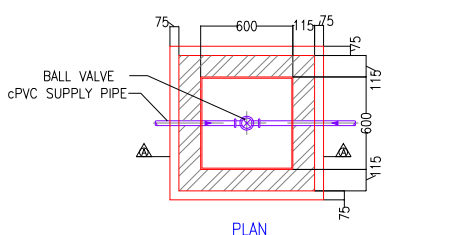

TYPICAL DETAIL OF VALVE
WITH CHAMBER

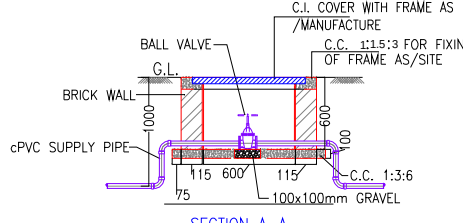


SECTION A-A

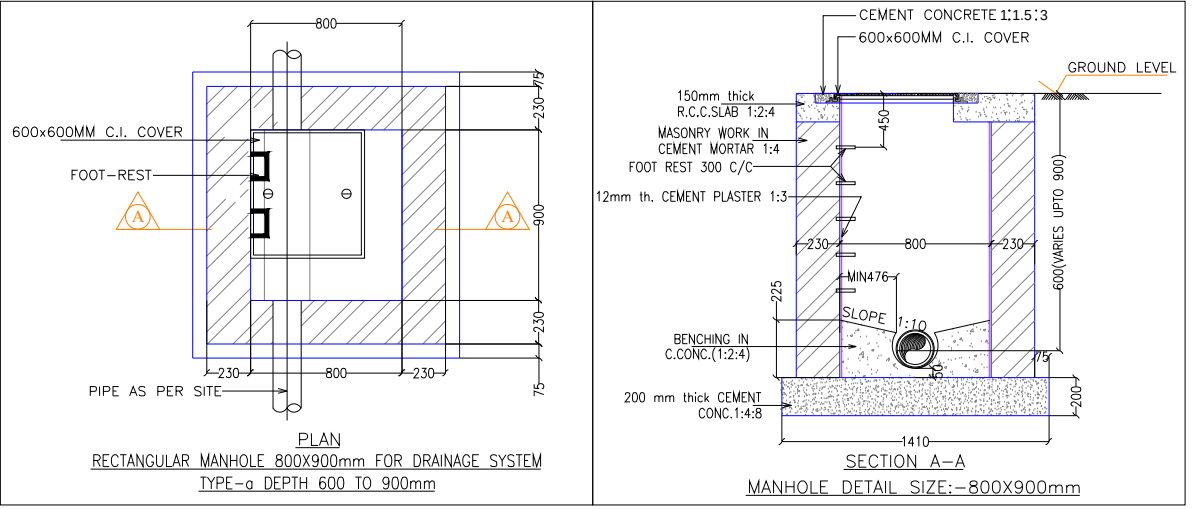


PLAN
RECTANGULAR MANHOLE 800X900mm FOR DRAINAGE SYSTEM
TYPE-a DEPTH 600 TO 900mm


SECTION A-A
MANHOLE DETAIL SIZE:-800X900mm

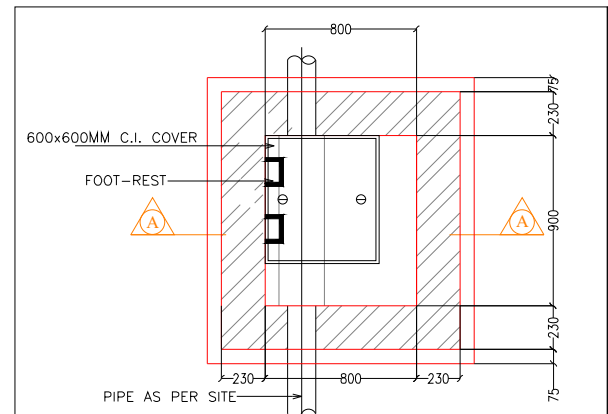

PLAN
RECTANGULAR MANHOLE 800X900mm FOR SEWERAGE SYSTEM
TYPE-a DEPTH 600 TO 900mm

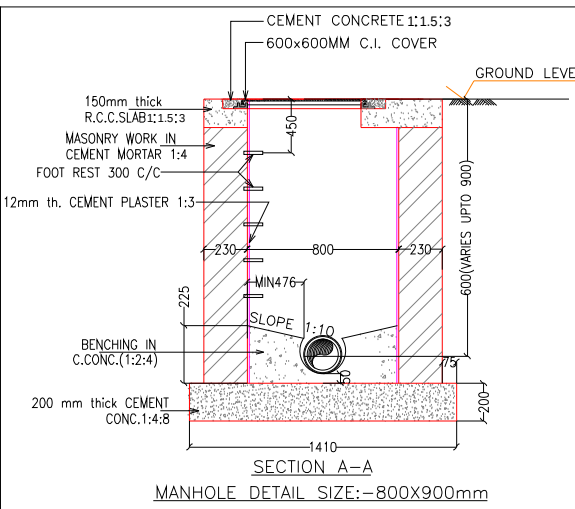

SECTION A-A
MANHOLE DETAIL SIZE:-800X900mm

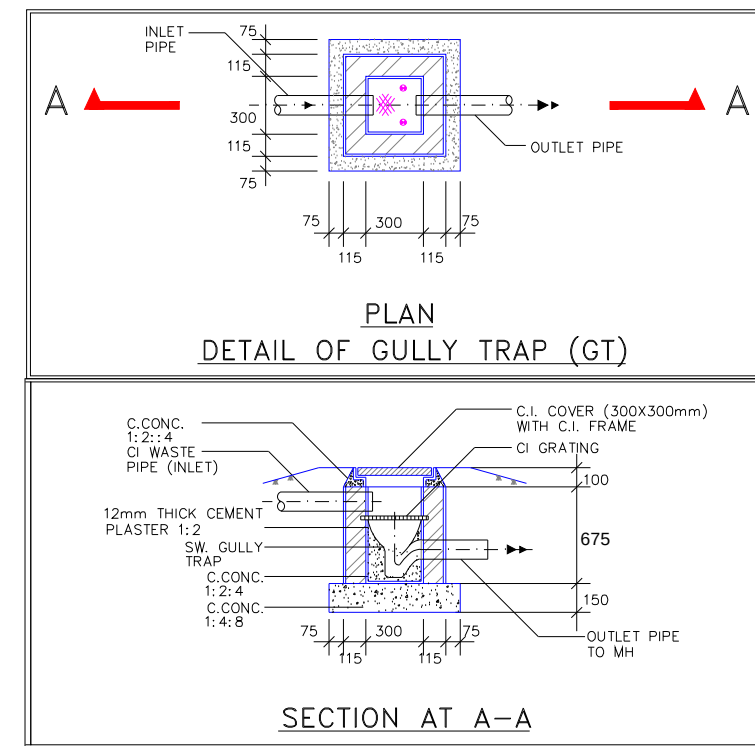

PLAN
DETAIL OF GULLY TRAP (GT)

SECTION AT A-A

NOTES:-

1. ALL DIMENSIONS ARE IN MM, UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWING TENDER DOCUMENTS.
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MAIN REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT RITES
(A Govt. of India Enterprise)









MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.
815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM


DRAWING TITLE
TYPICAL PLUMBING DETAILS

SCALE	DATE	DRAWN NO.
NTS	JULY 2025	RITES/BLD/DR/TEN/406

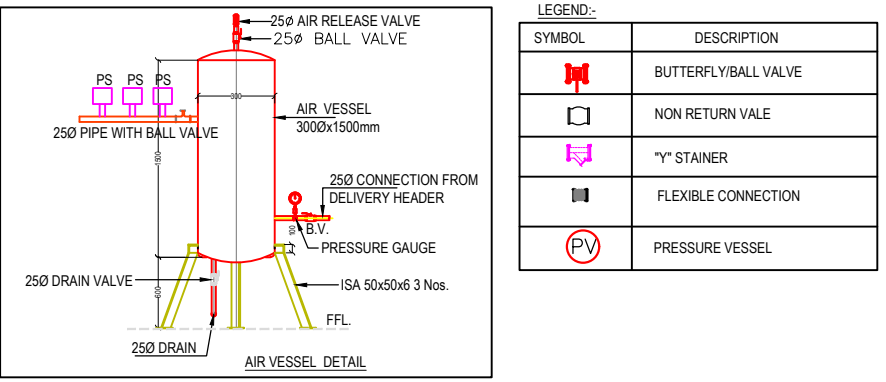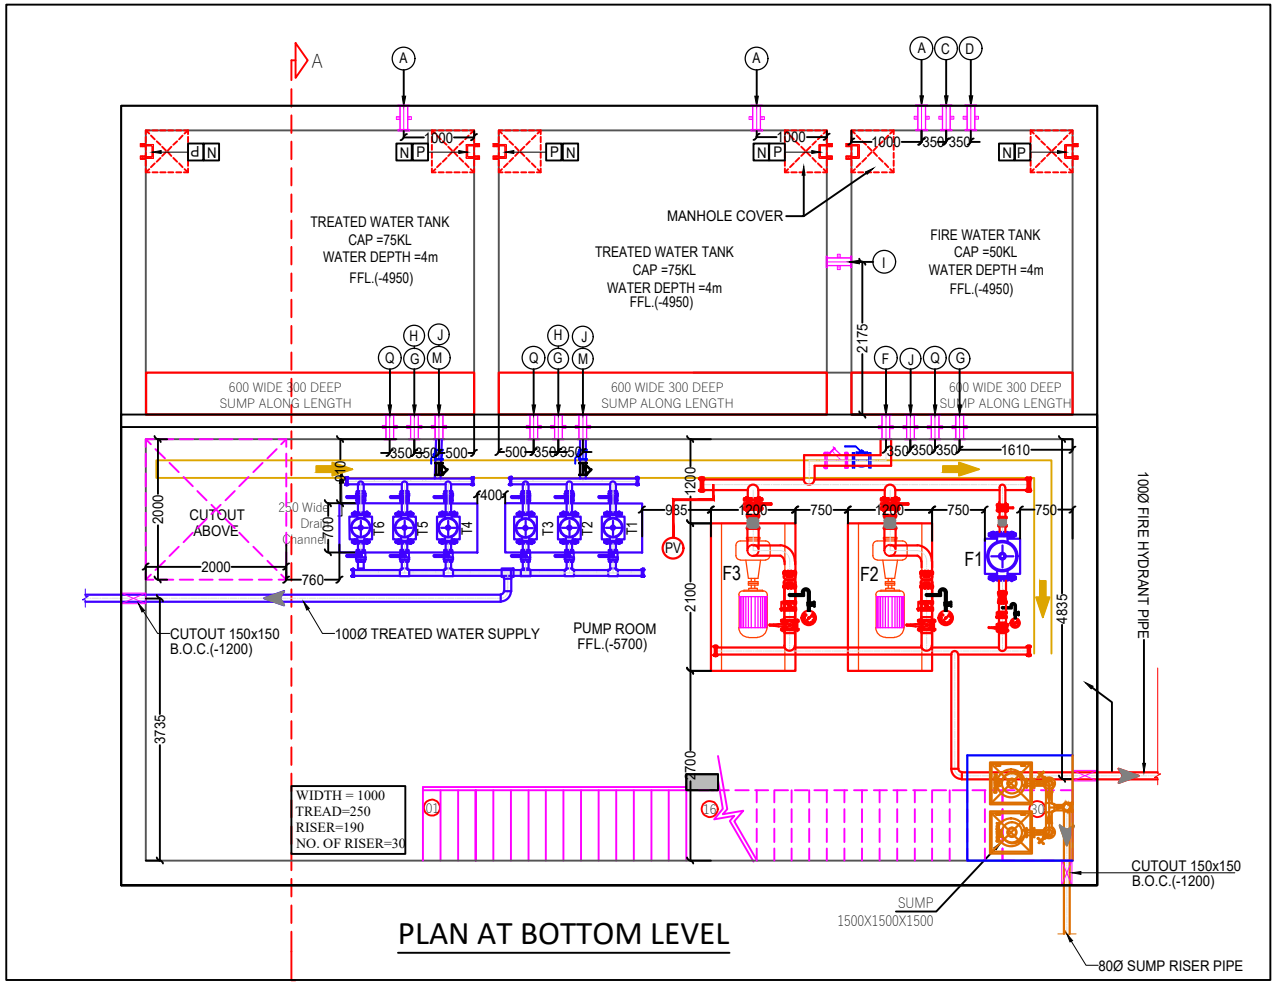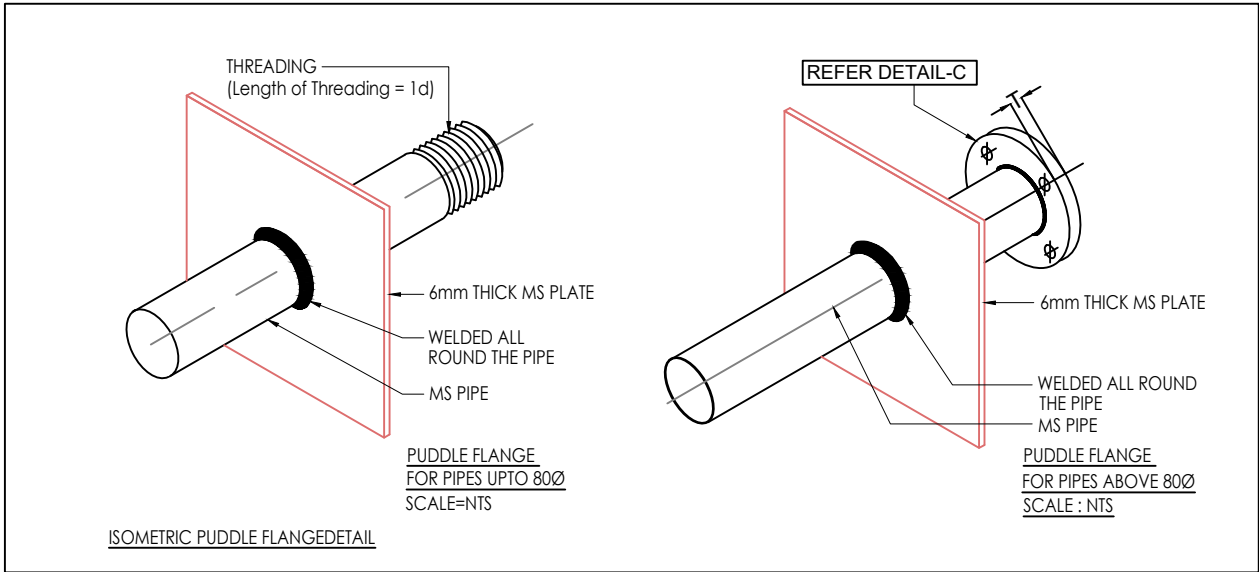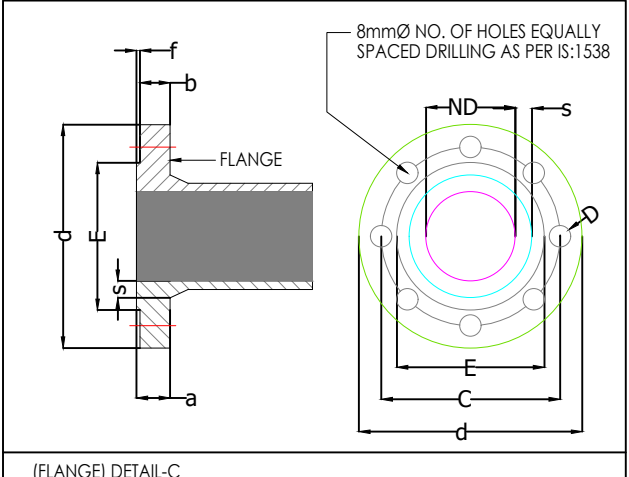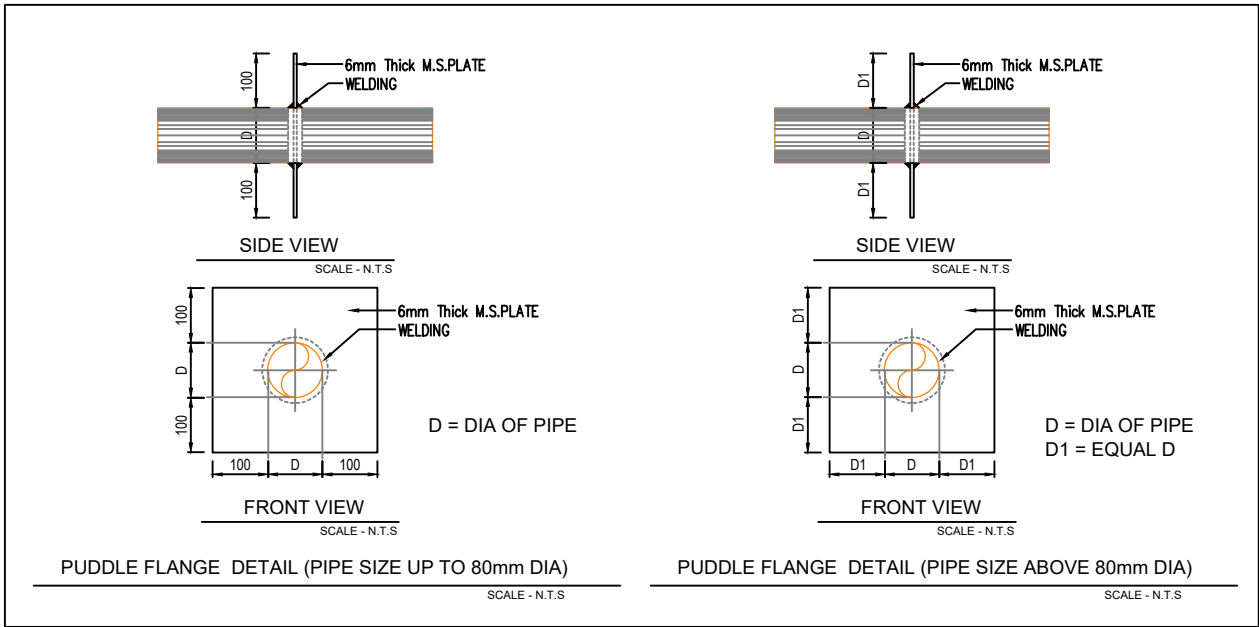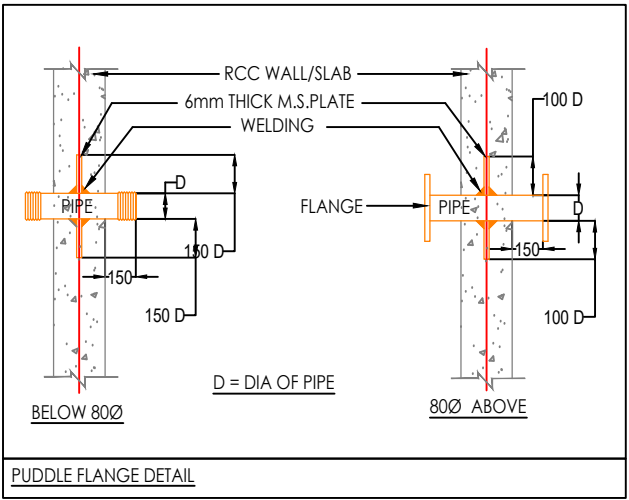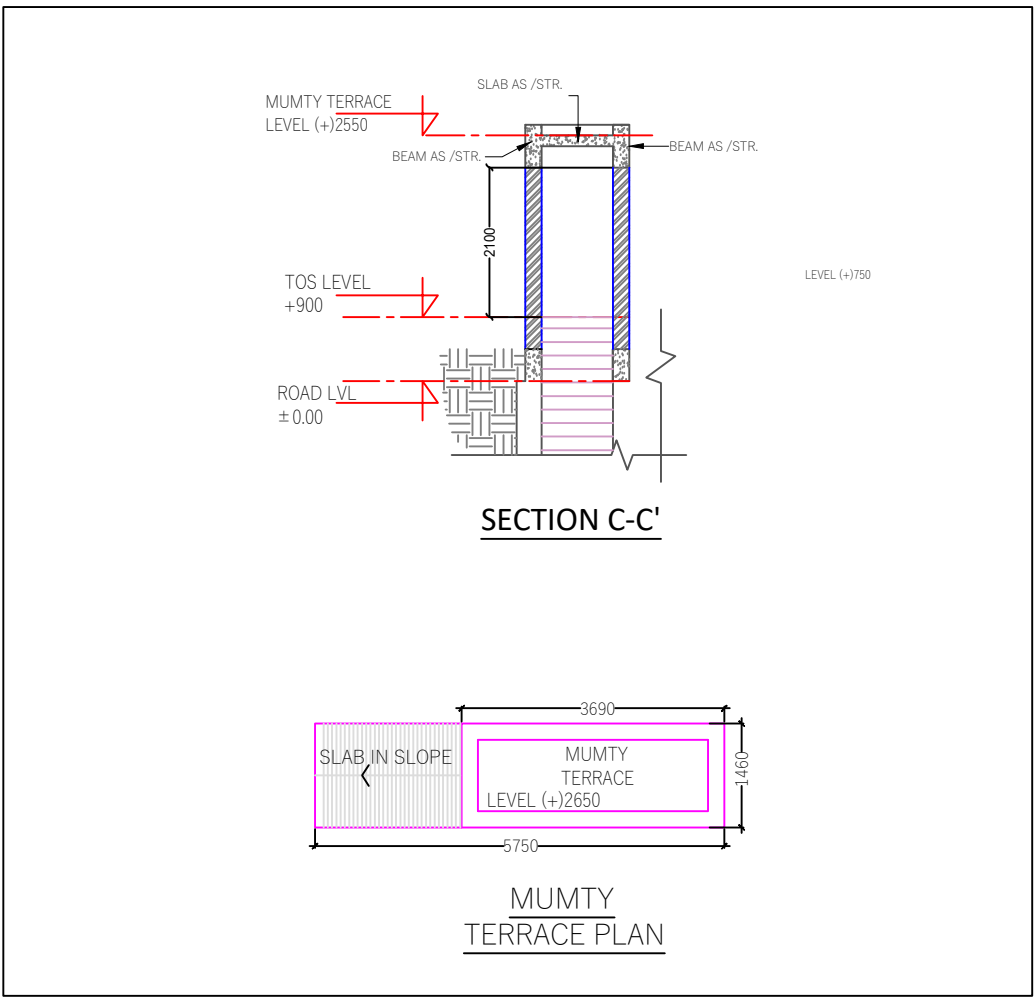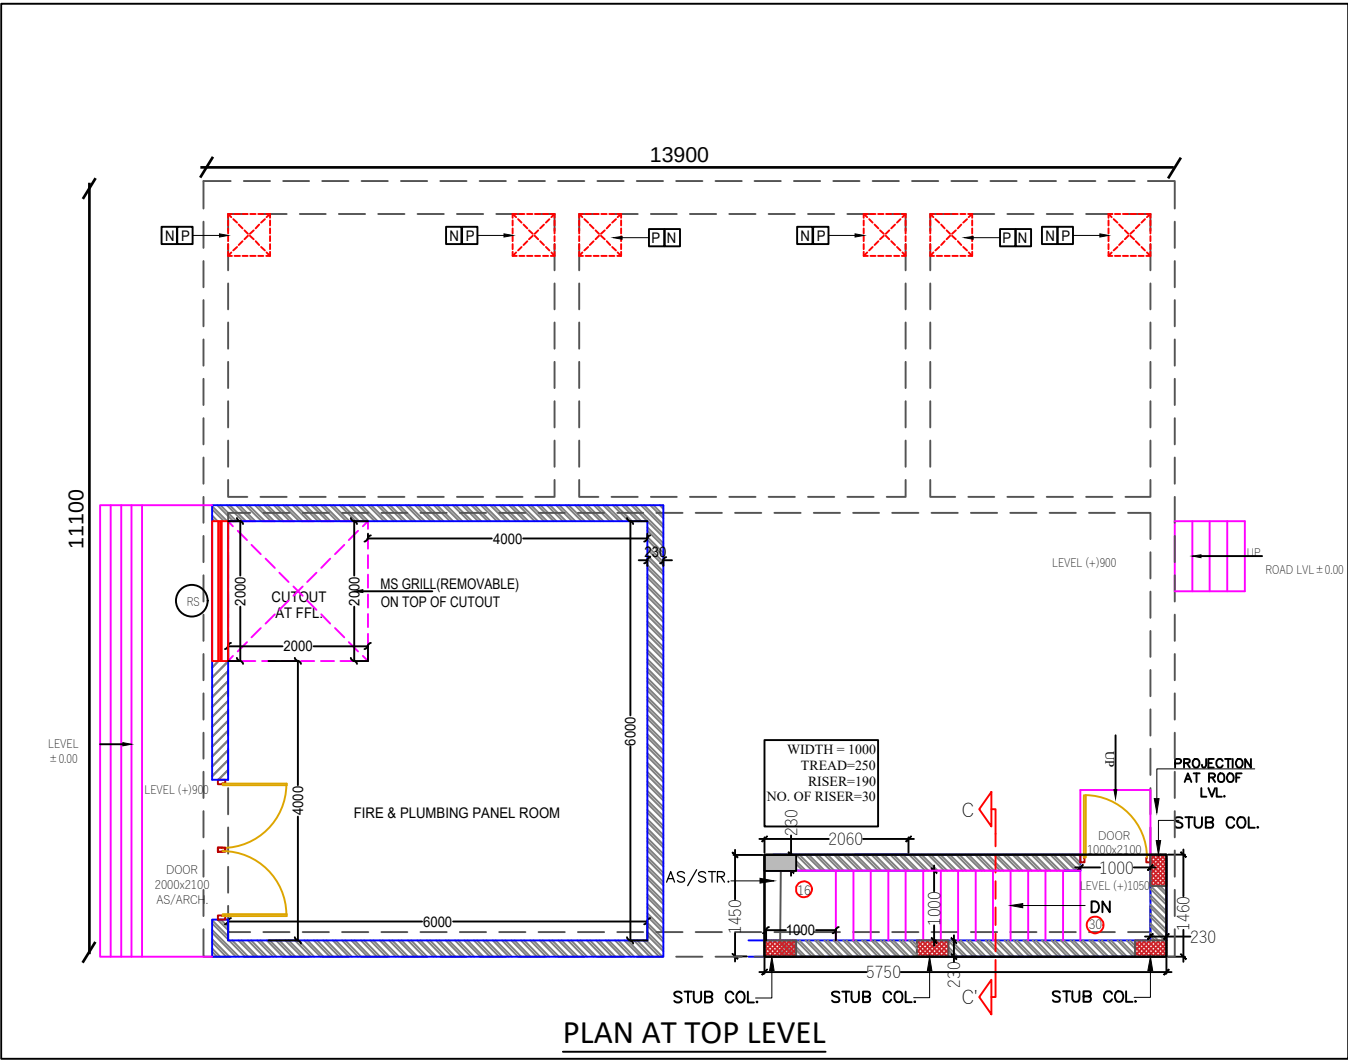

LEGEND:-

SYMBOL	DESCRIPTION
	BUTTERFLY/BALL VALVE
	NON RETURN VALE
	STAINER
	FLEXIBLE CONNECTION
	PRESSURE VESSEL


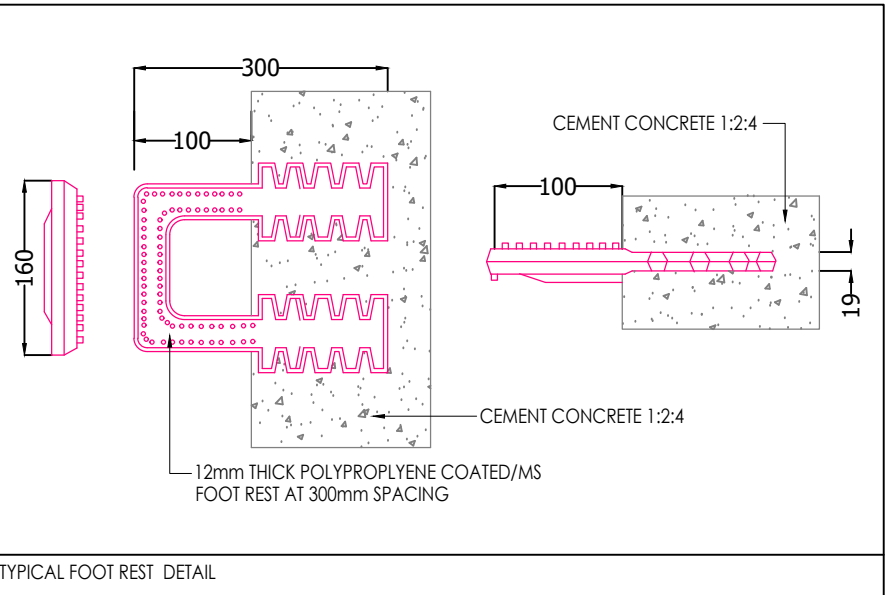


LEGEND:-

S.No.	INSERTS	DESCRIPTION	DA/SIZE (MM)	BOTTOM LEVELS OF PIPE (MM)
1.	A	EXISTING FILTERED WATER SUPPLY	100	(-900)
2.	C	FIRE BRIGADE INLET PIPE	150	(-900)
3.	D	FIRE BRIGADE OUTLET PIPE	150	(-900)
4.	F	FIRE WATER OUTLET PIPE	150	(-4950)
5.	G	DRAIN OUT PIPE	80	(-4900)
6.	H	OVER FLOW PIPE	80	(-950)
7.	I	FIRE TANK TO TREATED TANK OVER FLOW PIPE	150	(-950)
8.	J	LIQUID LEVEL CONTROLLER CABLE ENTRY	50	(-900)
9.	M	TREATED WATER OUTLET PIPE	80	(-4950)
10.	N	FOOT REST	SIZE AS MANF.	ON R.C.C WALL
11.	P	MANHOLE COVER 600x600mm		TOP OF SLAB
12.	Q	VENT PIPE	100	(-2650)

LEGEND:-

S.No.	INSERTS	DESCRIPTION
1.	F1	JOCKEY PUMP (FIRE) CAP.180 LPM HEAD-70M.
2.	F2	DIESEL ENGINE DRIVEN PUMP (FIRE) CAP.1620LPM HEAD-70M.
3.	F3	ELECTRICAL HYDRANT PUMP (FIRE) CAP.1620 LPM HEAD-70M.
4.	T1,T2,T3	DOMESTIC HYDRO-PNEUMATIC PUMP SET(ZWORKING+1 STANDBY)
5.	T4,T5, T6	DOMESTIC HYDRO-PNEUMATIC PUMP SET(ZWORKING+1 STANDBY)

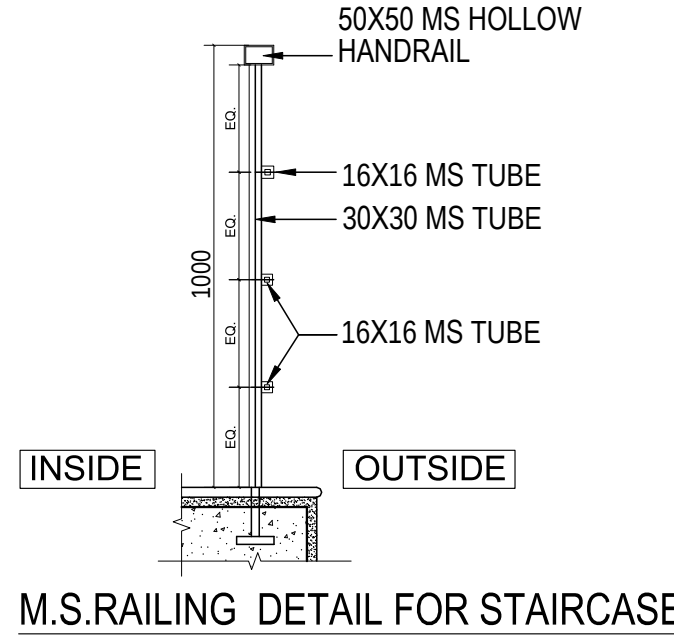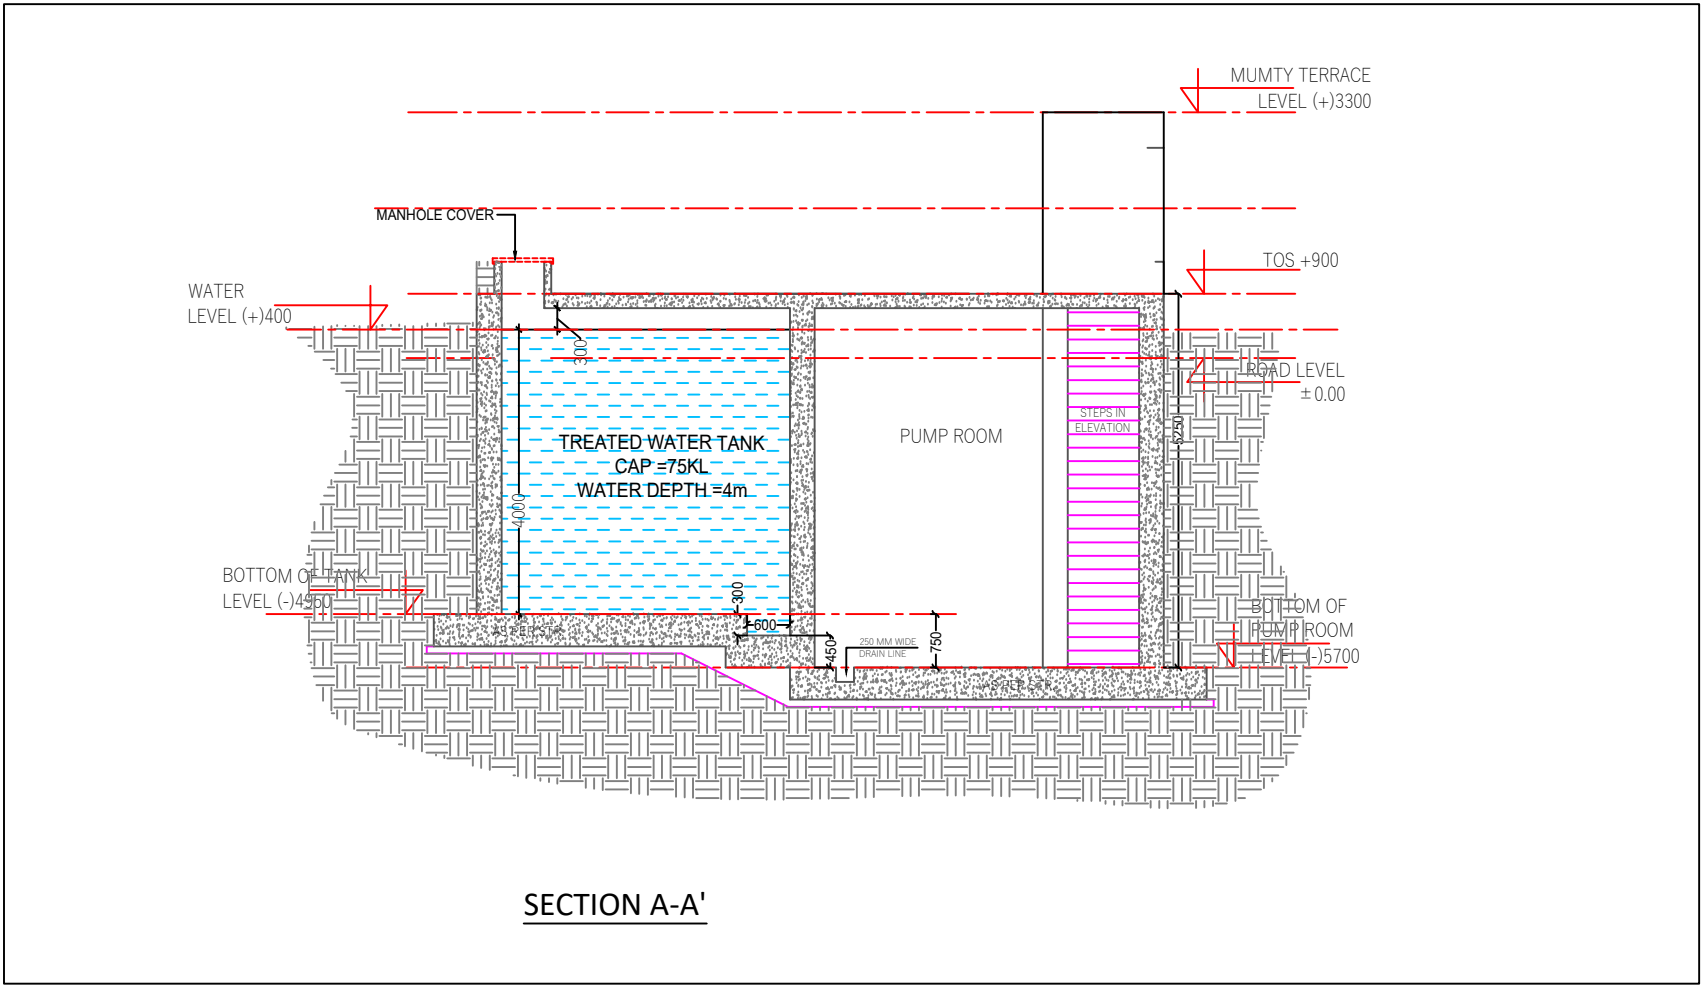

NOTES:-

- ALL DIMENSIONS ARE IN MM. UNLESS NOTED OTHERWISE.
- WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
- ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
- DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT: OIL INDIA LIMITED
(A Govt. of India Enterprise)


CONSULTANT: RITES
THE INFRASTRUCTURE PEOPLE
BUILDINGS UNIT
(ISO - 9001 CERTIFIED)

MEP CONSULTANT: PKV CONSULTING ENGINEERS (P) LTD.
815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE: BQ WORKMEN GROUP HOUSING COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE: EXTERNAL UGT PLAN & SECTION DETAIL

SCALE: NTS DATE: JULY 2025 DRG. NO: RITES/BLD/DR/TEN/406A

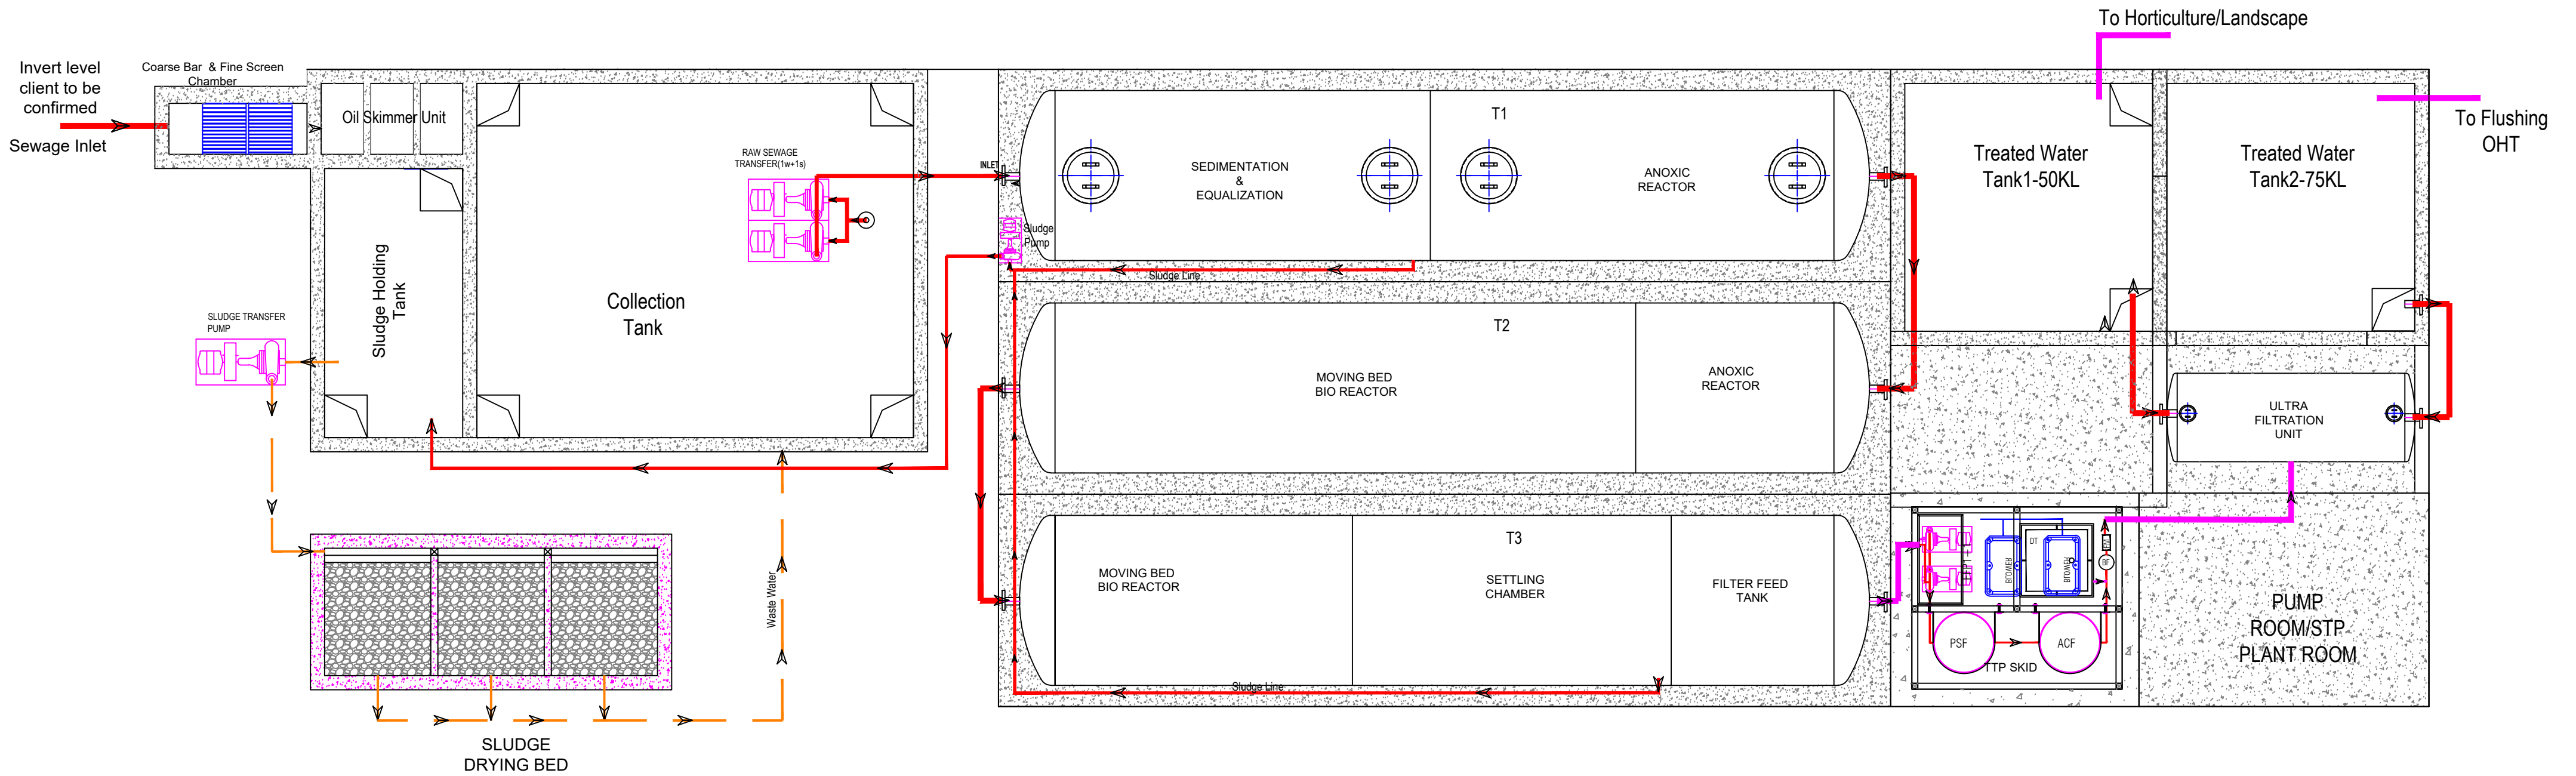

NOTES:-

1. ALL DIMENSIONS ARE IN MM. UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT



OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT

IRITES
THE INFRASTRUCTURE PEOPLE
BUILDINGS UNIT
(ISO - 9001 CERTIFIED)

MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.



815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE

**BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE

**EXTERNAL STP
PLAN & DETAIL**



SCALE

DATE

DRG. NO.

NTS

JULY 2025

IRITES/BLD/DR/TEN/406B

PLUMBING LEGENDS:-		
1.	150Ø uPVC SOIL PIPE	①
2.	100Ø uPVC WASTE PIPE	②
3.	DOMESTIC WATER SUPPLY PIPE	③
4.	FLUSHING WATER SUPPLY PIPE	④
5.	75Ø uPVC BALCONY WASTE PIPE	⑤
6.	150Ø uPVC RAIN WATER PIPE	⑥
7.	DOMESTIC WATER RISER PIPE	⑦
8.	FLUSHING WATER RISER PIPE	⑧
9.	PNG GAS SUPPLY RISER PIPE	⑨



NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT  **OIL INDIA LIMITED**
(A Govt. of India Enterprise)

CONSULTANT  **IRITES**
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
**BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE
**HOUSING BLOCK
GROUND FLOOR
PLUMBING DRAWING**



SCALE	DATE	DRG. NO.
NTS	JULY 2025	IRITES/BLD/DR/TEN/407

PLUMBING NOTES:-	
1.	ALL PIPE DIAMETERS ARE IN MM.
2.	THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
3.	MANHOLES SHALL BE CONSTRUCTED AS PER STANDARD DETAILS.
4.	SOIL,WASTE,RAIN & VENT PIPE WORK :- SOIL,WASTE & VENT PIPE WORK SHALL BE SINGLE LAYER uPVC PIPING SYSTEM AS PER ON IS 13592
5.	ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:50 AND NOT STEEPER THAN 1:10 UNLESS SPECIFIED OTHERWISE
6.	WATER SUPPLY PIPE WORK :- WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC (SDR-11) CONFORMING TO ASTM STANDARDS. ALL PIPE FITTINGS SHALL BE OF CPVC OF CLASS SAME AS PIPE CONFORMING TO ASTM STANDARDS SUITABLE FOR SOLVENT CEMENT JOINTS AS PER MFR.
7.	NO PIPE WORK SHALL BE CONCEALED IN WALLS OR BURIED IN FLOORS WITHOUT BEING SUBJECTED TO WATER TESTING AS PER THE DIRECTION OF THE SITE ENGINEER.
8.	ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR
9.	WATER INLETS AND WASTE OUTLETS FROM SANITARY WARE SHALL BE ARRANGED TO SUIT REQUIREMENTS OF SELECTED MAKES AND MODELS.
10.	ALL STONEWARE PIPES SHALL BE ENCASED IN 150 MM. THICK 1:5:10 CEMENT CONCRETE ALL AROUND.
11.	FLOOR TRAPS:- ALL FLOOR TRAPS SHALL BE FORMED OF 100X100 MM. DIA 'P' TRAP WITH 100 MM. DIA uPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
12.	FLOOR DRAIN:- DRAIN POINTS SHALL BE FORMED OF 75X75 MM. DIA uPVC ELBOW WITH 75 MM. DIA C.P. GRATING WITH FRAME.

PIPE SCHEDULE	
DESCRIPTION	SIZE
PIPE DIA FROM FD TO FT	63 OD uPVC PIPE
PIPE DIA FROM WB TO FT	40 OD uPVC PIPE
PIPE DIA FROM URINAL TO UT	40 OD uPVC PIPE
PIPE DIA FROM UT TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA FROM WC TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA FROM FT TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA HORIZONTAL STACK TO VERTICAL STACK	100Ø uPVC PIPE
PIPE DIA FROM WC TO MANHOLE	100Ø uPVC PIPE
PIPE DIA FROM FT TO GULLY TRAP	100Ø uPVC PIPE
PIPE DIA VERTICAL STACK TO GULLY TRAP	100Ø uPVC PIPE
PIPE DIA VERTICAL STACK TO MANHOLE	100Ø uPVC PIPE

PLUMBING LEGENDS:-	
1. 150Ø uPVC SOIL PIPE	①
2. 100Ø uPVC WASTE PIPE	②
3. DOMESTIC WATER SUPPLY PIPE	③
4. FLUSHING WATER SUPPLY PIPE	④
5. 75Ø uPVC BALCONY WASTE PIPE	⑤
6. 150Ø uPVC RAIN WATER PIPE	⑥
7. DOMESTIC WATER RISER PIPE	⑦
8. FLUSHING WATER RISER PIPE	⑧
9. PNG GAS SUPPLY RISER PIPE	⑨
10. FLOOR TRAP	FT
11. FLOOR DRAIN	FD
12. DRAIN POINT	DP
13. uPVC SOIL PIPE LINE	
14. uPVC WASTE PIPE LINE	
15. uPVC BALCONY WASTE PIPE LINE	
16. 150x150 FLOOR CUTOUT FOR FT, WC	
17. 125x125 FLOOR CUTOUT FOR FD	
17. 125x125 FLOOR CUTOUT FOR DP	


NOTE :
All ac drain pipes of 25mm dia. to be provided to the nearest drain point.
The routing from the drop point to the drainage connection will be concealed, as per site conditions.

NOTES:-	
1.	ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2.	WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3.	ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4.	THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
5.	DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT	 OIL INDIA LIMITED (A Govt. of India Enterprise)		
CONSULTANT	 THE INFRASTRUCTURE PEOPLE (A Govt. of India Enterprise)		
MEP CONSULTANT	 PKV CONSULTING ENGINEERS (P) LTD. 815 - C DDA FLATS EAST OF LONI ROAD DELHI - 110093 email:-info@pkv.co.in		
JOB TITLE	BQ WORKMEN GROUP HOUSING COMPLEX AT DULIAJAN ASSAM		
DRAWING TITLE	HOUSING BLOCK TYPICAL FLOOR 1st to 6th PLUMBING DRAWING		
SCALE	DATE	DRG. NO.	
NTS	JULY 2025	RTES/BLD/DR/TEN/408	

PLUMBING LEGENDS:-		
1.	150Ø uPVC SOIL PIPE	① 
2.	100Ø uPVC WASTE PIPE	② 
3.	DOMESTIC WATER SUPPLY PIPE	③ 
4.	FLUSHING WATER SUPPLY PIPE	④ 
5.	75Ø uPVC BALCONY WASTE PIPE	⑤ 
6.	150Ø uPVC RAIN WATER PIPE	⑥ 
7.	DOMESTIC WATER RISER PIPE	⑦ 
8.	FLUSHING WATER RISER PIPE	⑧ 
9.	DOMESTIC WATER SUPPLY LINE	
10.	FLUSHING WATER SUPPLY LINE	
11.	FLUSHING WATER RISER LINE	
12.	DOMESTIC WATER RISER LINE	
13.	BALL VALVE	
14.	FLOW DIRECTION	
15.	KHURRA 450X450	

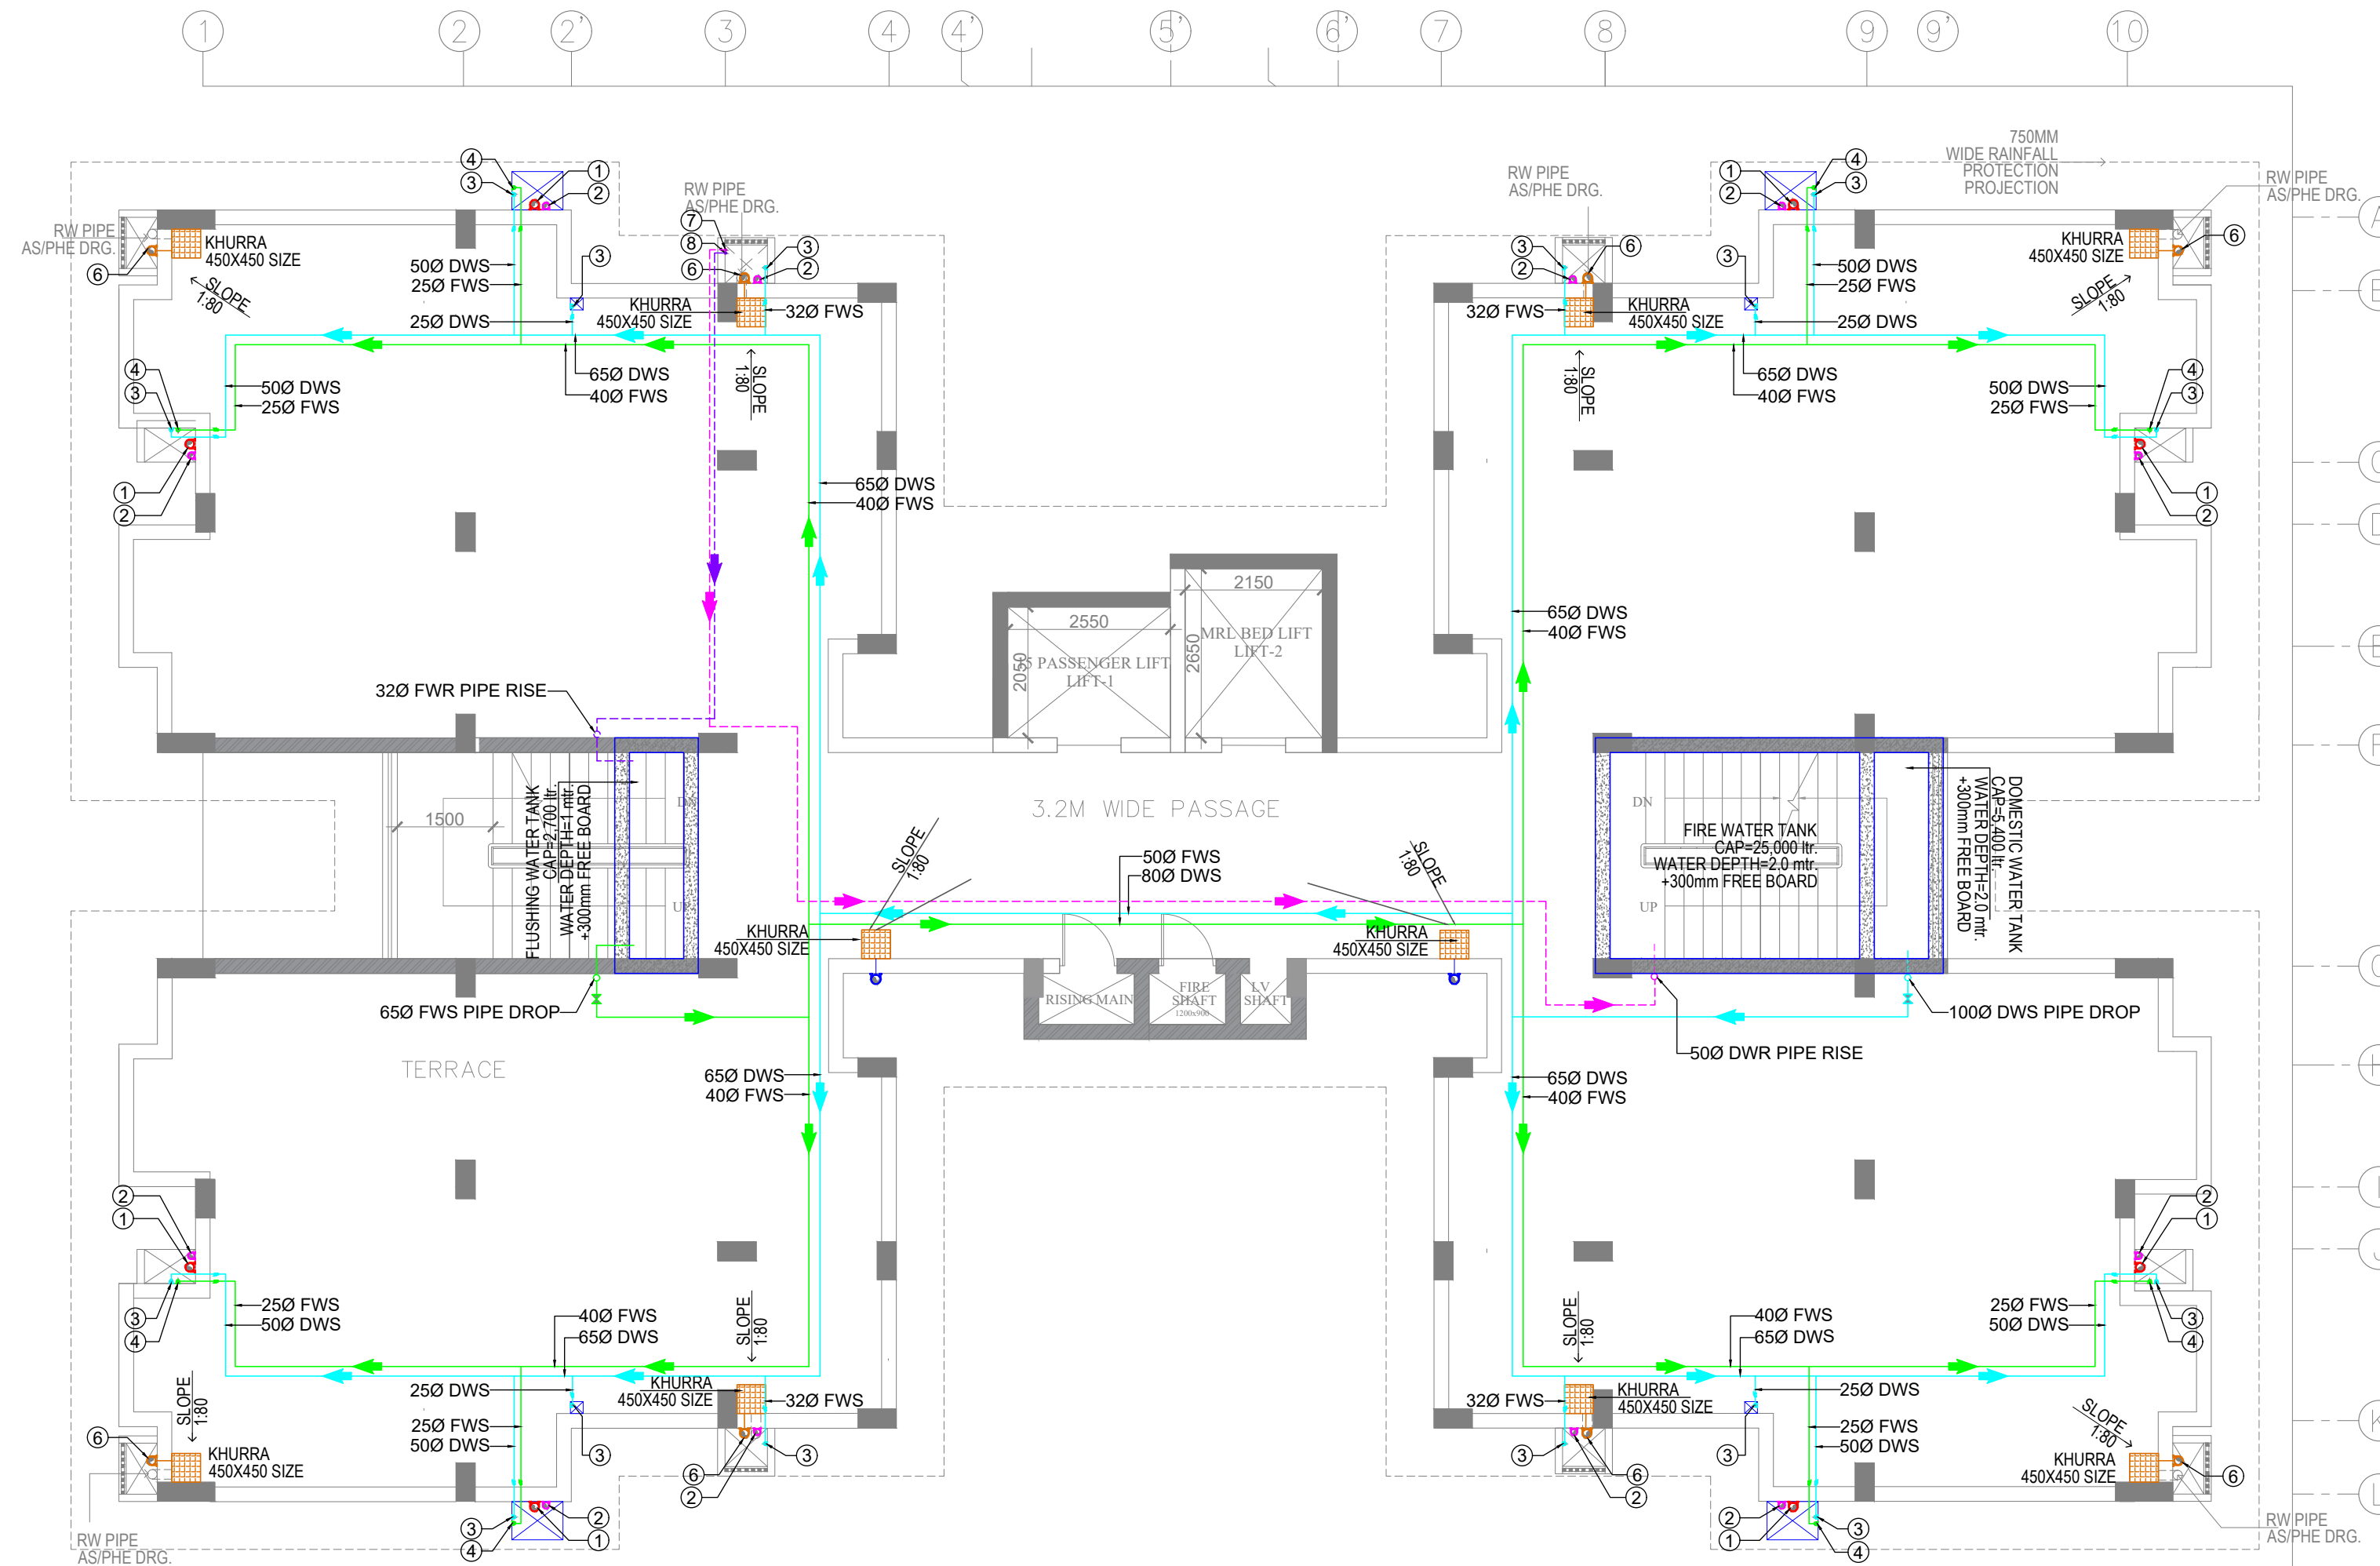

NOTES:—

- | | |
|----|--|
| 1. | ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE. |
| 2. | WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED. |
| 3. | ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER. |
| 4. | THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS. |
| 4. | THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS. |
| 5. | DRAWINGS ARE INDICATIVE IN NATURE, AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS. |

TENDER DRAWING

	CLIENT
--	--------



CONSULTANT



MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.




	JOB TITLE
--	-----------

BQ WORKMEN HOUSING

	DRAWING TITLE
--	---------------

HOUSING BLOCK
TERRACE FLOOR
PLUMBING DRAWING



SCALE

DATE _____



DRG. NO.

NTS

JULY 2025

RITES/BLD/DR/TEN/409

HOUSING BLOCK

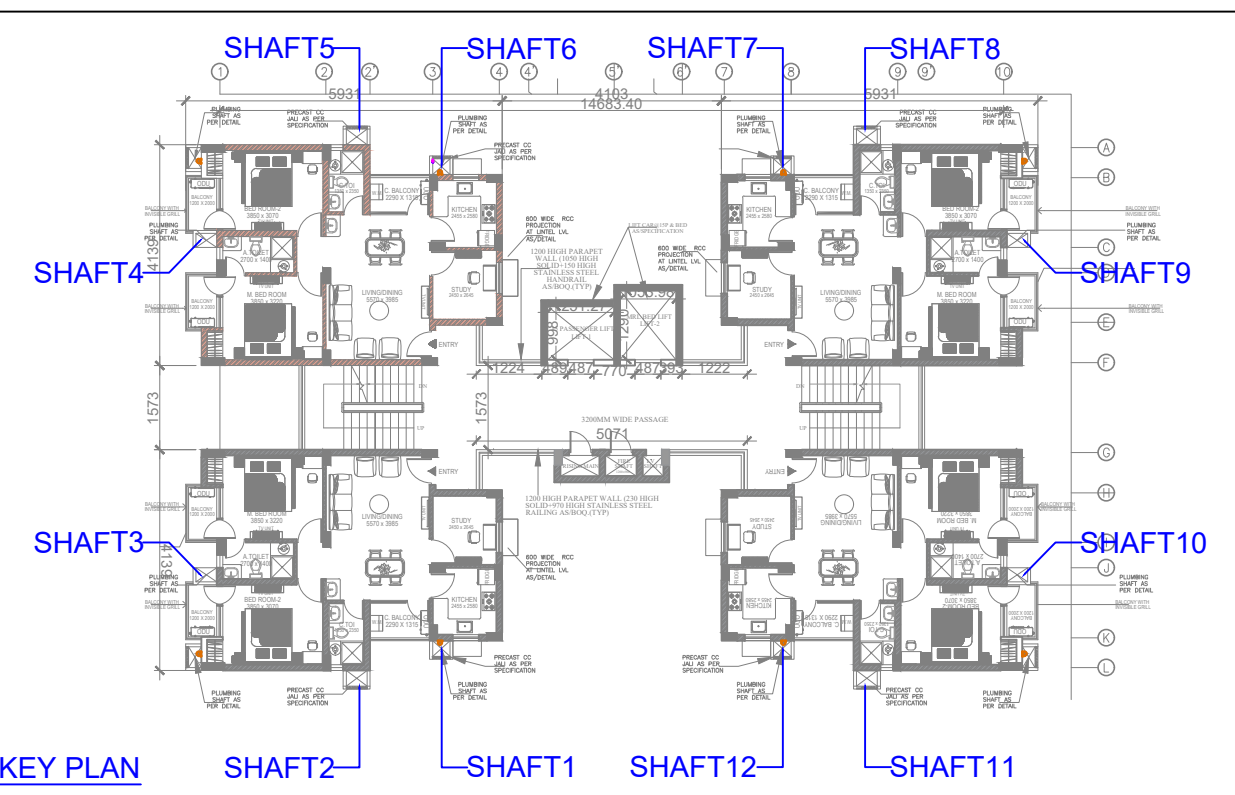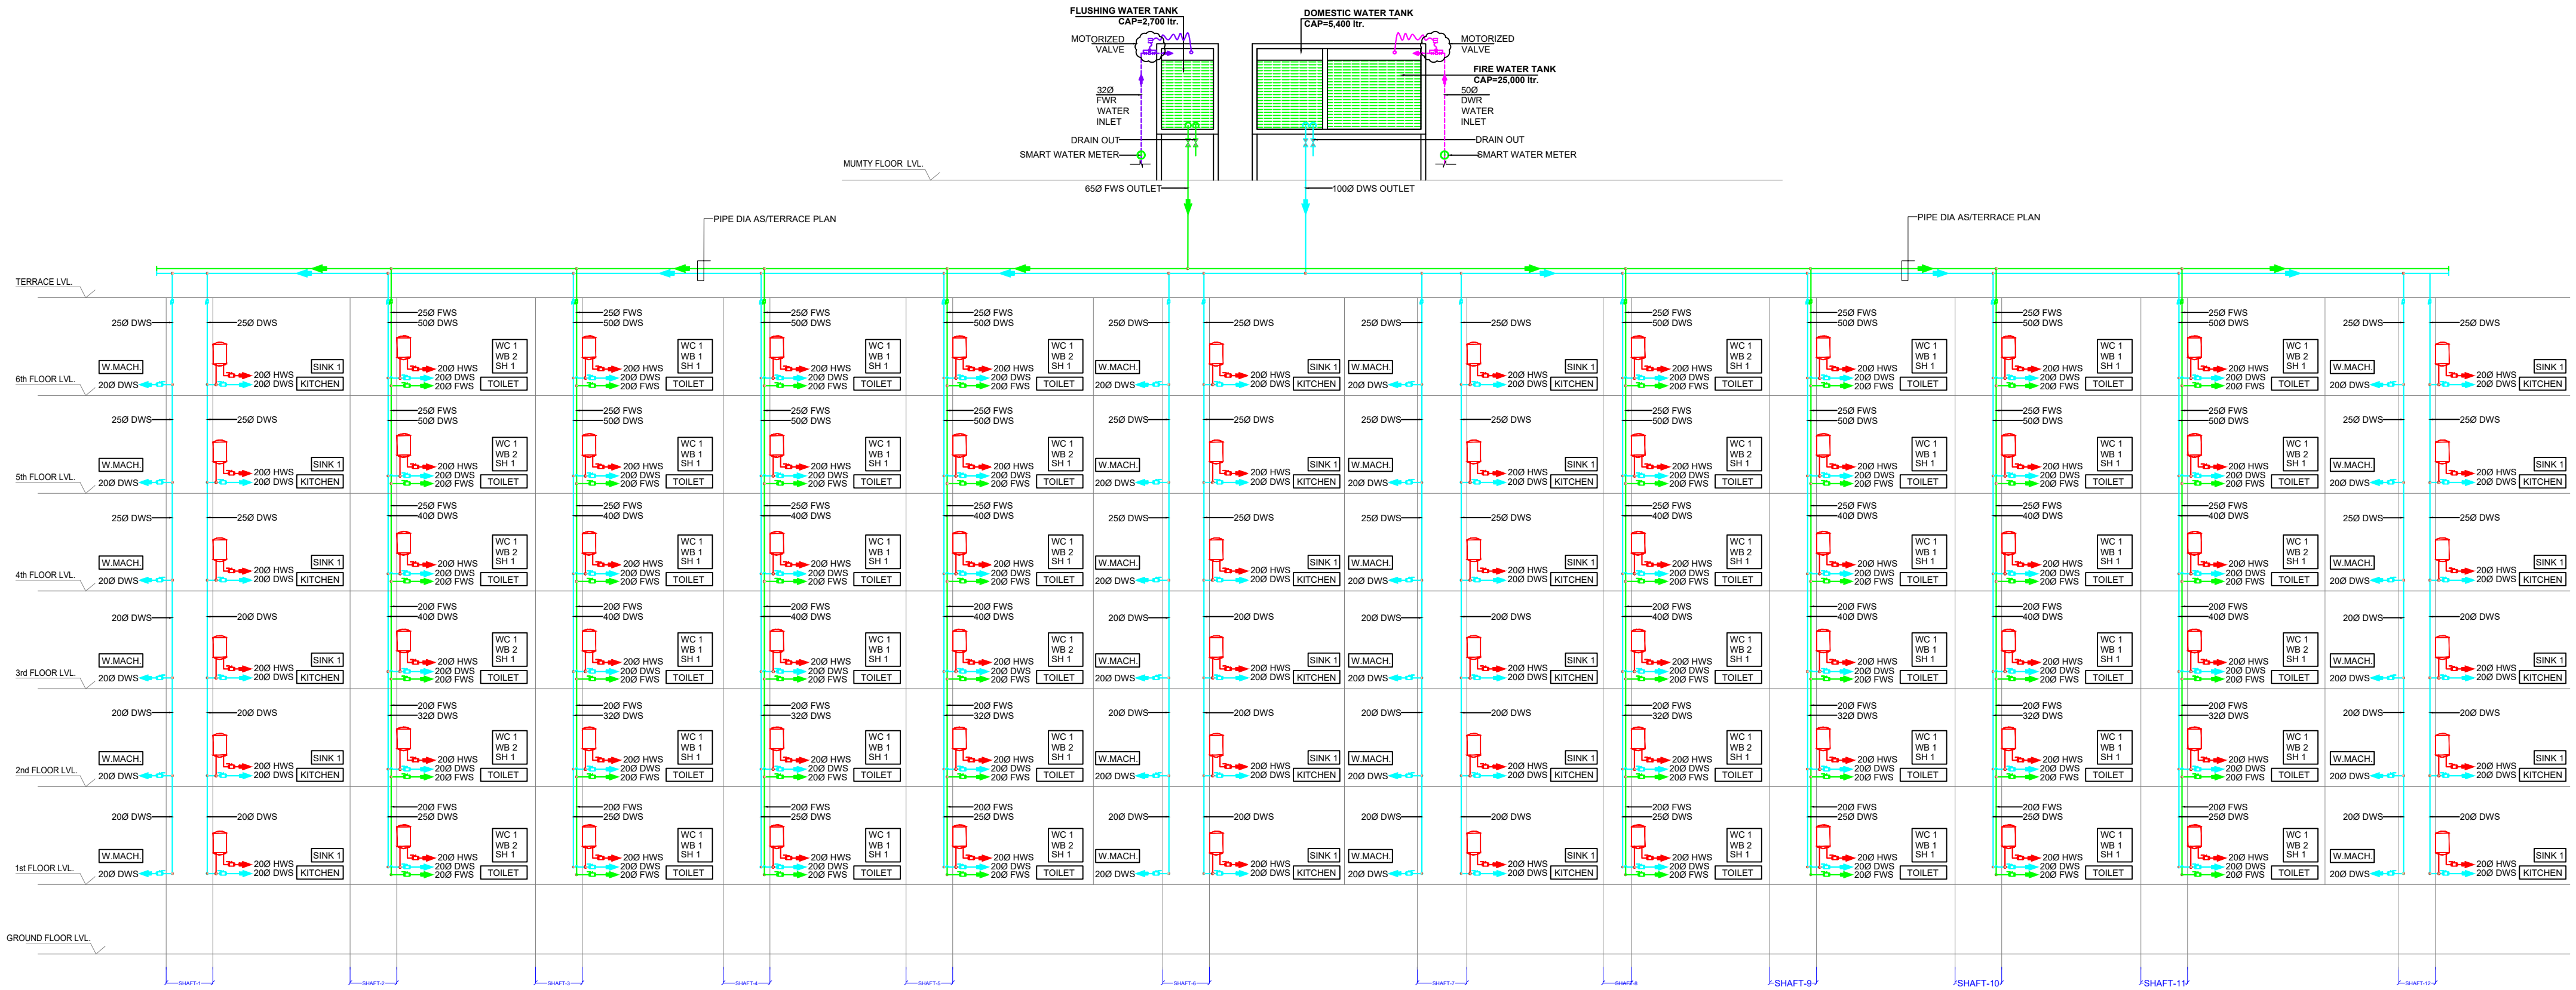

PLUMBING LEGENDS:-	
1. DOMESTIC WATER SUPPLY PIPE (DWS)	
2. FLUSHING WATER SUPPLY PIPE (FWS)	
3. DOMESTIC WATER RISER PIPE (DWR)	
4. FLUSHING WATER RISER PIPE (FWR)	
5. HOT WATER SUPPLY PIPE (HWS)	
6. BALL VALVE	
7. GEYSER	
8. FLOW DIRECTION	

- NOTES:-
1. ALL DIMENSIONS ARE IN MM, UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS.
 5. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 6. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
 OIL INDIA LIMITED
(A Govt. of India Enterprise)


CONSULTANT
 RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email: -info@pkv.co.in

JOB TITLE
**BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE
**HOUSING BLOCK
WATER SUPPLY SCHEMATIC**

Scale	Date	DRG. NO.
NTS	JULY 2025	RITES/BLD/DR/TEN410

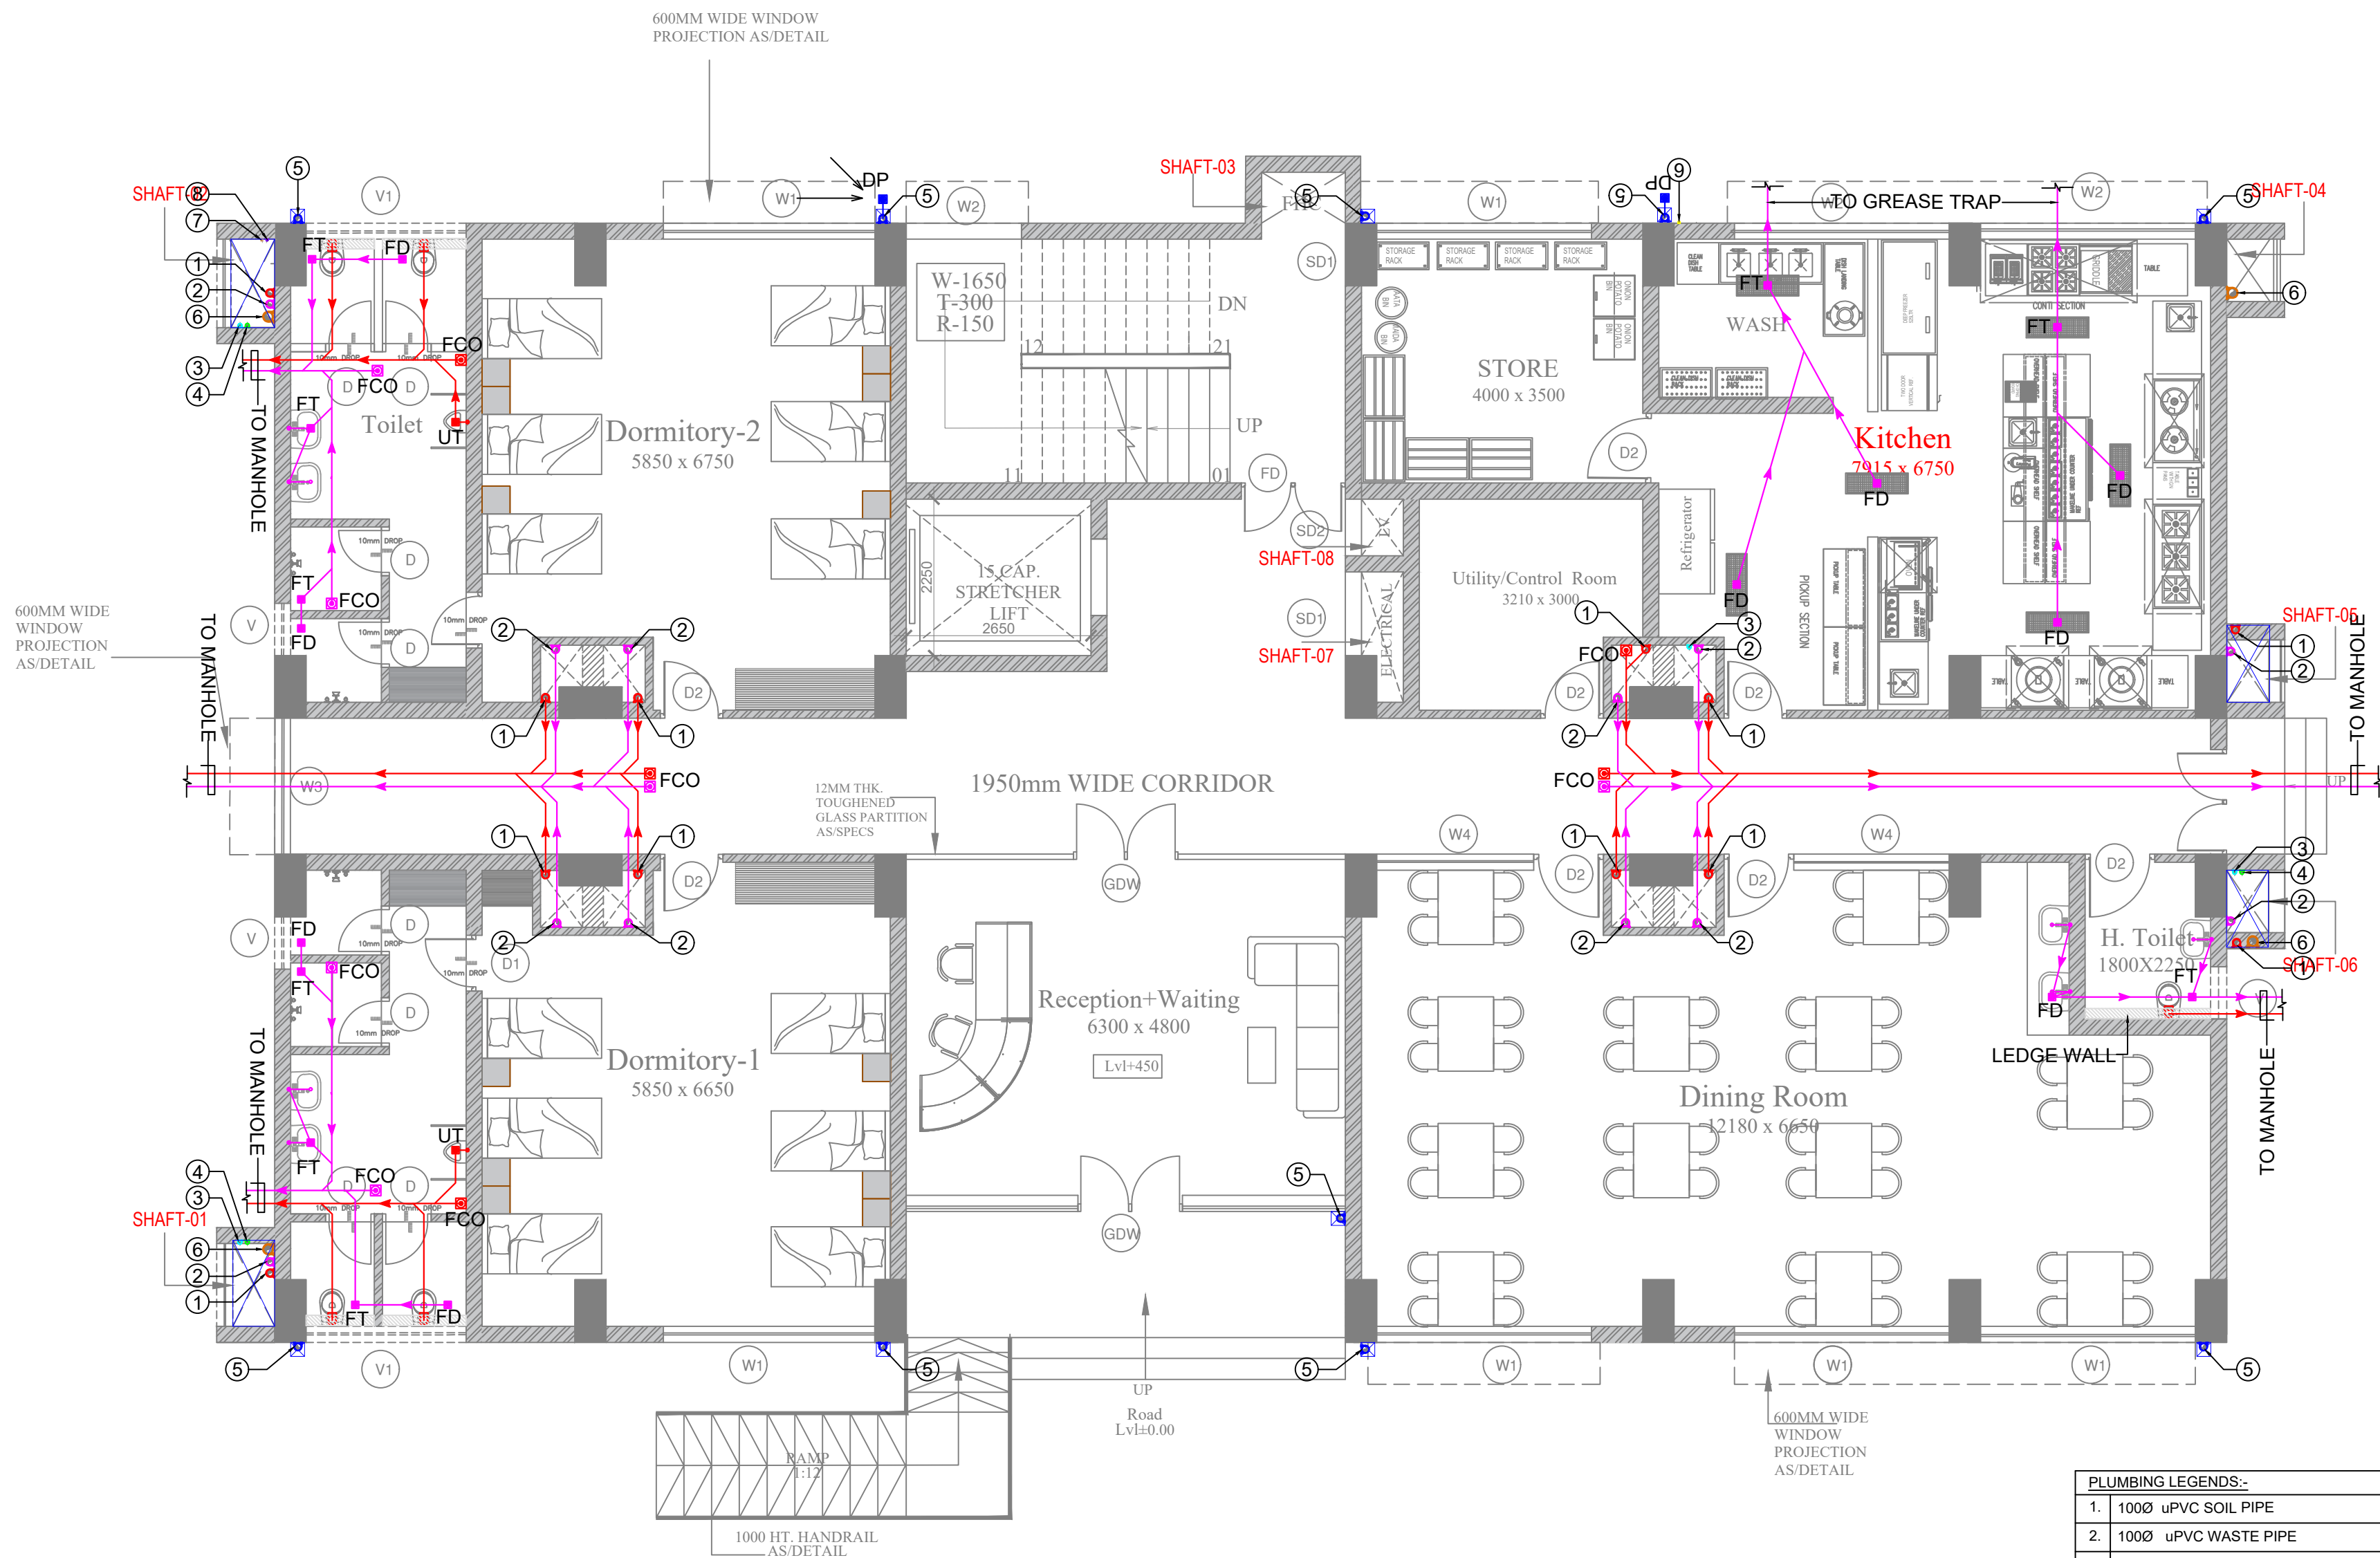

- PLUMBING NOTES :-
1. ALL PIPE DIAMETERS ARE IN MM.
 2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 3. SOIL, WASTE & VENT PIPE WORK:-
SOIL, WASTE & VENT PIPES WORKS SHALL BE CARRIED OUT IN uPVC PIPES CLASS "B" SOLVENT CEMENT AND FITTINGS CONFORMING TO IS : 13592
 4. ALL HORIZONTAL SOIL AND WASTE PIPES IN TOILET SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:100 UNLESS SPECIFIED OTHERWISE.
 5. ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE SUSPENDED AT CEILING LEVEL.
 6. FLOOR TRAPS:-
ALL FLOOR TRAPS SHALL BE FORMED OF 110 X110 MM. DIA 'P' TRAP WITH 110 MM.DIA uPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
 7. FLOOR DRAINS:-
FLOOR DRAINS SHALL BE FORMED OF 63X63 MM. OUTER DIA uPVC ELBOW WITH 85 MM. DIA C.P GRATING WITH FRAME.
 8. WASTE PIPES:-
ALL WASTE PIPE WORK FROM WASH BASINS SINKS AND DRAIN POINTS SHALL BE IN uPVC PIPES AND FITTING OF 6KG/CM² PRESSURE.
 9. ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING & CEILING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR.
 10. WATER SUPPLY PIPING SYSTEM:-
a. ALL HOT & COLD WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC OF CLASS SDR-11 PIPES WITH PIPE MATERIAL AS PER ASTM D-1884 & PIPE DIMENSION AS PER ASTM F 441C/ASTM D 2846 COMPLETE WITH CPVC FITTINGS.

PIPE SCHEDULE	
DESCRIPTION	SIZE
PIPE DIA FROM FD TO FT	63Ø uPVC PIPE
PIPE DIA FROM WB TO FT	40Ø uPVC PIPE
PIPE DIA FROM URINAL TO UT	40Ø uPVC PIPE
PIPE DIA FROM UT TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA FROM WC TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA FROM FT TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA HORIZONTAL STACK TO VERTICAL STACK	110 OD uPVC PIPE
PIPE DIA FROM WC TO MANHOLE	110 OD uPVC PIPE
PIPE DIA FROM FT TO GULLY TRAP	110 OD uPVC PIPE
PIPE DIA VERTICAL STACK TO GULLY TRAP	110 OD uPVC PIPE
PIPE DIA VERTICAL STACK TO MANHOLE	110 OD uPVC PIPE

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS
CLIENT



CONSULTANT
RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULAJAN ASSAM


DRAWING TITLE
GROUND FLOOR PLAN
GUEST HOUSE
PLUMBING DRAWING

SCALE	DATE	DRG. NO.
NTS.	JULY 2025	RITES/BLD/DR/TEN/411

PLUMBING LEGENDS:-		
1. 100Ø uPVC SOIL PIPE	①	▲
2. 100Ø uPVC WASTE PIPE	②	▲
3. DOMESTIC WATER SUPPLY PIPE	③	▲
4. FLUSHING WATER SUPPLY PIPE	④	▲
5. 75Ø uPVC BALCONY WASTE PIPE	⑤	▲
6. 150Ø uPVC RAIN WATER PIPE	⑥	▲
7. DOMESTIC WATER RISER PIPE	⑦	▲
8. FLUSHING WATER RISER PIPE	⑧	▲
9. PNG GAS SUPPLY RISER PIPE	⑨	▲
10. FLOOR TRAP	FT	■
11. FLOOR DRAIN	FD	■
12. DRAIN POINT	DP	■
13. URINAL TRAP	UT	■
14. FLOOR CLEAN OUT PLUG	FCO	■
15. CEILING CLEAN OUT PLUG	COP	■
16. uPVC SOIL PIPE LINE		—
16. uPVC WASTE PIPE LINE		—
17. uPVC BALCONY WASTE PIPE LINE		—

NOTE :

All ac drain pipes of 25mm dia. to be provided to the nearest drain point.
The routing from the drop point to the drainage connection will be concealed, as per site conditions.

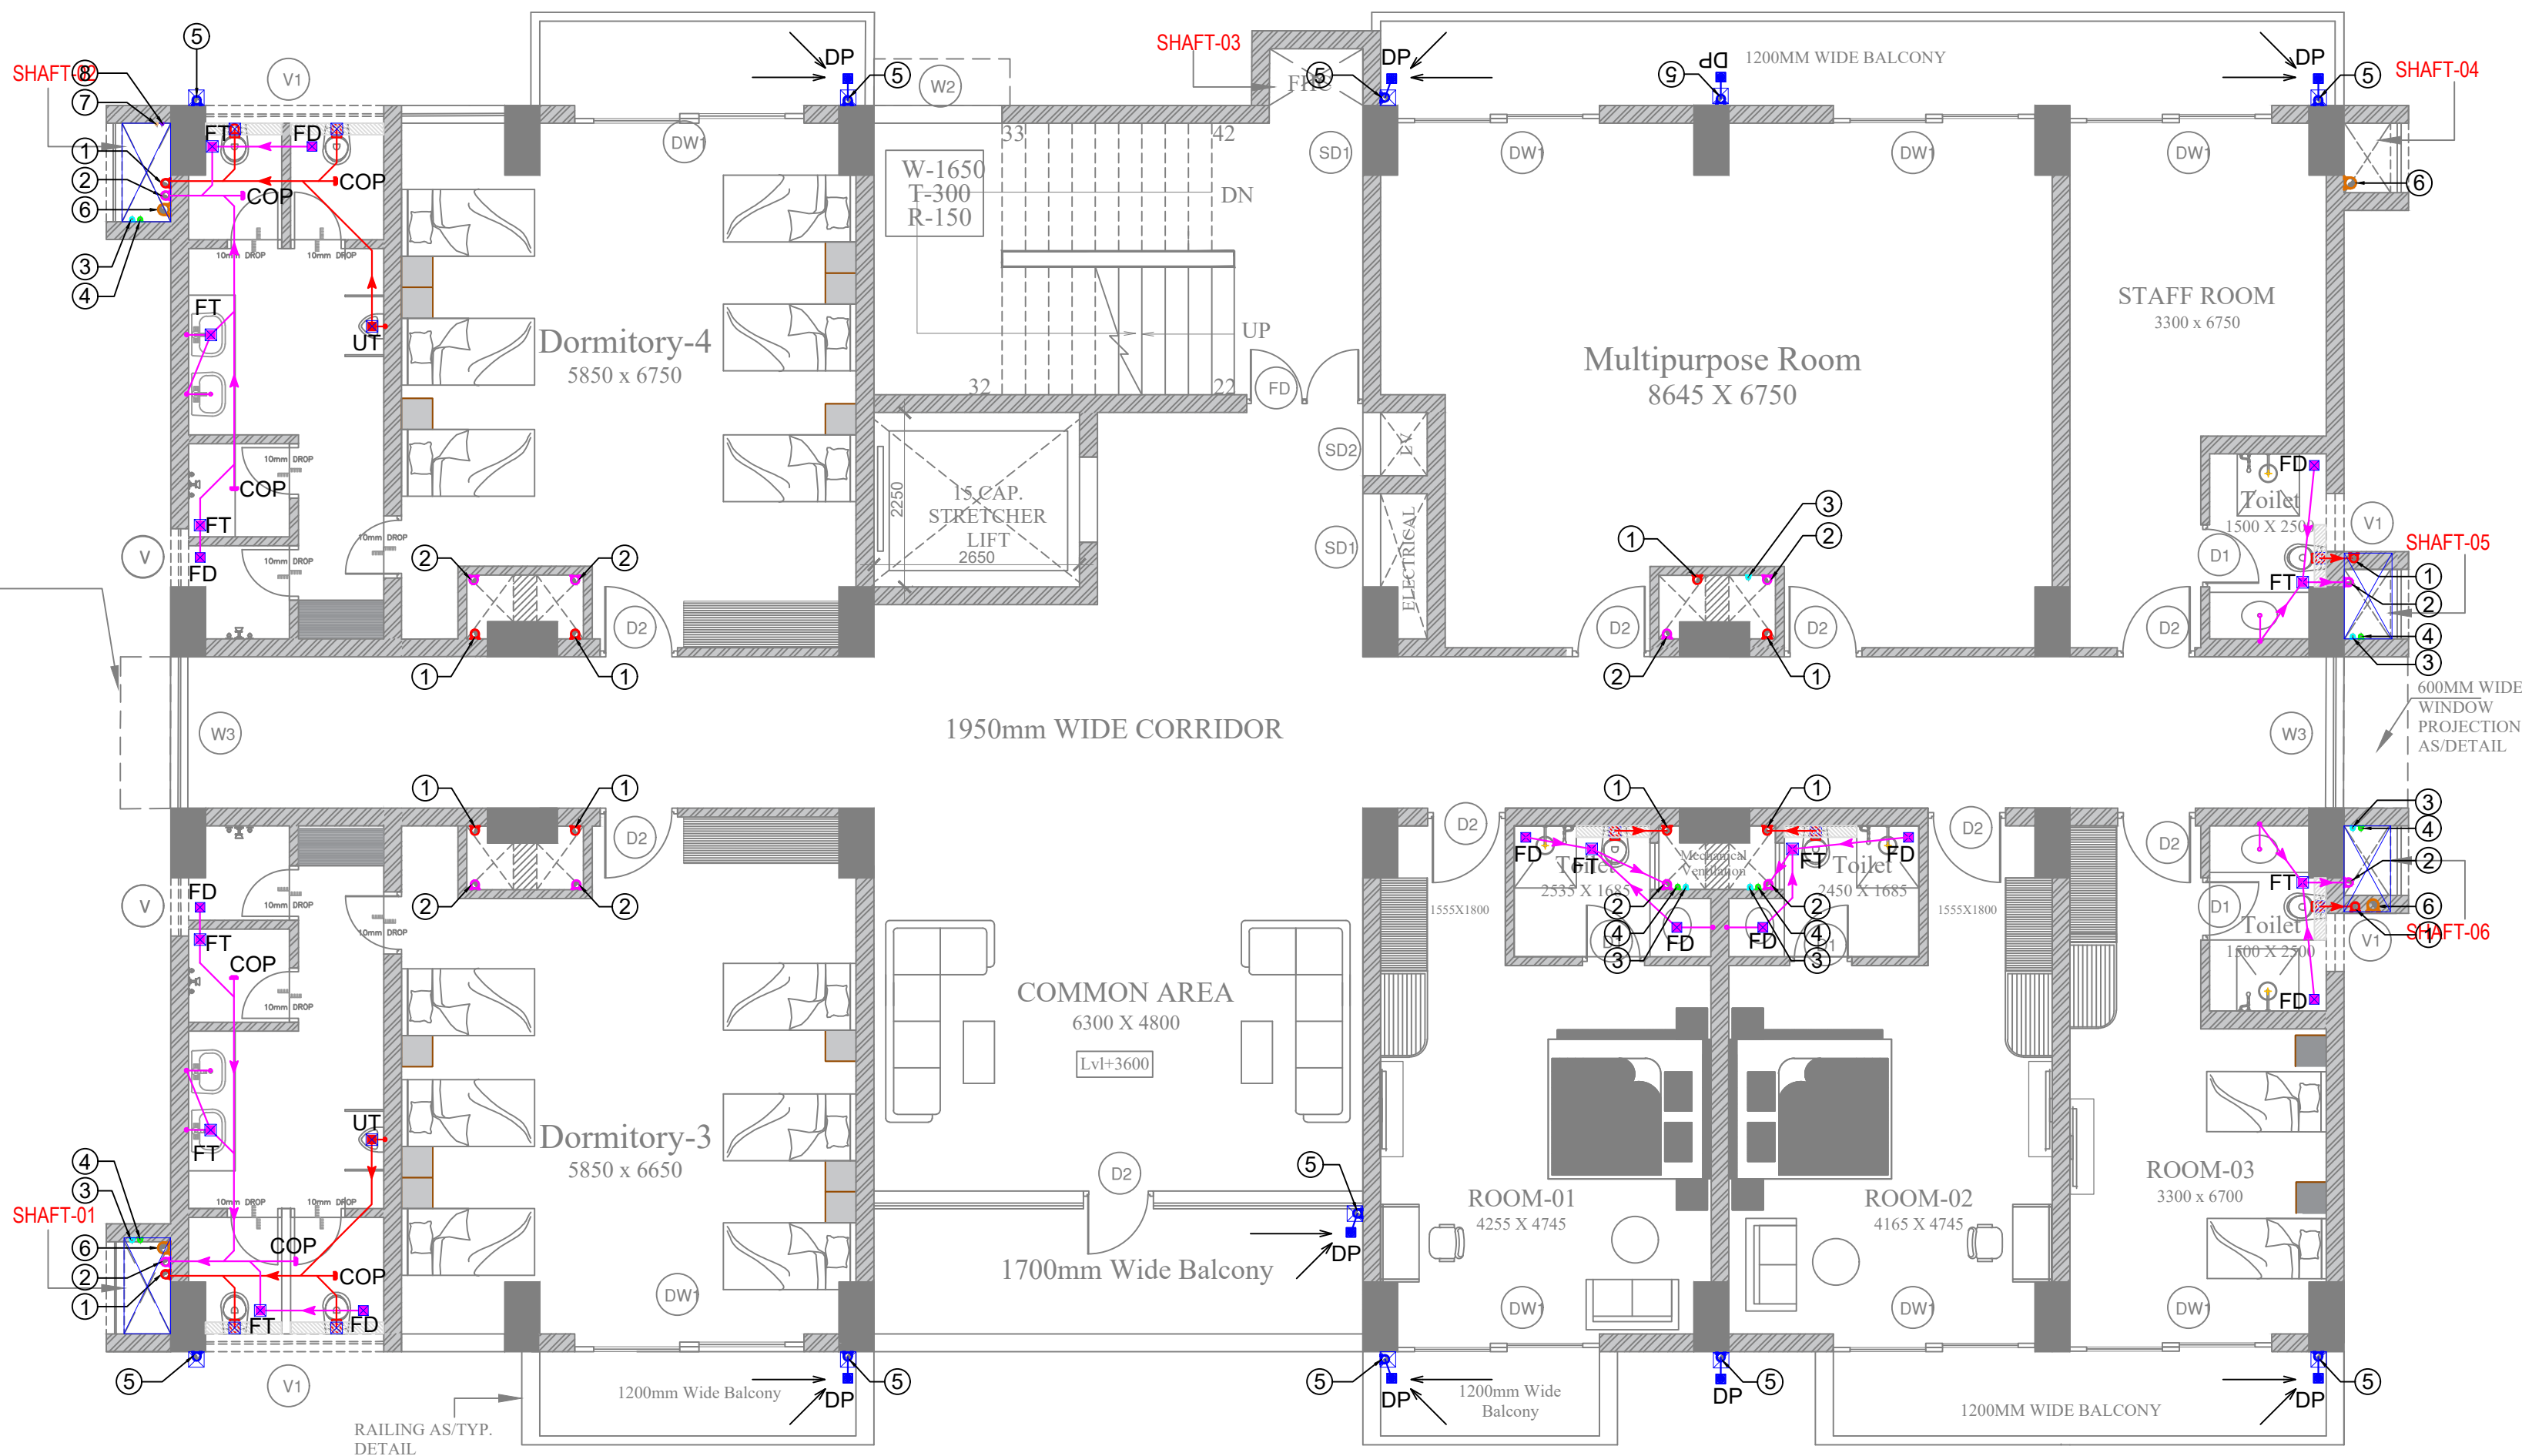

- PLUMBING NOTES :-**
1. ALL PIPE DIAMETERS ARE IN MM.
 2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 3. **SOIL, WASTE & VENT PIPE WORK:**
SOIL, WASTE & VENT PIPES WORKS SHALL BE CARRIED OUT IN uPVC PIPES CLASS "B" SOLVENT CEMENT AND FITTINGS CONFORMING TO IS : 13592
 4. ALL HORIZONTAL SOIL AND WASTE PIPES IN TOILET SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:100 UNLESS SPECIFIED OTHERWISE.
 5. ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE SUSPENDED AT CEILING LEVEL.
 6. **FLOOR TRAPS:**
ALL FLOOR TRAPS SHALL BE FORMED OF 110 X110 MM. DIA 'P' TRAP WITH 110 MM. DIA uPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
 7. **FLOOR DRAINS:-**
FLOOR DRAINS SHALL BE FORMED OF 63X63 MM. OUTER DIA uPVC ELBOW WITH 85 MM. DIA C.P GRATING WITH FRAME.
 8. **WASTE PIPES:-**
ALL WASTE PIPE WORK FROM WASH BASINS SINKS AND DRAIN POINTS SHALL BE IN uPVC PIPES AND FITTING OF 6KG/CM² PRESSURE.
 9. ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING & CEILING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR.
 10. **WATER SUPPLY PIPING SYSTEM:-**
a. ALL HOT & COLD WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC OF CLASS SDR-11 PIPES WITH PIPE MATERIAL AS PER ASTM D-1884 & PIPE DIMENSION AS PER ASTM F 441C/ASTM D 2846 COMPLETE WITH CPVC FITTINGS.

DESCRIPTION	SIZE
PIPE DIA FROM FD TO FT	63Ø uPVC PIPE
PIPE DIA FROM WB TO FT	40Ø uPVC PIPE
PIPE DIA FROM URINAL TO UT	40Ø uPVC PIPE
PIPE DIA FROM WC TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA FROM FT TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA HORIZONTAL STACK TO VERTICAL STACK	110 OD uPVC PIPE
PIPE DIA FROM WC TO MANHOLE	110 OD uPVC PIPE
PIPE DIA FROM FT TO GULLY TRAP	110 OD uPVC PIPE
PIPE DIA VERTICAL STACK TO GULLY TRAP	110 OD uPVC PIPE
PIPE DIA VERTICAL STACK TO MANHOLE	110 OD uPVC PIPE

- NOTES:-**
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
IRITES
THE INFRASTRUCTURE PEOPLE
BUILDINGS UNIT
(ISO - 9001 CERTIFIED)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM


DRAWING TITLE
FIRST FLOOR PLAN
GUEST HOUSE
PLUMBING DRAWING

SCALE
DATE
JULY 2025
DRG. NO.
NTS.
RITES/BLD/DR/TEN/412

PLUMBING LEGENDS:-		
1. 110 OD uPVC SOIL PIPE	①	▲
2. 110 OD uPVC WASTE PIPE	②	▲
3. DOMESTIC WATER SUPPLY PIPE	③	▲
4. FLUSHING WATER SUPPLY PIPE	④	▲
5. 75Ø uPVC BALCONY WASTE PIPE	⑤	▲
6. 160 OD uPVC RAIN WATER PIPE	⑥	▲
7. DOMESTIC WATER RISER PIPE	⑦	▲
8. FLUSHING WATER RISER PIPE	⑧	▲
9. FLOOR TRAP	FT	■
10. FLOOR DRAIN	FD	■
11. DRAIN POINT	DP	■
12. URINAL TRAP	UT	■
13. FLOOR CLEAN OUT PLUG	FCO	■
14. CEILING CLEAN OUT PLUG	COP	■
15. uPVC SOIL PIPE LINE		—
16. uPVC WASTE PIPE LINE		—
17. 150x150 FLOOR CUTOOUT FOR FT, WC, UT		■
18. 125x125 FLOOR CUTOOUT FOR FD		■
19. 125x125 FLOOR CUTOOUT FOR DP		■

NOTE :

All ac drain pipes of 25mm dia. to be provided to the nearest drain point.
The routing from the drop point to the drainage connection will be concealed, as per site conditions.

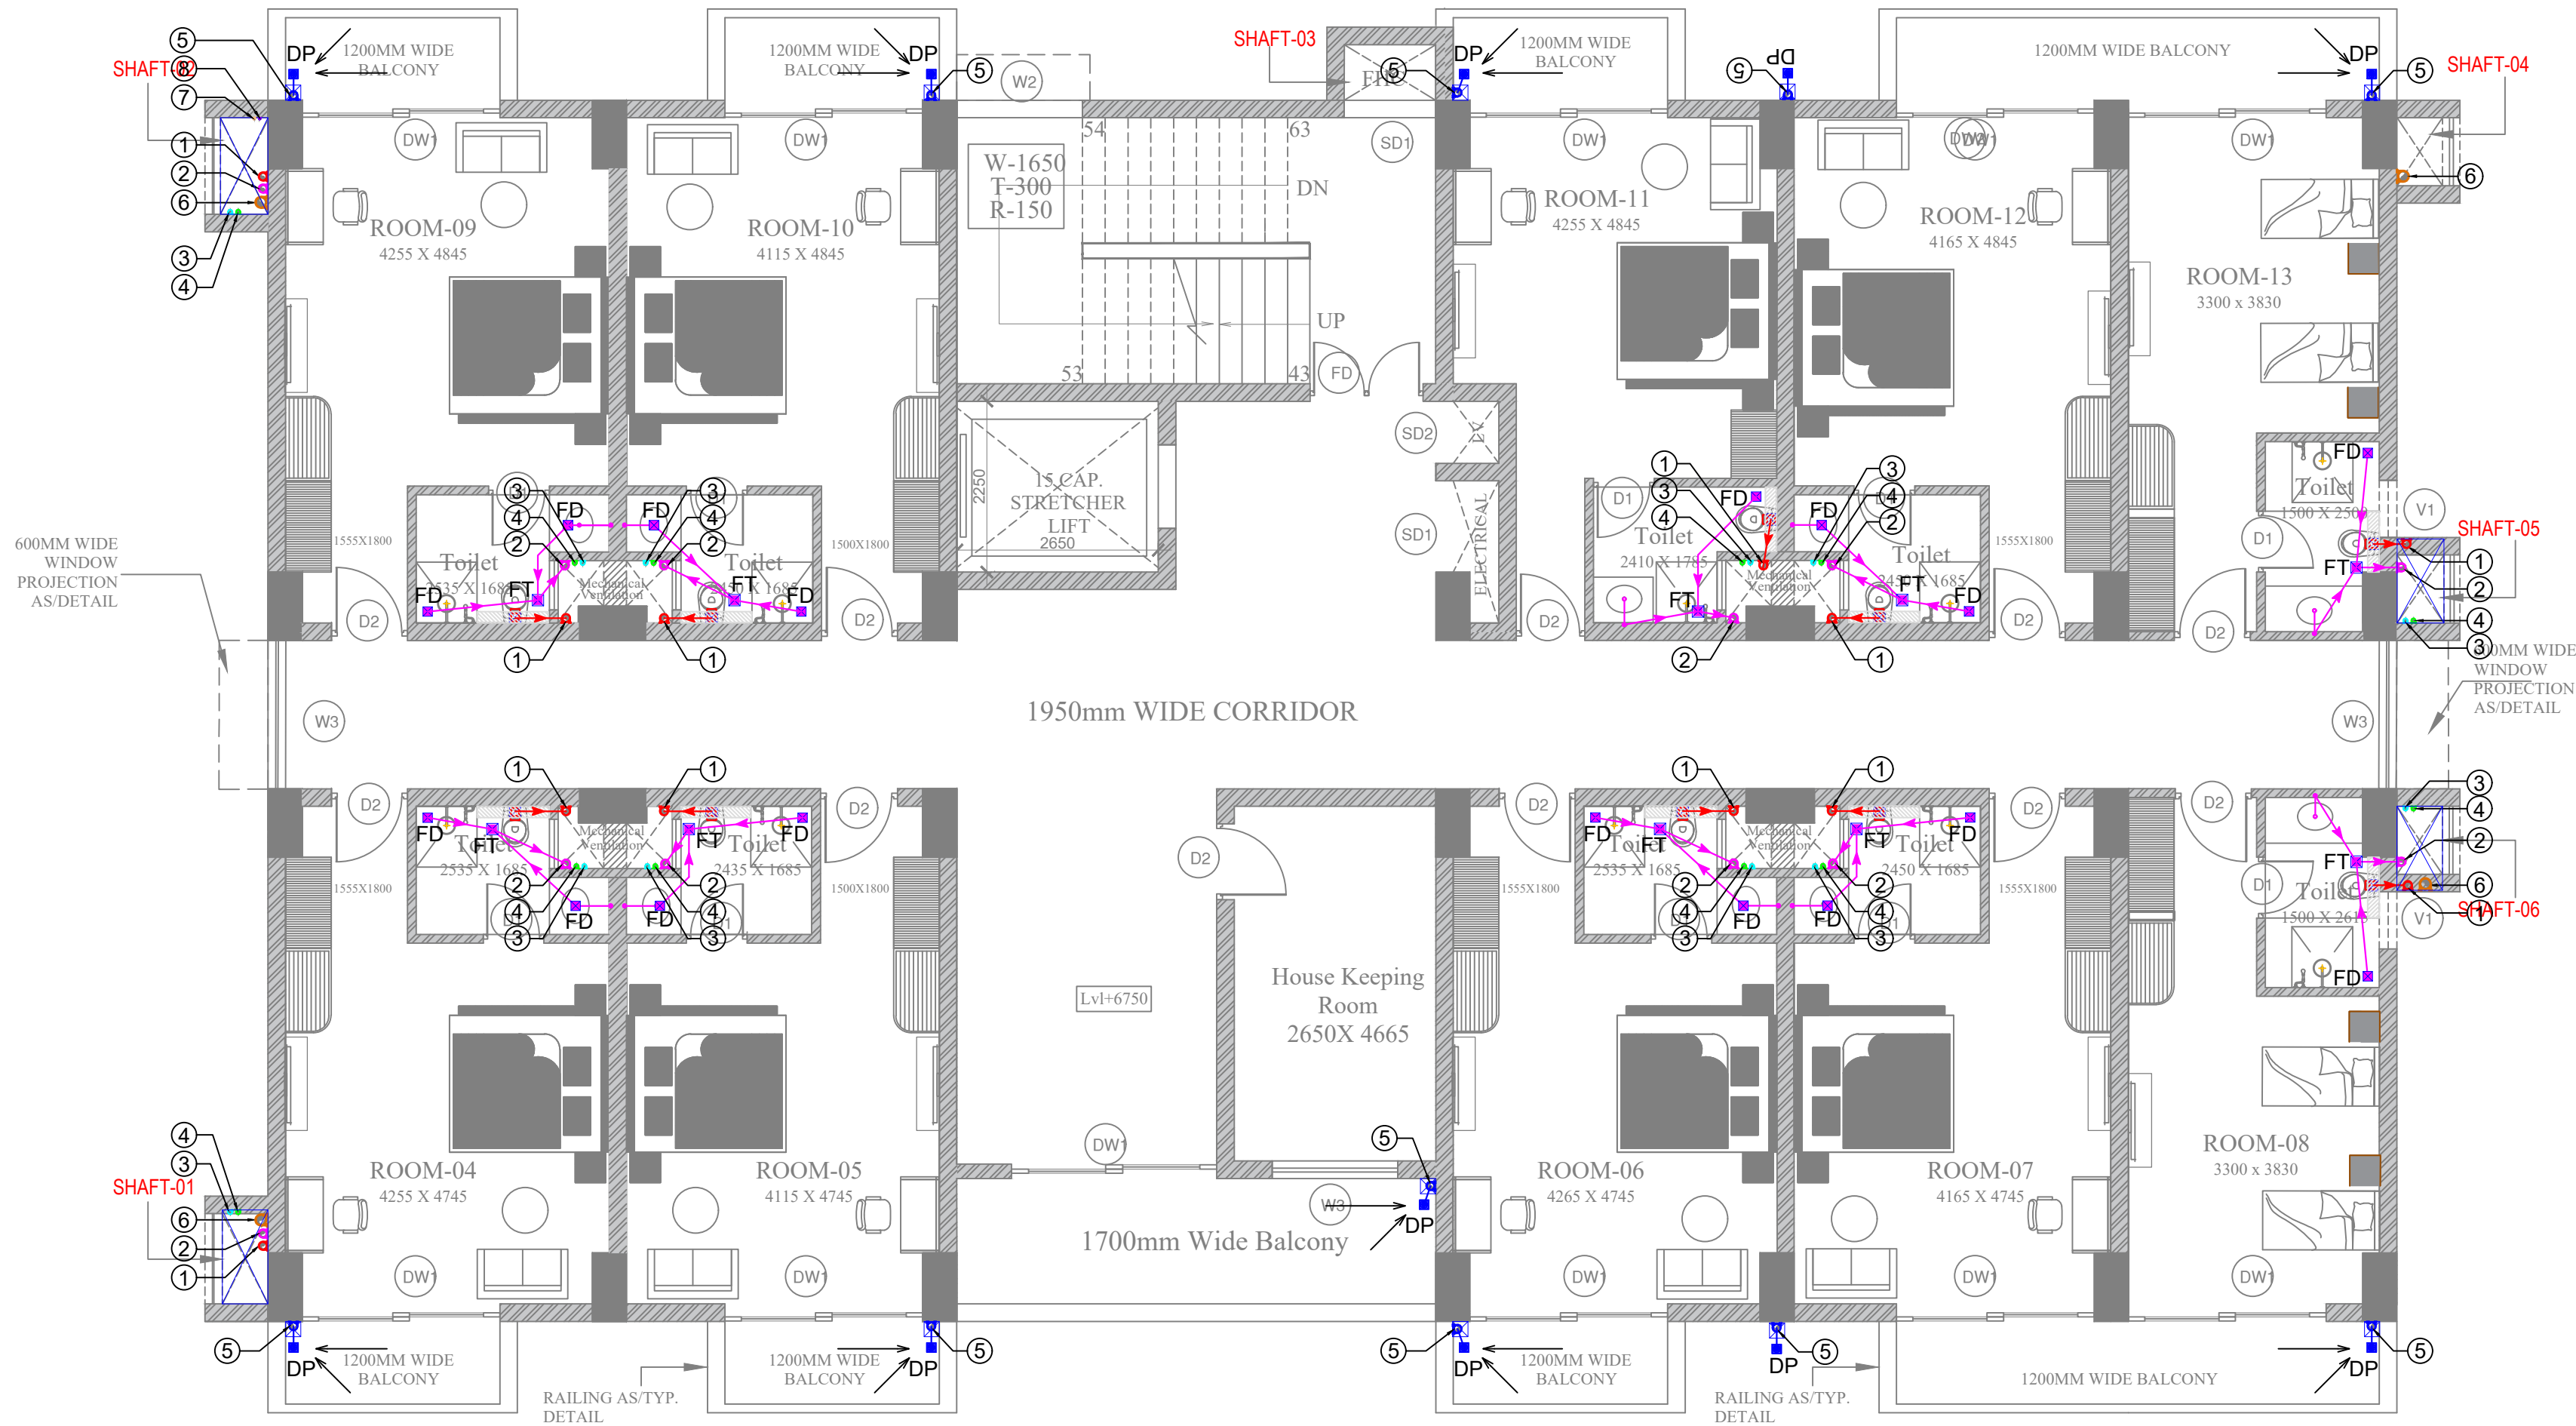

- PLUMBING NOTES :-
1. ALL PIPE DIAMETERS ARE IN MM.
 2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 3. **SOIL, WASTE & VENT PIPE WORK:**
SOIL, WASTE & VENT PIPE WORKS SHALL BE CARRIED OUT IN uPVC PIPES CLASS "B" SOLVENT CEMENT AND FITTINGS CONFORMING TO IS : 13592
 4. ALL HORIZONTAL SOIL AND WASTE PIPES IN TOILET SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:100 UNLESS SPECIFIED OTHERWISE.
 5. ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE SUSPENDED AT CEILING LEVEL.
 6. **FLOOR TRAPS:**
ALL FLOOR TRAPS SHALL BE FORMED OF 110 X110 MM. DIA 'P' TRAP WITH 110 MM.DIA uPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
 7. **FLOOR DRAINS:-**
FLOOR DRAINS SHALL BE FORMED OF 63X63 MM. OUTER DIA uPVC ELBOW WITH 85 MM. DIA C.P GRATING WITH FRAME.
 8. **WASTE PIPES:-**
ALL WASTE PIPE WORK FROM WASH BASINS SINKS AND DRAIN POINTS SHALL BE IN uPVC PIPES AND FITTING OF 6KG/CM² PRESSURE.
 9. ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING & CEILING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR.
 10. **WATER SUPPLY PIPING SYSTEM:-**
a. ALL HOT & COLD WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC OF CLASS SDR-11 PIPES WITH PIPE MATERIAL AS PER ASTM D-1884 & PIPE DIMENSION AS PER ASTM F 441C/ASTM D 2846 COMPLETE WITH CPVC FITTINGS.

PIPE SCHEDULE	
DESCRIPTION	SIZE
PIPE DIA FROM FD TO FT	63Ø uPVC PIPE
PIPE DIA FROM WB TO FT	40Ø uPVC PIPE
PIPE DIA FROM URINAL TO UT	40Ø uPVC PIPE
PIPE DIA FROM UT TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA FROM WC TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA FROM FT TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA HORIZONTAL STACK TO VERTICAL STACK	110 OD uPVC PIPE
PIPE DIA FROM WC TO MANHOLE	110 OD uPVC PIPE
PIPE DIA FROM FT TO GULLY TRAP	110 OD uPVC PIPE
PIPE DIA VERTICAL STACK TO GULLY TRAP	110 OD uPVC PIPE
PIPE DIA VERTICAL STACK TO MANHOLE	110 OD uPVC PIPE

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
 **OIL INDIA LIMITED**
(A Govt. of India Enterprise)

CONSULTANT
 **THE INFRASTRUCTURE PEOPLE**
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.

 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM


DRAWING TITLE
SECOND FLOOR PLAN
GUEST HOUSE
PLUMBING DRAWING

SCALE	DATE	DRG. NO.
NTS.	JULY 2025	MITES/BLD/DR/TEN/413

PLUMBING LEGENDS:-		
1.	110 OD uPVC SOIL PIPE	①
2.	110 OD uPVC WASTE PIPE	②
3.	DOMESTIC WATER SUPPLY PIPE	③
4.	FLUSHING WATER SUPPLY PIPE	④
5.	75Ø uPVC BALCONY WASTE PIPE	⑤
6.	160 OD uPVC RAIN WATER PIPE	⑥
7.	DOMESTIC WATER RISER PIPE	⑦
8.	FLUSHING WATER RISER PIPE	⑧
9.	FLOOR TRAP	FT
10.	FLOOR DRAIN	FD
11.	DRAIN POINT	DP
12.	URINAL TRAP	UT
13.	FLOOR CLEAN OUT PLUG	FCO
14.	CEILING CLEAN OUT PLUG	COP
15.	uPVC SOIL PIPE LINE	
16.	uPVC WASTE PIPE LINE	
17.	uPVC BALCONY WASTE PIPE LINE	
18.	150x150 FLOOR CUTOUT FOR FT, WC, UT	
19.	125x125 FLOOR CUTOUT FOR FD	
20.	125x125 FLOOR CUTOUT FOR DP	

NOTE :

All ac drain pipes of 25mm dia. to be provided to the nearest drain point.
The routing from the drop point to the drainage connection will be concealed, as per site conditions.

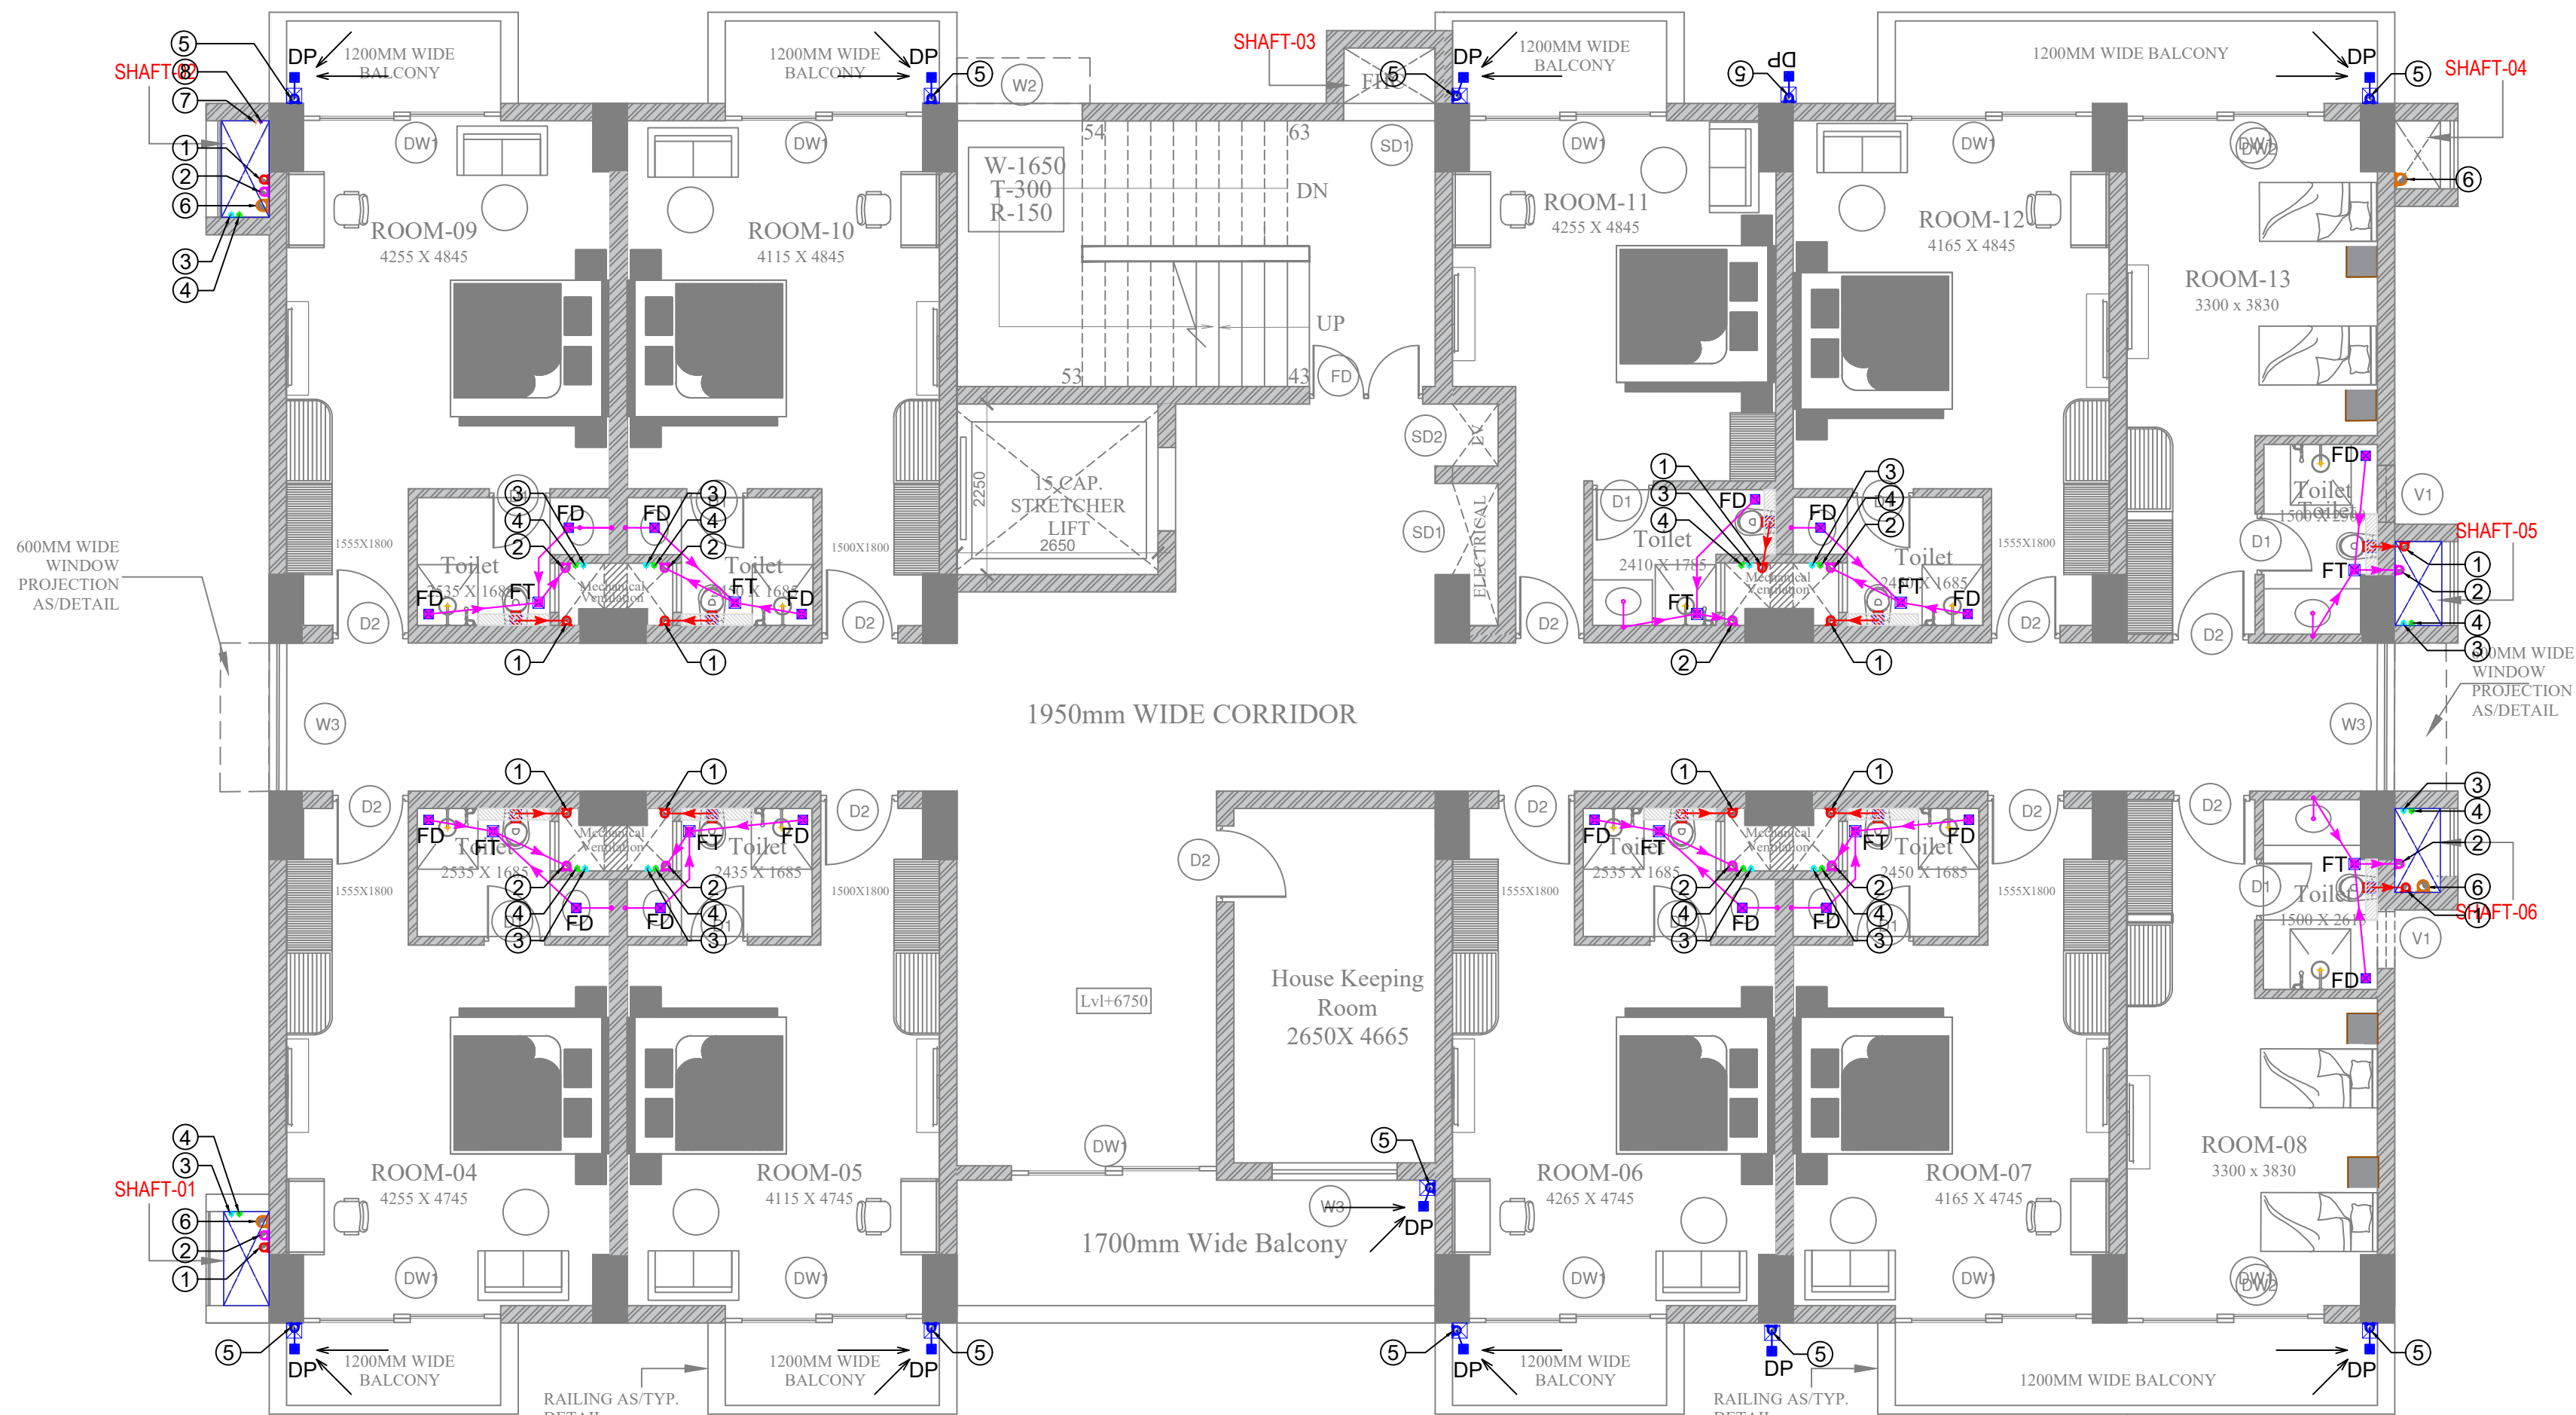

- PLUMBING NOTES :-**
1. ALL PIPE DIAMETERS ARE IN MM.
 2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 3. **SOIL, WASTE & VENT PIPE WORK:**
SOIL, WASTE & VENT PIPE WORKS SHALL BE CARRIED OUT IN uPVC PIPES CLASS "B" SOLVENT CEMENT AND FITTINGS CONFORMING TO IS : 13592
 4. ALL HORIZONTAL SOIL AND WASTE PIPES IN TOILET SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:100 UNLESS SPECIFIED OTHERWISE.
 5. ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE SUSPENDED AT CEILING LEVEL.
 6. **FLOOR TRAPS:**
ALL FLOOR TRAPS SHALL BE FORMED OF 110 X110 MM. DIA "P" TRAP WITH 110 MM DIA uPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
 7. **FLOOR DRAINS:-**
FLOOR DRAINS SHALL BE FORMED OF 63X63 MM. OUTER DIA uPVC ELBOW WITH 85 MM. DIA C.P GRATING WITH FRAME.
 8. **WASTE PIPES:-**
ALL WASTE PIPE WORK FROM WASH BASINS SINKS AND DRAIN POINTS SHALL BE IN uPVC PIPES AND FITTING OF 6KG/CM² PRESSURE.
 9. ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING & CEILING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR.
 10. **WATER SUPPLY PIPING SYSTEM:-**
a. ALL HOT & COLD WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC OF CLASS SDR-11 PIPES WITH PIPE MATERIAL AS PER ASTM D-1884 & PIPE DIMENSION AS PER ASTM F 441C/ASTM D 2846 COMPLETE WITH CPVC FITTINGS.

PIPE SCHEDULE	
DESCRIPTION	SIZE
PIPE DIA FROM FD TO FT	63Ø uPVC PIPE
PIPE DIA FROM WB TO FT	40Ø uPVC PIPE
PIPE DIA FROM URINAL TO UT	40Ø uPVC PIPE
PIPE DIA FROM UT TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA FROM WC TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA FROM FT TO HORIZONTAL STACK	110 OD uPVC PIPE
PIPE DIA HORIZONTAL STACK TO VERTICAL STACK	110 OD uPVC PIPE
PIPE DIA FROM WC TO MANHOLE	110 OD uPVC PIPE
PIPE DIA FROM FT TO GULLY TRAP	110 OD uPVC PIPE
PIPE DIA VERTICAL STACK TO GULLY TRAP	110 OD uPVC PIPE
PIPE DIA VERTICAL STACK TO MANHOLE	110 OD uPVC PIPE

- NOTES:-**
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
IRITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE
THIRD FLOOR PLAN
GUEST HOUSE
PLUMBING DRAWING


SCALE
DATE
NTS.
JULY 2025

DRG. NO.
RITES/BLD/DR/TEN/414

PLUMBING LEGENDS:-		
1. 110 OD uPVC SOIL PIPE	①	Red line with arrow
2. 110 OD uPVC WASTE PIPE	②	Purple line with arrow
3. DOMESTIC WATER SUPPLY PIPE	③	Blue line with arrow
4. FLUSHING WATER SUPPLY PIPE	④	Green line with arrow
5. 75Ø uPVC BALCONY WASTE PIPE	⑤	Blue line with arrow
6. 160 OD uPVC RAIN WATER PIPE	⑥	Orange line with arrow
7. DOMESTIC WATER RISER PIPE	⑦	Blue line with arrow
8. FLUSHING WATER RISER PIPE	⑧	Blue line with arrow
9. FLOOR TRAP	FT	Blue square
10. FLOOR DRAIN	FD	Blue square
11. DRAIN POINT	DP	Blue square
12. URINAL TRAP	UT	Red square
13. FLOOR CLEAN OUT PLUG	FCO	Red square
14. CEILING CLEAN OUT PLUG	COP	Red square
15. uPVC SOIL PIPE LINE		Red line
16. uPVC WASTE PIPE LINE		Purple line
17. 150x150 FLOOR CUTOUT FOR FT, WC, UT		Blue square
18. 125x125 FLOOR CUTOUT FOR FD		Blue square
19. 125x125 FLOOR CUTOUT FOR DP		Blue square

NOTE :

All ac drain pipes of 25mm dia. to be provided to the nearest drain point.
The routing from the drop point to the drainage connection will be concealed, as per site conditions.

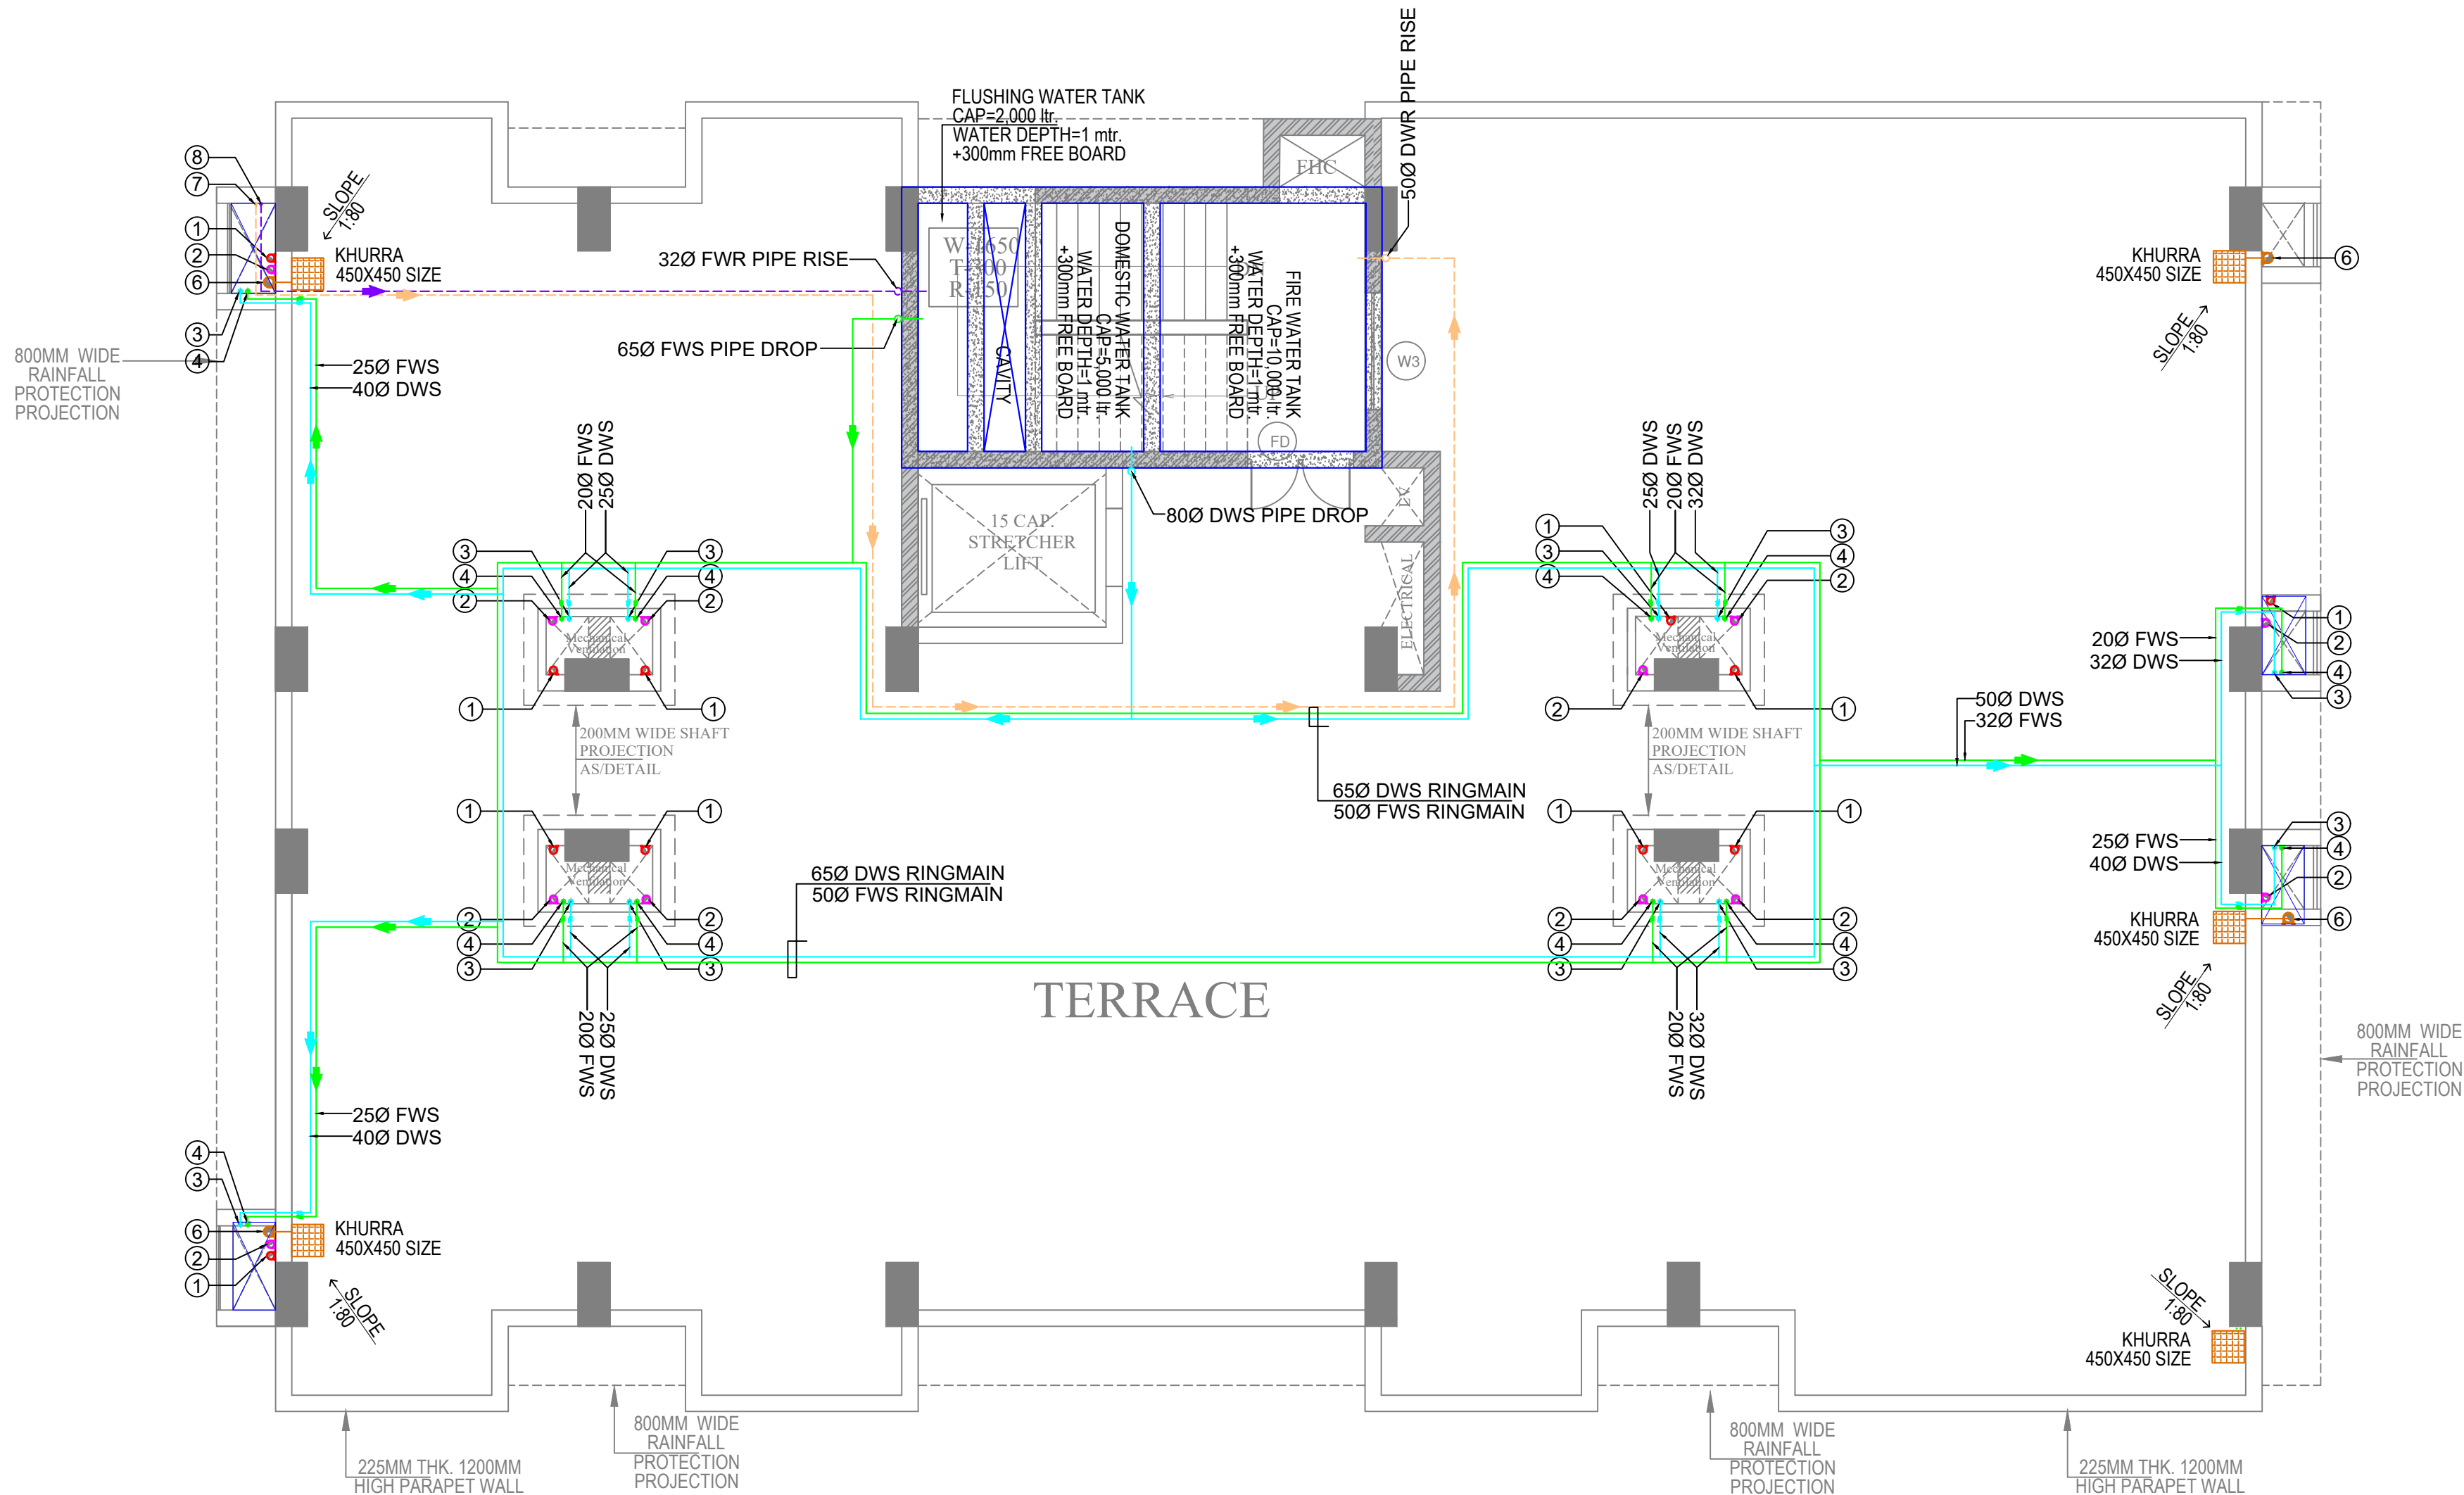

PLUMBING LEGENDS:-		
1.	110 OD uPVC SOIL PIPE	①
2.	110 OD uPVC WASTE PIPE	②
3.	DOMESTIC WATER SUPPLY PIPE	③
4.	FLUSHING WATER SUPPLY PIPE	④
5.	75Ø uPVC BALCONY WASTE PIPE	⑤
6.	160 OD uPVC RAIN WATER PIPE	⑥
7.	DOMESTIC WATER RISER PIPE	⑦
8.	FLUSHING WATER RISER PIPE	⑧
9.	DOMESTIC WATER SUPPLY LINE	—
10.	FLUSHING WATER SUPPLY LINE	—
11.	FLUSHING WATER RISER LINE	—
12.	DOMESTIC WATER RISER LINE	—
13.	BALL VALVE	⊞
14.	FLOW DIRECTION	→
15.	KHURRA 450X450	⊞

NOTES:-

- ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
- WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
- ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
- DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
IRITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in



JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE
TERRACE PLAN
GUEST HOUSE
PLUMBING DRAWING

SCALE
DATE
JULY 2025

DRG. NO.
RITES/BLD/DR/TEN/415

GUEST HOUSE

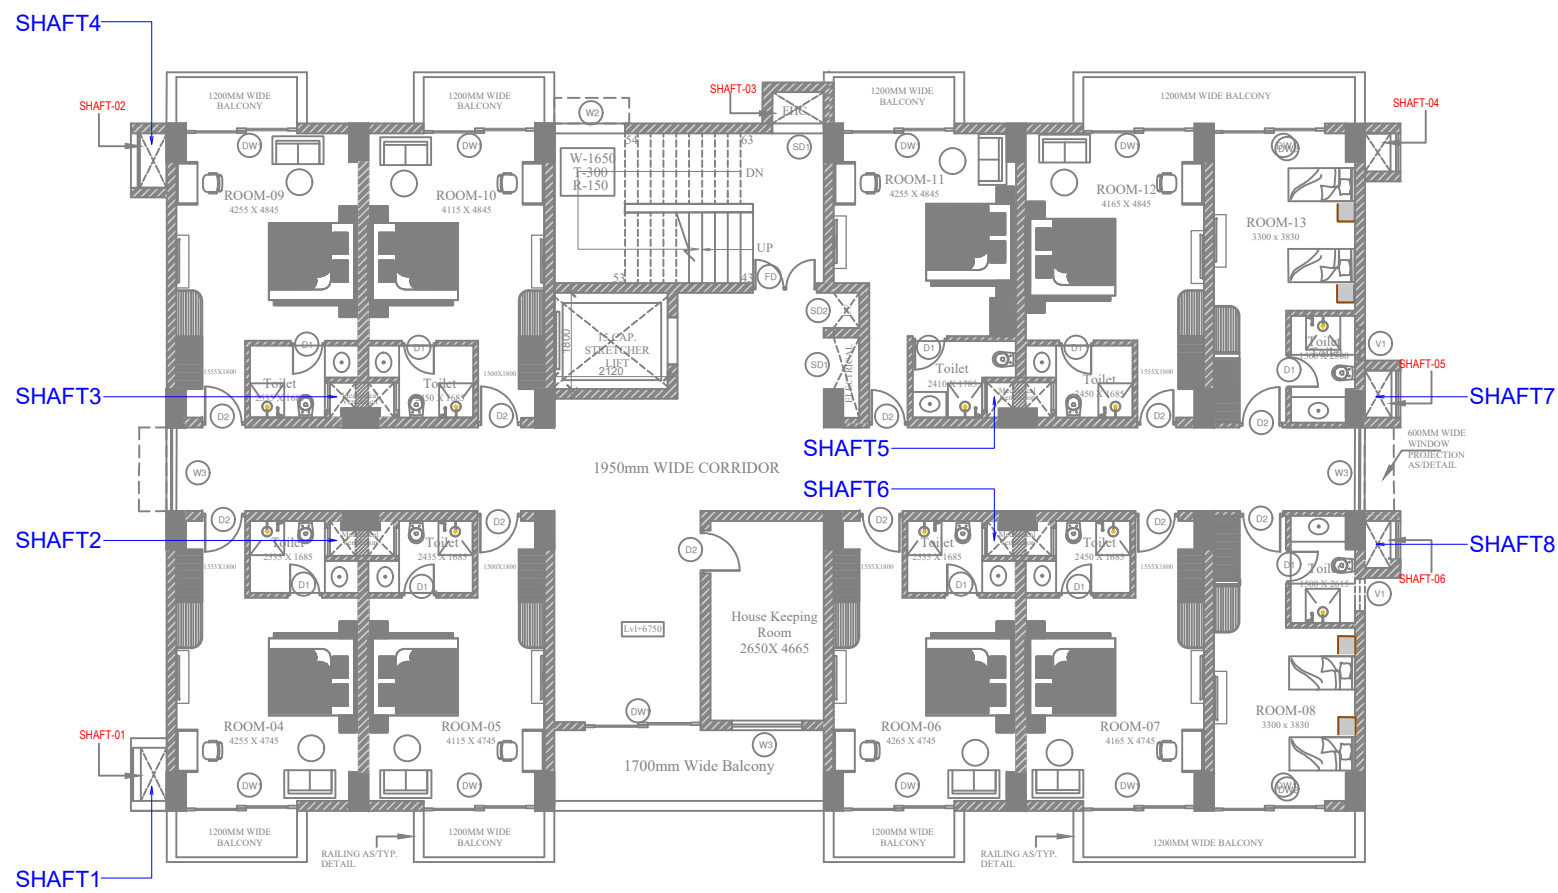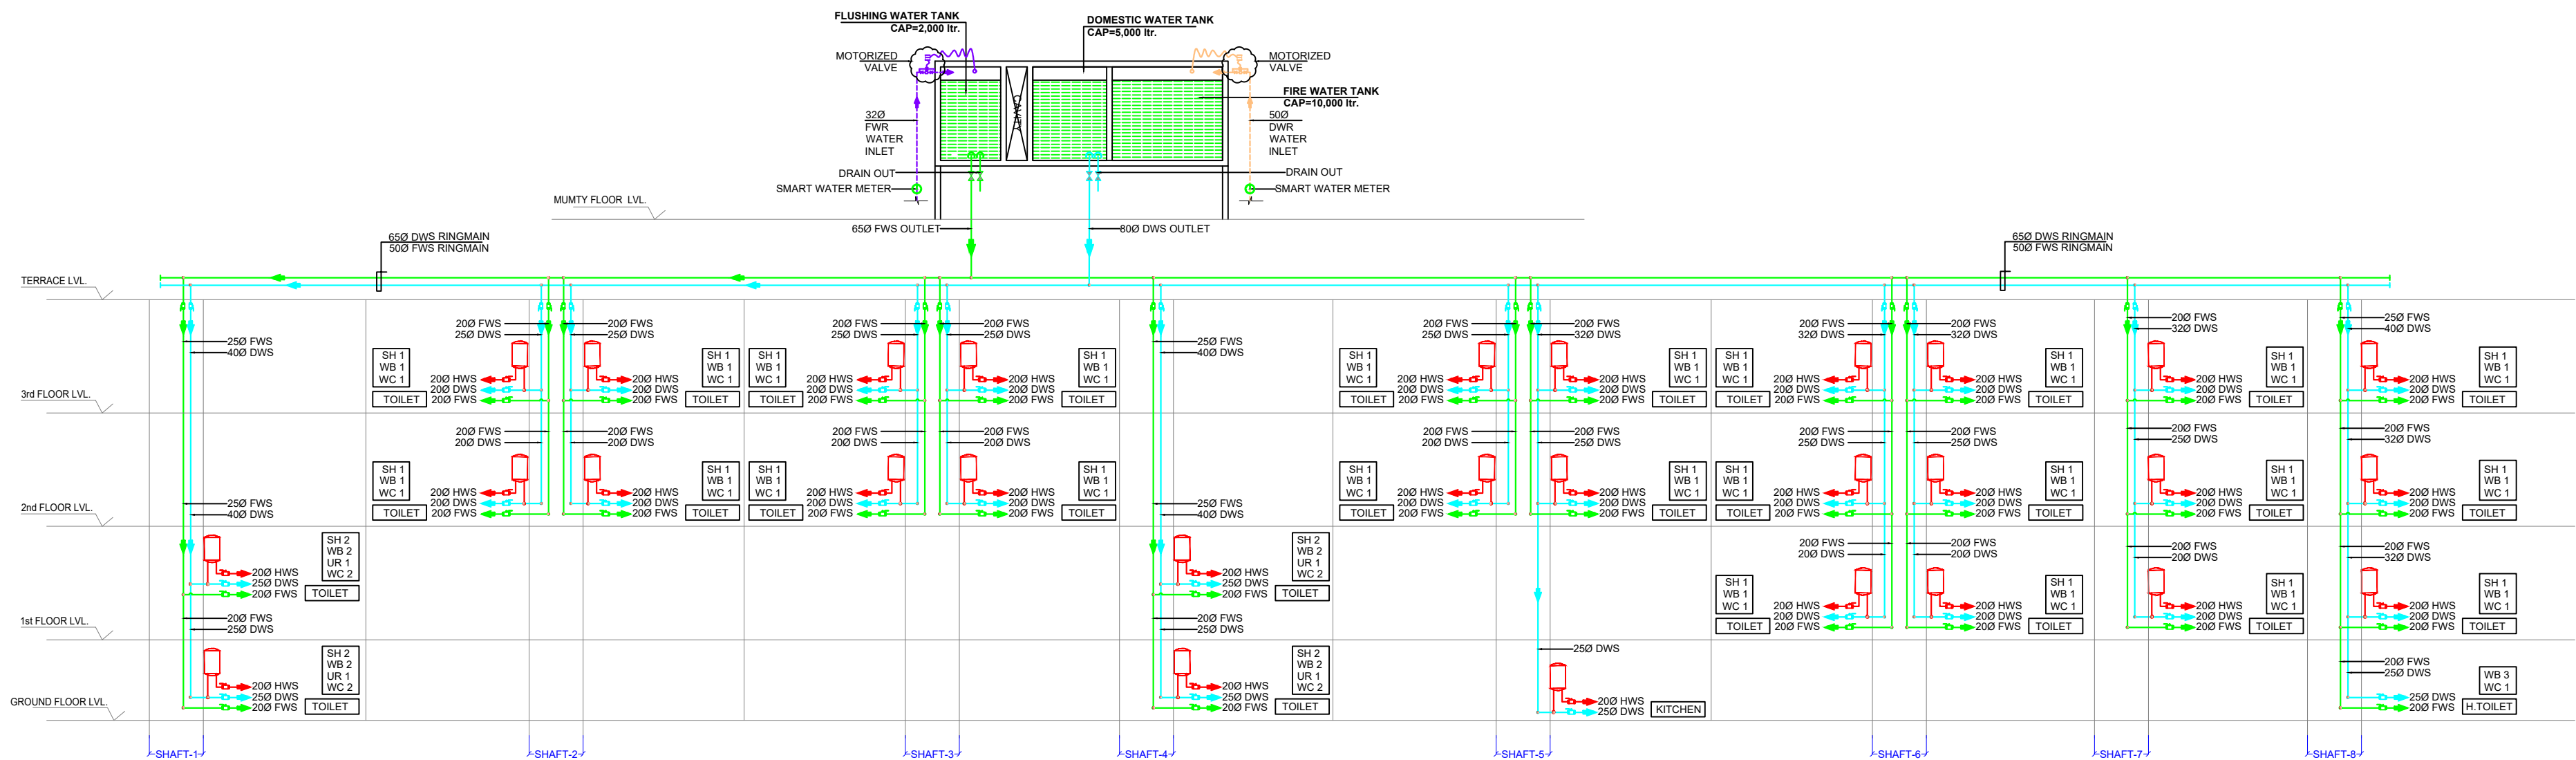

KEY PLAN

PLUMBING LEGENDS:-	
1. DOMESTIC WATER SUPPLY PIPE (DWS)	
2. FLUSHING WATER SUPPLY PIPE (FWS)	
3. DOMESTIC WATER RISER PIPE (DWR)	
4. FLUSHING WATER RISER PIPE (FWR)	
5. HOT WATER SUPPLY PIPE (HWS)	
6. BALL VALVE	
7. GEYSER	
8. FLOW DIRECTION	

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWING TENDER DOCUMENTS.
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT



CONSULTANT



MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE

BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE

GUEST HOUSE
WATER SUPPLY SCHEMATIC

SCALE


NTS.

DATE

JULY 2025

DRG. NO.

NTS. JULY 2025 RITES/BLD/DR/TEN/416

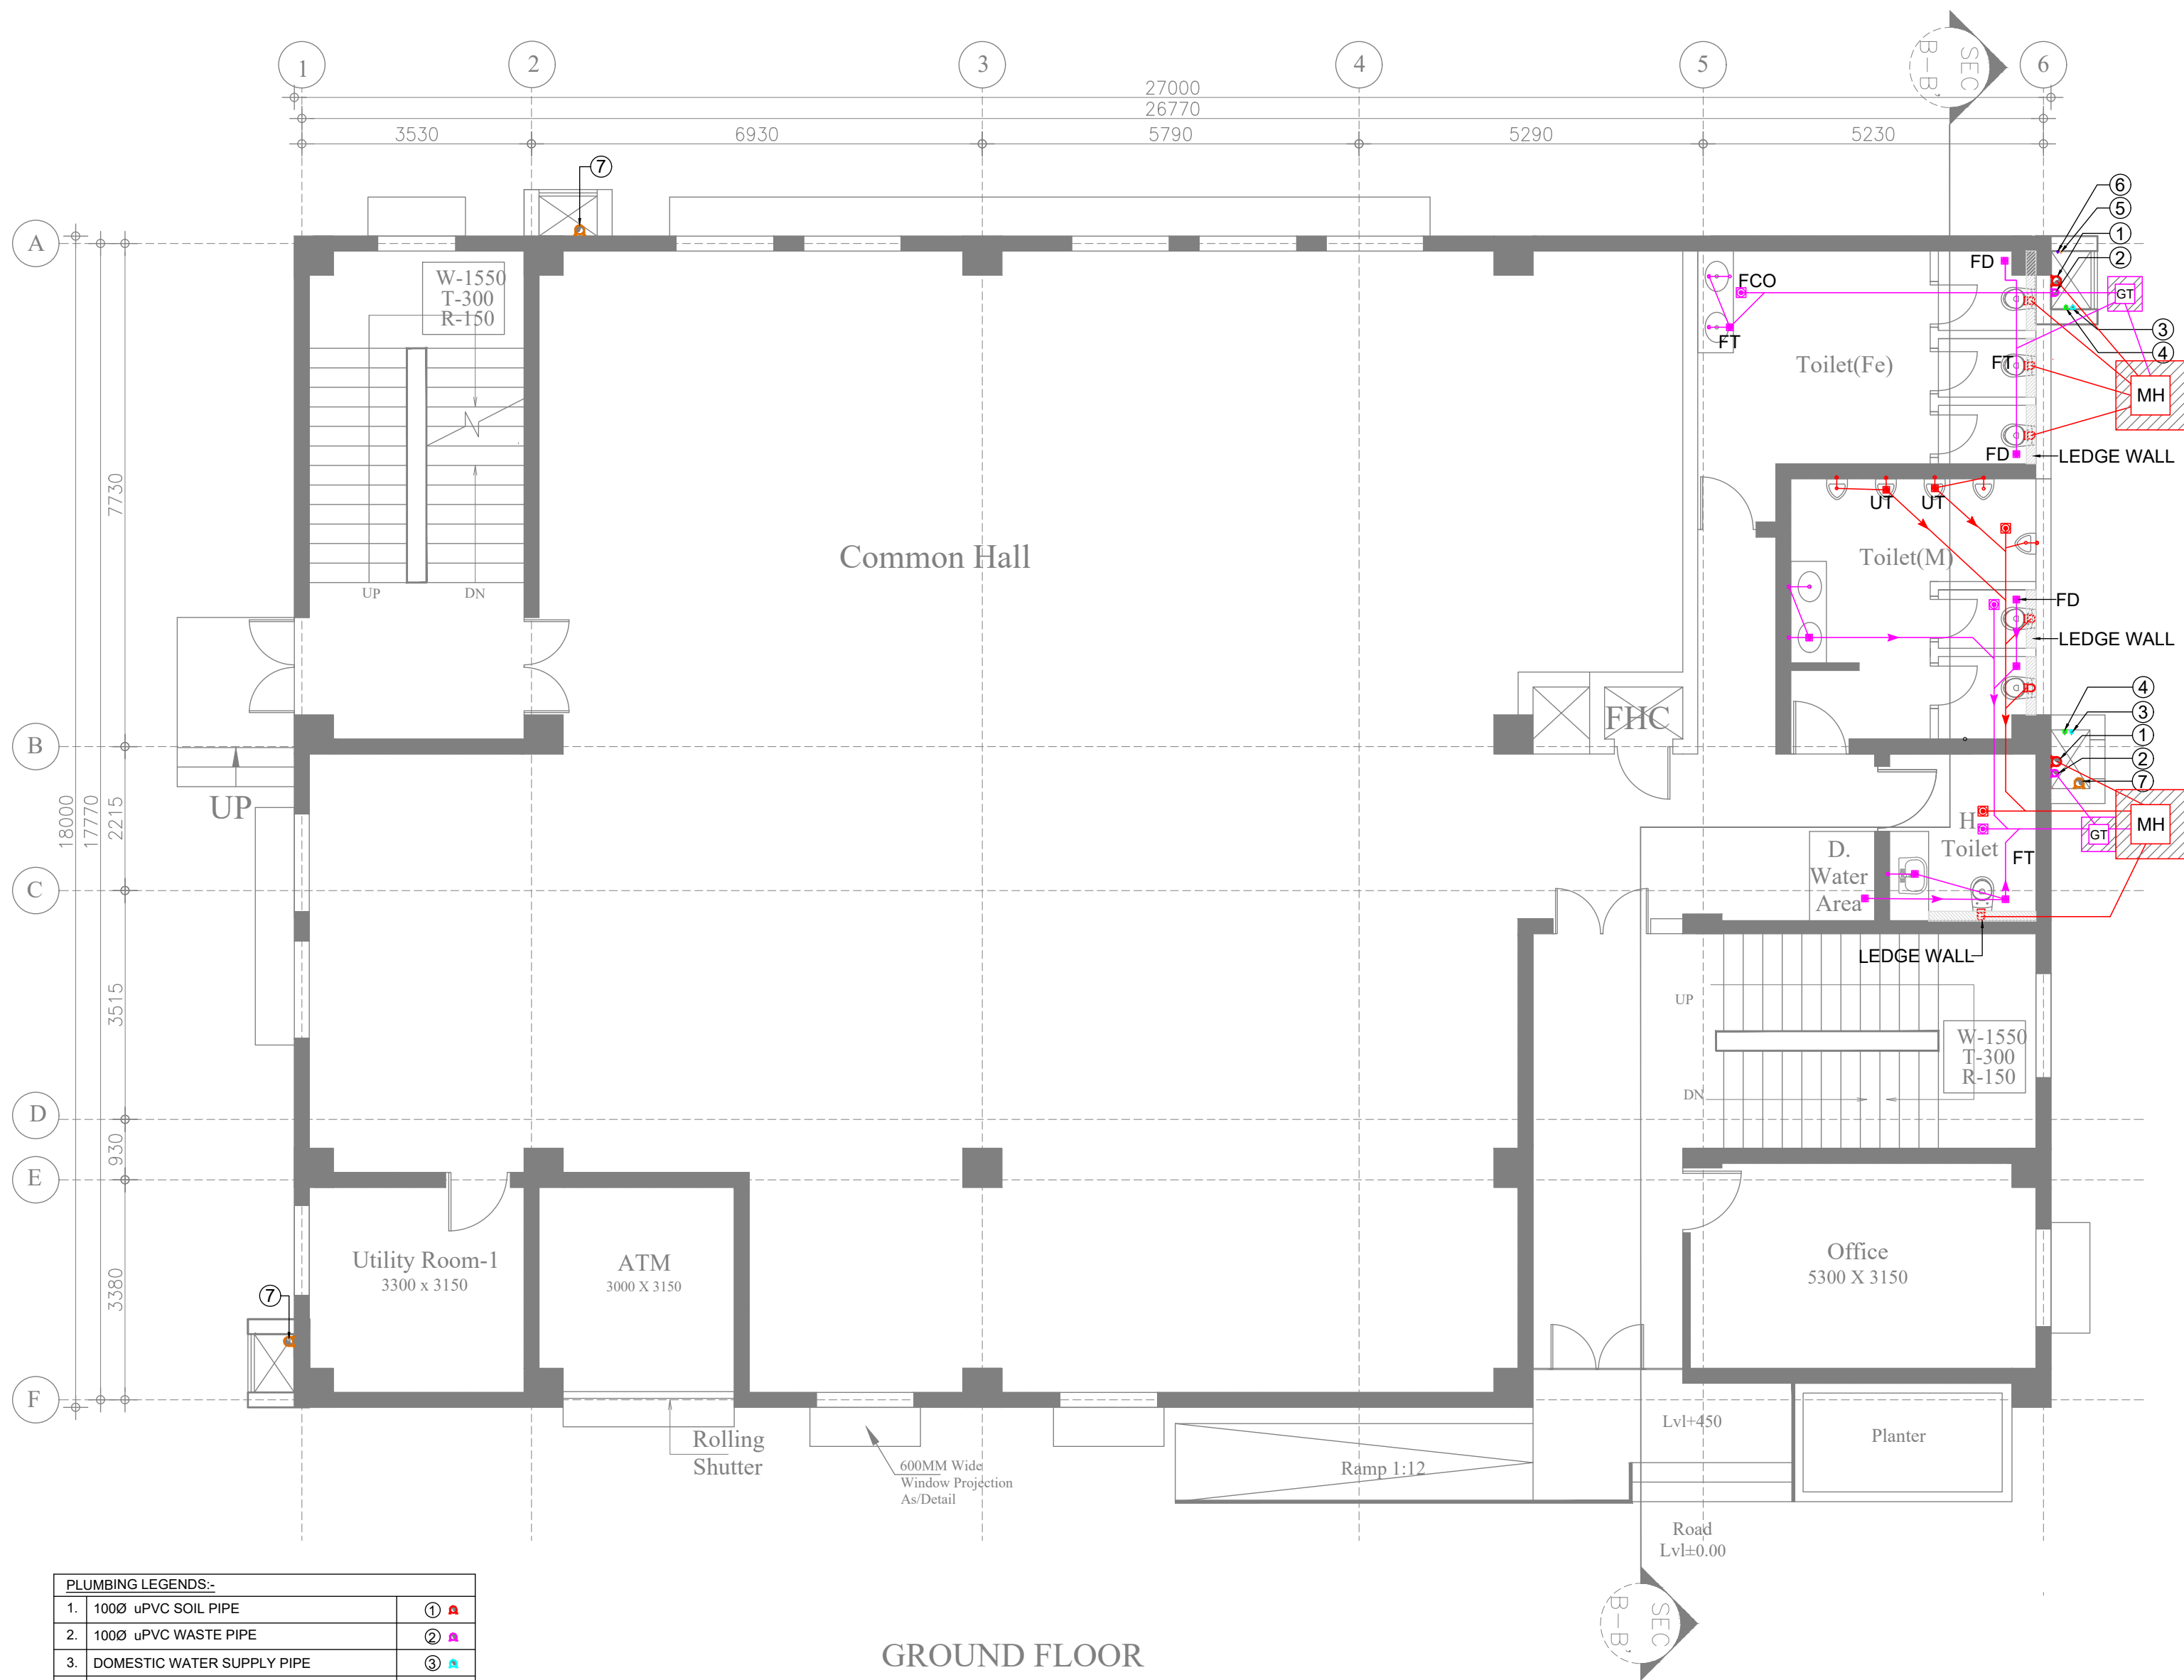

PIPE SCHEDULE	
DESCRIPTION	SIZE
PIPE DIA FROM FD TO FT	63 OD uPVC PIPE
PIPE DIA FROM WB TO FT	40 OD uPVC PIPE
PIPE DIA FROM URINAL TO UT	40 OD uPVC PIPE
PIPE DIA FROM UT TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA FROM WC TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA FROM FT TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA HORIZONTAL STACK TO VERTICAL STACK	100Ø uPVC PIPE
PIPE DIA FROM WC TO MANHOLE	100Ø uPVC PIPE
PIPE DIA FROM FT TO GULLY TRAP	100Ø uPVC PIPE
PIPE DIA VERTICAL STACK TO GULLY TRAP	100Ø uPVC PIPE
PIPE DIA VERTICAL STACK TO MANHOLE	100Ø uPVC PIPE

- PLUMBING NOTES:-
- ALL PIPE DIAMETERS ARE IN MM.
 - THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 - MANHOLES SHALL BE CONSTRUCTED AS PER STANDARD DETAILS.
 - SOIL,WASTE,RAIN & VENT PIPE WORK :-
SOIL,WASTE & VENT PIPE WORK SHALL BE SINGLE LAYER uPVC PIPING SYSTEM AS PER ON IS 13592
 - ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:50 AND NOT STEEPER THAN 1:10 UNLESS SPECIFIED OTHERWISE
 - WATER SUPPLY PIPE WORK :-
WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC (SDR-11) CONFORMING TO ASTM STANDARDS. ALL PIPE FITTINGS SHALL BE OF CPVC OF CLASS SAME AS PIPE CONFORMING TO ASTM STANDARDS SUITABLE FOR SOLVENT CEMENT JOINTS AS PER MFR.
 - NO PIPE WORK SHALL BE CONCEALED IN WALLS OR BURIED IN FLOORS WITHOUT BEING SUBJECTED TO WATER TESTING AS PER THE DIRECTION OF THE SITE ENGINEER.
 - ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR
 - WATER INLETS AND WASTE OUTLETS FROM SANITARY WARE SHALL BE ARRANGED TO SUIT REQUIREMENTS OF SELECTED MAKES AND MODELS.
 - ALL STONEWARE PIPES SHALL BE ENCASED IN 150 MM. THICK 1:5:10 CEMENT CONCRETE ALL AROUND.
 - FLOOR TRAPS:-
ALL FLOOR TRAPS SHALL BE FORMED OF 100X100 MM. DIA 'P' TRAP WITH 100 MM. DIA PP PIPE EXTENSION PIECE FOR SIDE INLETS.
 - FLOOR DRAIN:-
DRAIN POINTS SHALL BE FORMED OF 75X75 MM. DIA PP ELBOW WITH 75 MM. DIA C.P. GRATING WITH FRAME.

NOTES:-

- ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
- WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
- ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
- DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

PLUMBING LEGENDS:-		
1.	100Ø uPVC SOIL PIPE	①
2.	100Ø uPVC WASTE PIPE	②
3.	DOMESTIC WATER SUPPLY PIPE	③
4.	FLUSHING WATER SUPPLY PIPE	④
5.	DOMESTIC WATER RISER PIPE	⑤
6.	FLUSHING WATER RISER PIPE	⑥
7.	150Ø uPVC RAIN WATER PIPE	⑦
8.	FLOOR TRAP	FT
9.	FLOOR DRAIN	FD
10.	DRAIN POINT	DP
11.	URINAL TRAP	UT
12.	FLOOR CLEAN OUT PLUG	FCO
13.	CEILING CLEAN OUT PLUG	COP
14.	uPVC SOIL PIPE LINE	
15.	uPVC WASTE PIPE LINE	
16.	150x150 FLOOR CUTOUT FOR FT, WC, UT	
17.	125x125 FLOOR CUTOUT FOR FD	

GROUND FLOOR

CLIENT



CONSULTANT



JOB TITLE

BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE

COMMUNITY CENTRE, GROUND
FLOOR PLAN PLUMBING



SCALE


NTS

DATE

JULY 2025

DRG. NO.

RITES/BLD/DR/TEN/417

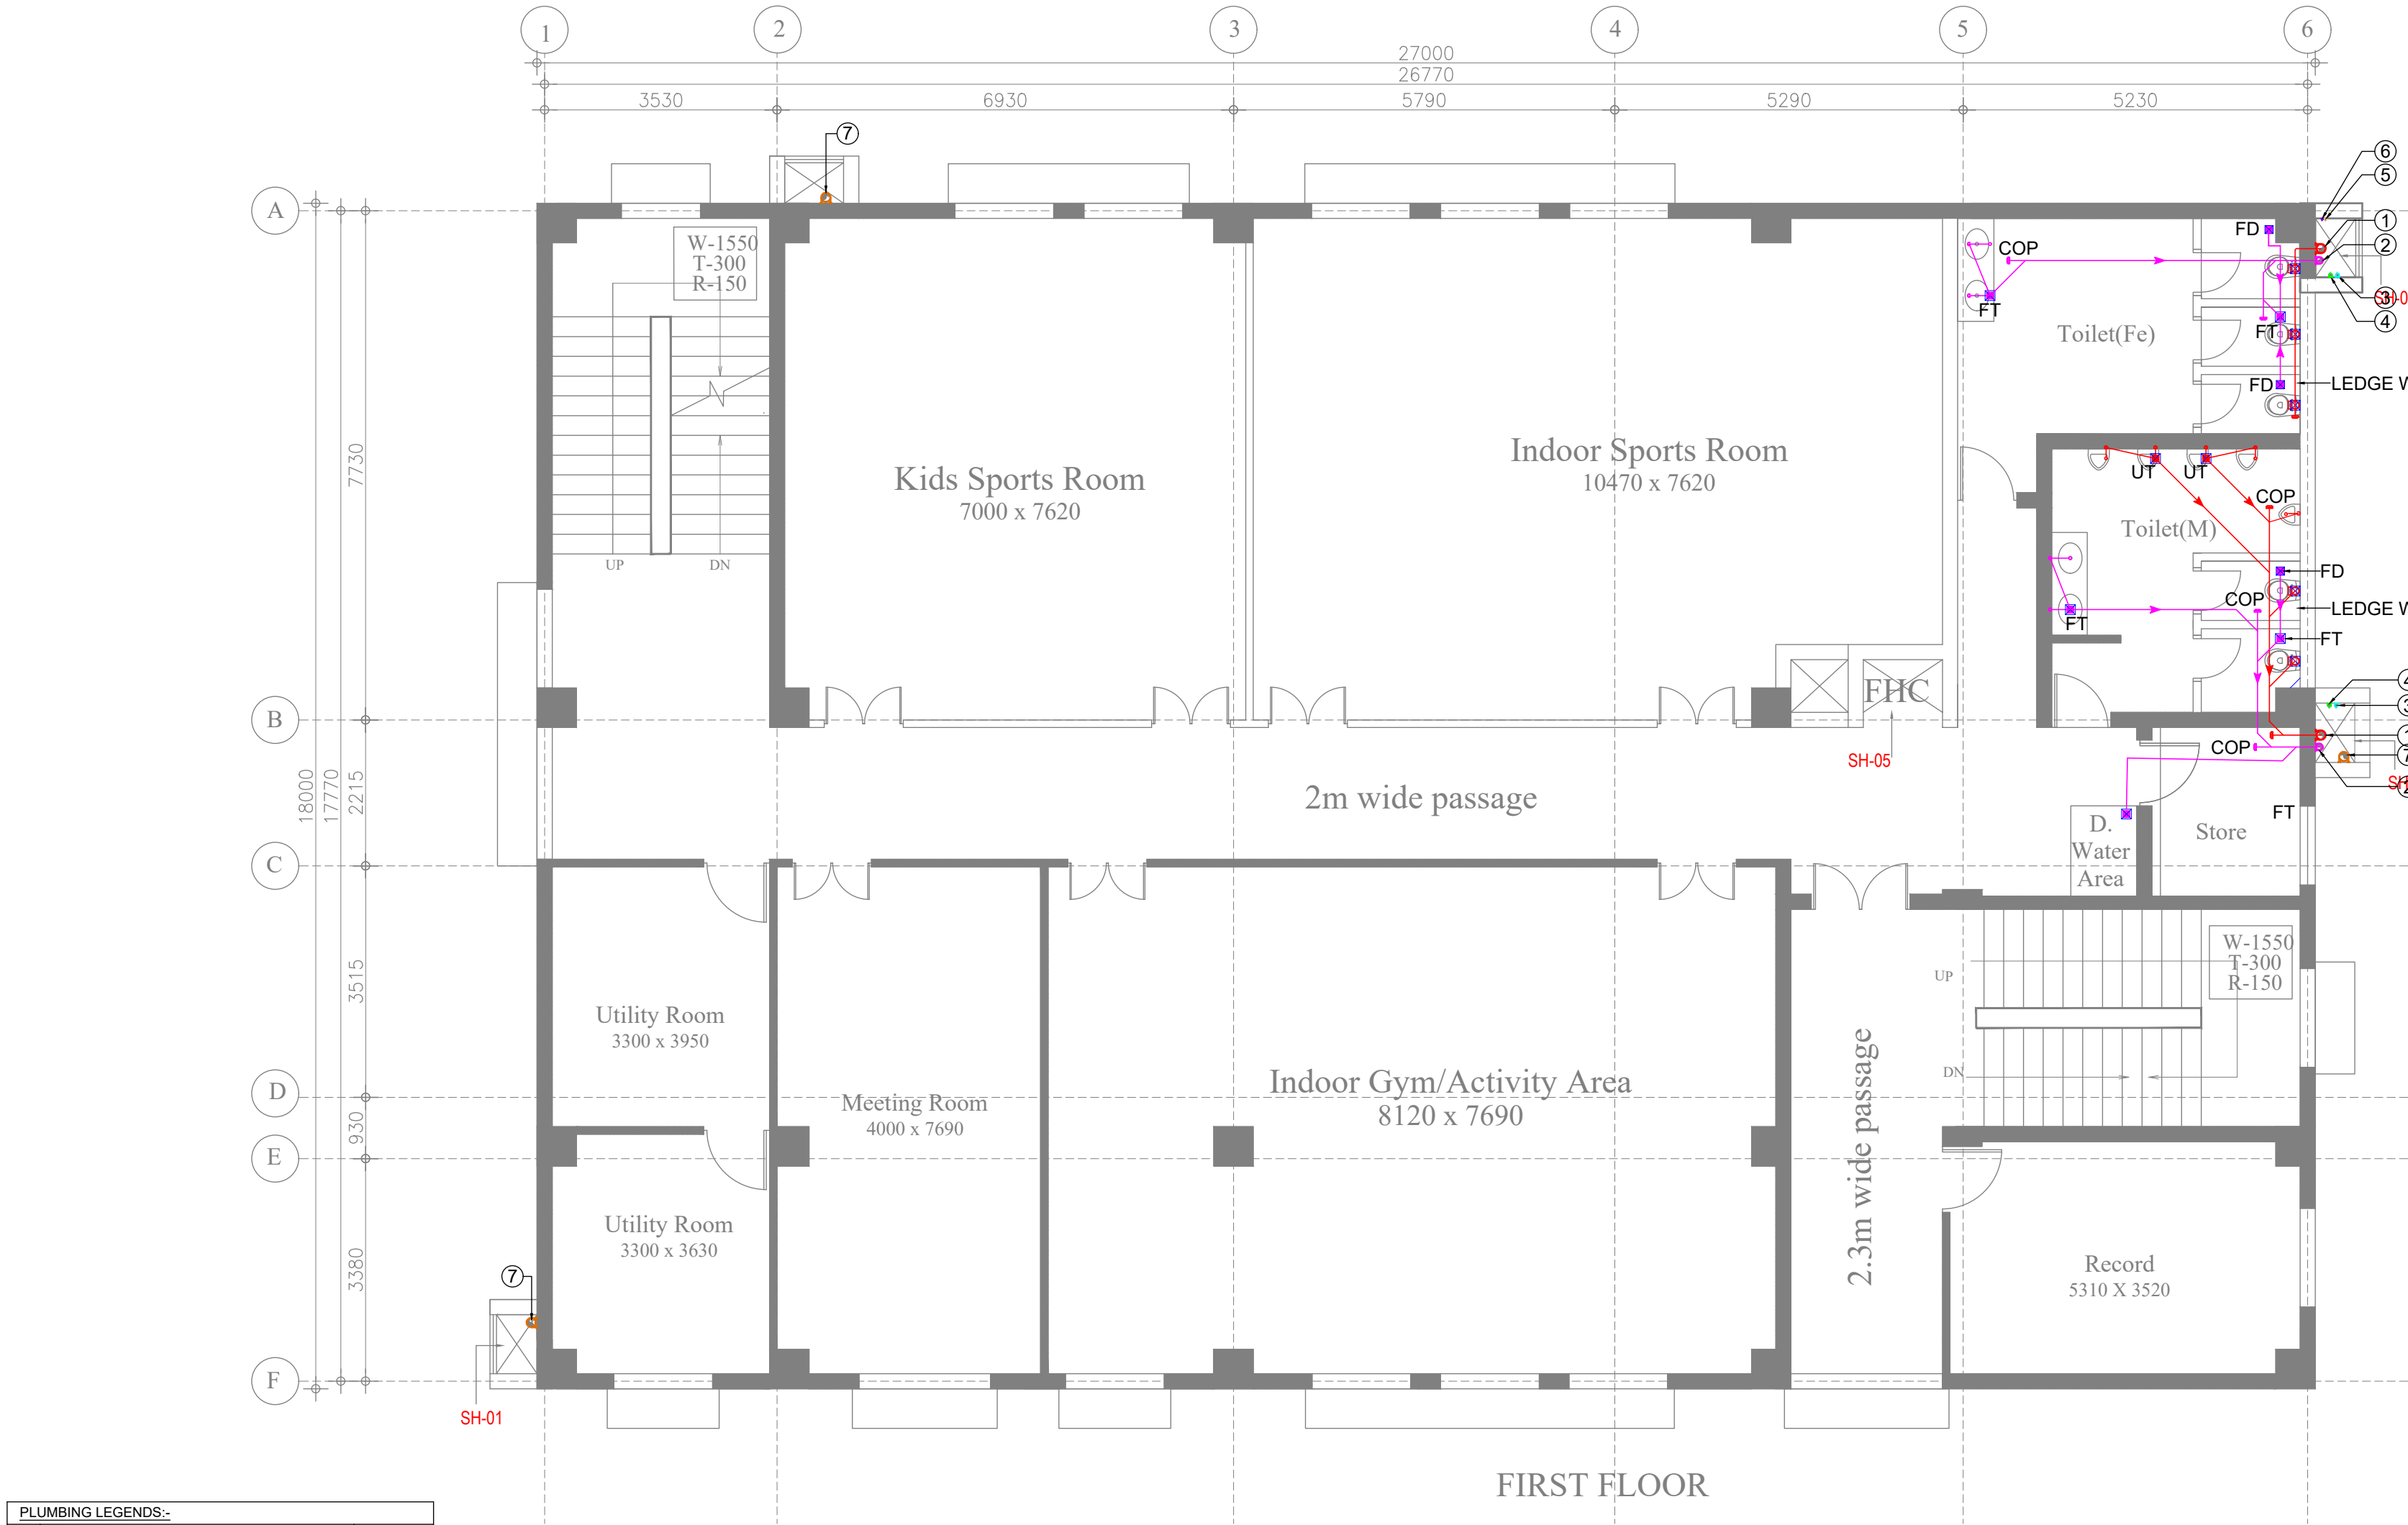



PIPE SCHEDULE	
DESCRIPTION	SIZE
PIPE DIA FROM FD TO FT	63 OD uPVC PIPE
PIPE DIA FROM WB TO FT	40 OD uPVC PIPE
PIPE DIA FROM URINAL TO UT	40 OD uPVC PIPE
PIPE DIA FROM UT TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA FROM WC TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA FROM FT TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA HORIZONTAL STACK TO VERTICAL STACK	100Ø uPVC PIPE
PIPE DIA FROM WC TO MANHOLE	100Ø uPVC PIPE
PIPE DIA FROM FT TO GULLY TRAP	100Ø uPVC PIPE
PIPE DIA VERTICAL STACK TO GULLY TRAP	100Ø uPVC PIPE
PIPE DIA VERTICAL STACK TO MANHOLE	100Ø uPVC PIPE

PLUMBING NOTES:-	
1.	ALL PIPE DIAMETERS ARE IN MM.
2.	THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
3.	MANHOLES SHALL BE CONSTRUCTED AS PER STANDARD DETAILS.
4.	SOIL,WASTE,RAIN & VENT PIPE WORK :- SOIL,WASTE & VENT PIPE WORK SHALL BE SINGLE LAYER uPVC PIPING SYSTEM AS PER ON IS 13592
5.	ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:50 AND NOT STEEPER THAN 1:10 UNLESS SPECIFIED OTHERWISE
6.	WATER SUPPLY PIPE WORK :- WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC (SDR-11) CONFORMING TO ASTM STANDARDS. ALL PIPE FITTINGS SHALL BE OF CPVC OF CLASS SAME AS PIPE CONFORMING TO ASTM STANDARDS SUITABLE FOR SOLVENT CEMENT JOINTS AS PER MFR.
7.	NO PIPE WORK SHALL BE CONCEALED IN WALLS OR BURIED IN FLOORS WITHOUT BEING SUBJECTED TO WATER TESTING AS PER THE DIRECTION OF THE SITE ENGINEER.
8.	ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR
9.	WATER INLETS AND WASTE OUTLETS FROM SANITARY WARE SHALL BE ARRANGED TO SUIT REQUIREMENTS OF SELECTED MAKES AND MODELS.
10.	ALL STONEWARE PIPES SHALL BE ENCASED IN 150 MM. THICK 1:5:10 CEMENT CONCRETE ALL AROUND.
11.	FLOOR TRAPS:- ALL FLOOR TRAPS SHALL BE FORMED OF 100X100 MM. DIA 'P' TRAP WITH 100 MM. DIA PP PIPE EXTENSION PIECE FOR SIDE INLETS.
12.	FLOOR DRAIN:- DRAIN POINTS SHALL BE FORMED OF 75X75 MM. DIA PP ELBOW WITH 75 MM. DIA C.P. GRATING WITH FRAME.

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

PLUMBING LEGENDS:-	
1. 100Ø uPVC SOIL PIPE	①
2. 100Ø uPVC WASTE PIPE	②
3. DOMESTIC WATER SUPPLY PIPE	③
4. FLUSHING WATER SUPPLY PIPE	④
5. DOMESTIC WATER RISER PIPE	⑤
6. FLUSHING WATER RISER PIPE	⑥
7. 150Ø uPVC RAIN WATER PIPE	⑦
8. FLOOR TRAP	FT
9. FLOOR DRAIN	FD
10. DRAIN POINT	DP
11. URINAL TRAP	UT
12. FLOOR CLEAN OUT PLUG	FCO
13. CEILING CLEAN OUT PLUG	COP
14. uPVC SOIL PIPE LINE	
15. uPVC WASTE PIPE LINE	
16. 150x150 FLOOR CUTOUT FOR FT, WC, UT	
17. 125x125 FLOOR CUTOUT FOR FD	

CLIENT		
 OIL INDIA LIMITED (A Govt. of India Enterprise)		
CONSULTANT		
 THE INFRASTRUCTURE PEOPLE (A Govt. of India Enterprise)		
JOB TITLE		
BQ WORKMEN GROUP HOUSING COMPLEX AT DULIAJAN ASSAM		
DRAWING TITLE		
COMMUNITY CENTRE, FIRST FLOOR PLAN PLUMBING		
SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/DR/TEN/418

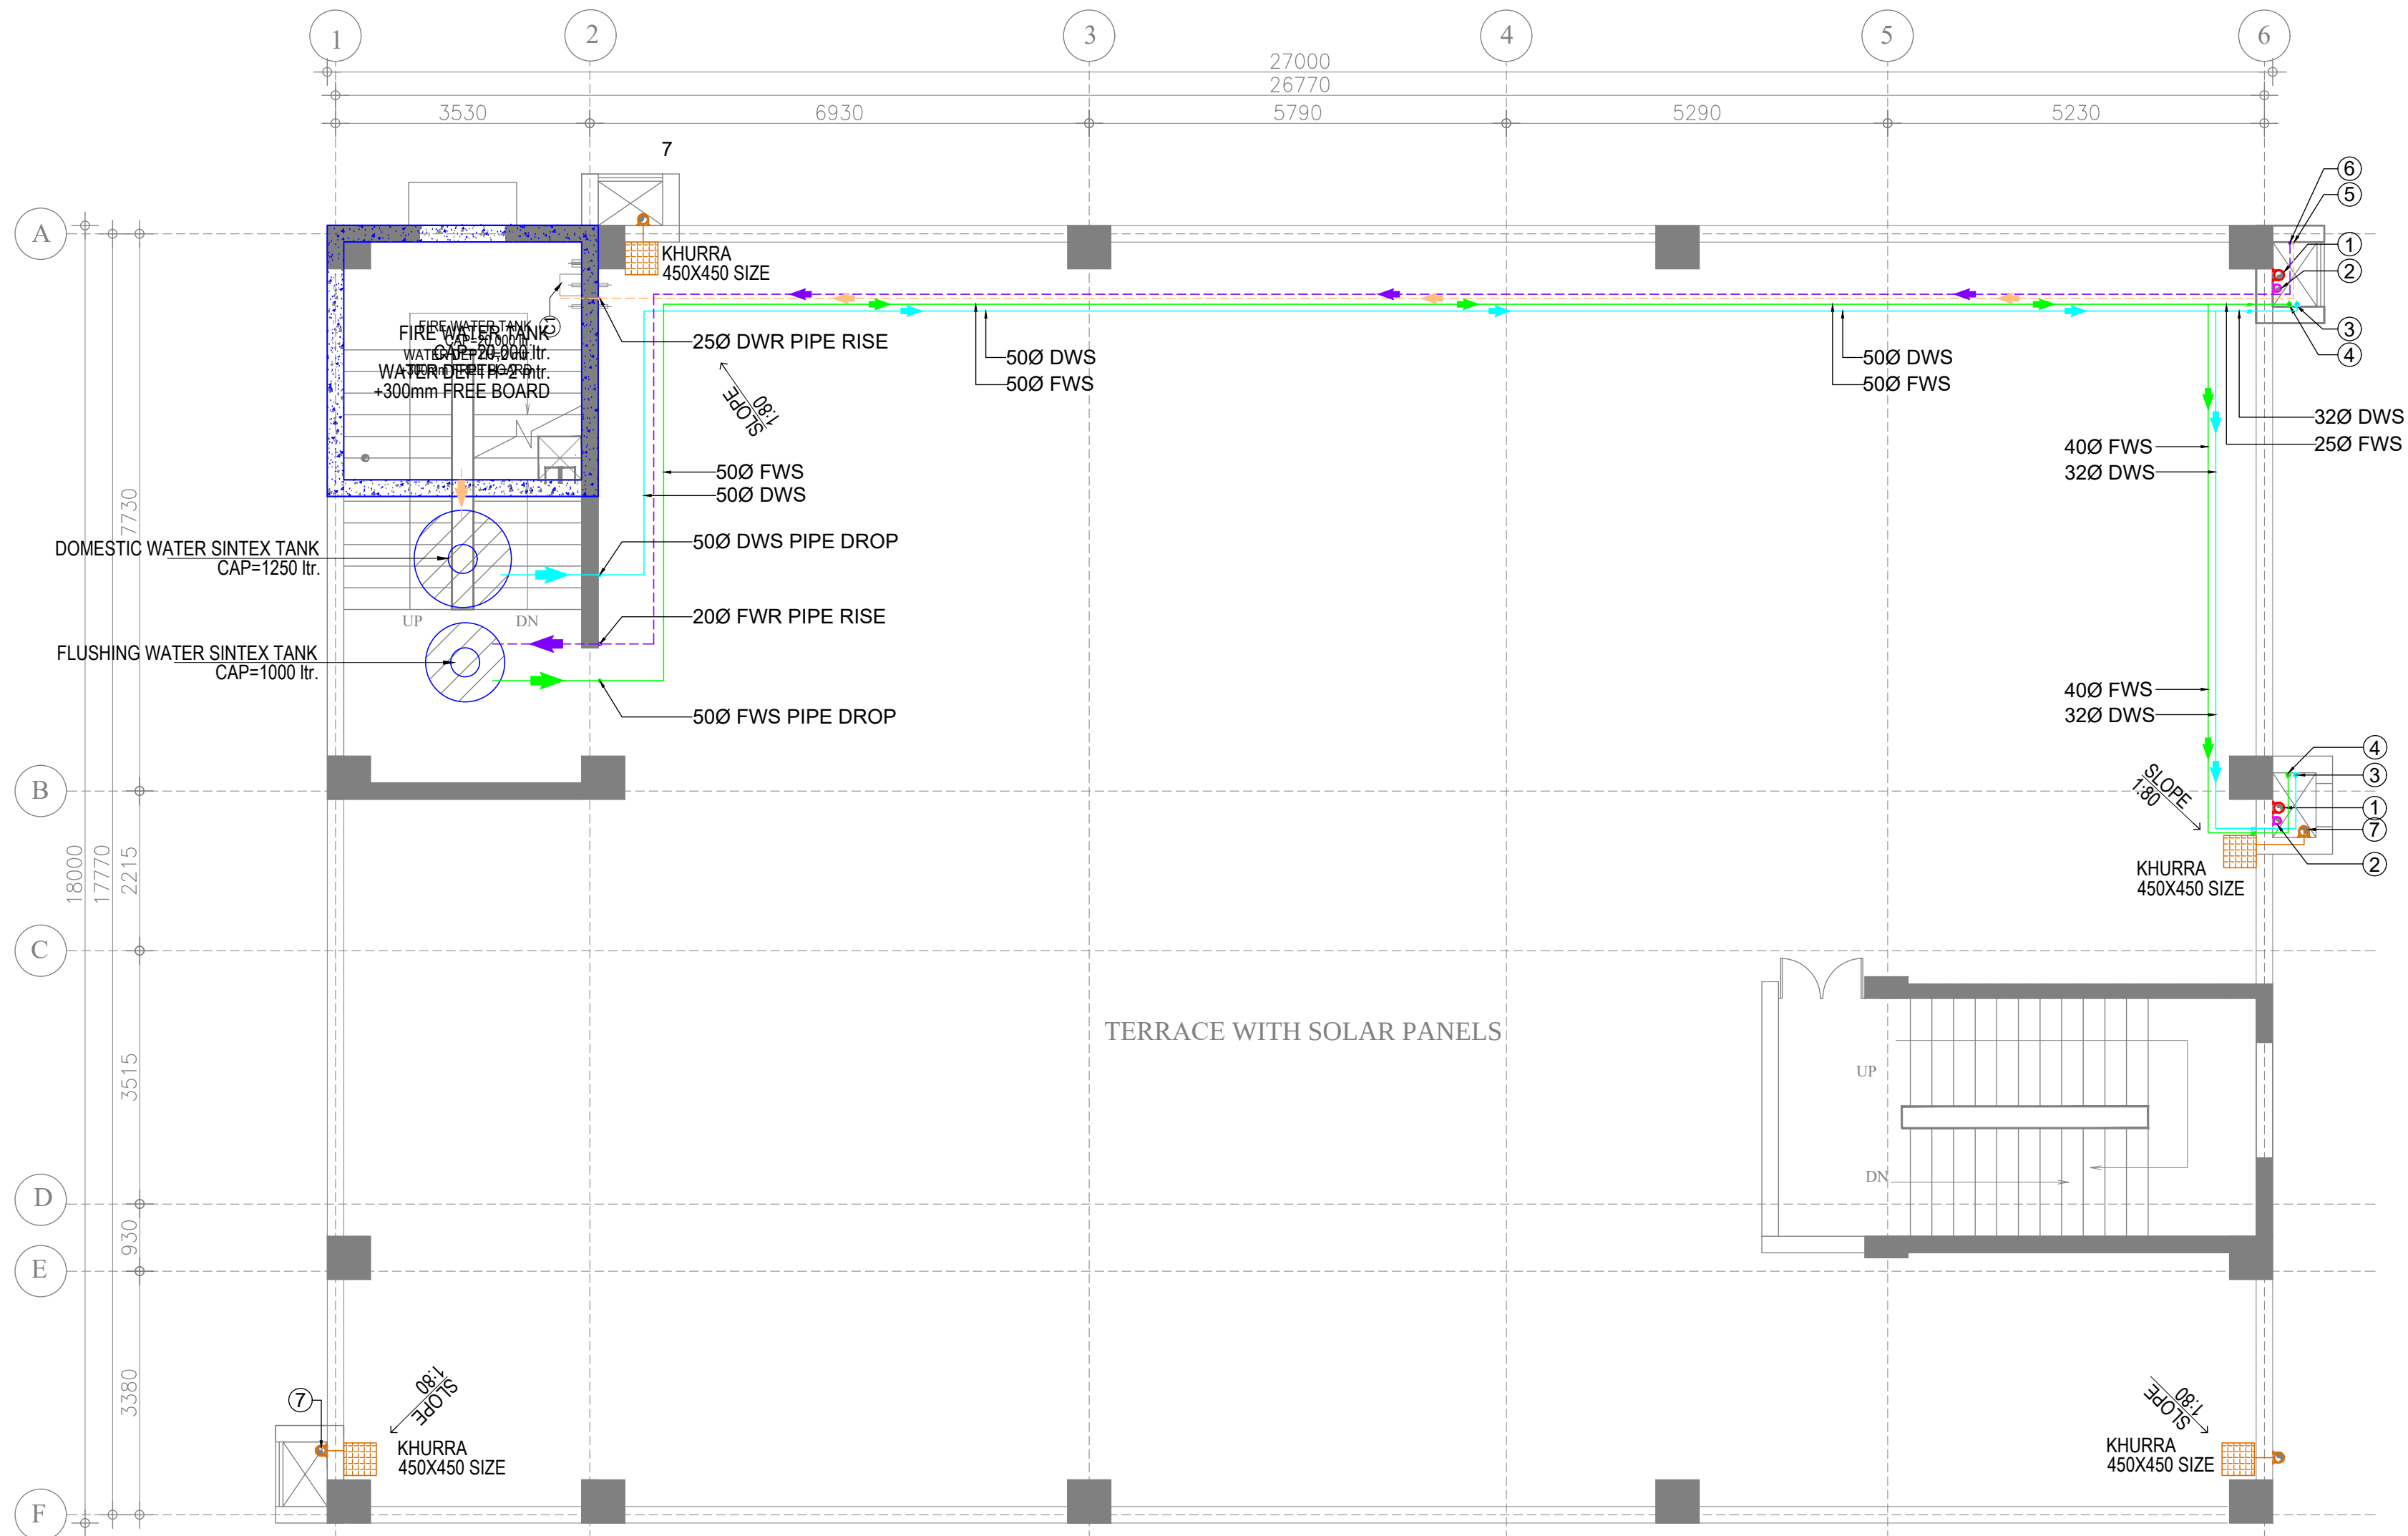

PLUMBING LEGENDS:-		
1. 100Ø uPVC SOIL PIPE	①	🔴
2. 100Ø uPVC WASTE PIPE	②	🟡
3. DOMESTIC WATER SUPPLY PIPE	③	🟢
4. FLUSHING WATER SUPPLY PIPE	④	🟢
5. DOMESTIC WATER RISER PIPE	⑤	🟡
6. FLUSHING WATER RISER PIPE	⑥	🟡
7. 150Ø uPVC RAIN WATER PIPE	⑦	🟡
8. FLOOR TRAP	FT	🔵
9. FLOOR DRAIN	FD	🔵
10. DRAIN POINT	DP	🔵
11. URINAL TRAP	UT	🔴
12. FLOOR CLEAN OUT PLUG	FCO	🔴
13. CEILING CLEAN OUT PLUG	COP	🔴
14. uPVC SOIL PIPE LINE		—
15. uPVC WASTE PIPE LINE		—
16. 150x150 FLOOR CUTOUT FOR FT, WC, UT		🔵
17. 125x125 FLOOR CUTOUT FOR FD		🔵

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

CLIENT



CONSULTANT



JOB TITLE

BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE

COMMUNITY CENTRE, TERRACE
PLAN PLUMBING



SCALE

DATE



DRG. NO.

NTS

JULY 2025

RITES/BLD/DR/TEN/419

COMMUNITY CENTRE

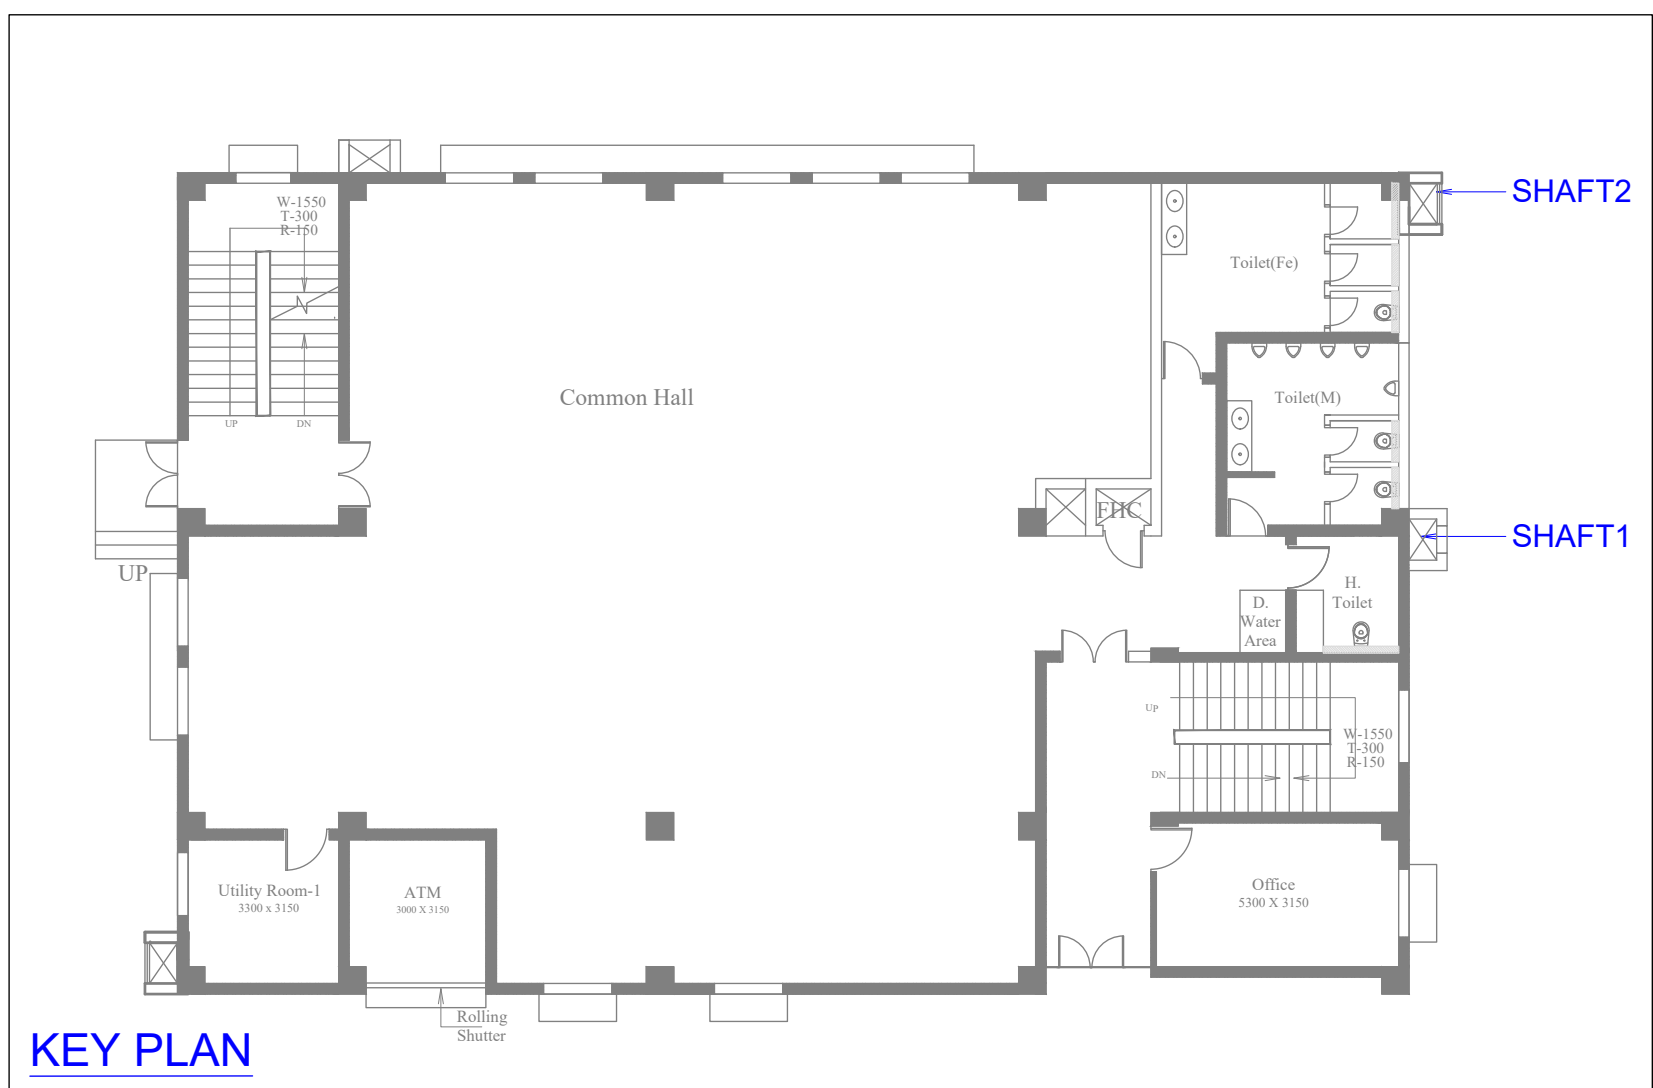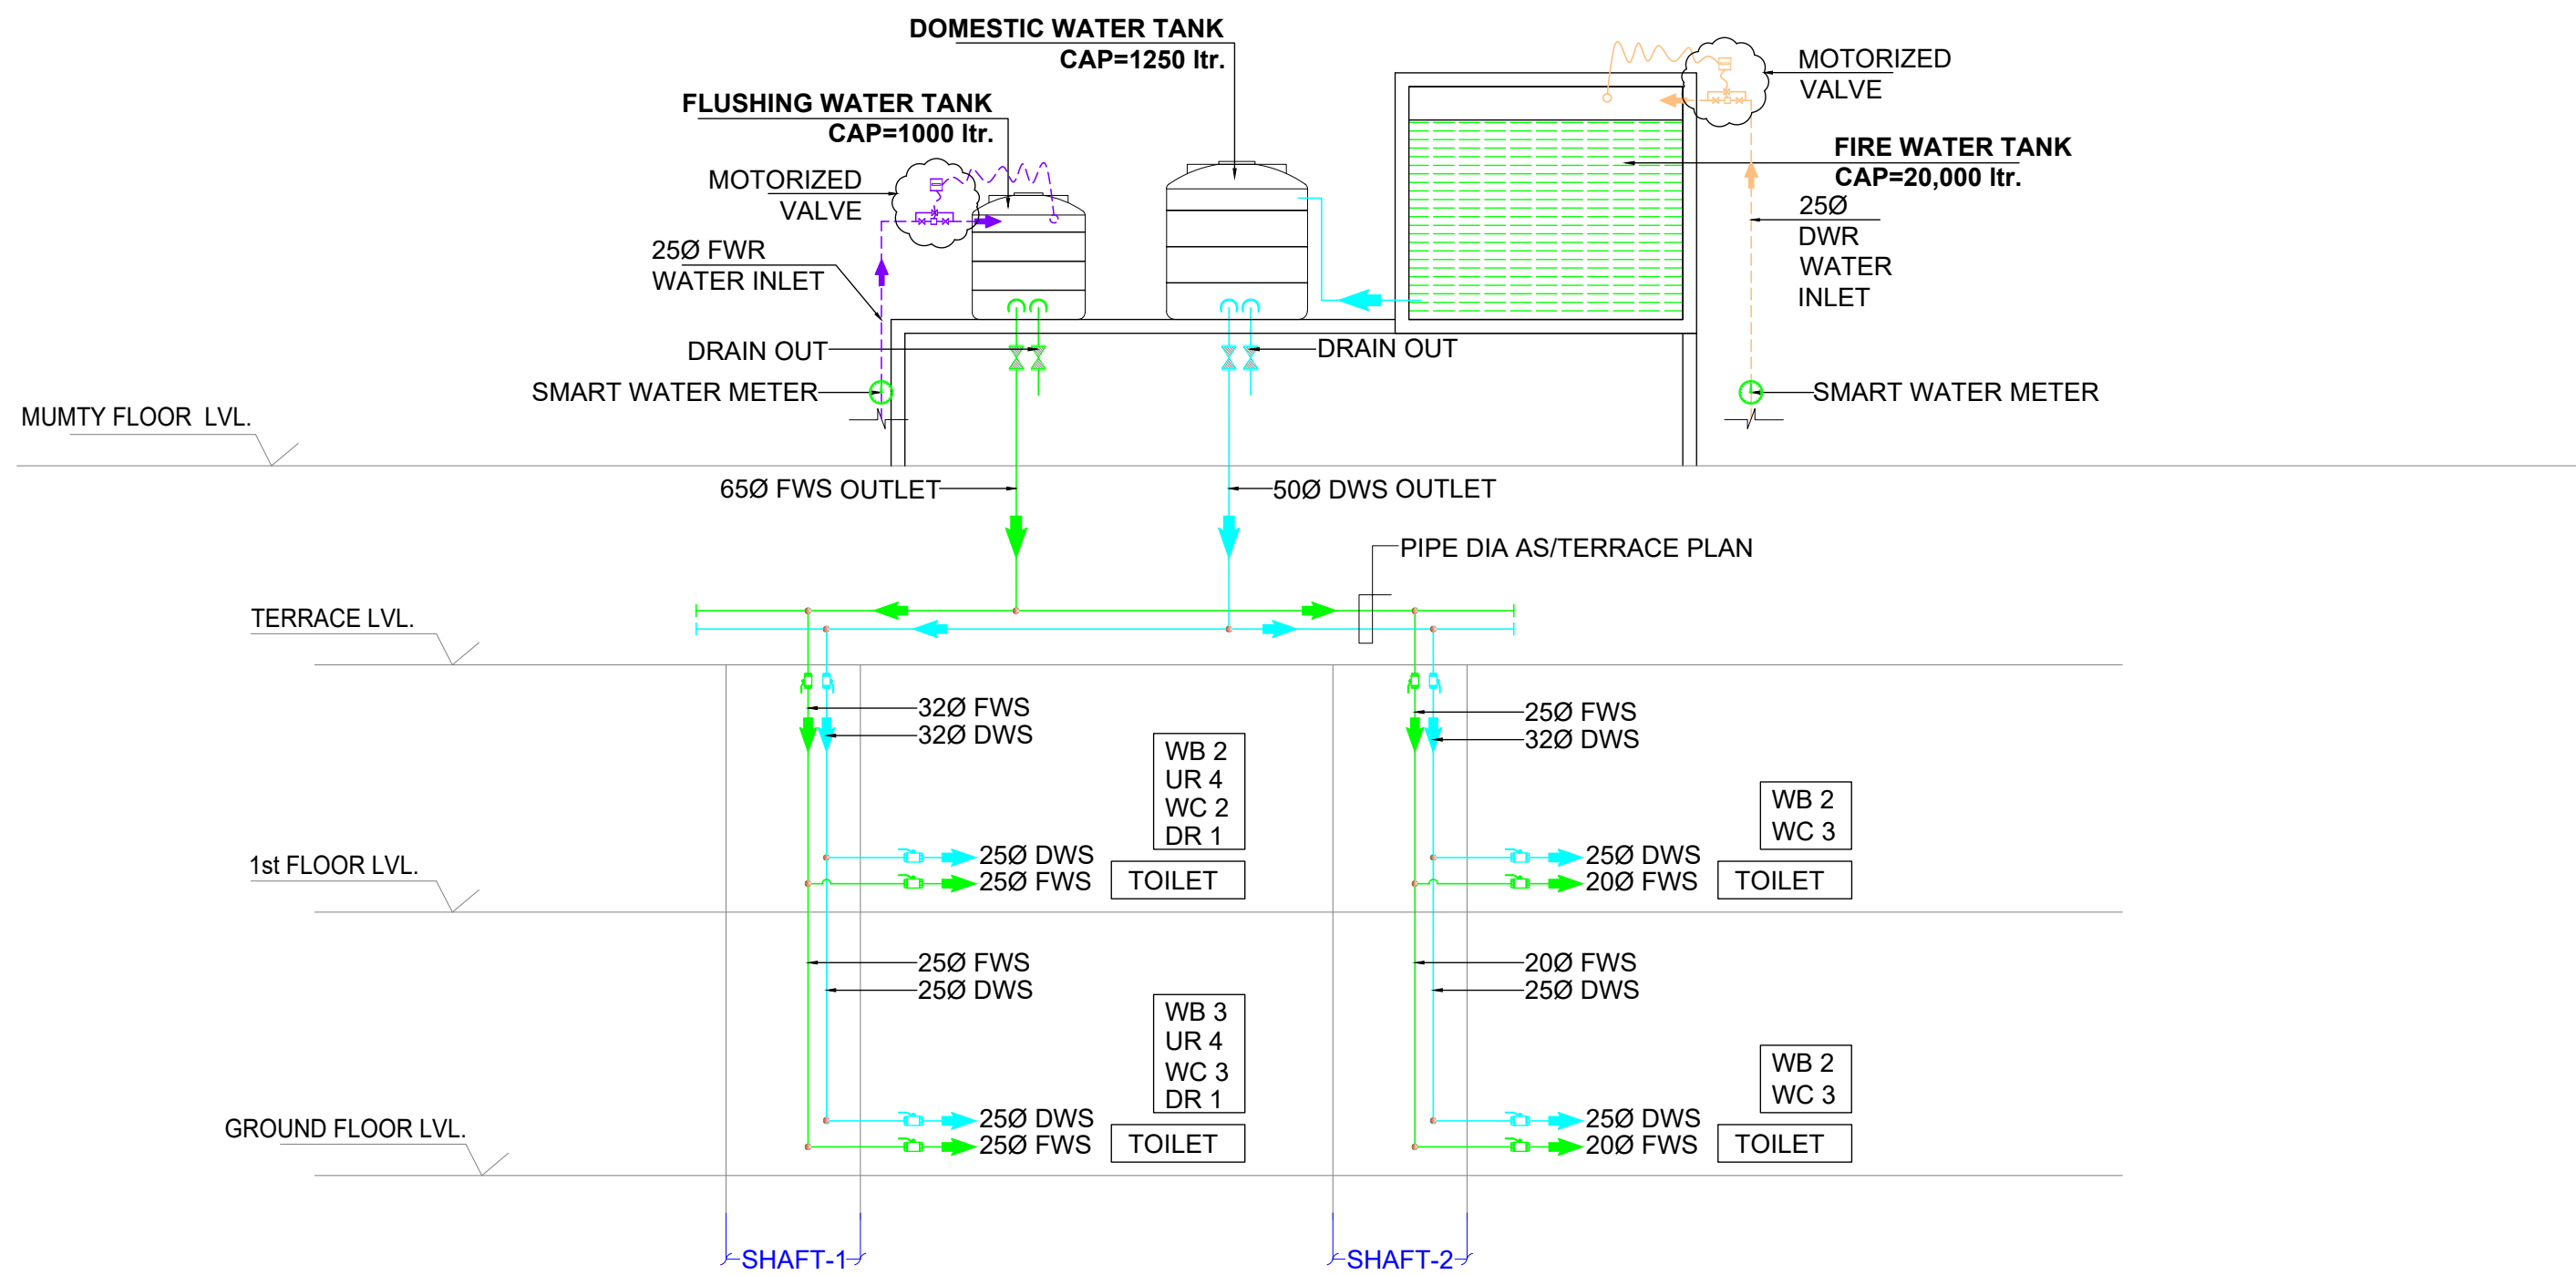

PLUMBING LEGENDS:-		
1.	DOMESTIC WATER SUPPLY PIPE (DWS)	
2.	FLUSHING WATER SUPPLY PIPE (FWS)	
3.	DOMESTIC WATER RISER PIPE (DWR)	
4.	FLUSHING WATER RISER PIPE (FWR)	
5.	BALL VALVE	
6.	FLOW DIRECTION	

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
 OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
 RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email: -info@pkv.co.in

JOB TITLE
**BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE
**COMMUNITY CENTRE,
WATER SUPPLY SCHEMATIC**

SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/DR/TEN/420

- PLUMBING NOTES:-
1. ALL PIPE DIAMETERS ARE IN MM.
 2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 3. MANHOLES SHALL BE CONSTRUCTED AS PER STANDARD DETAILS.
 4. SOIL, WASTE, RAIN & VENT PIPE WORK :-
SOIL, WASTE & VENT PIPES WORKS SHALL BE CARRIED OUT IN uPVC PIPES CLASS "B" SOLVENT CEMENT AND FITTINGS CONFORMING TO IS : 13592
 5. ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:50 AND NOT STEEPER THAN 1:10 UNLESS SPECIFIED OTHERWISE
 6. WATER SUPPLY PIPE WORK :-
WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC (SDR-11) CONFORMING TO ASTM STANDARDS. ALL PIPE FITTINGS SHALL BE OF CPVC OF CLASS SAME AS PIPE CONFORMING TO ASTM STANDARDS SUITABLE FOR SOLVENT CEMENT JOINTS AS PER MFR.
 7. NO PIPE WORK SHALL BE CONCEALED IN WALLS OR BURIED IN FLOORS WITHOUT BEING SUBJECTED TO WATER TESTING AS PER THE DIRECTION OF THE SITE ENGINEER.
 8. ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR
 9. WATER INLETS AND WASTE OUTLETS FROM SANITARY WARE SHALL BE ARRANGED TO SUIT REQUIREMENTS OF SELECTED MAKES AND MODELS.
 10. ALL STONEWARE PIPES SHALL BE ENCASED IN 150 MM. THICK 1:5:10 CEMENT CONCRETE ALL AROUND.
 11. FLOOR TRAPS:-
ALL FLOOR TRAPS SHALL BE FORMED OF 100X100 MM. DIA 'P' TRAP WITH 100 MM. DIA uPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
 12. FLOOR DRAIN:-
DRAIN POINTS SHALL BE FORMED OF 75X75 MM. DIA uPVC ELBOW WITH 75 MM. DIA C.P. GRATING WITH FRAME.

PIPE SCHEDULE	
DESCRIPTION	SIZE
PIPE DIA FROM FD TO FT	63 OD uPVC PIPE
PIPE DIA FROM WB TO FT	40 OD uPVC PIPE
PIPE DIA FROM URINAL TO UT	40 OD uPVC PIPE
PIPE DIA FROM UT TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA FROM WC TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA FROM FT TO HORIZONTAL STACK	100Ø uPVC PIPE
PIPE DIA HORIZONTAL STACK TO VERTICAL STACK	100Ø uPVC PIPE
PIPE DIA FROM WC TO MANHOLE	100Ø uPVC PIPE
PIPE DIA FROM FT TO GULLY TRAP	100Ø uPVC PIPE
PIPE DIA VERTICAL STACK TO GULLY TRAP	100Ø uPVC PIPE
PIPE DIA VERTICAL STACK TO MANHOLE	100Ø uPVC PIPE

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
 **OIL INDIA LIMITED**
(A Govt. of India Enterprise)

CONSULTANT
 **MITES**
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)


MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.

 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in


JOB TITLE
**BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE
GUARD ROOM PLUMBING LAYOUT

SCALE	DATE	DRG. NO.
NTS	JULY 2025	MITES/BLD/DR/TEN/421

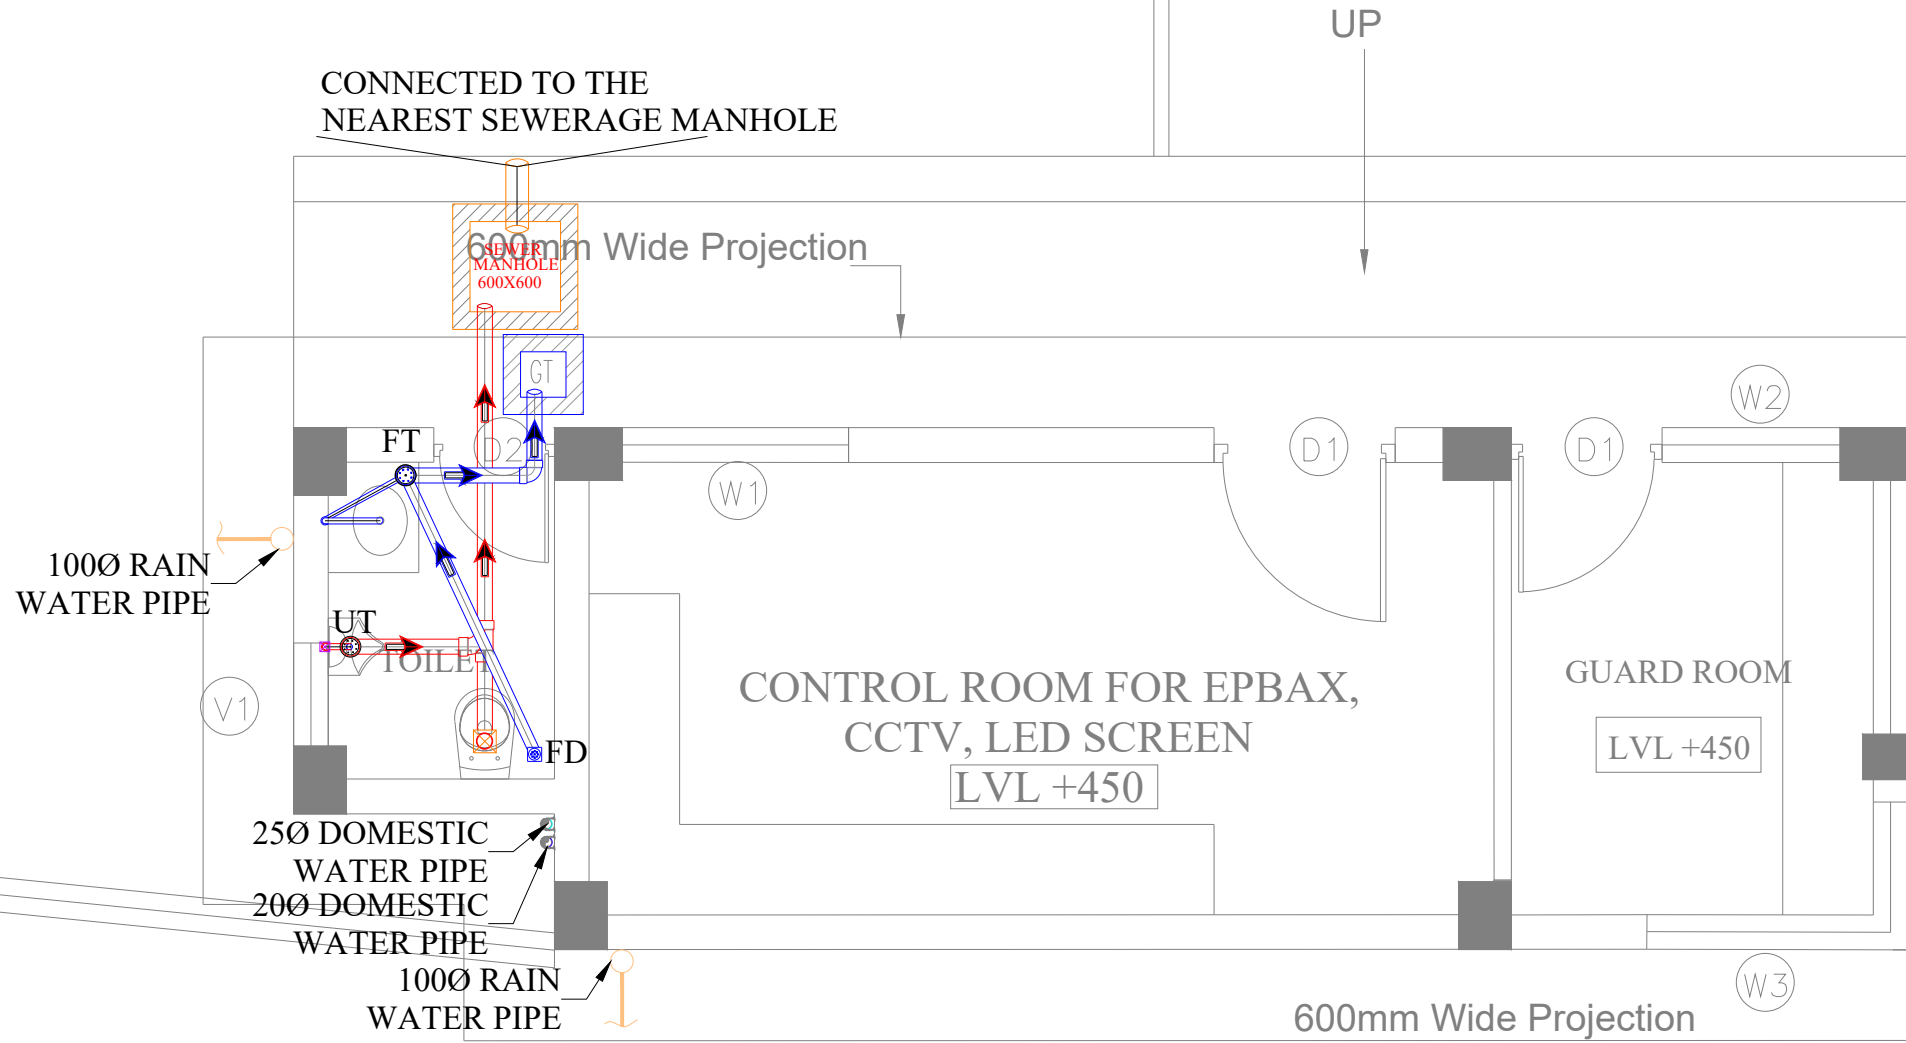


GROUND FLOOR TOILET DRAINAGE LAYOUT

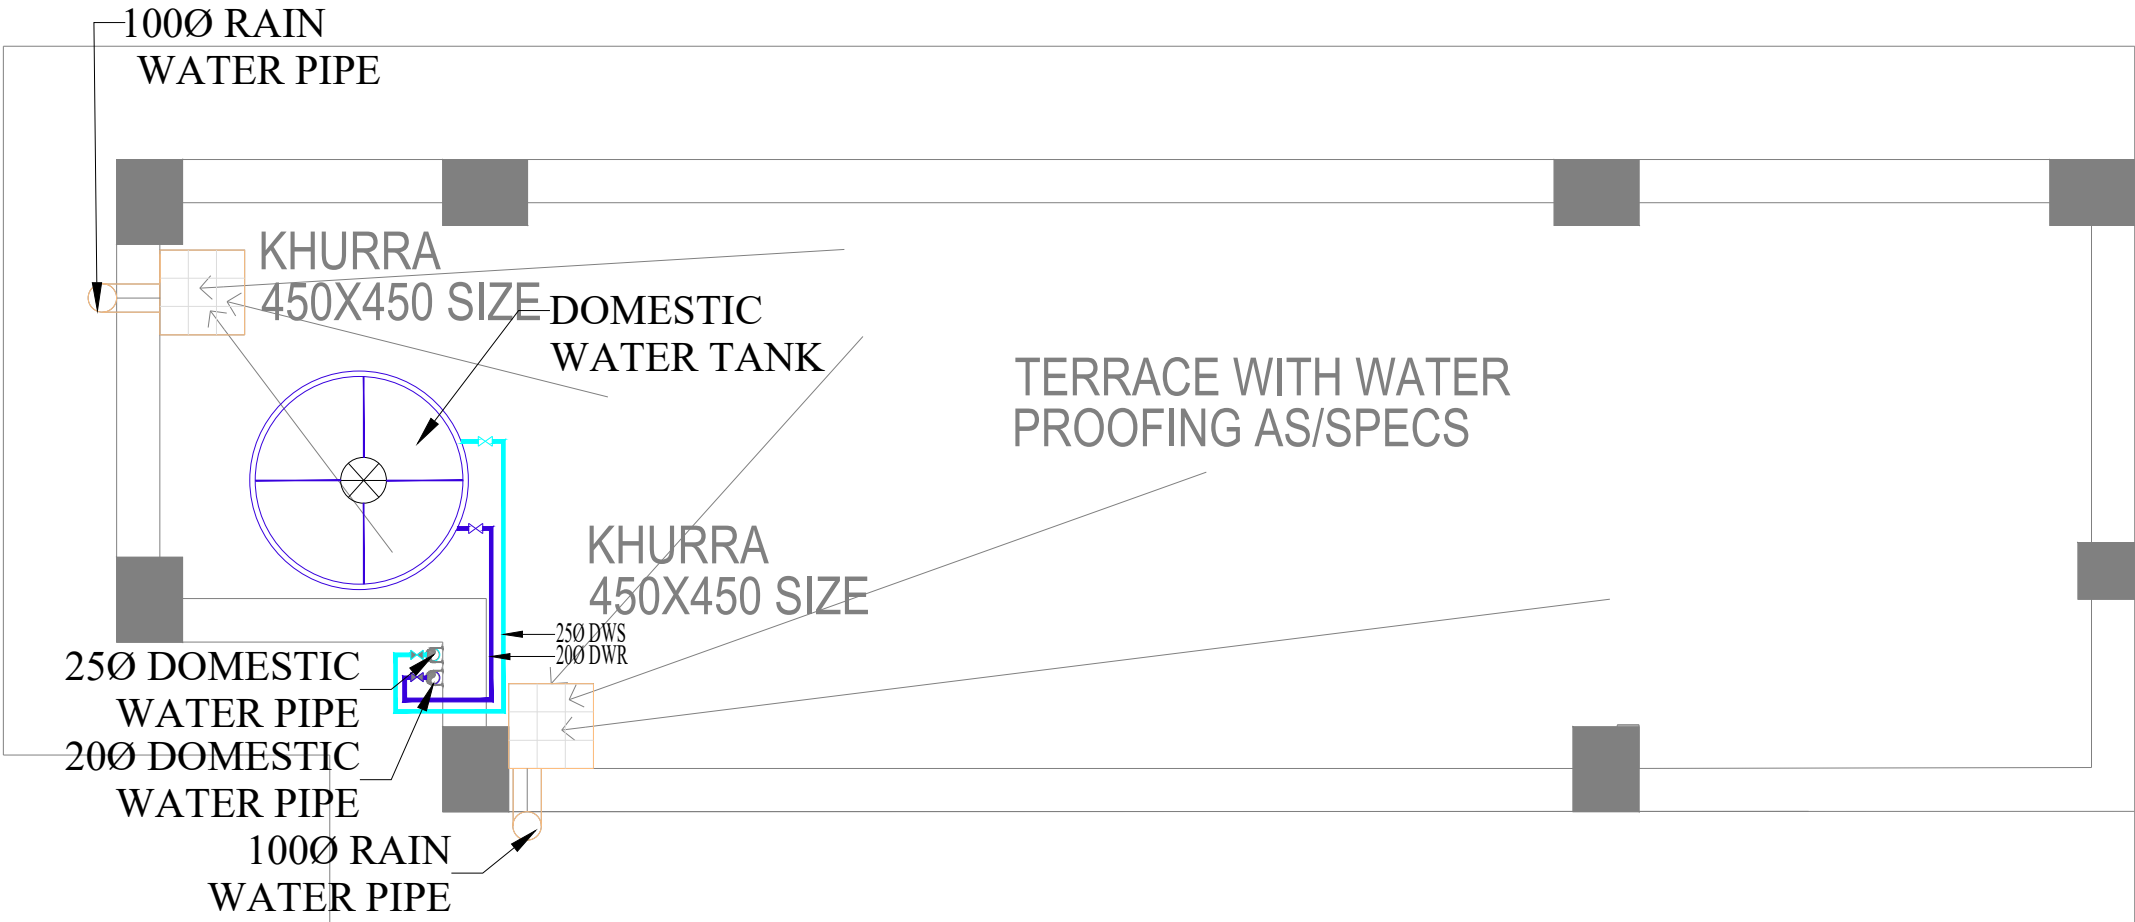




TERRACE PLAN PLUMBING LAYOUT

PLUMBING LEGENDS:-	
1. FLOOR TRAP	FT
2. FLOOR DRAIN	FD
3. URINAL TRAP	UT
4. uPVC SOIL PIPE LINE	
5. uPVC WASTE PIPE LINE	

DETAILS OF SANITARY FIXTURES TO BE INSTALLED			
SYMBOL DESCRIPTION	*MOUNTING HEIGHT (MM.)*	*MOUNTING HEIGHT (MM.)*	
AG(B)	ANGLE VALVE WITH WALL FLANGE AND CP PIPE FOR BASIN MIXER	450	
AG(C)	ANGLE VALVE WITH WALL FLANGE AND CP PIPE FOR CISTERN	450	
HF	HEALTH FAUCET	450	
	PIPE DROP		
	DOMESTIC WATER SUPPLY(DWS)		
	BALL VALVE		
C(B)	BASIN MIXER	AS/ARCH.	

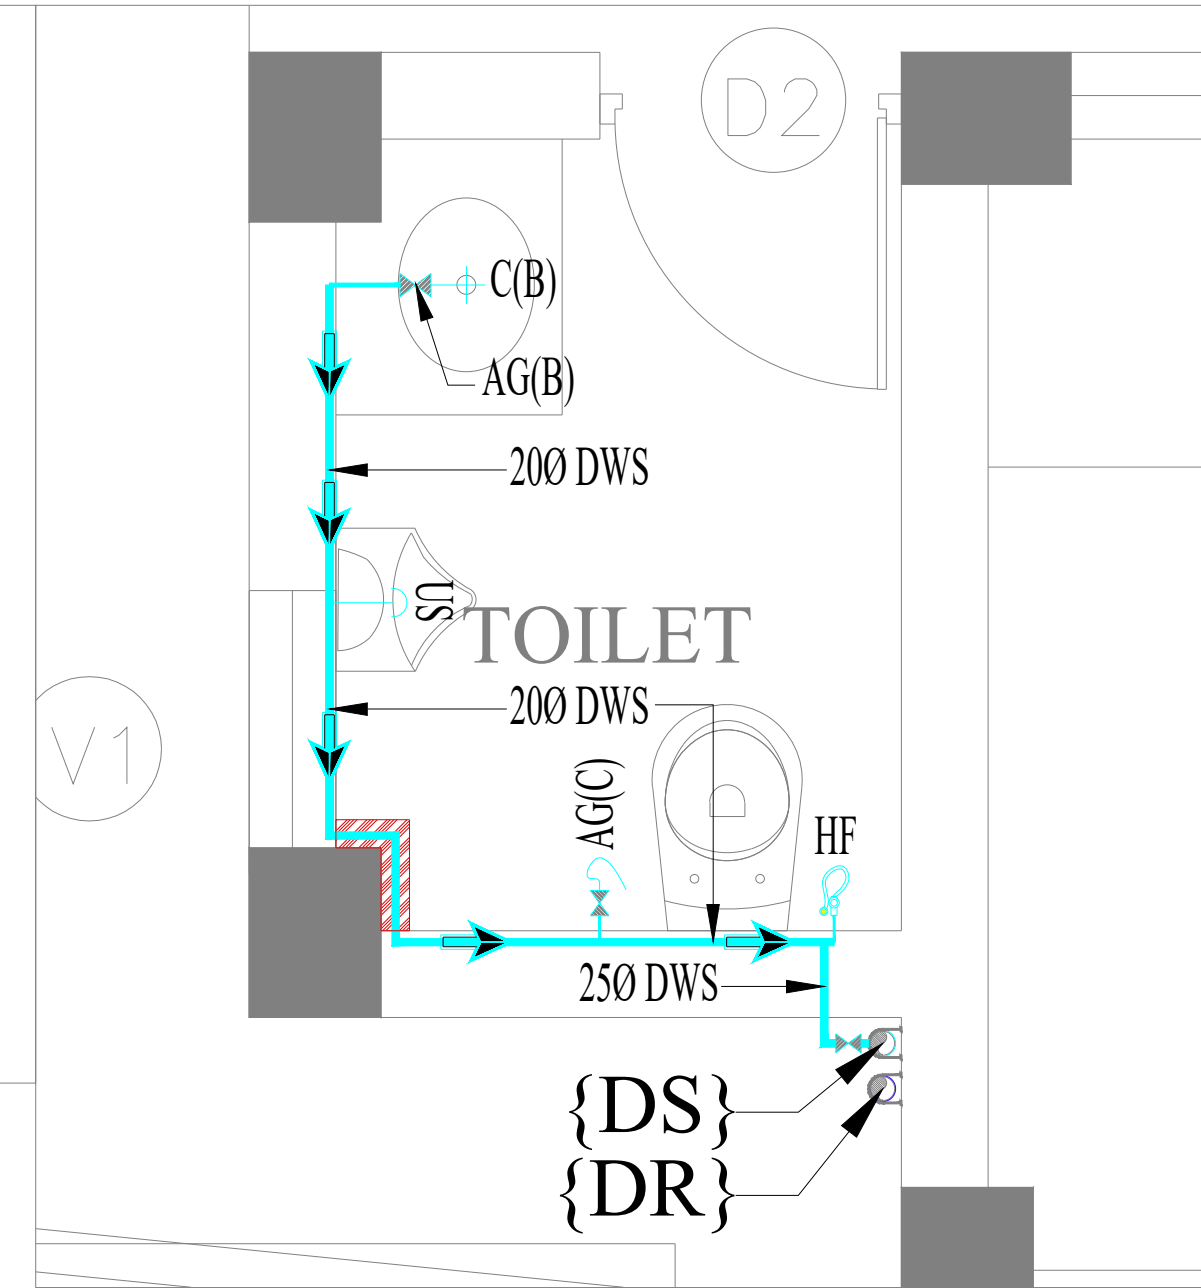

GROUND FLOOR WATER SUPPLY LAYOUT

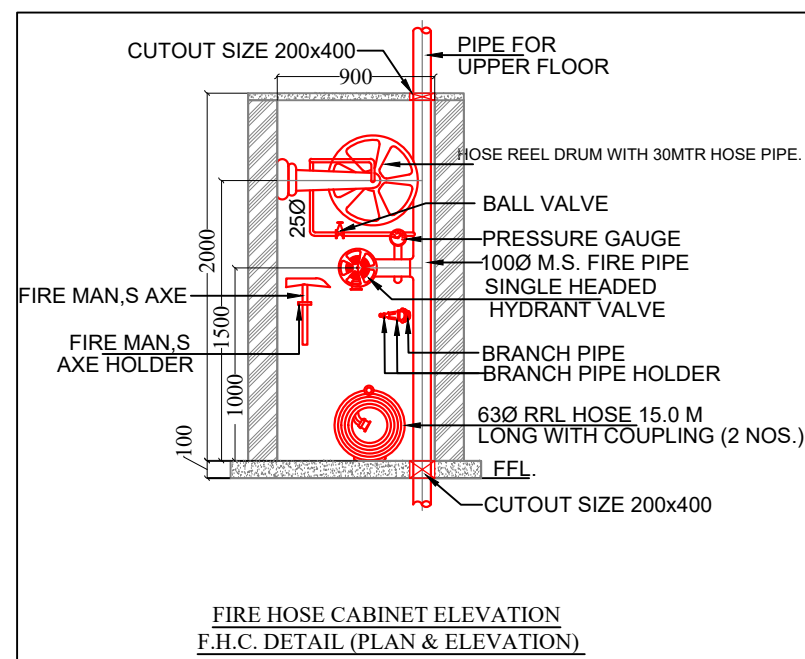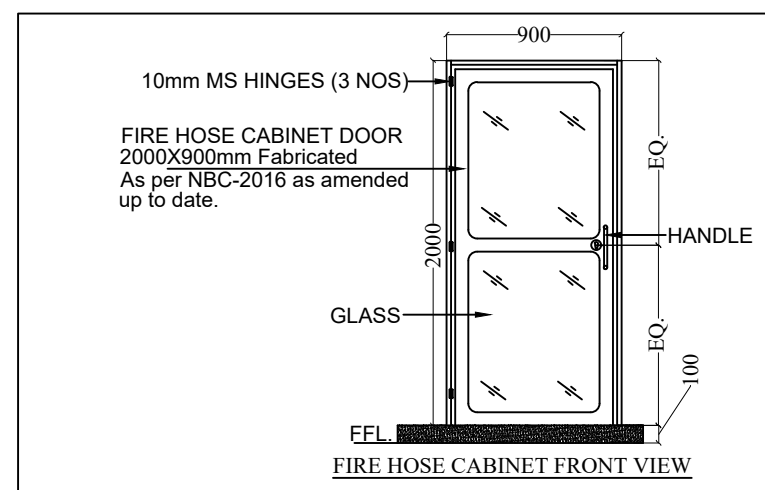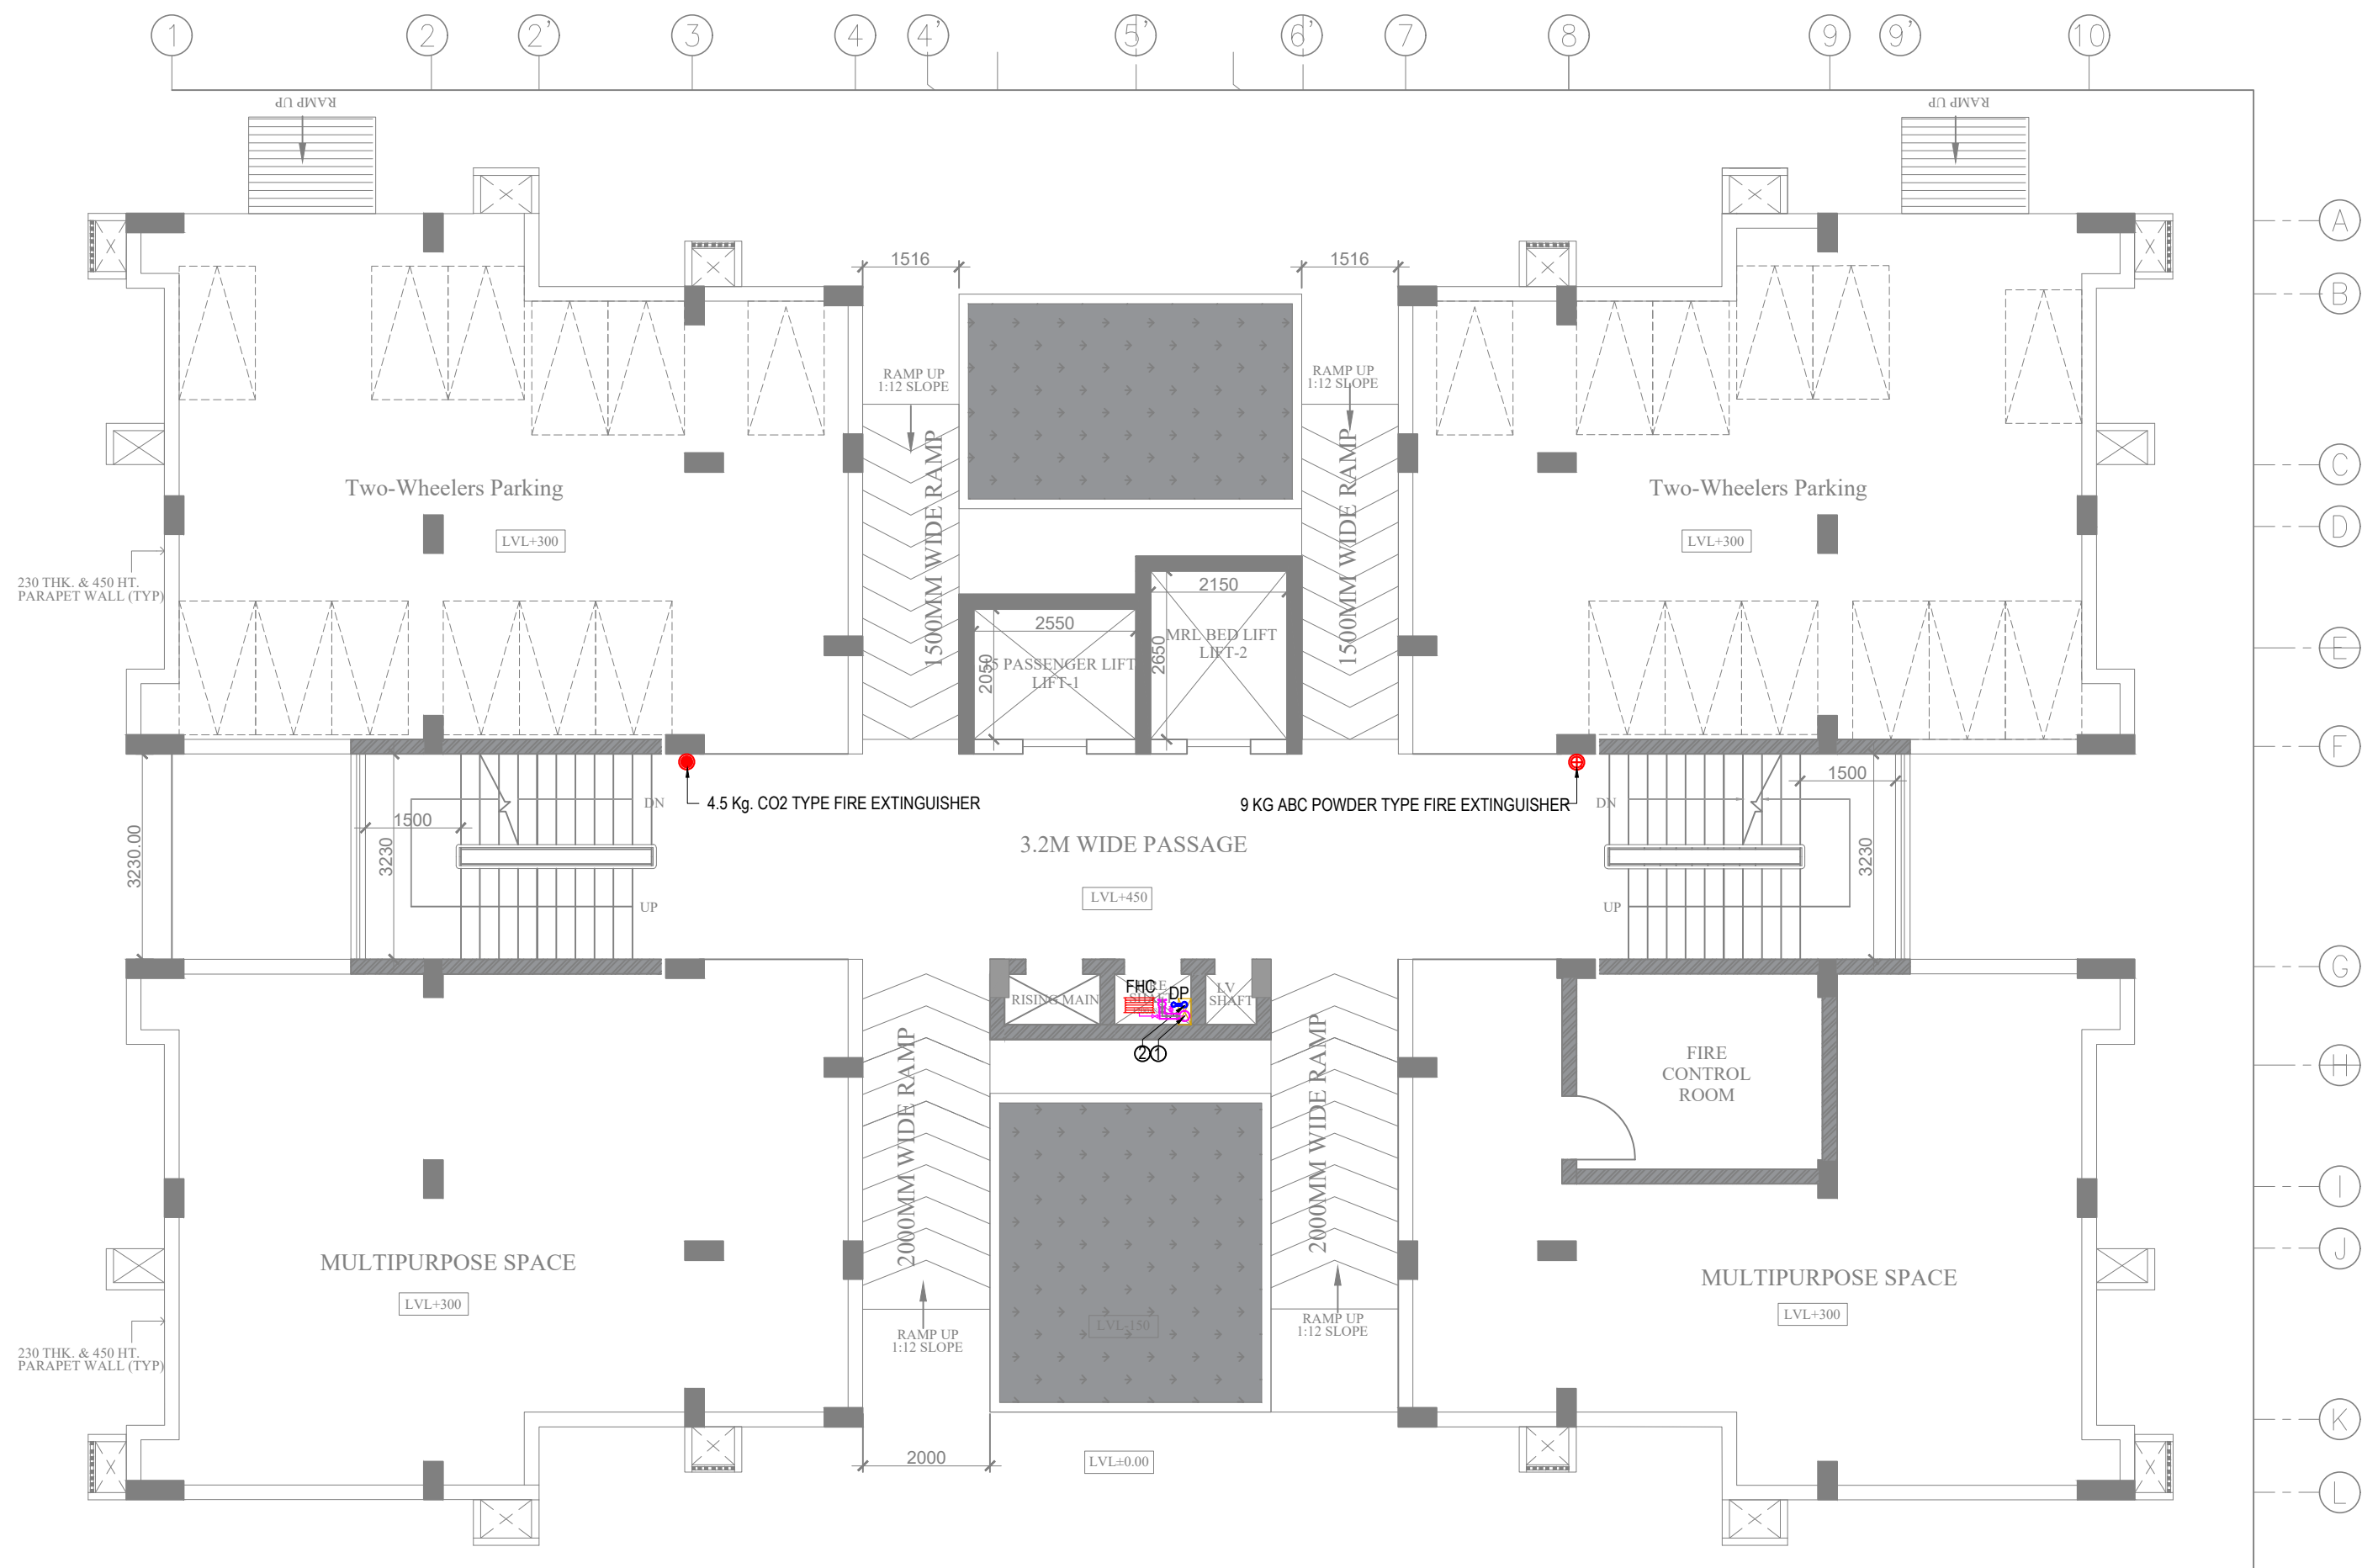

LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	1000 FIRE HYDRANT DOWNCOMER PIPE	①
3.	650 FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	③
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	④
6.	9 KG DCP FIRE EXTINGUISHER	⑤
7.	AIR RELEASE VALVE (ARV)	⑥
8.	LANDING VALVE (LV)	⑦
9.	PRESSURE GAUGE	⑧

NOTE-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT



CONSULTANT



MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE

BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE

HOUSING BLOCK
GROUND FLOOR
FIRE DRAWING

SCALE

DATE




DRG. NO.

NTS

JULY 2025

NTS

RITES/BLD/FF/TEN/501

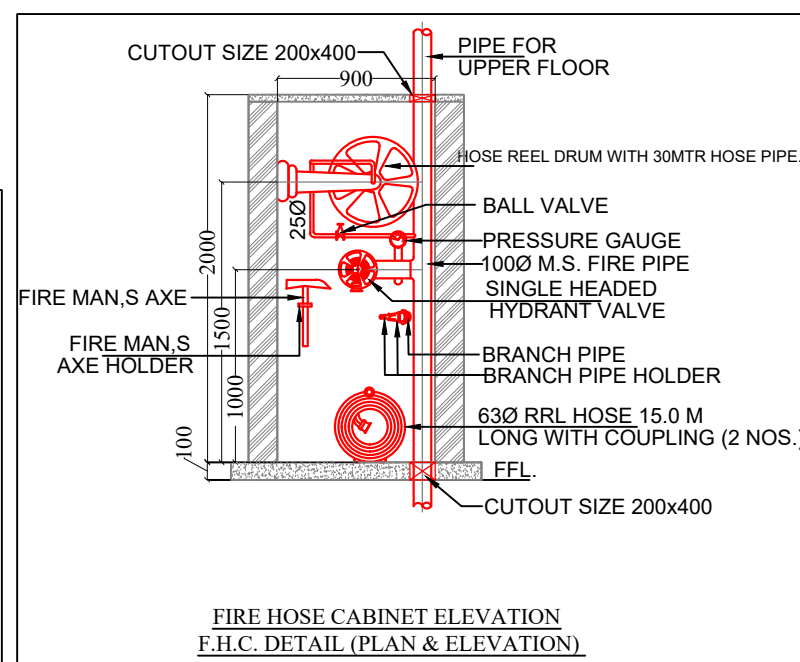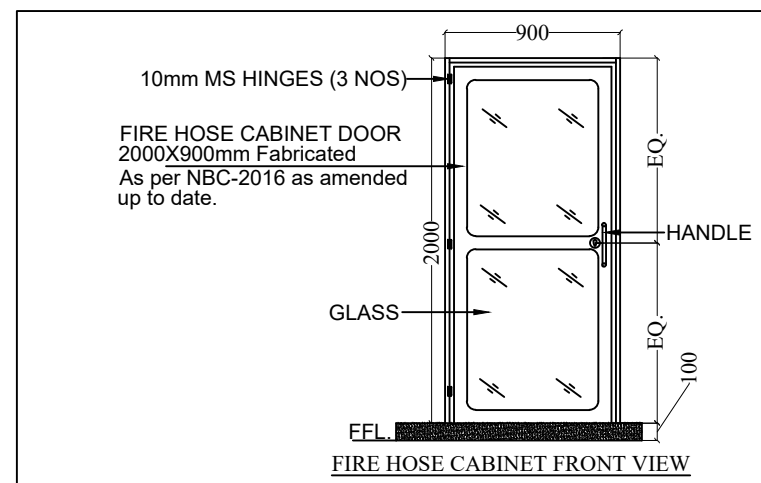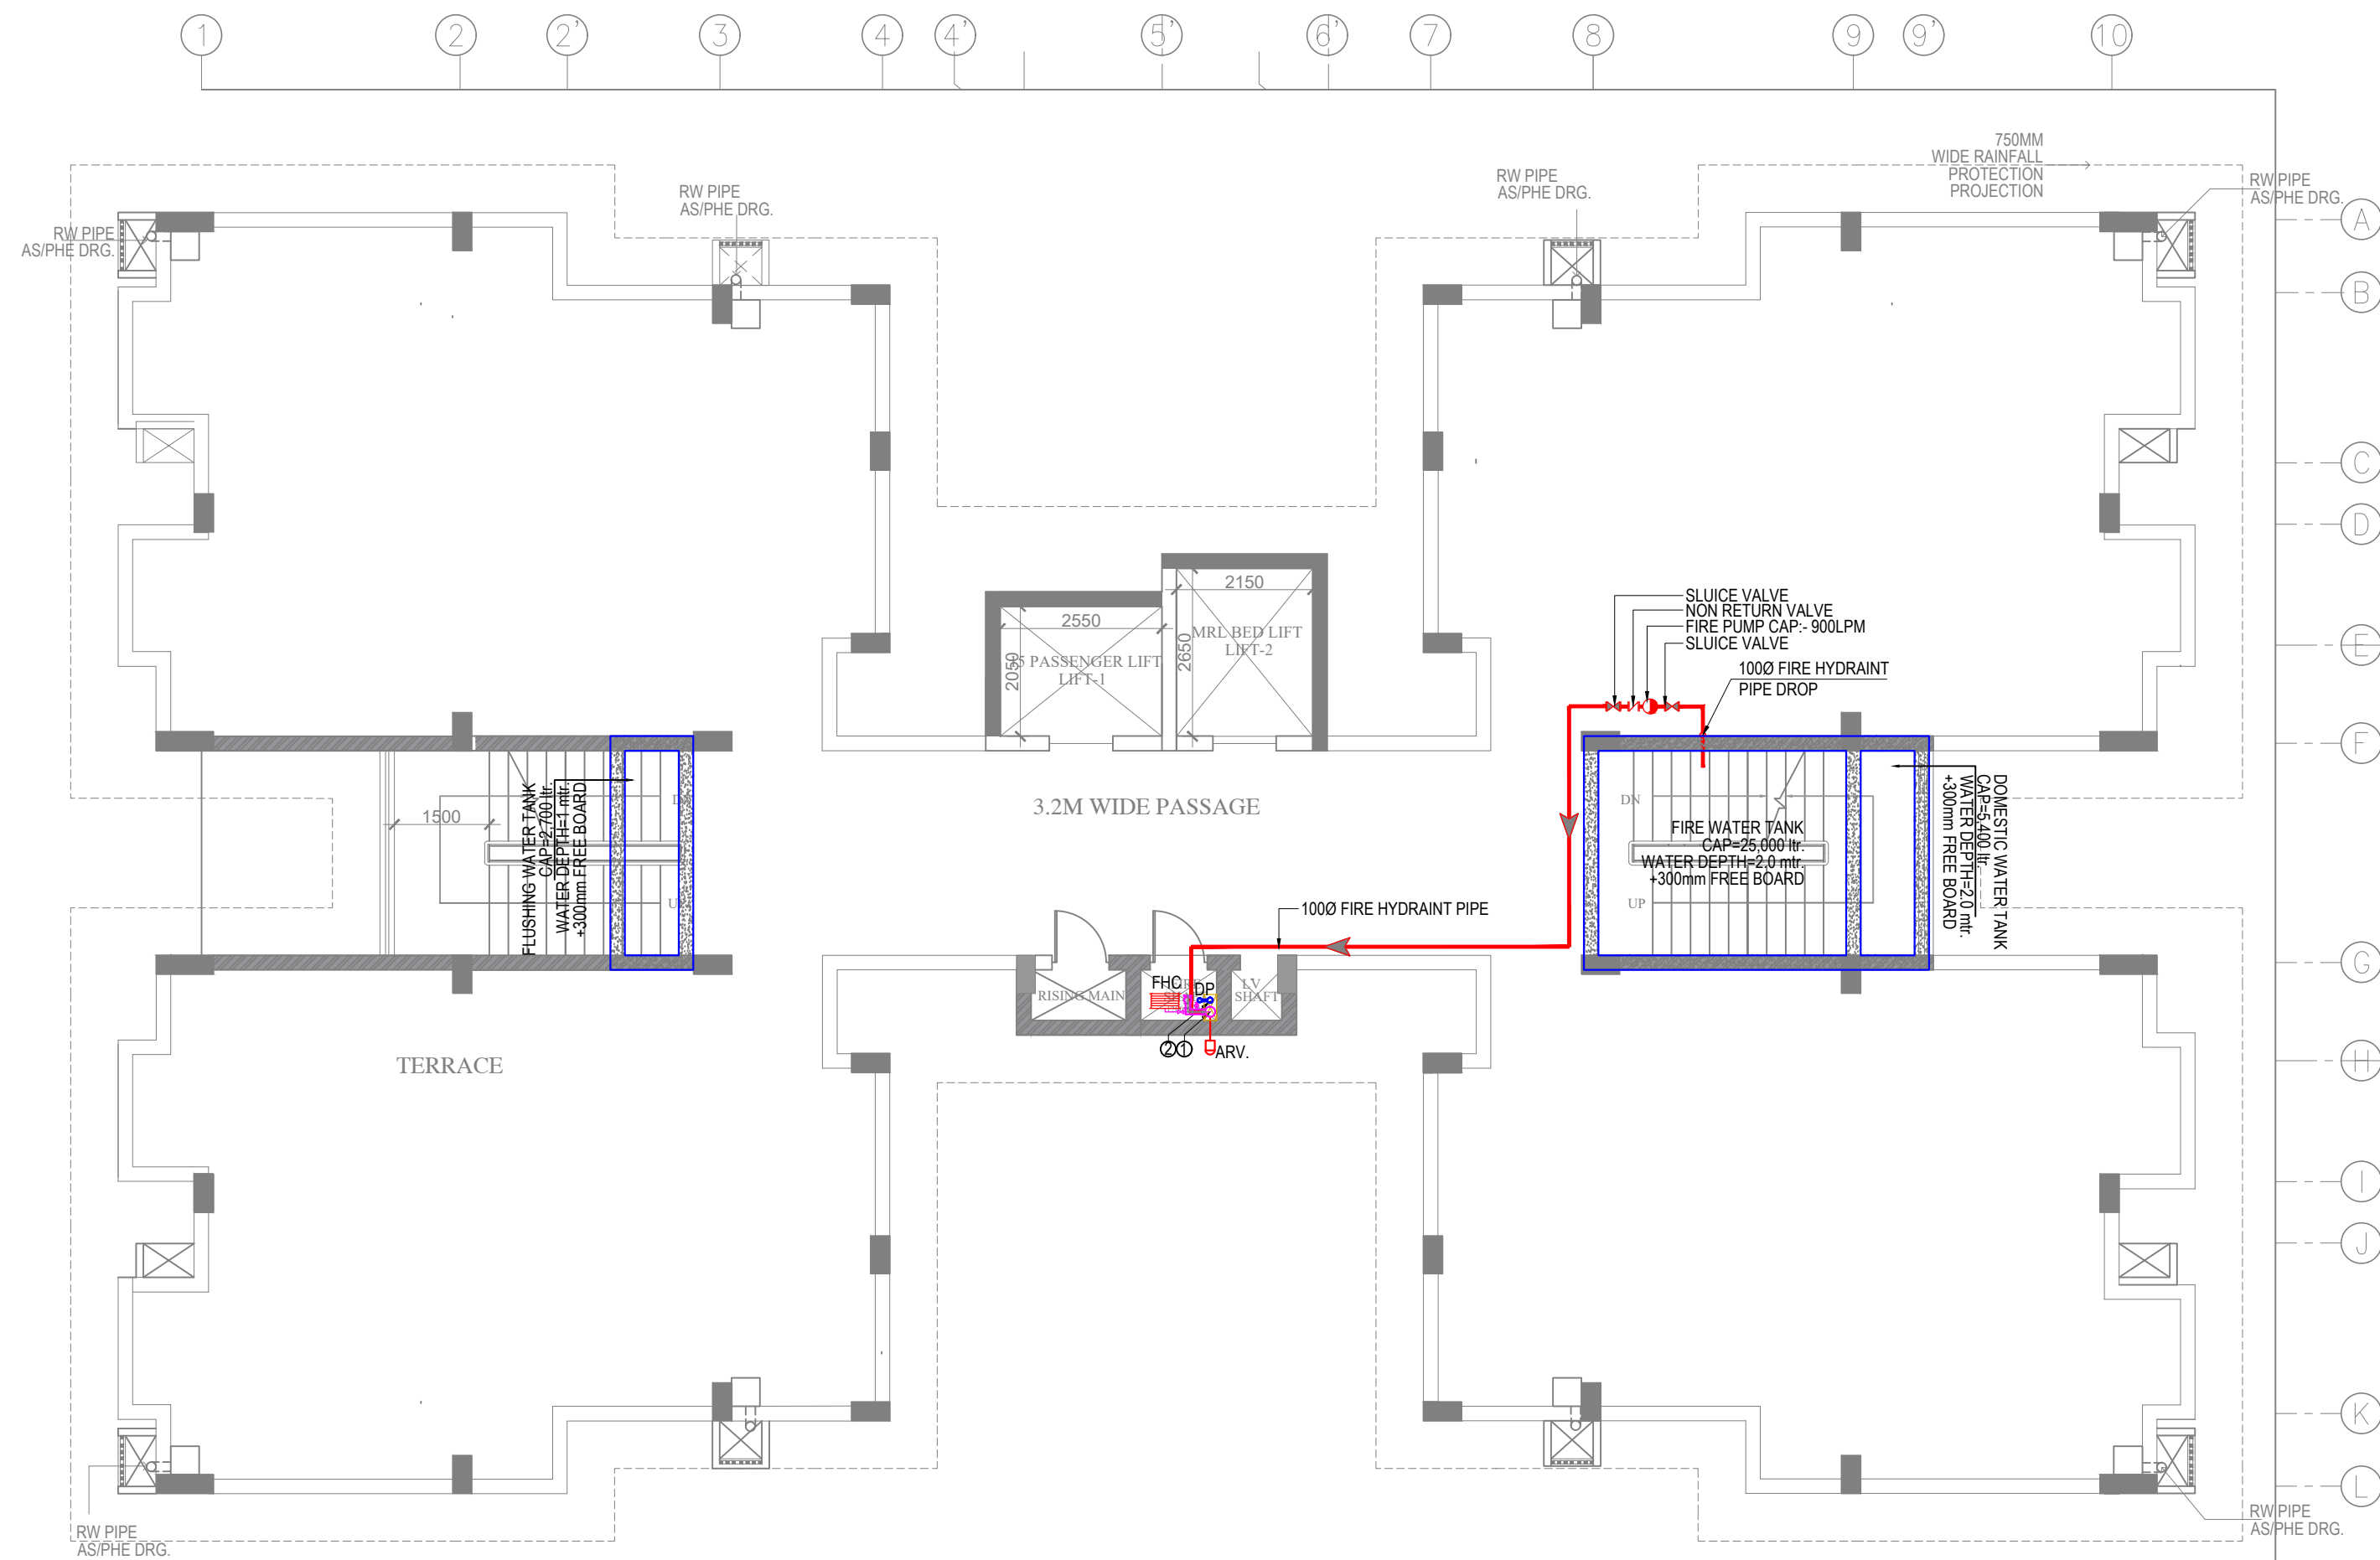

LEGEND:-

S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	1000 FIRE HYDRANT DOWNCOMER PIPE	①
3.	650 FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	⊙
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	⊞
8.	LANDING VALVE (LV)	⊞
9.	PRESSURE GAUGE	⊞

NOTE-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
IRITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
**BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**


DRAWING TITLE
**HOUSING BLOCK
TERRACE FLOOR
FIRE DRAWING**

SCALE
NTS

DATE
JULY 2025

DRG. NO.
RITES/BLD/FF/TEN/503

HOUSING BLOCK

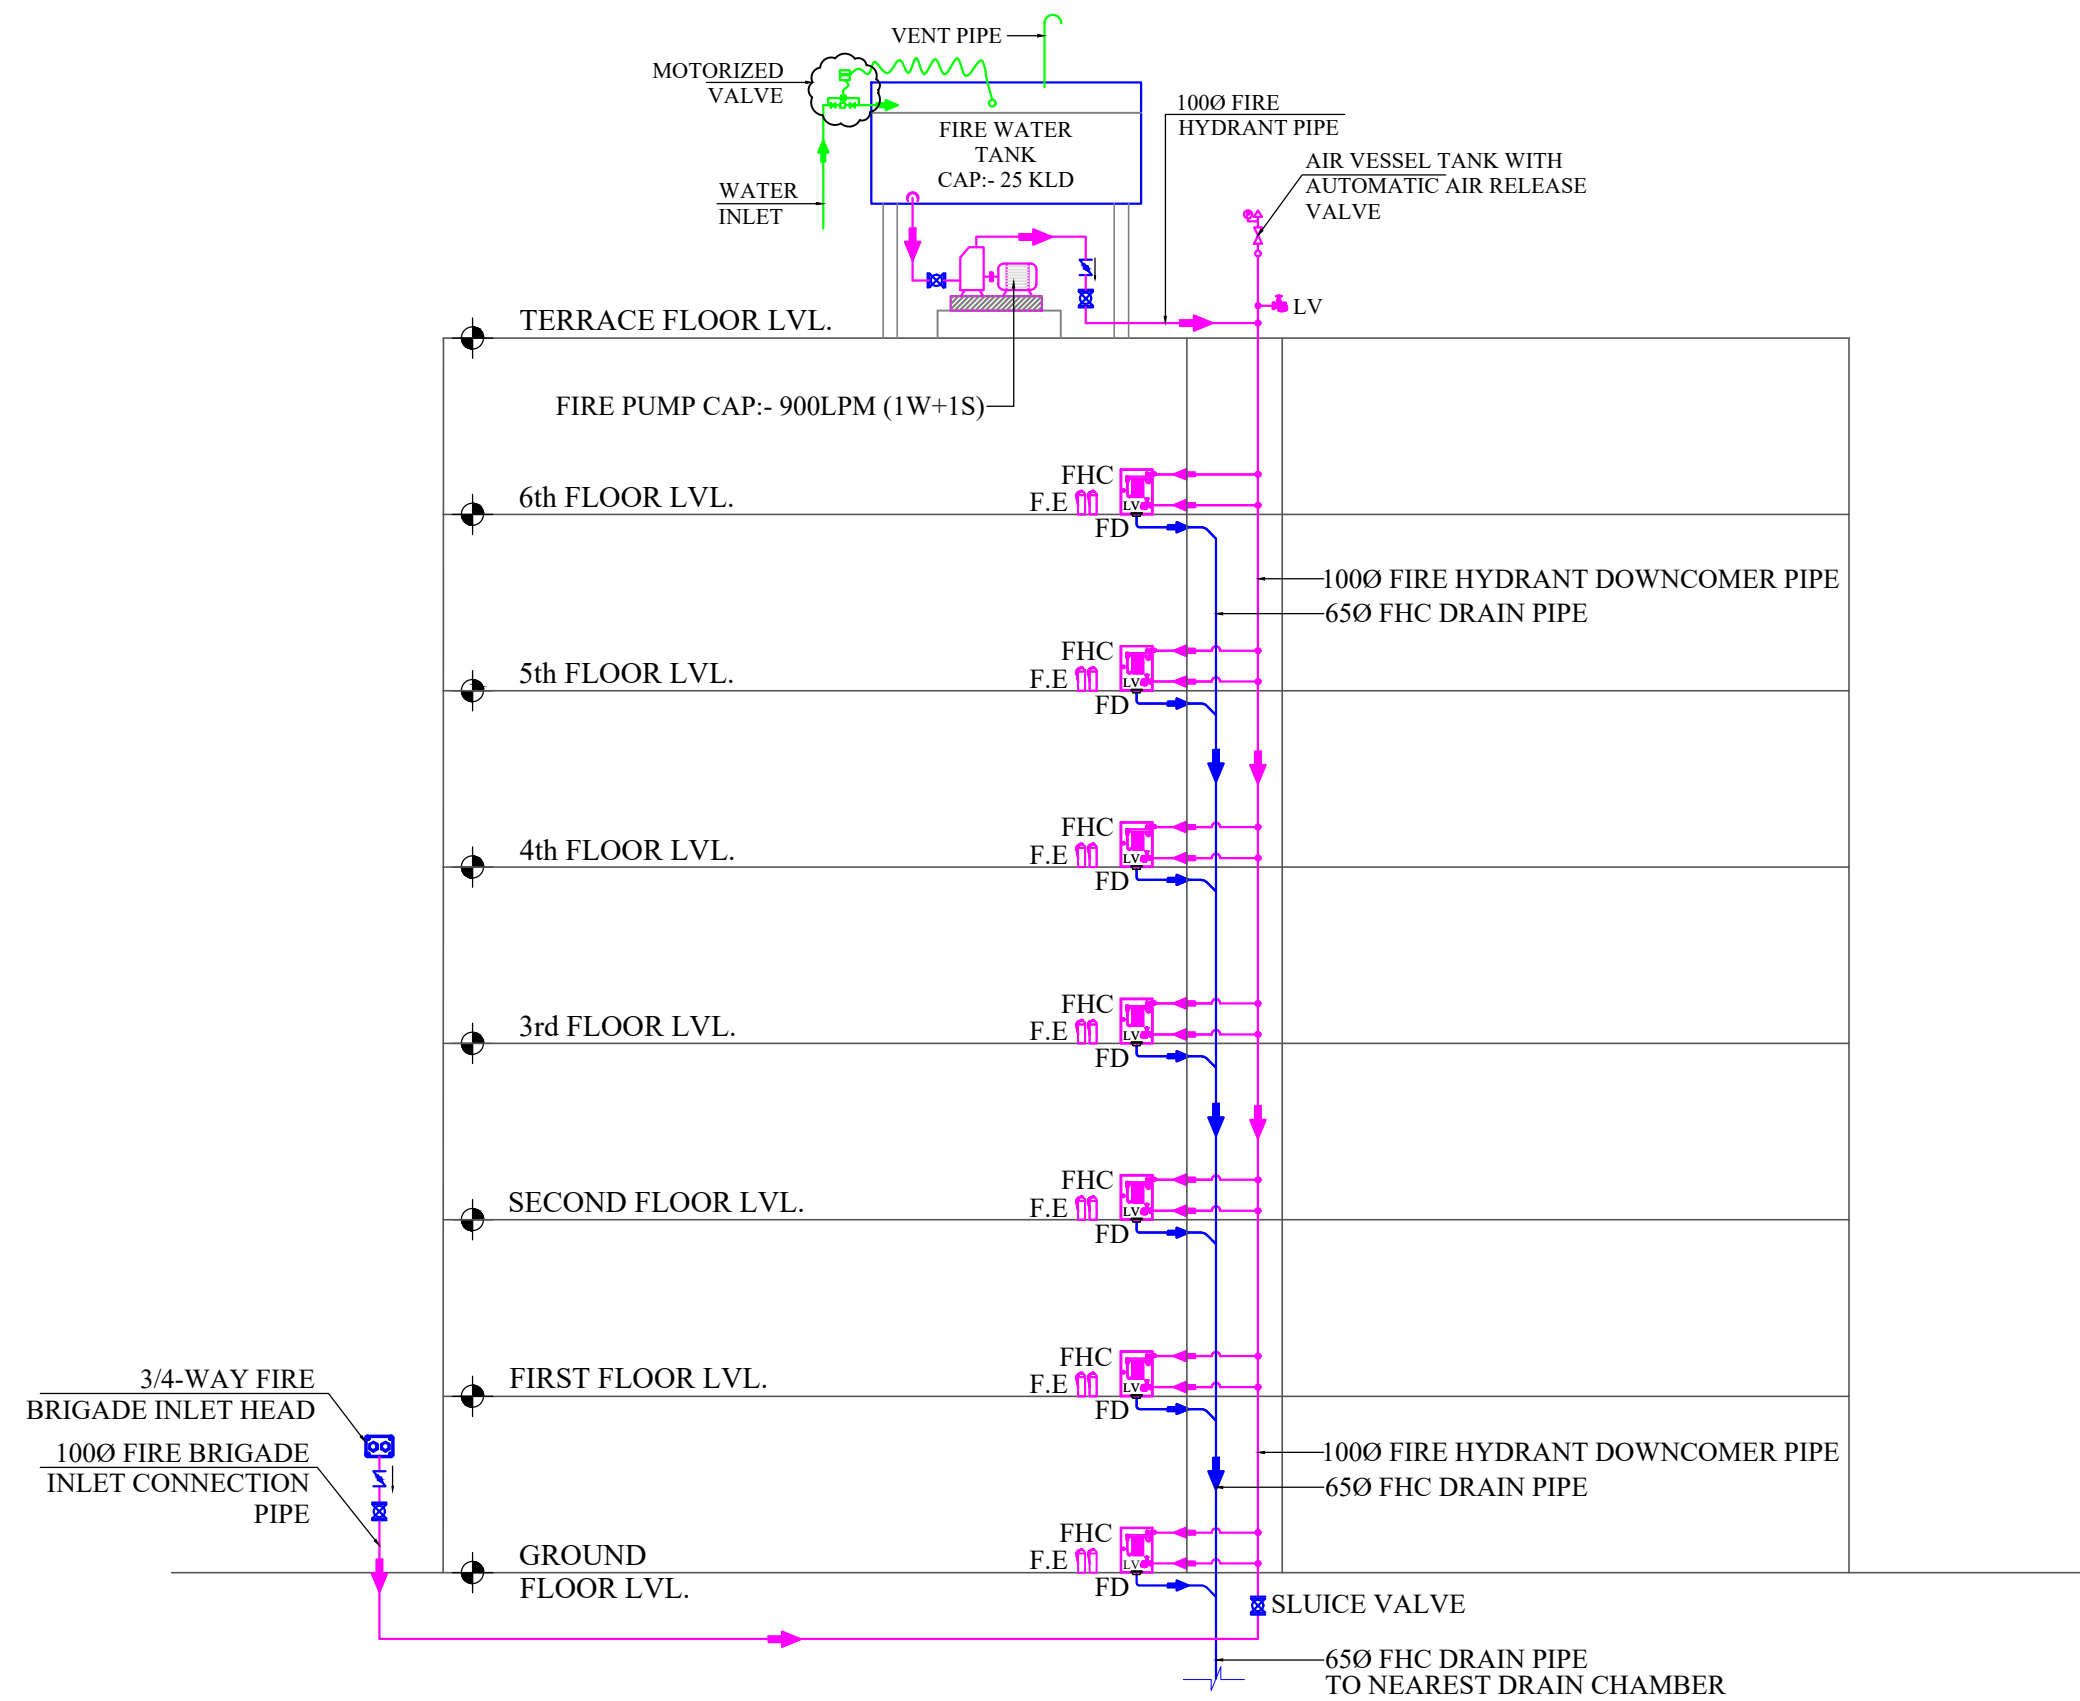

NOTE—
SYNTHETIC FIRE HOSES TYPE—III (63 Ø AND 15M) AS PER IS:636.

NOTES:—

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
IRITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in



JOB TITLE
**BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE
**HOUSING BLOCK TYPICAL
FIRE SCHEMATIC**

SCALE
NTS

DATE
JULY 2025

DRG. NO.
RITES/BLD/FF/TEN/504

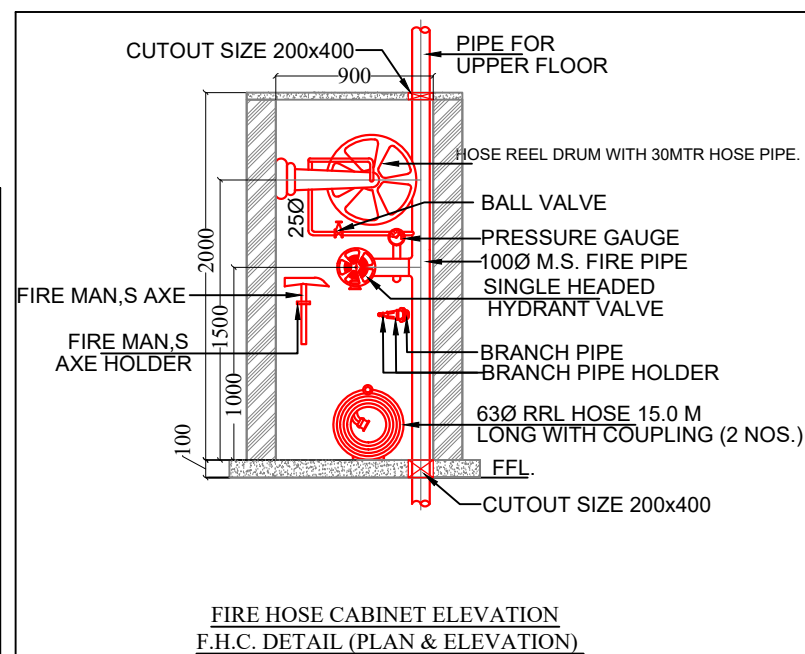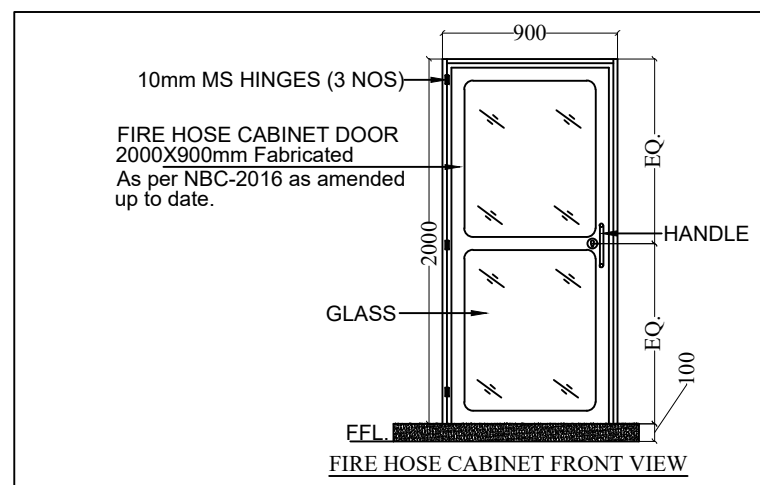


LEGEND:-

	SLUICE VALVE
	NON RETURN VALVE
	FIRST AID FIRE HOSE REEL 30m LENGTH x 20 MM Ø
	SINGLE OUTLET LANDING VALVE
	FIRE HOSE CABINET
	FHC FLOOR DRAIN
	FIRE EXTINGUISHERS 9 LITRE WATER CO2 TYPE FIRE EXTINGUISHER 6 kg ABC POWDER TYPE FIRE EXTINGUISHER

LEGEND:-

S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	
2.	1000 FIRE HYDRANT DOWNCOMER PIPE	①
3.	650 FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	
6.	9 KG DCP FIRE EXTINGUISHER	
7.	AIR RELEASE VALVE (ARV)	
8.	LANDING VALVE (LV)	
9.	PRESSURE GAUGE	

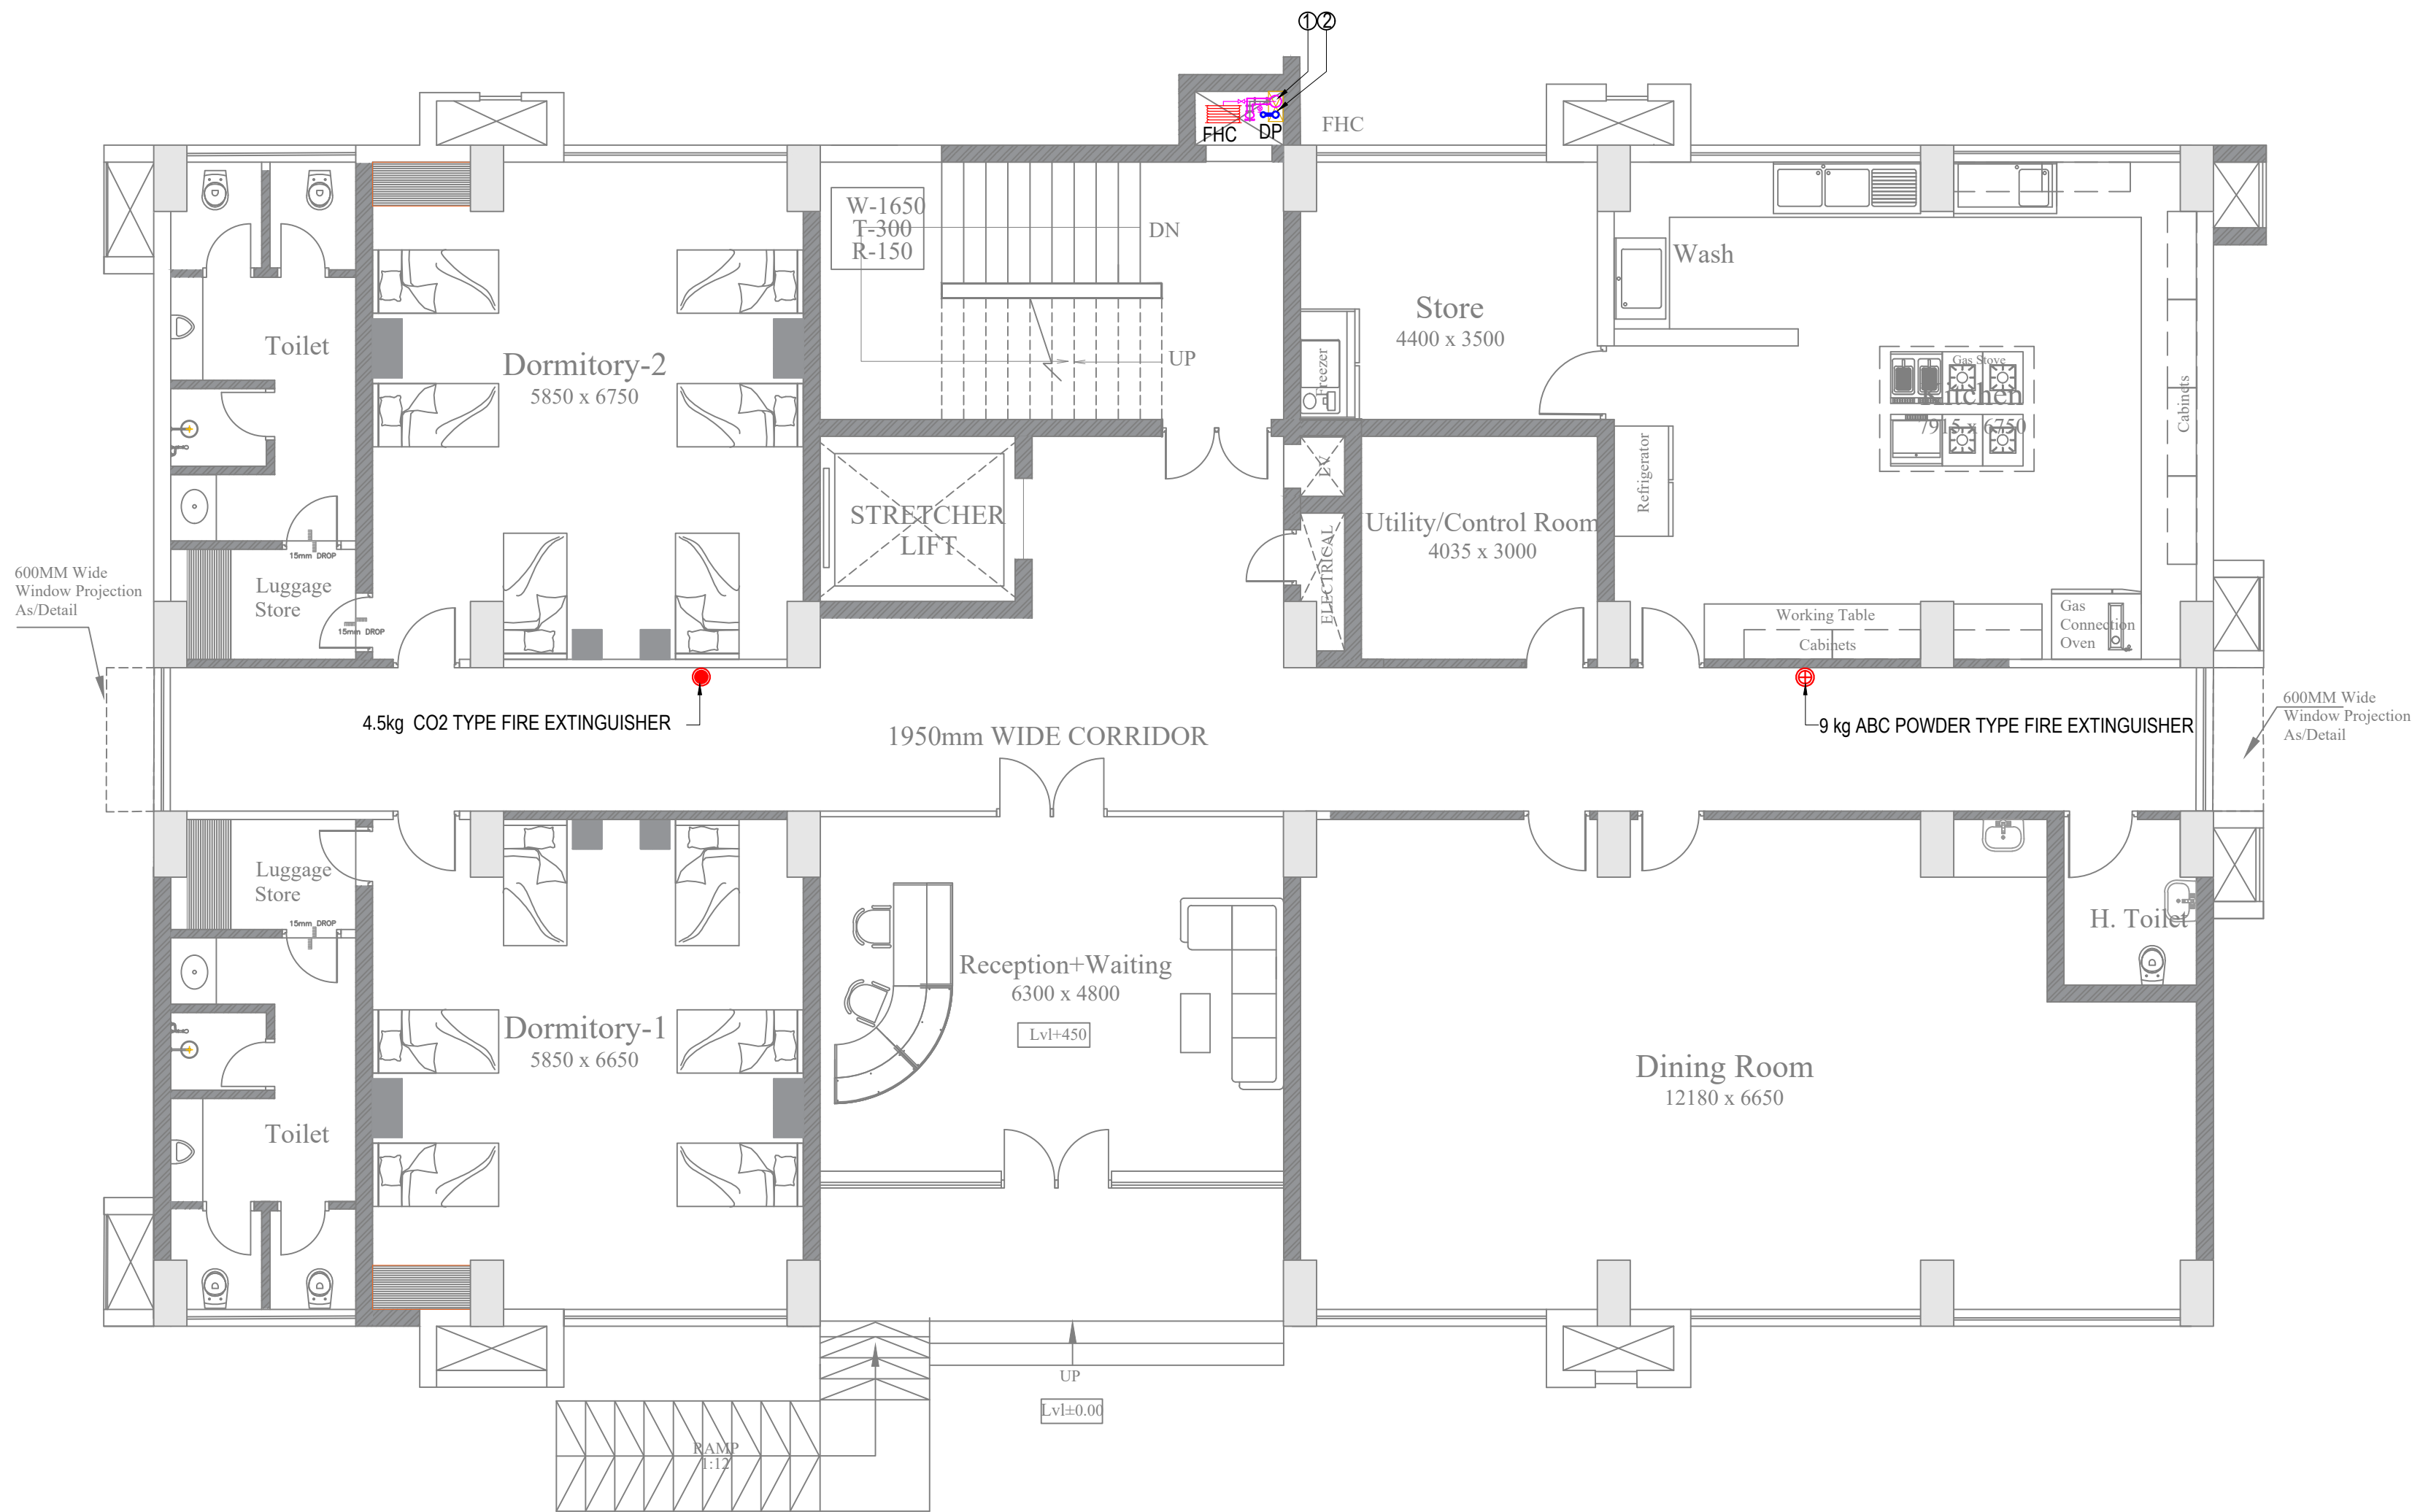

LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REAL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	100Ø FIRE HYDRANT DOWNCOMER PIPE	①
3.	65Ø FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	⊙
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	⊞
8.	LANDING VALVE (LV)	⊞
9.	PRESSURE GAUGE	⊞

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
IRITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)



MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in


JOB TITLE
**BO WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE
**GROUND FLOOR PLAN
GUEST HOUSE
FIRE DRAWING**

SCALE	DATE	DRG. NO.
NTS	JULY 2025	IRITES/BLD/FF/TEN/505

NOTE-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

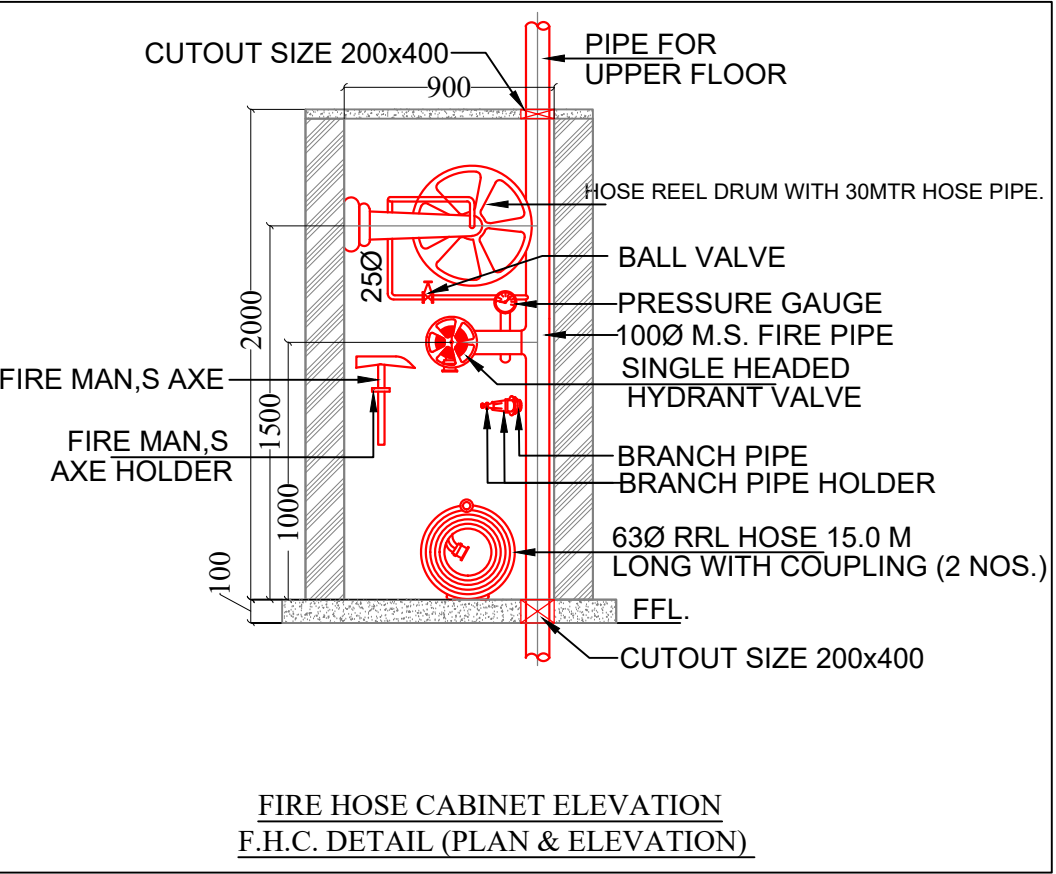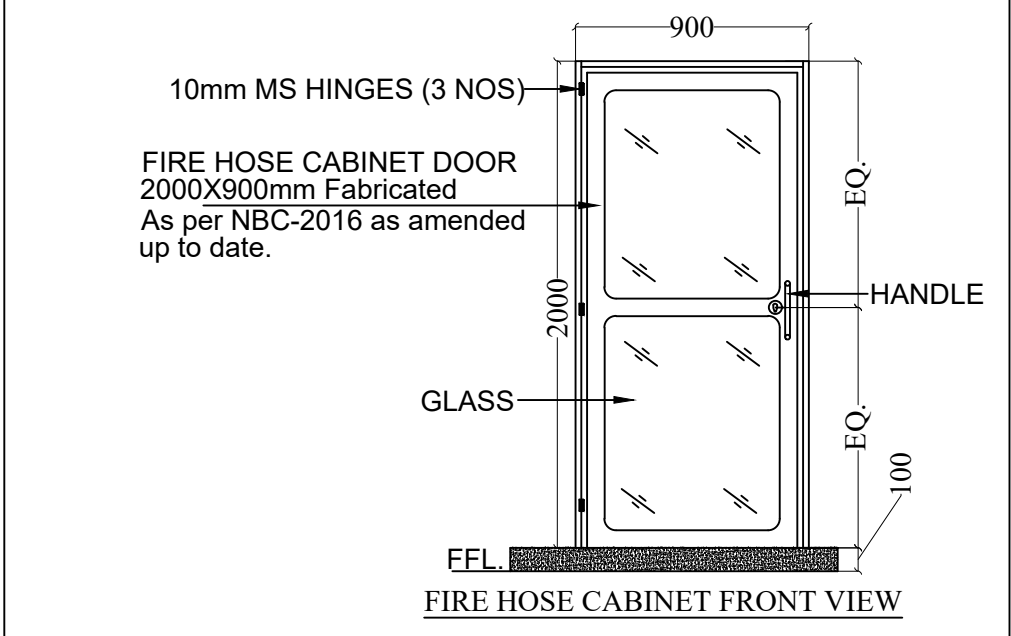

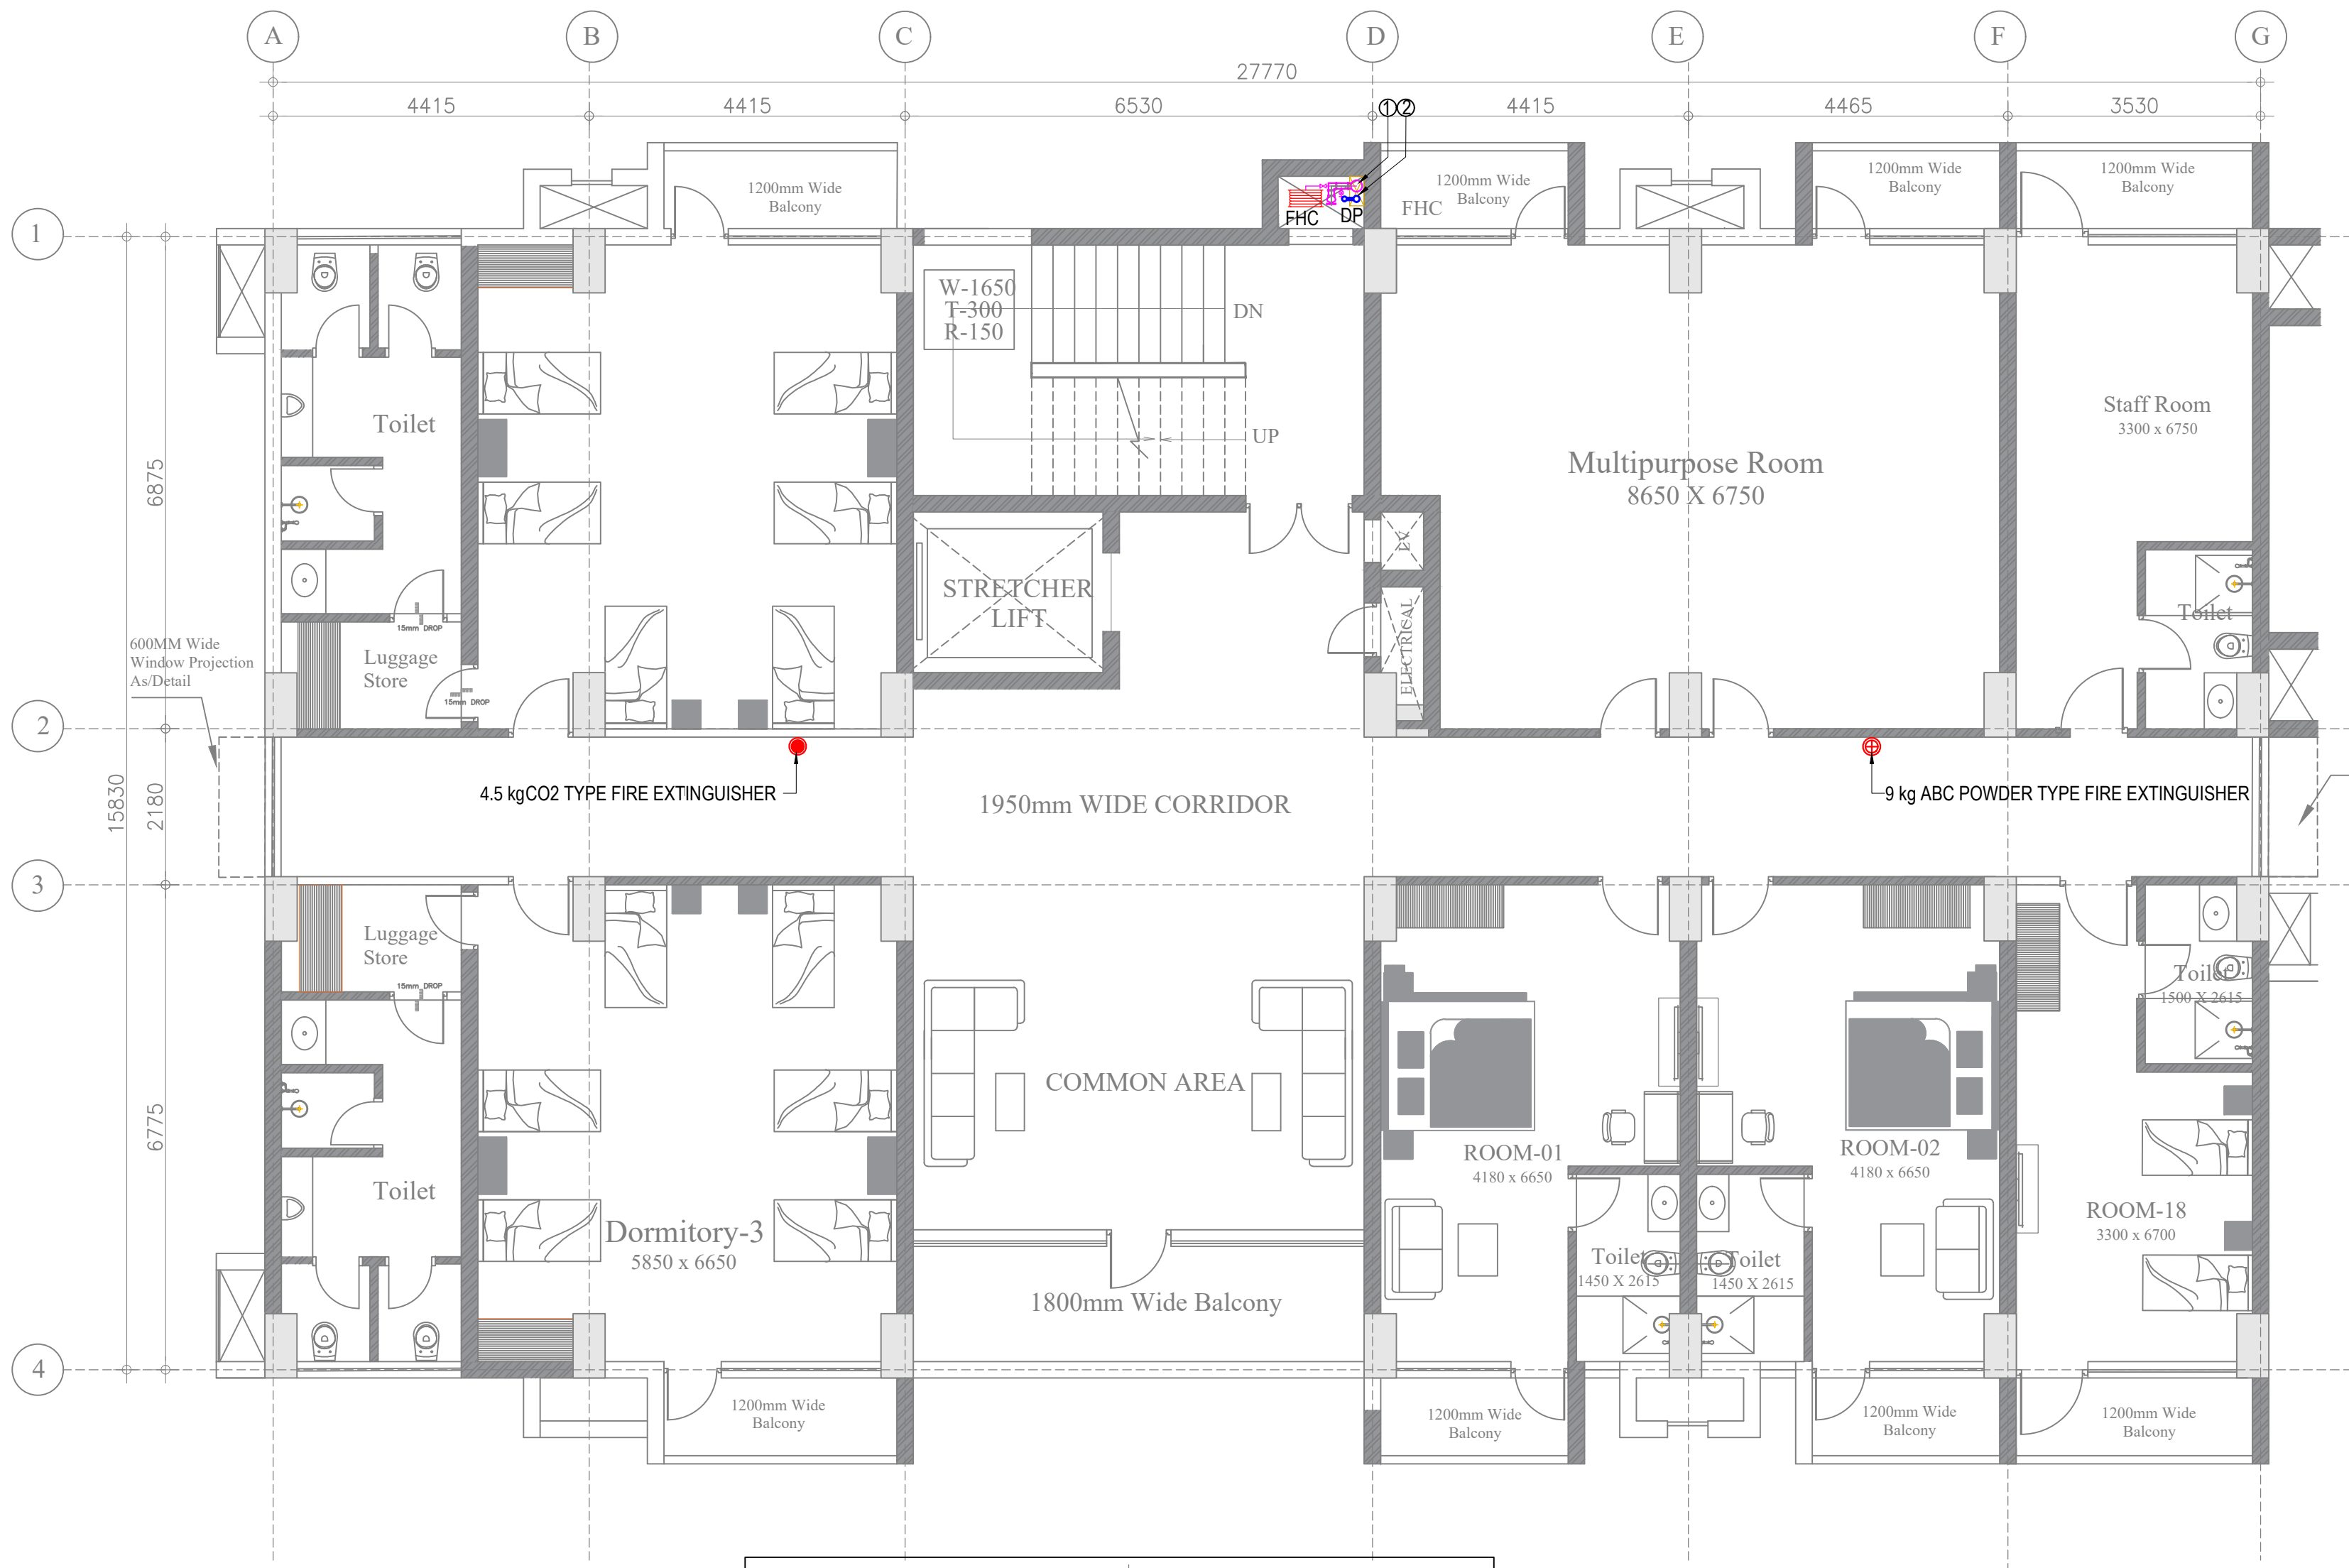

LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	100Ø FIRE HYDRANT DOWNCOMER PIPE	①
3.	65Ø FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	⊙
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	⊞
8.	LANDING VALVE (LV)	⊞
9.	PRESSURE GAUGE	⊞

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)



CONSULTANT
IRITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in


JOB TITLE
**BO WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE
**FIRST FLOOR PLAN
GUEST HOUSE
FIRE DRAWING**

SCALE	DATE	DRG. NO.
NTS	JULY 2025	IRITES/BLD/FF/TEN/508

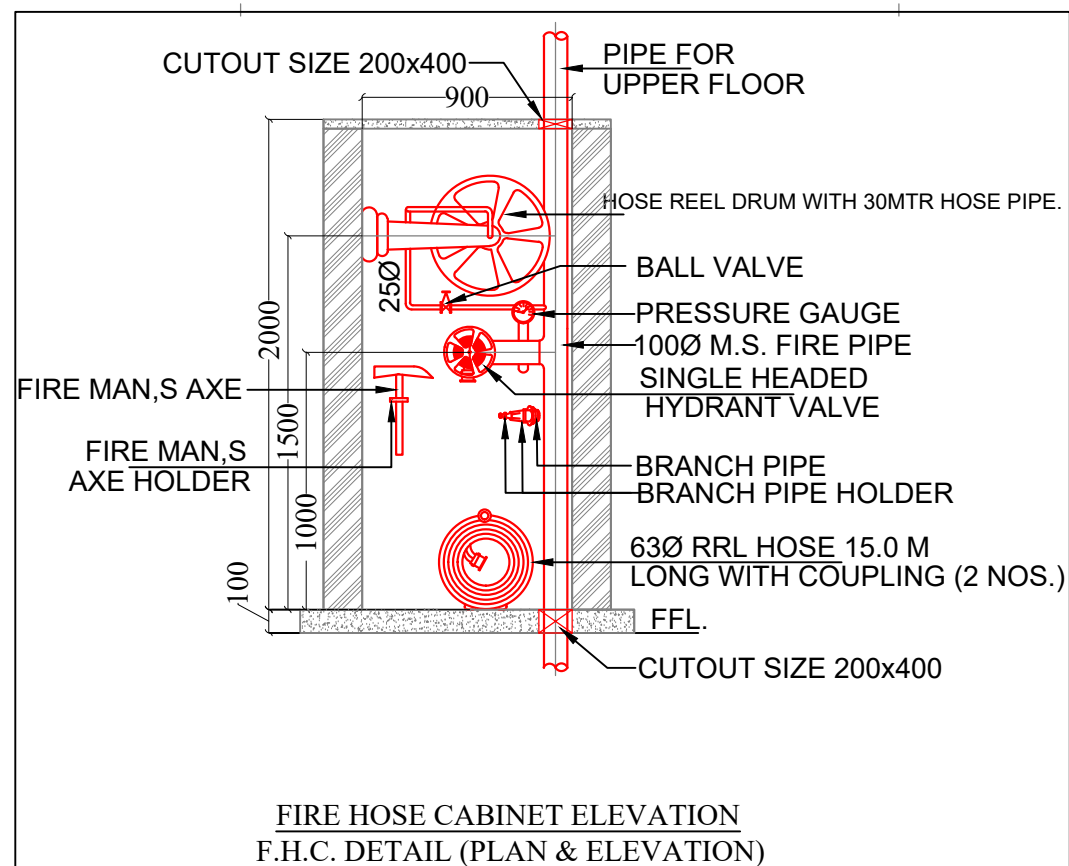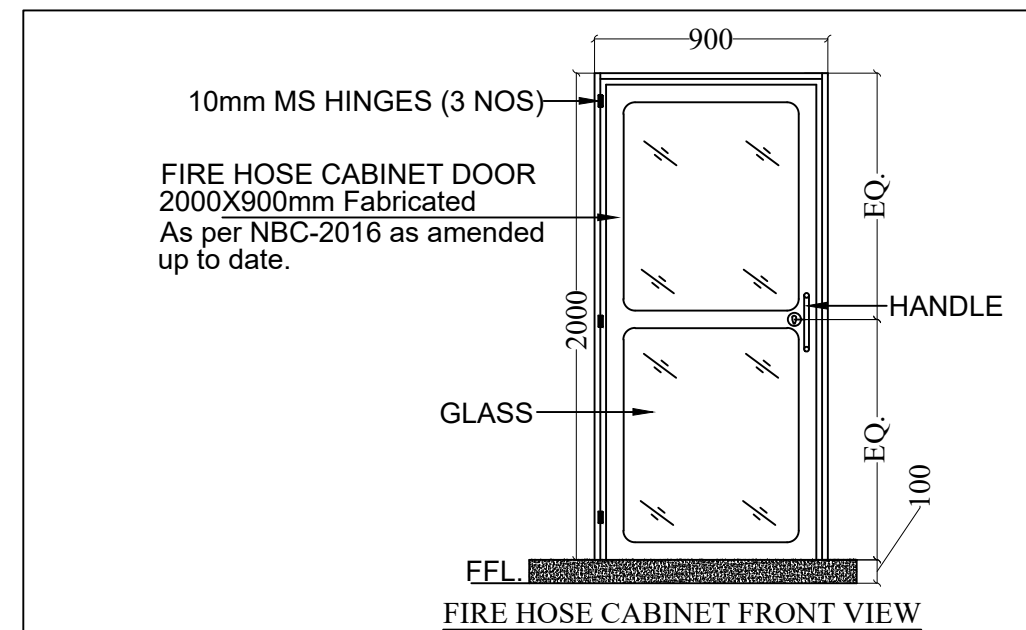

NOTE-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

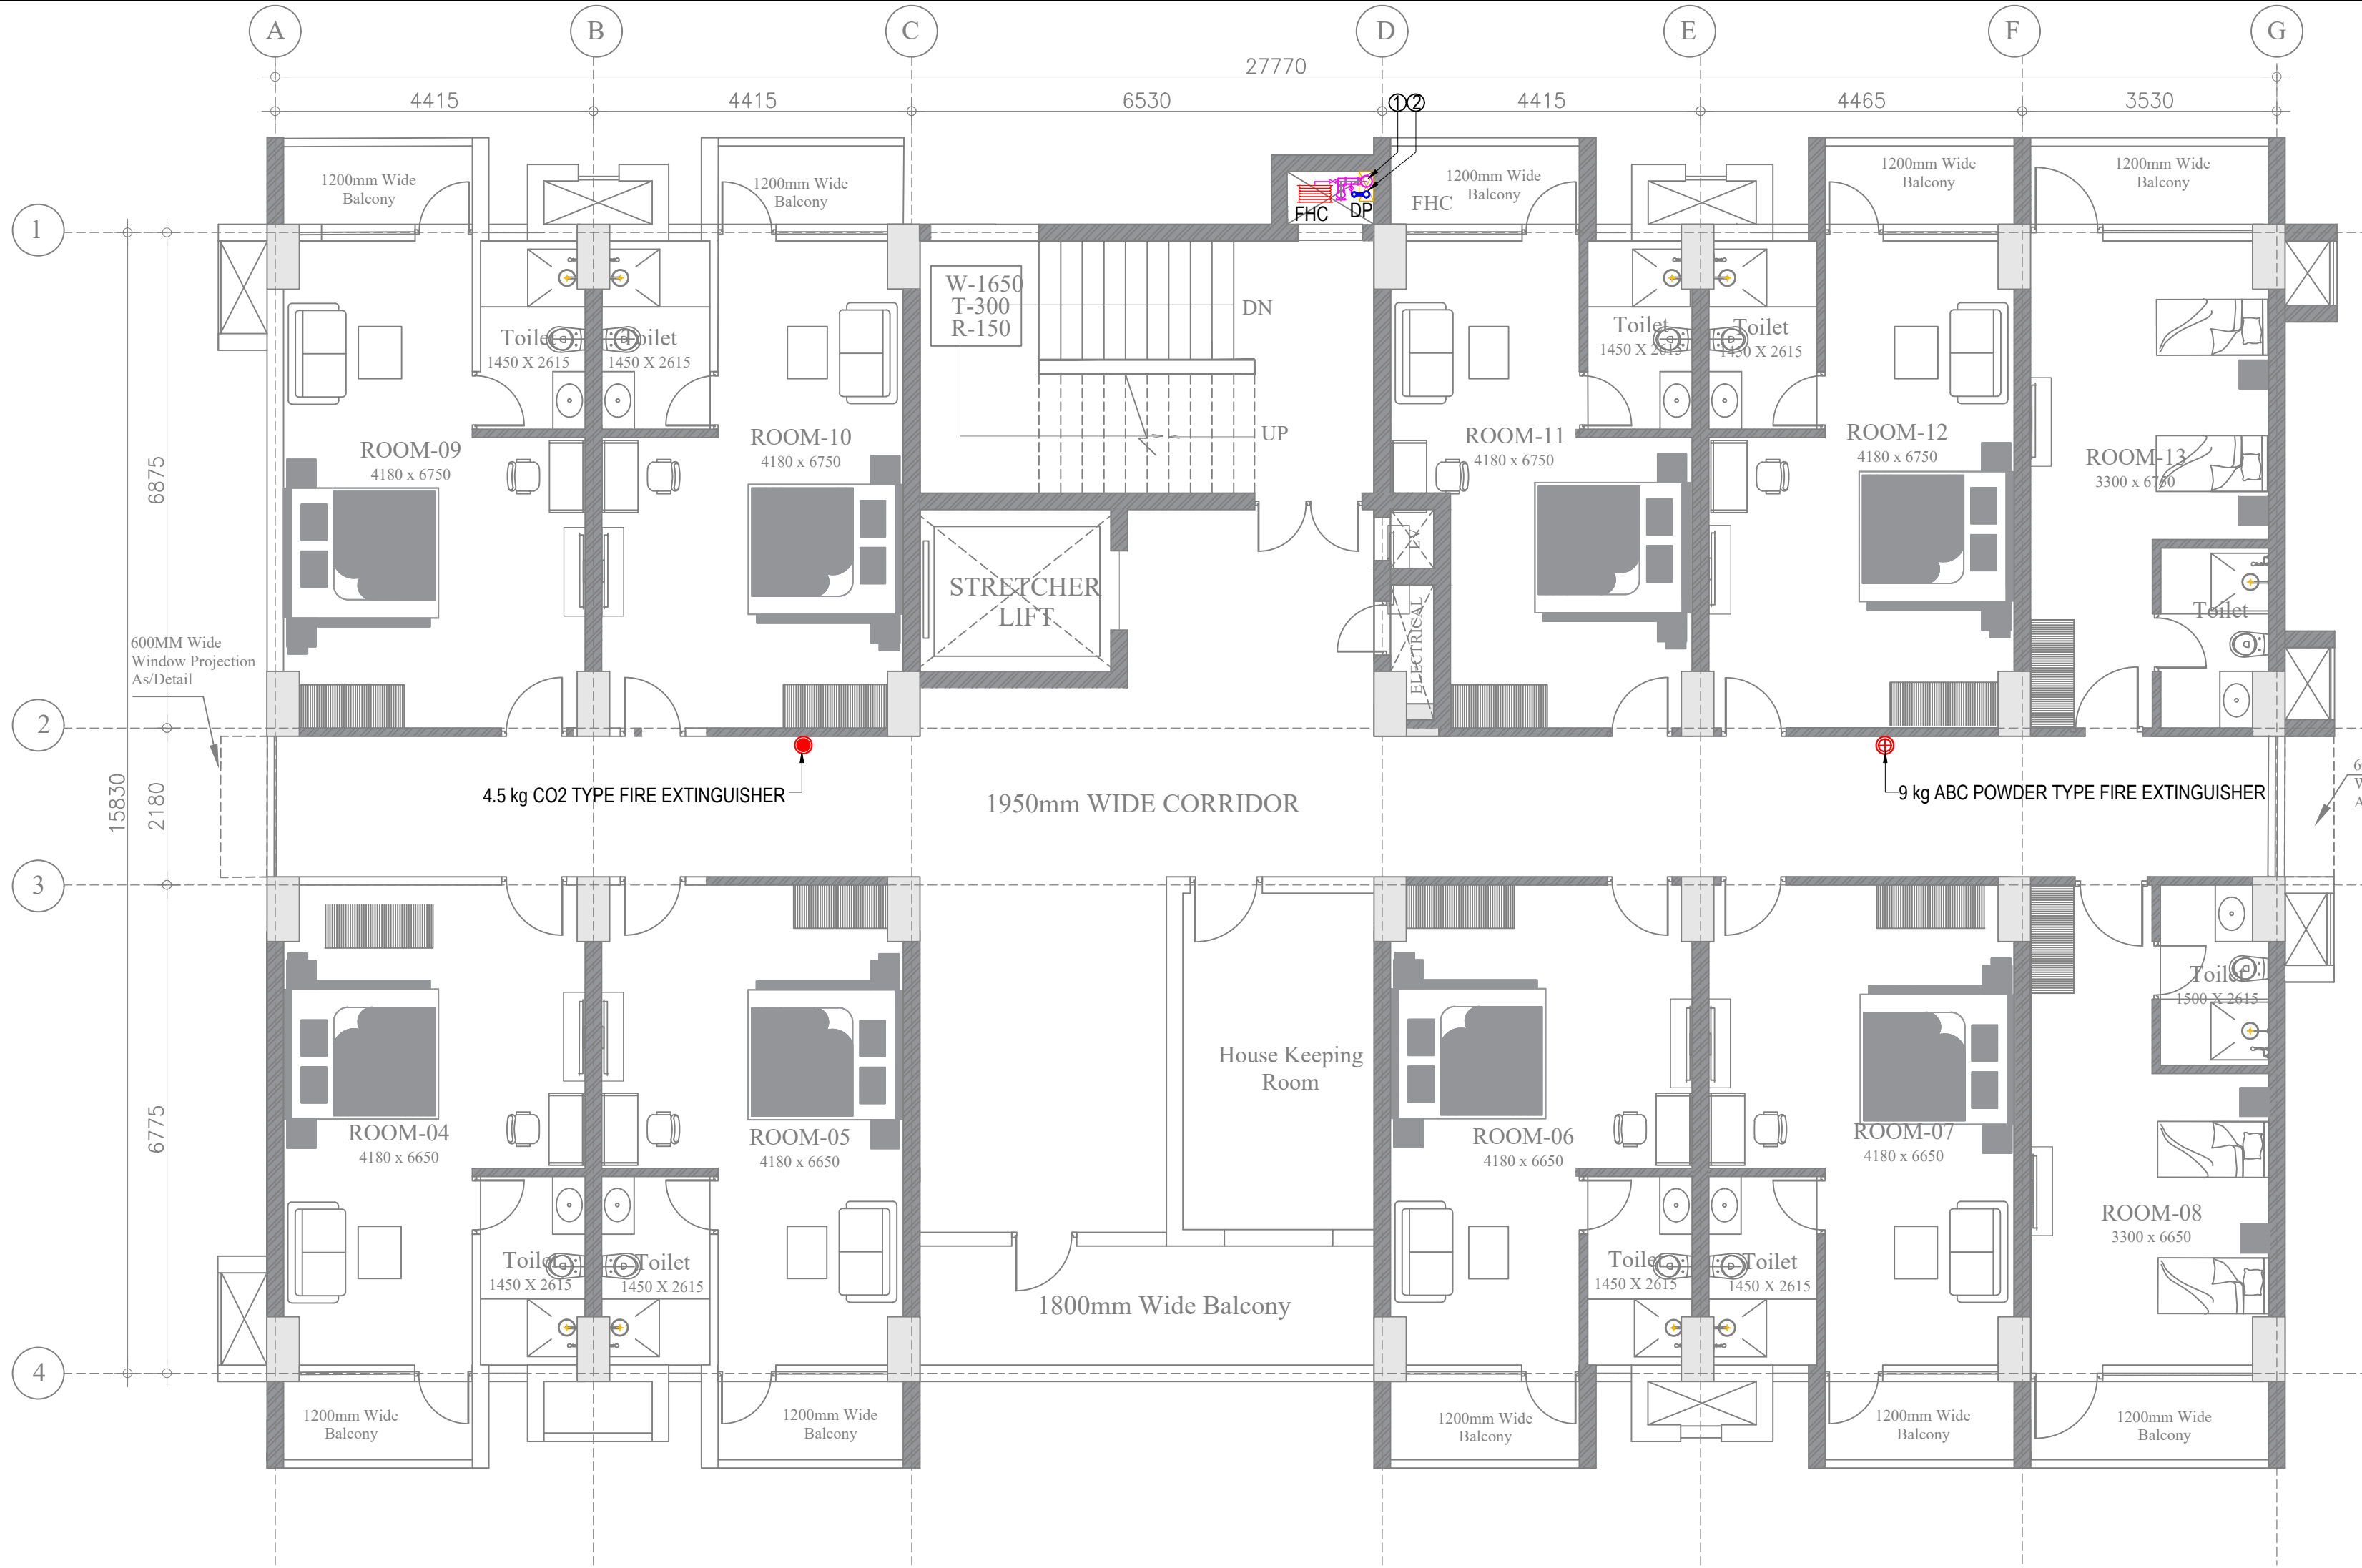

LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	100Ø FIRE HYDRANT DOWNCOMER PIPE	①
3.	65Ø FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	○
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	□
8.	LANDING VALVE (LV)	⌂
9.	PRESSURE GAUGE	⌚

- NOTES:-
- ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 - WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 - ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 - THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 - DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT

OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT

RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in



JOB TITLE

**BO WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**


DRAWING TITLE

**SECOND FLOOR PLAN
GUEST HOUSE
FIRE DRAWING**



SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/FF/TEN/507

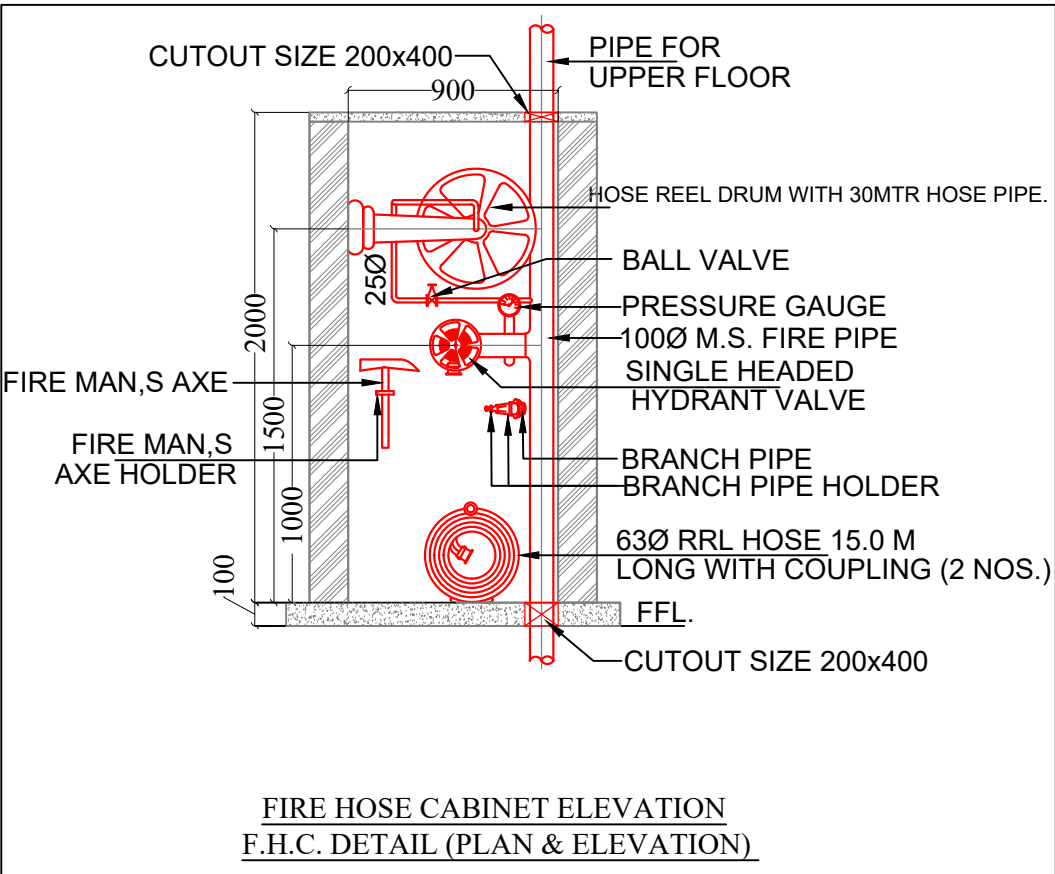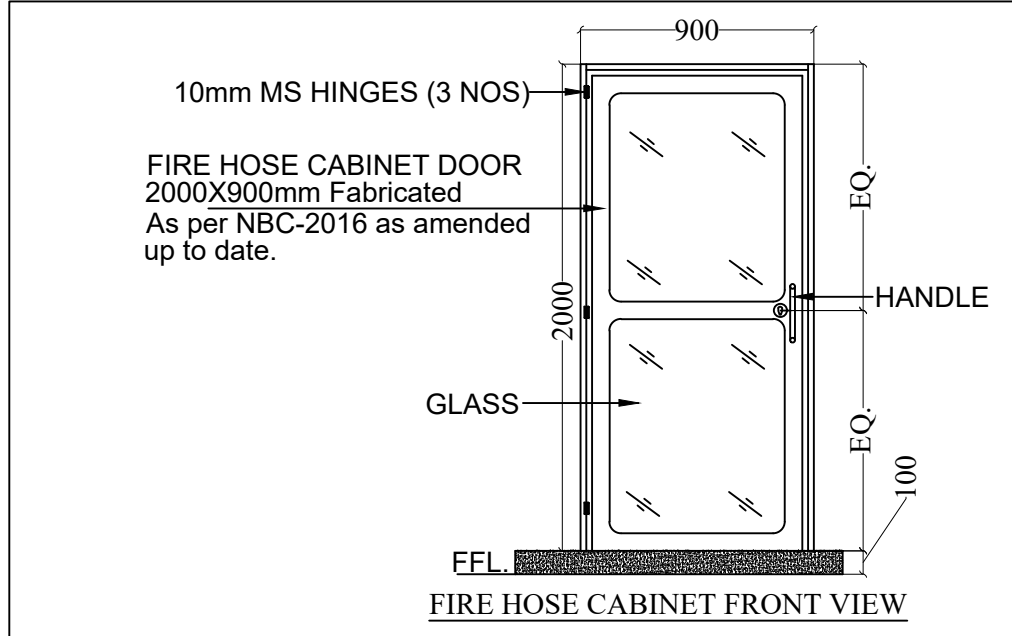

NOTE-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

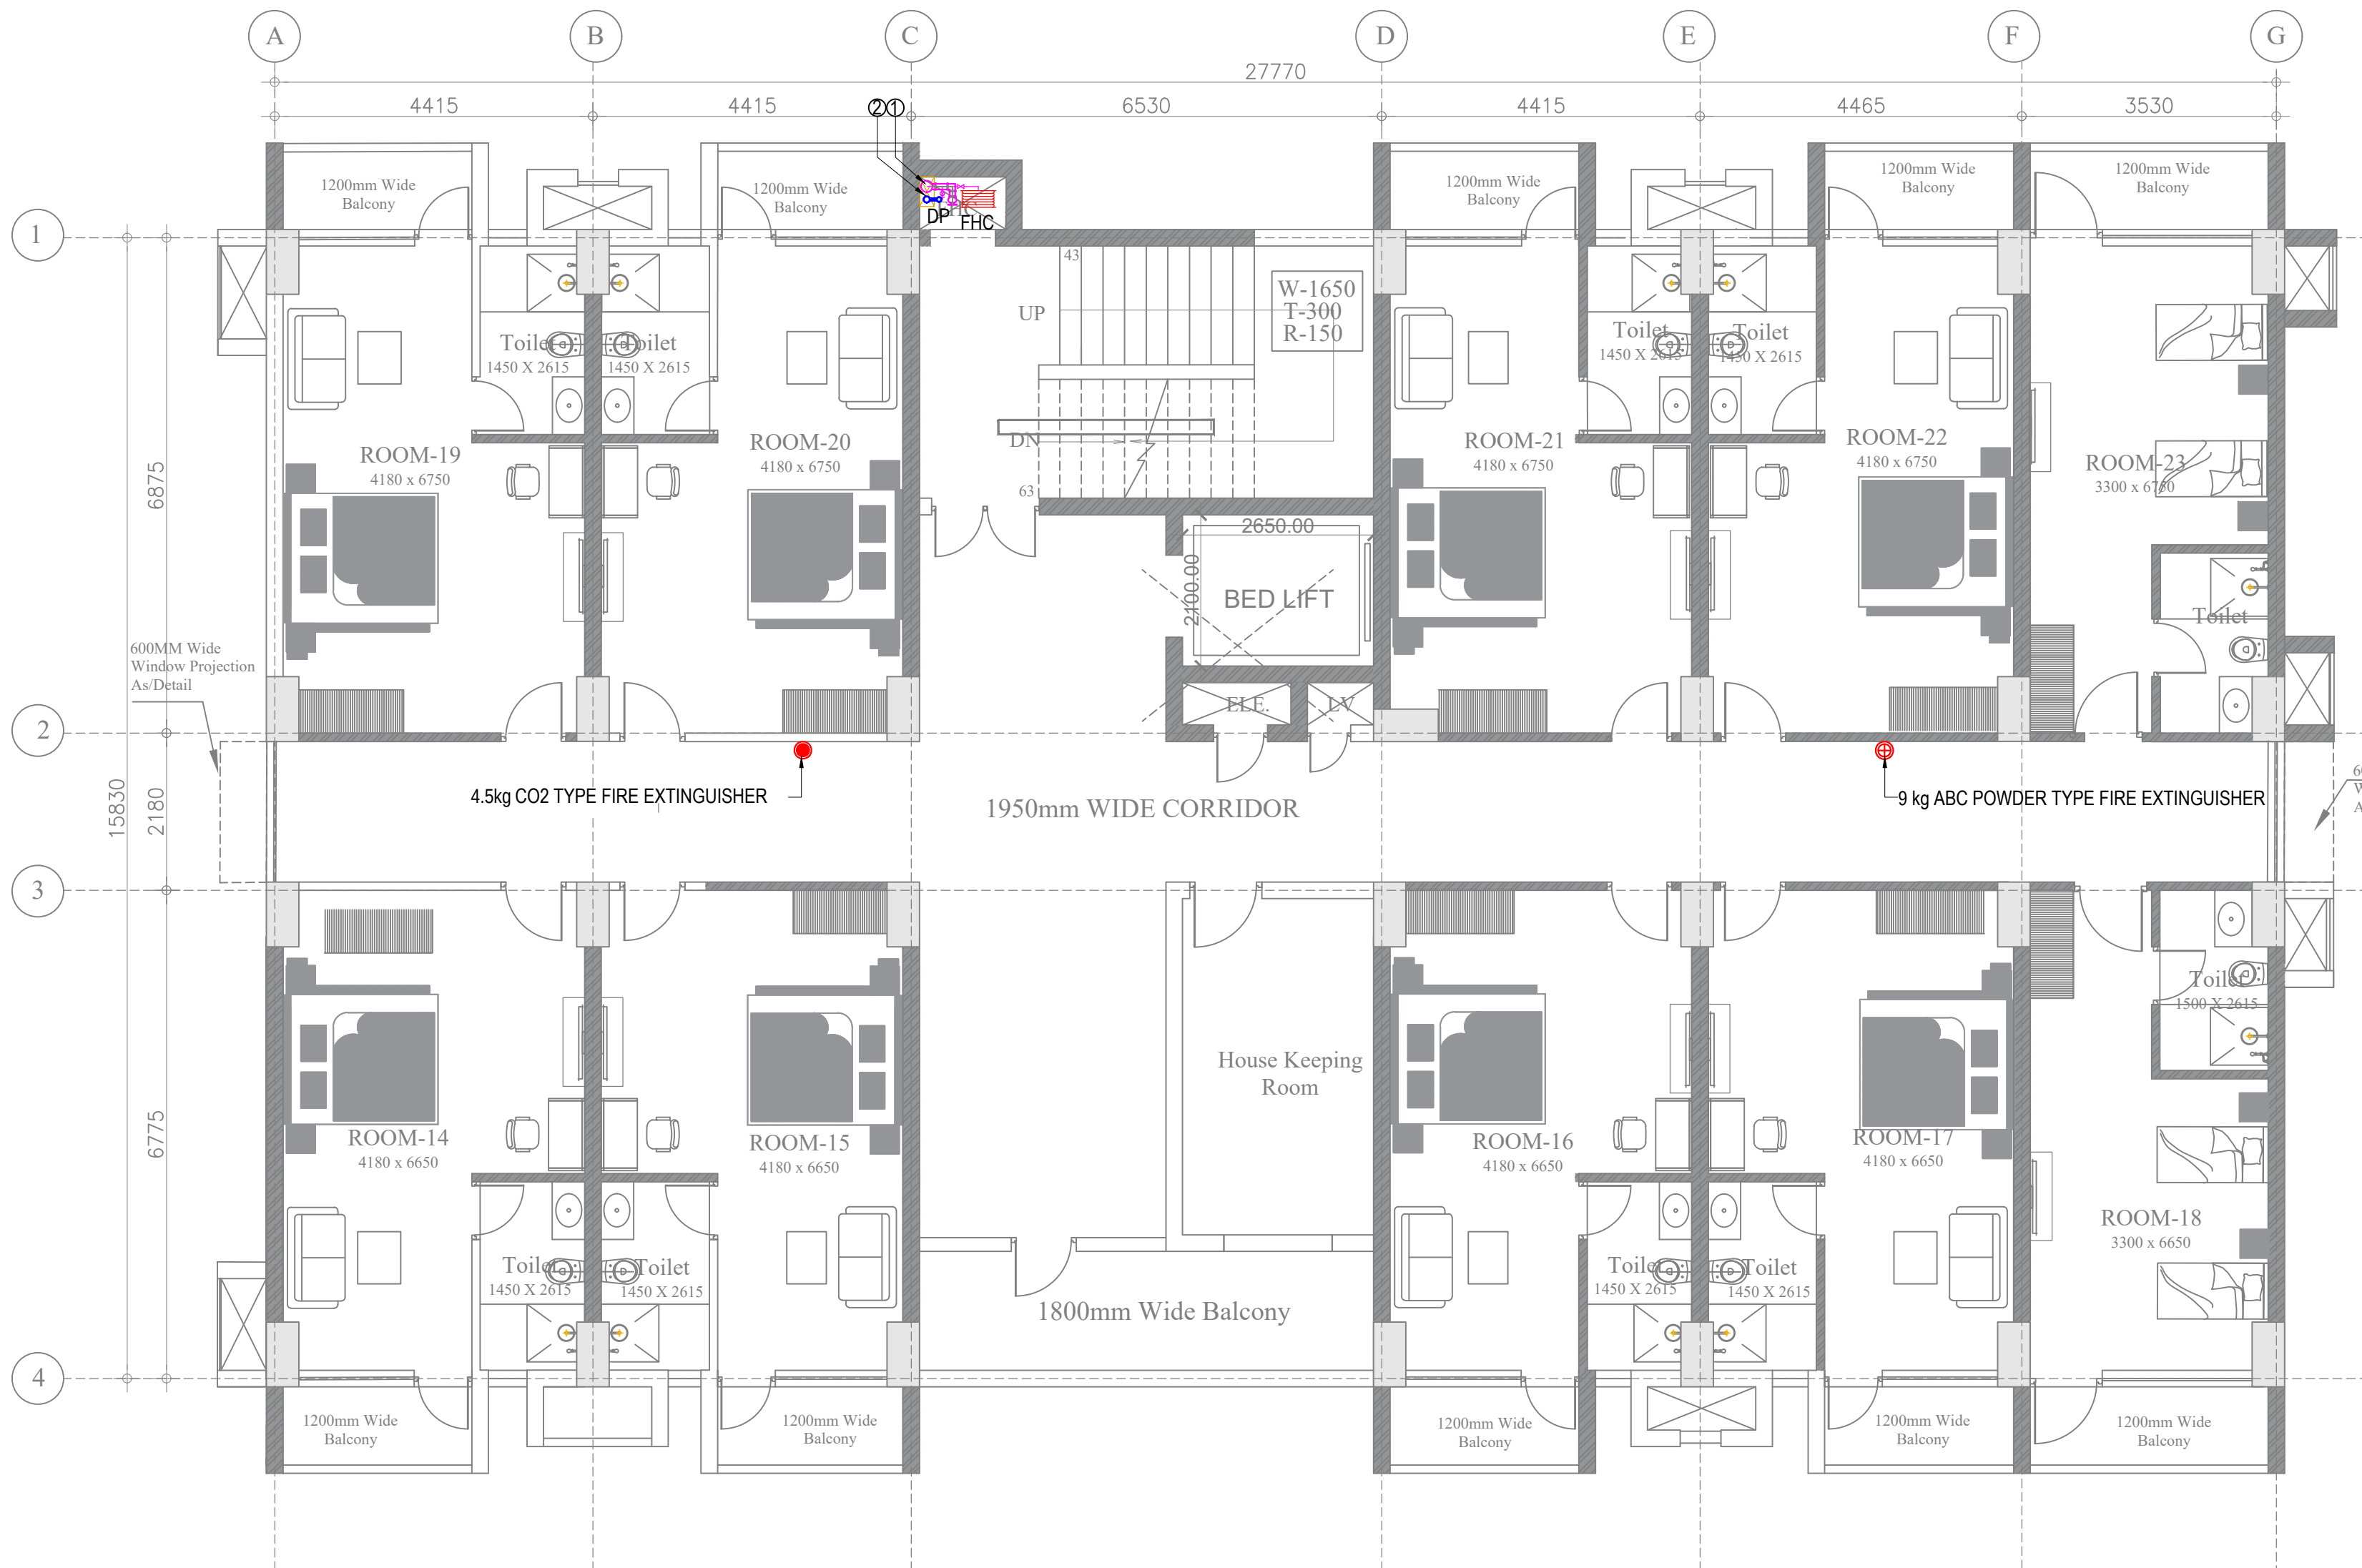


LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	100Ø FIRE HYDRANT DOWNCOMER PIPE	①
3.	65Ø FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	⊙
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	⊞
8.	LANDING VALVE (LV)	⊞
9.	PRESSURE GAUGE	⊞

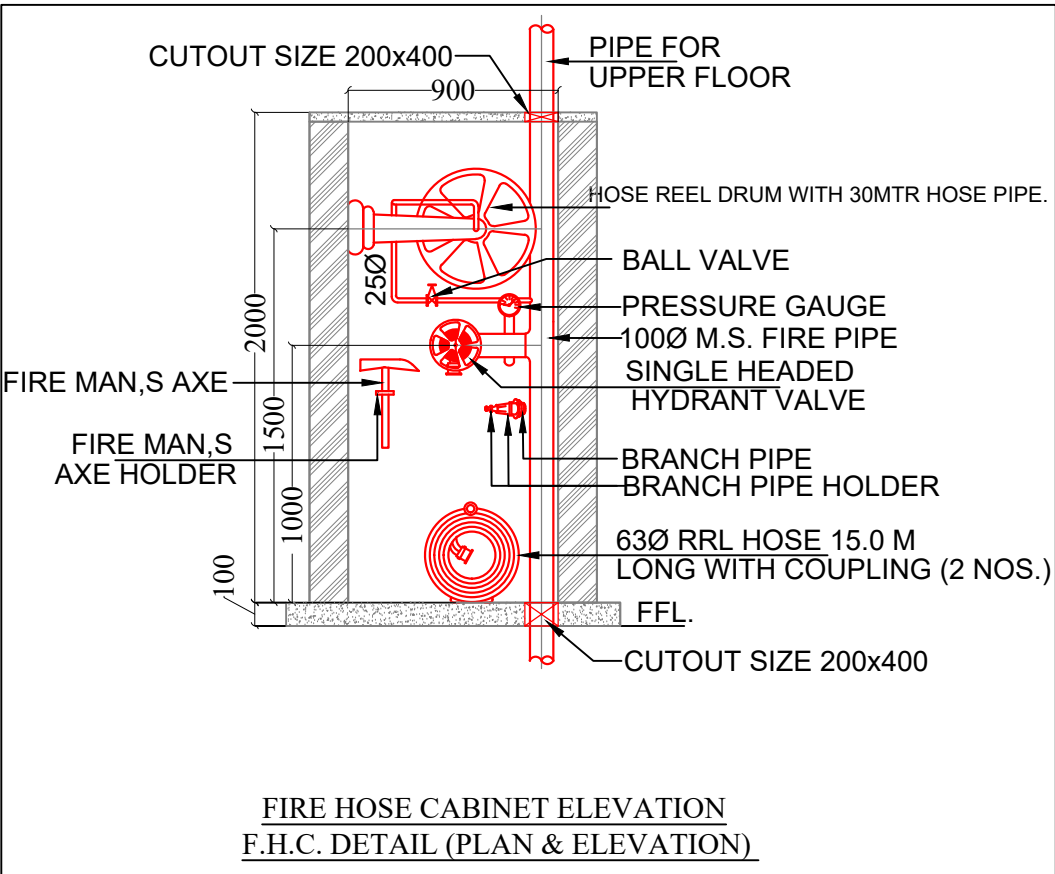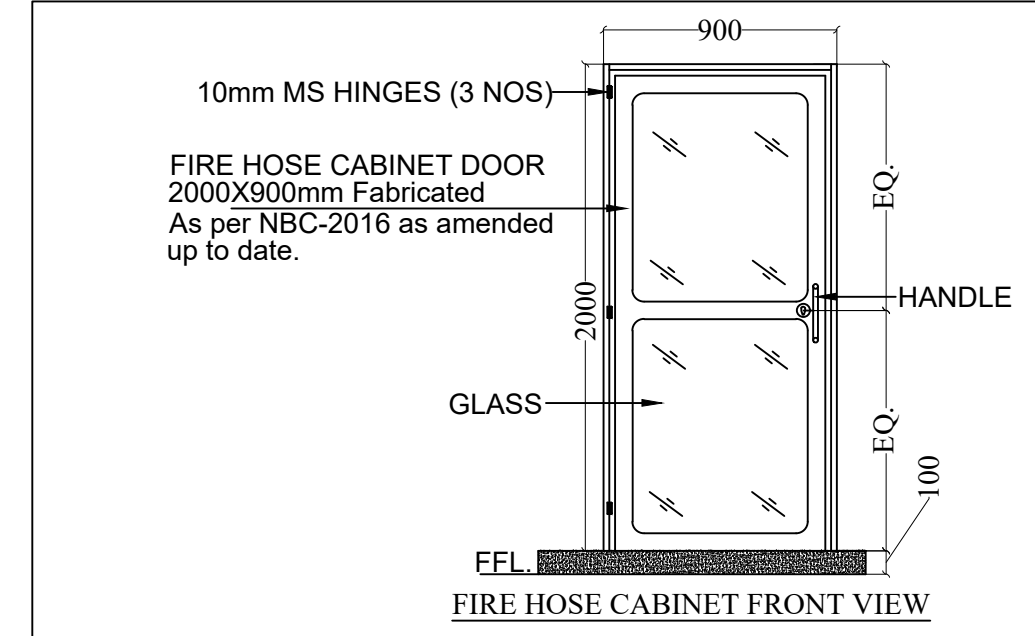



NOTE—
SYNTHETIC FIRE HOSES TYPE—III (63 Ø AND 15M) AS PER IS:636.

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING		
REVISIONS		
CLIENT	 OIL INDIA LIMITED (A Govt. of India Enterprise)	
CONSULTANT	 RITES THE INFRASTRUCTURE PEOPLE (A Govt. of India Enterprise)	
MEP CONSULTANT	PKV CONSULTING ENGINEERS (P) LTD.  815 - C DDA FLATS EAST OF LONI ROAD DELHI - 110093 email:-info@pkv.co.in	
JOB TITLE	BQ WORKMEN GROUP HOUSING COMPLEX AT DULIAJAN ASSAM	
DRAWING TITLE	THIRD FLOOR PLAN GUEST HOUSE FIRE DRAWING	
SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/FF/TEN/508

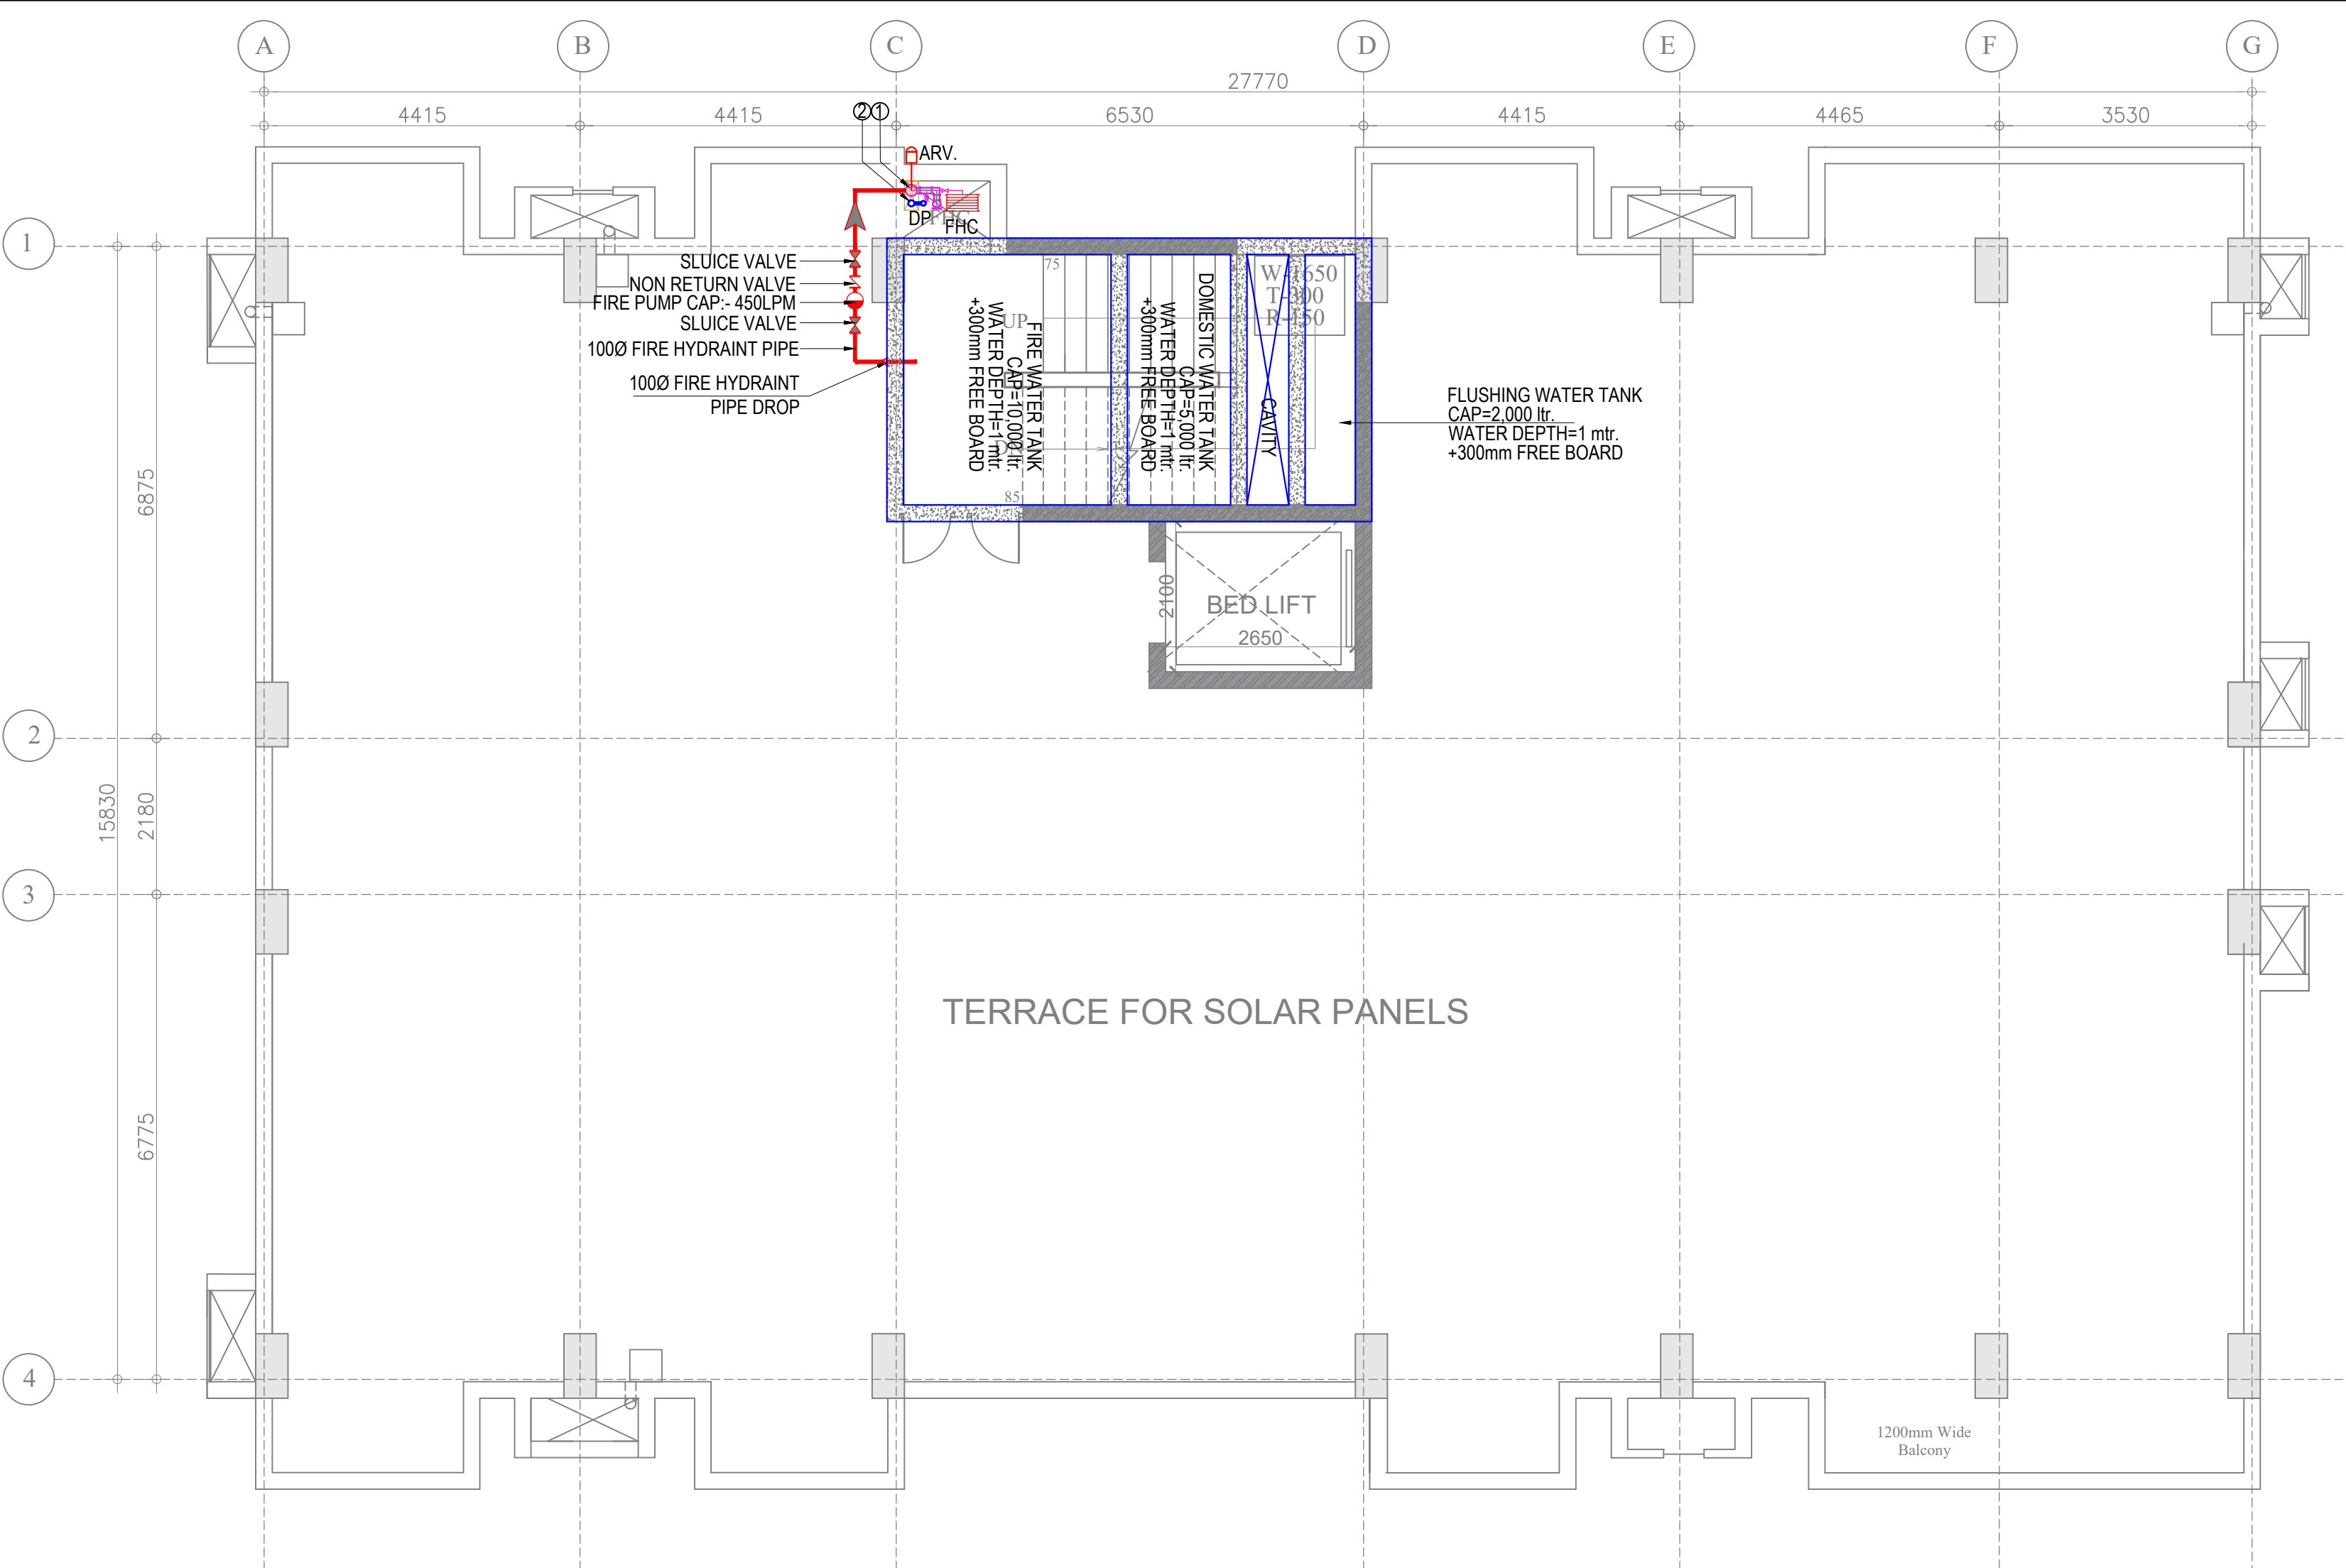

LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	100Ø FIRE HYDRANT DOWNCOMER PIPE	①
3.	65Ø FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	⊙
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	⊞
8.	LANDING VALVE (LV)	⊞
9.	PRESSURE GAUGE	⊞

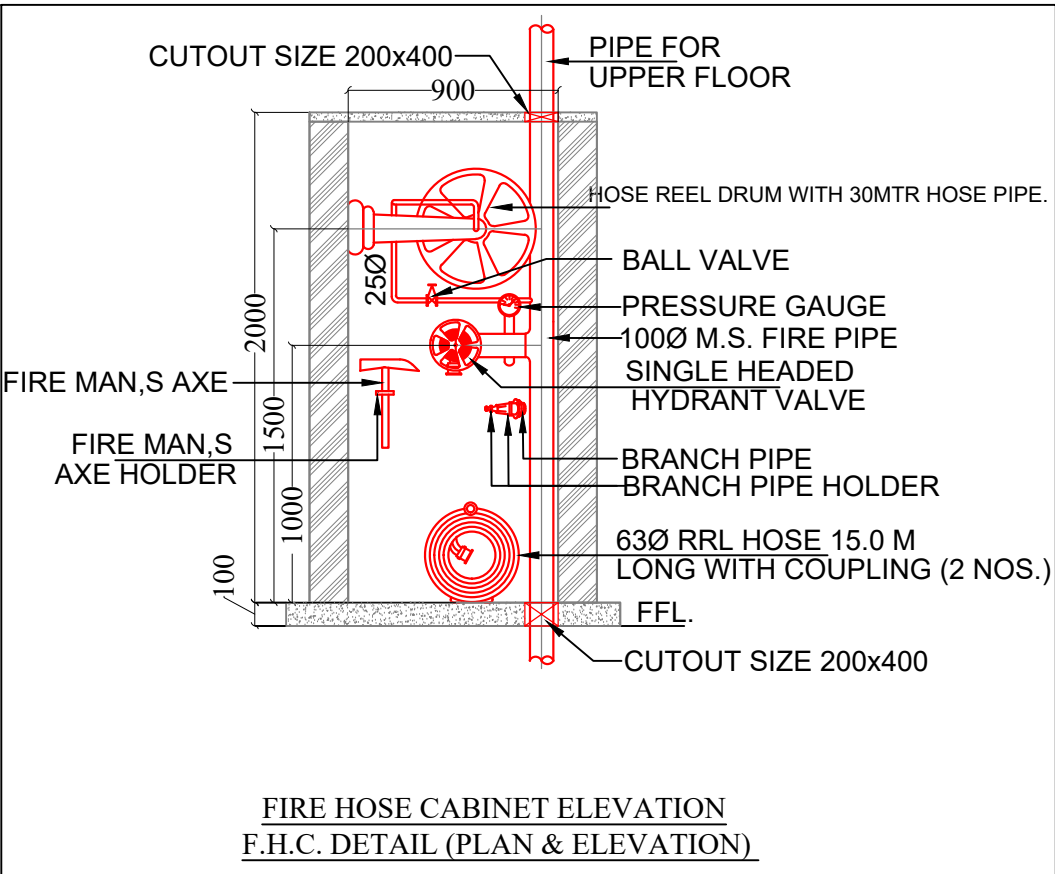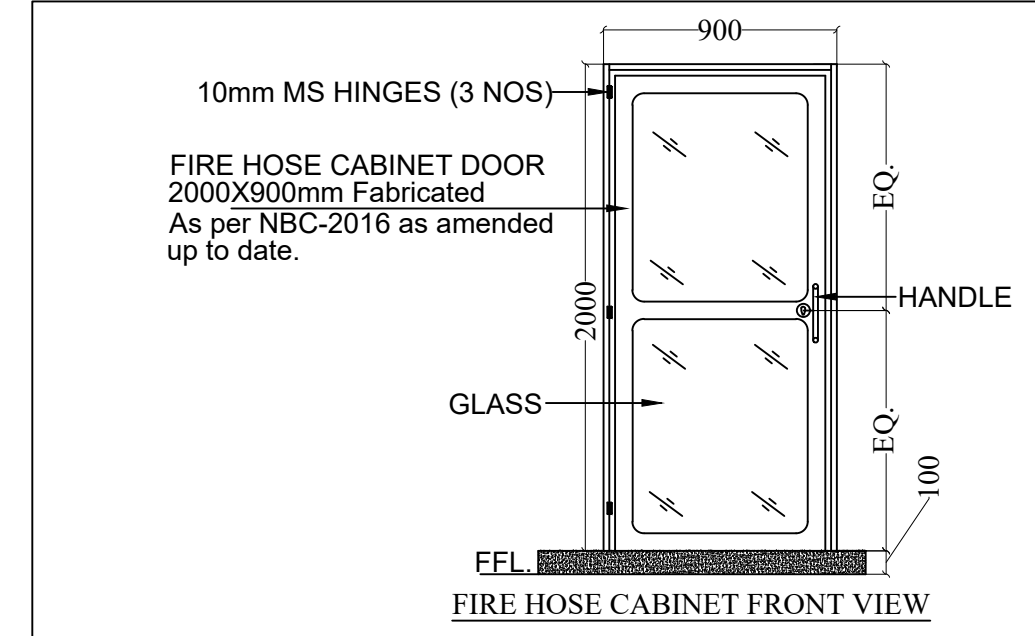

NOTE-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in




JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE
TERRACE PLAN
GUEST HOUSE
FIRE DRAWING

SCALE
NTS

DATE
JULY 2025

DRG. NO.
RITES/BLD/FF/TEN/509

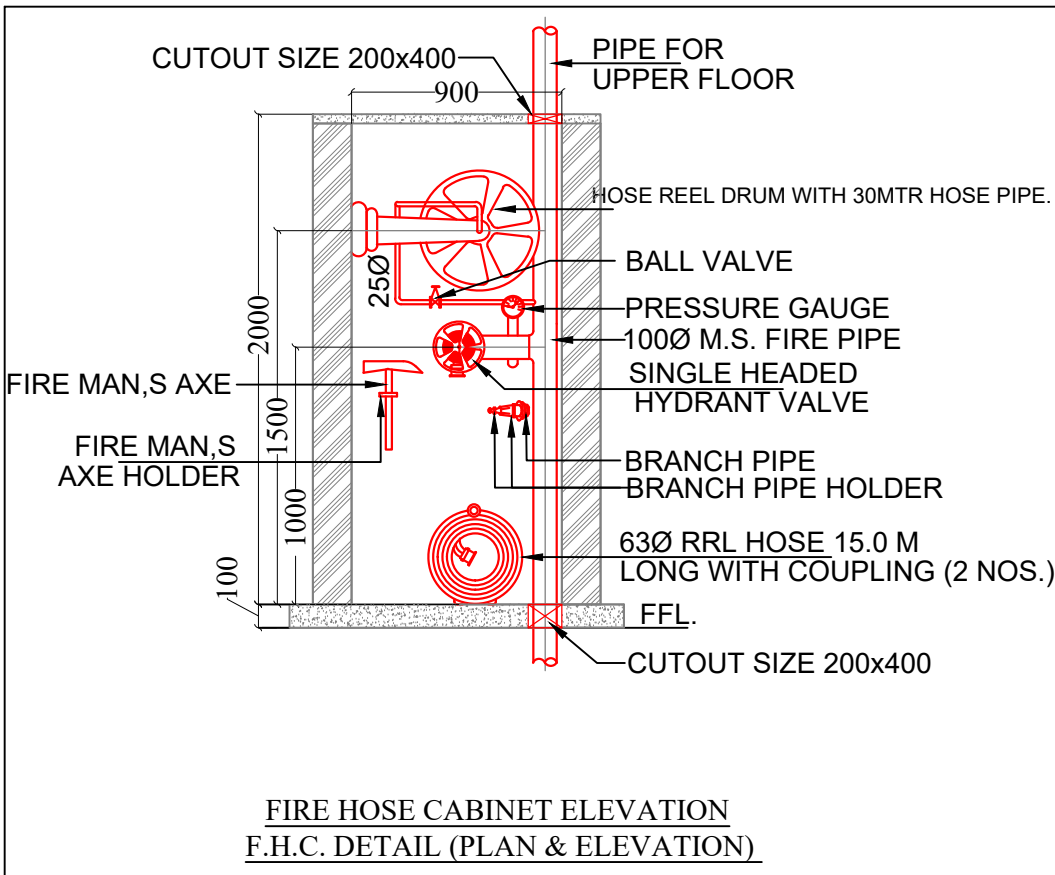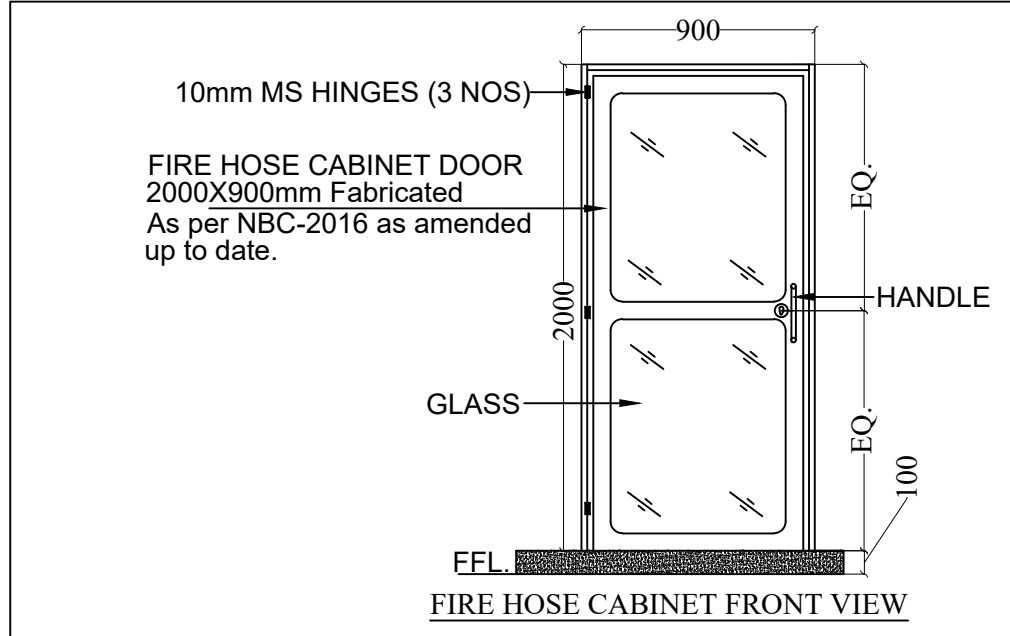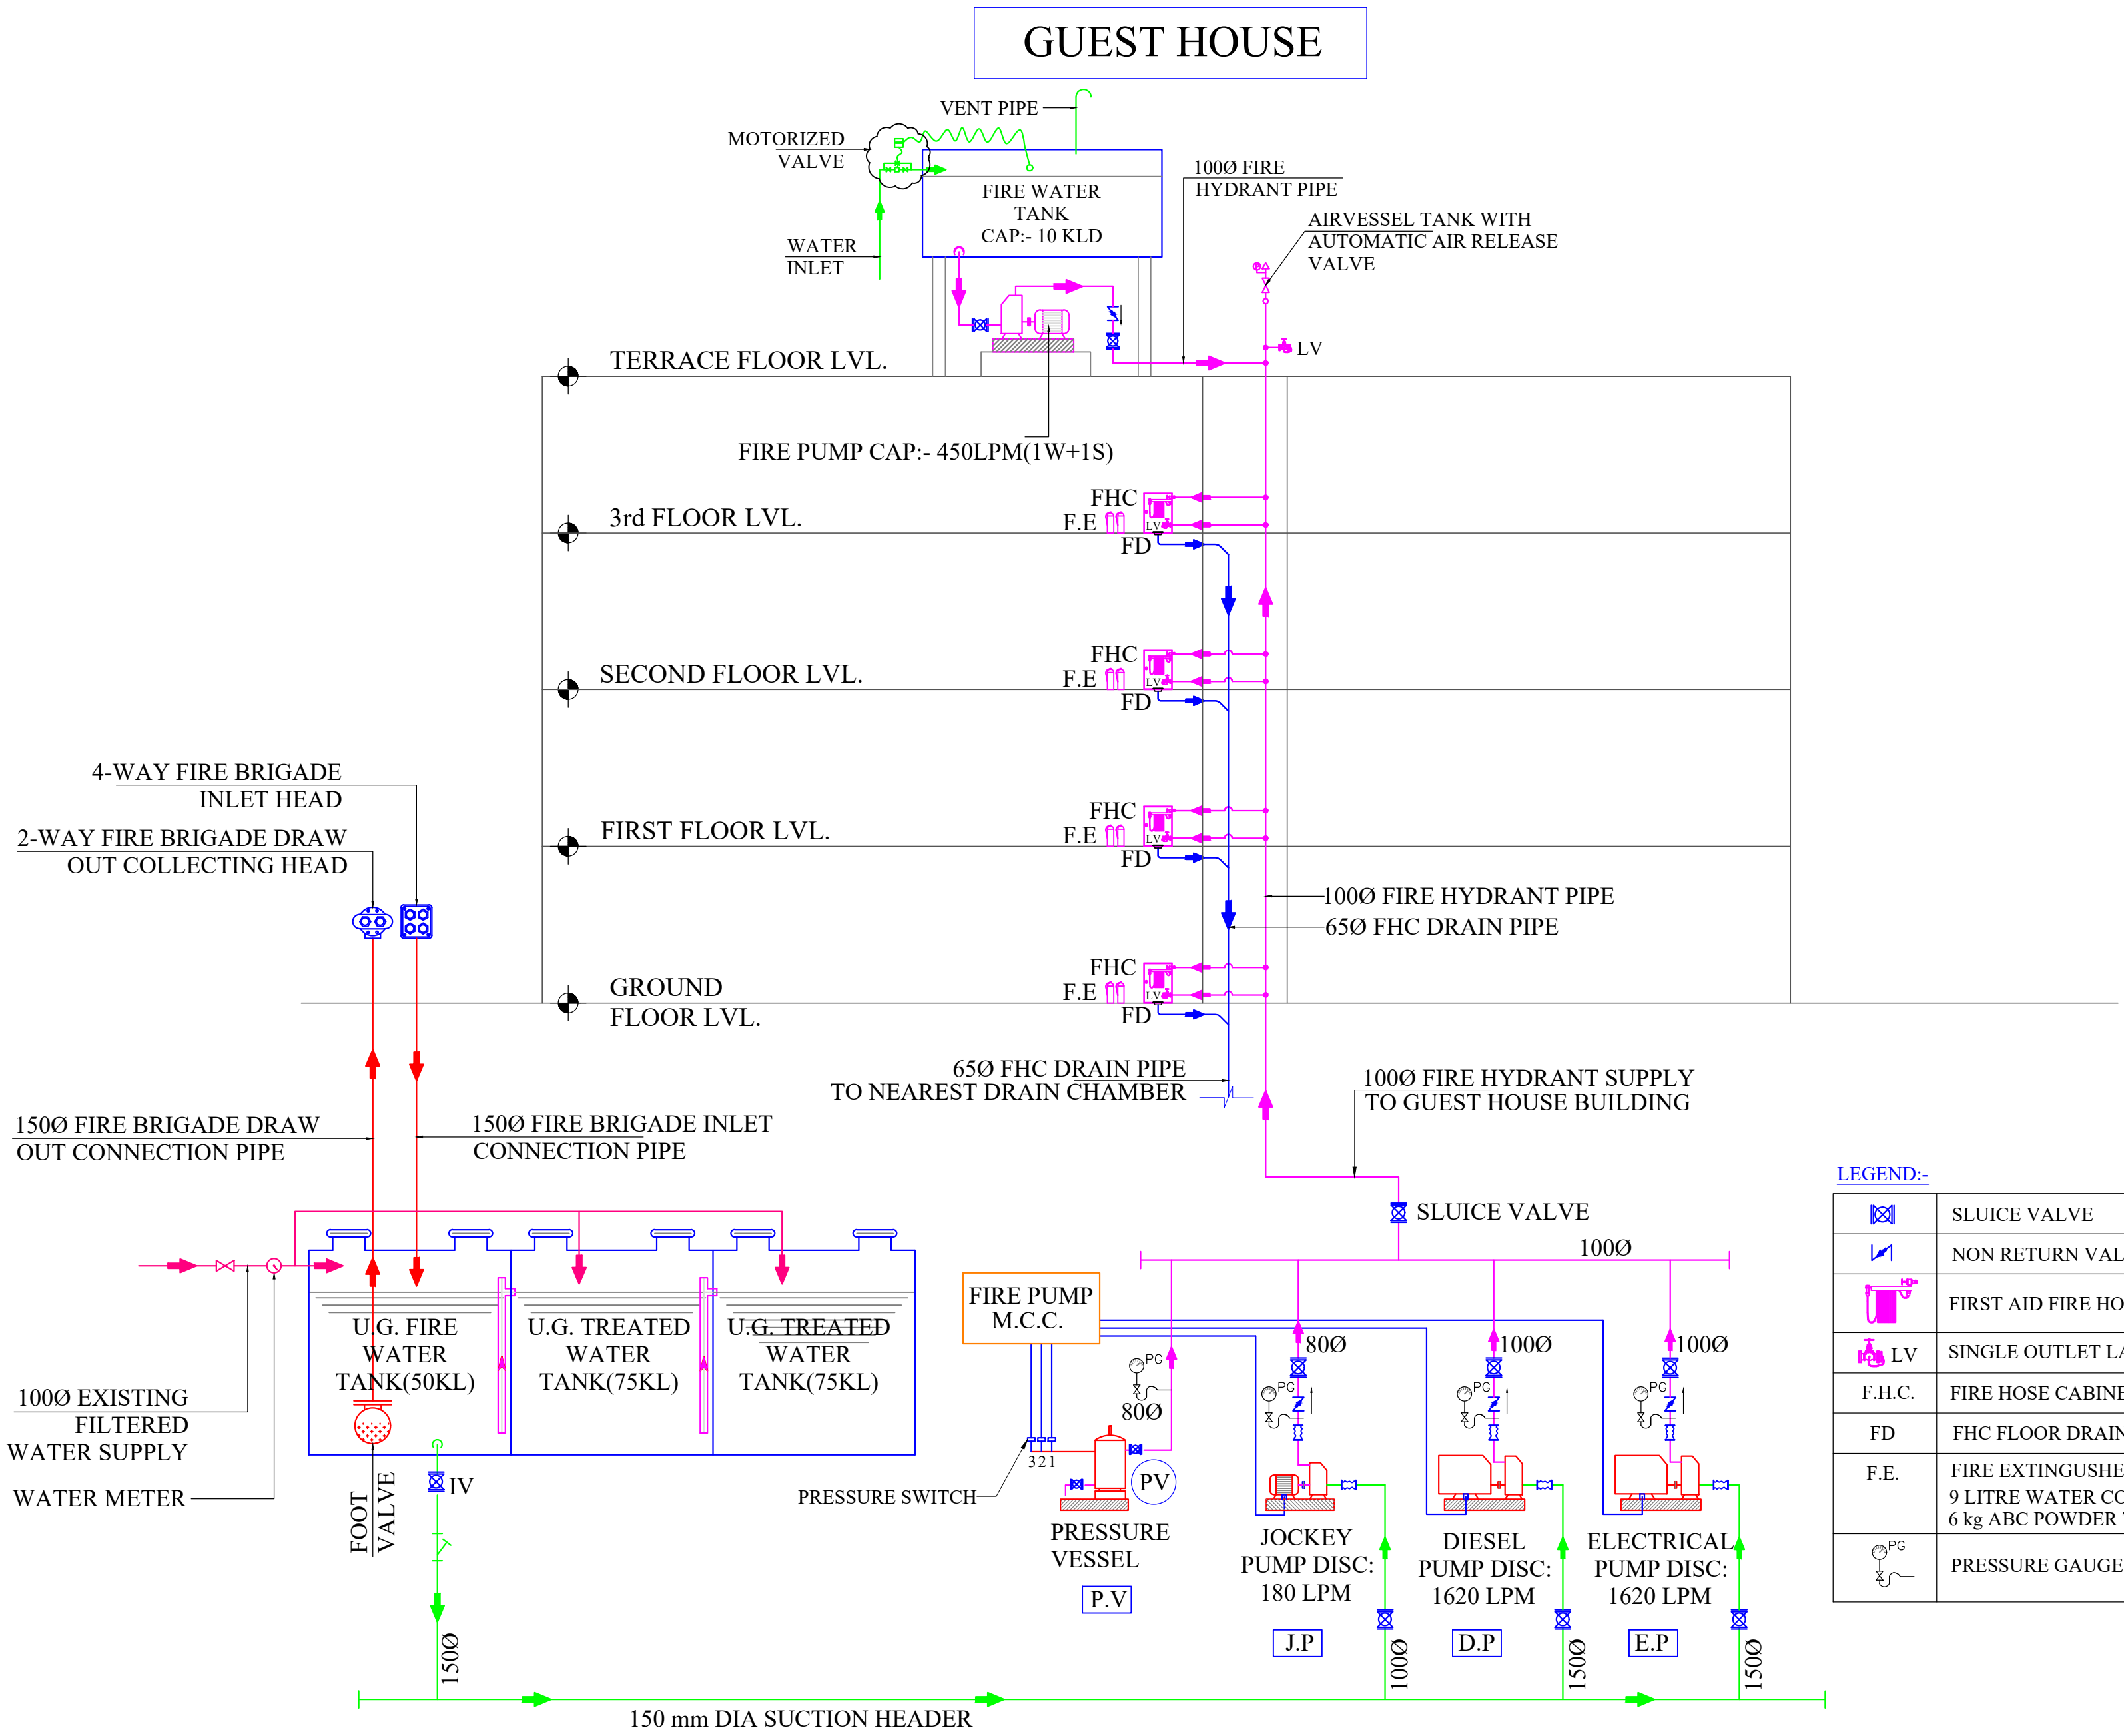

LEGEND:-

	SLUICE VALVE
	NON RETURN VALVE
	FIRST AID FIRE HOSE REEL 30m LENGTH x 20 MM Ø
	SINGLE OUTLET LANDING VALVE
	FIRE HOSE CABINET
	FHC FLOOR DRAIN
	FIRE EXTINGUISHERS 9 LITRE WATER CO2 TYPE FIRE EXTINGUISHER 6 kg ABC POWDER TYPE FIRE EXTINGUISHER
	PRESSURE GAUGE

PUMPS LEGEND:-

S.No.	INSERTS	DESCRIPTION
1.	F1	JOCKEY PUMP (FIRE) CAP,180 LPM, HEAD 70M.
2.	F2	DIESEL ENGINE DRIVEN PUMP (FIRE) CAP 1620 LPM, HEAD 70M.
3.	F3	ELECTRICAL HYDRANT PUMP (FIRE) CAP1620 LPM, HEAD 70M.

NOTE-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

NOTES:-

- ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
- WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
- ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
- DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT OIL INDIA LIMITED
(A Govt. of India Enterprise)


CONSULTANT RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE
GUEST HOUSE
FIRE SCHEMATIC

SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/FF/TEN/510

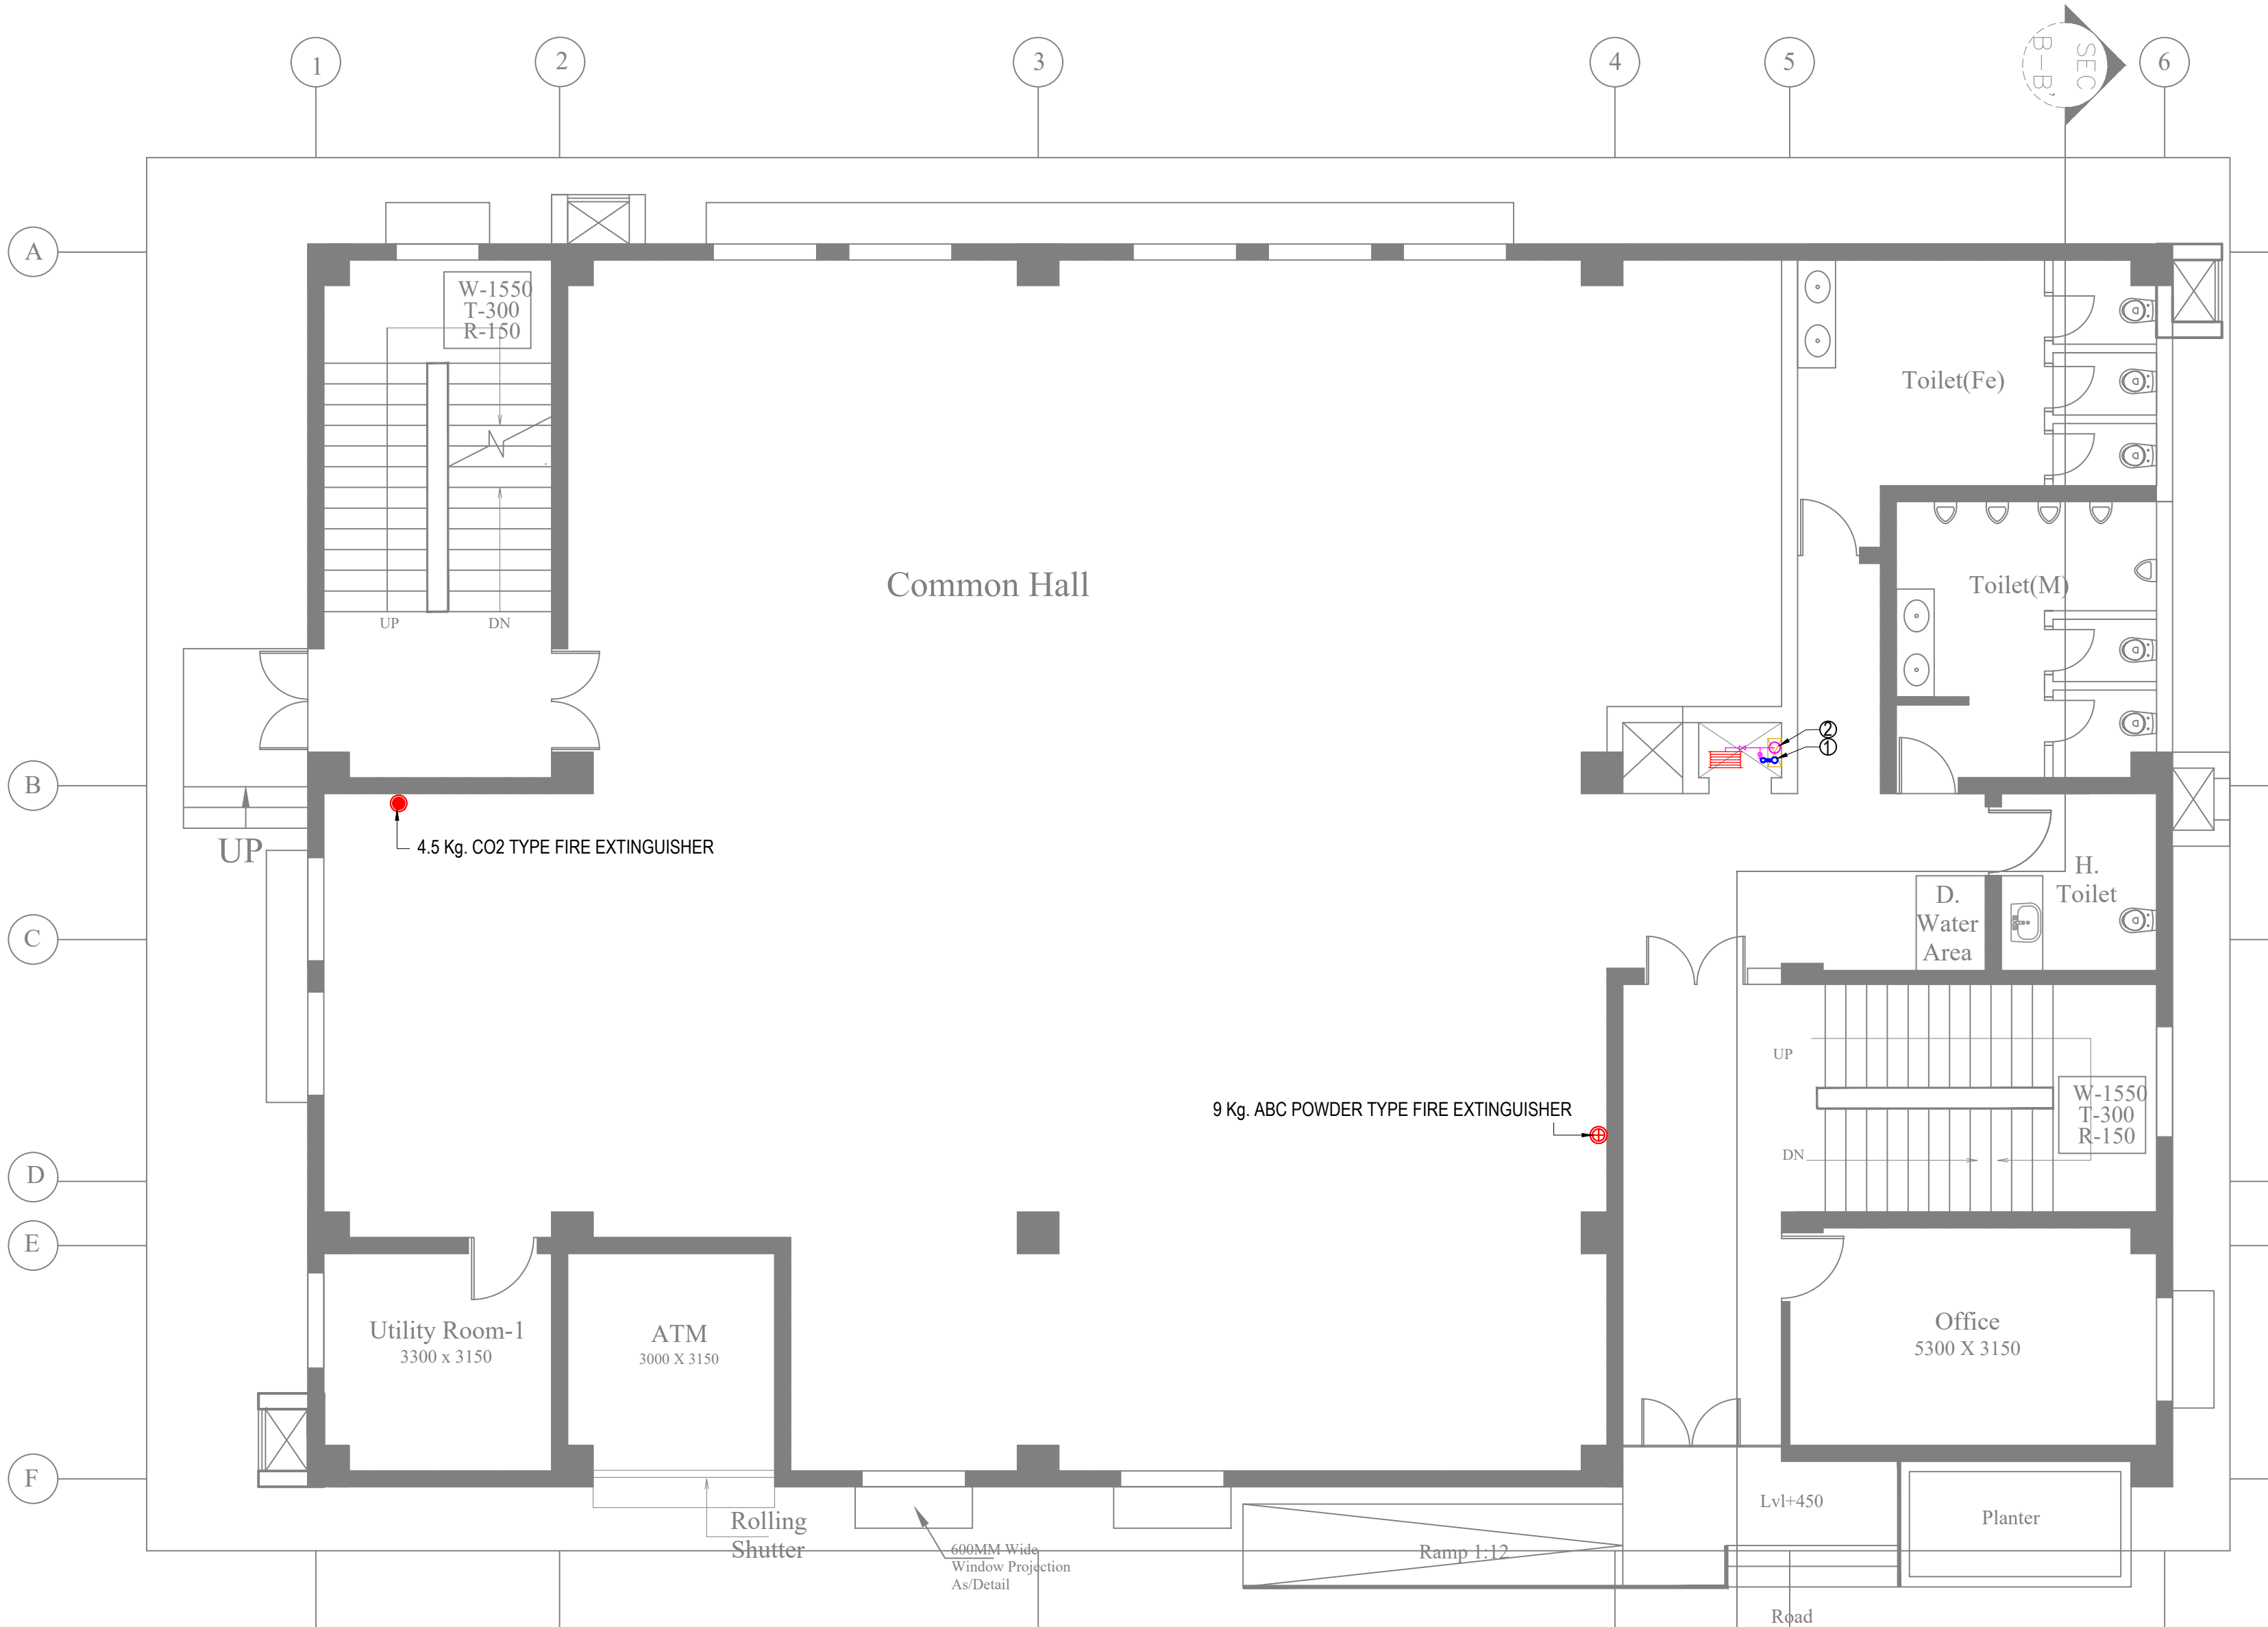

LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	100Ø FIRE HYDRANT DOWNCOMER PIPE	①
3.	65Ø FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	○
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	⊞
8.	LANDING VALVE (LV)	⊞
9.	PRESSURE GAUGE	⊞

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT



CONSULTANT



MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE

BQ WORKMEN HOUSING

DRAWING TITLE

GROUND FLOOR PLAN
COMMUNITY CENTRE
FIRE DRAWING



SCALE

DATE

DRG. NO.



NTS


JULY 2025

RITES/BLD/FF/TEN/511

GROUND FLOOR

NOTE:-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

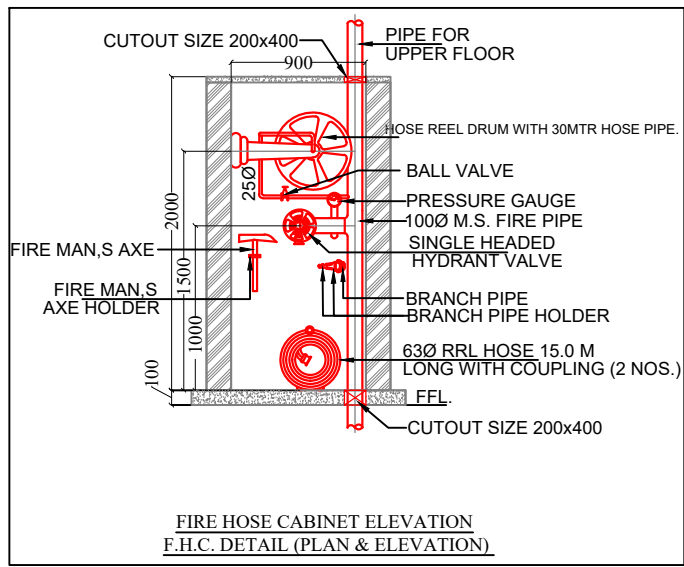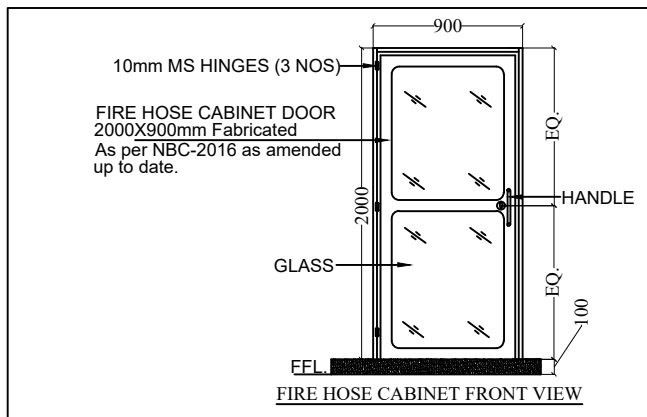

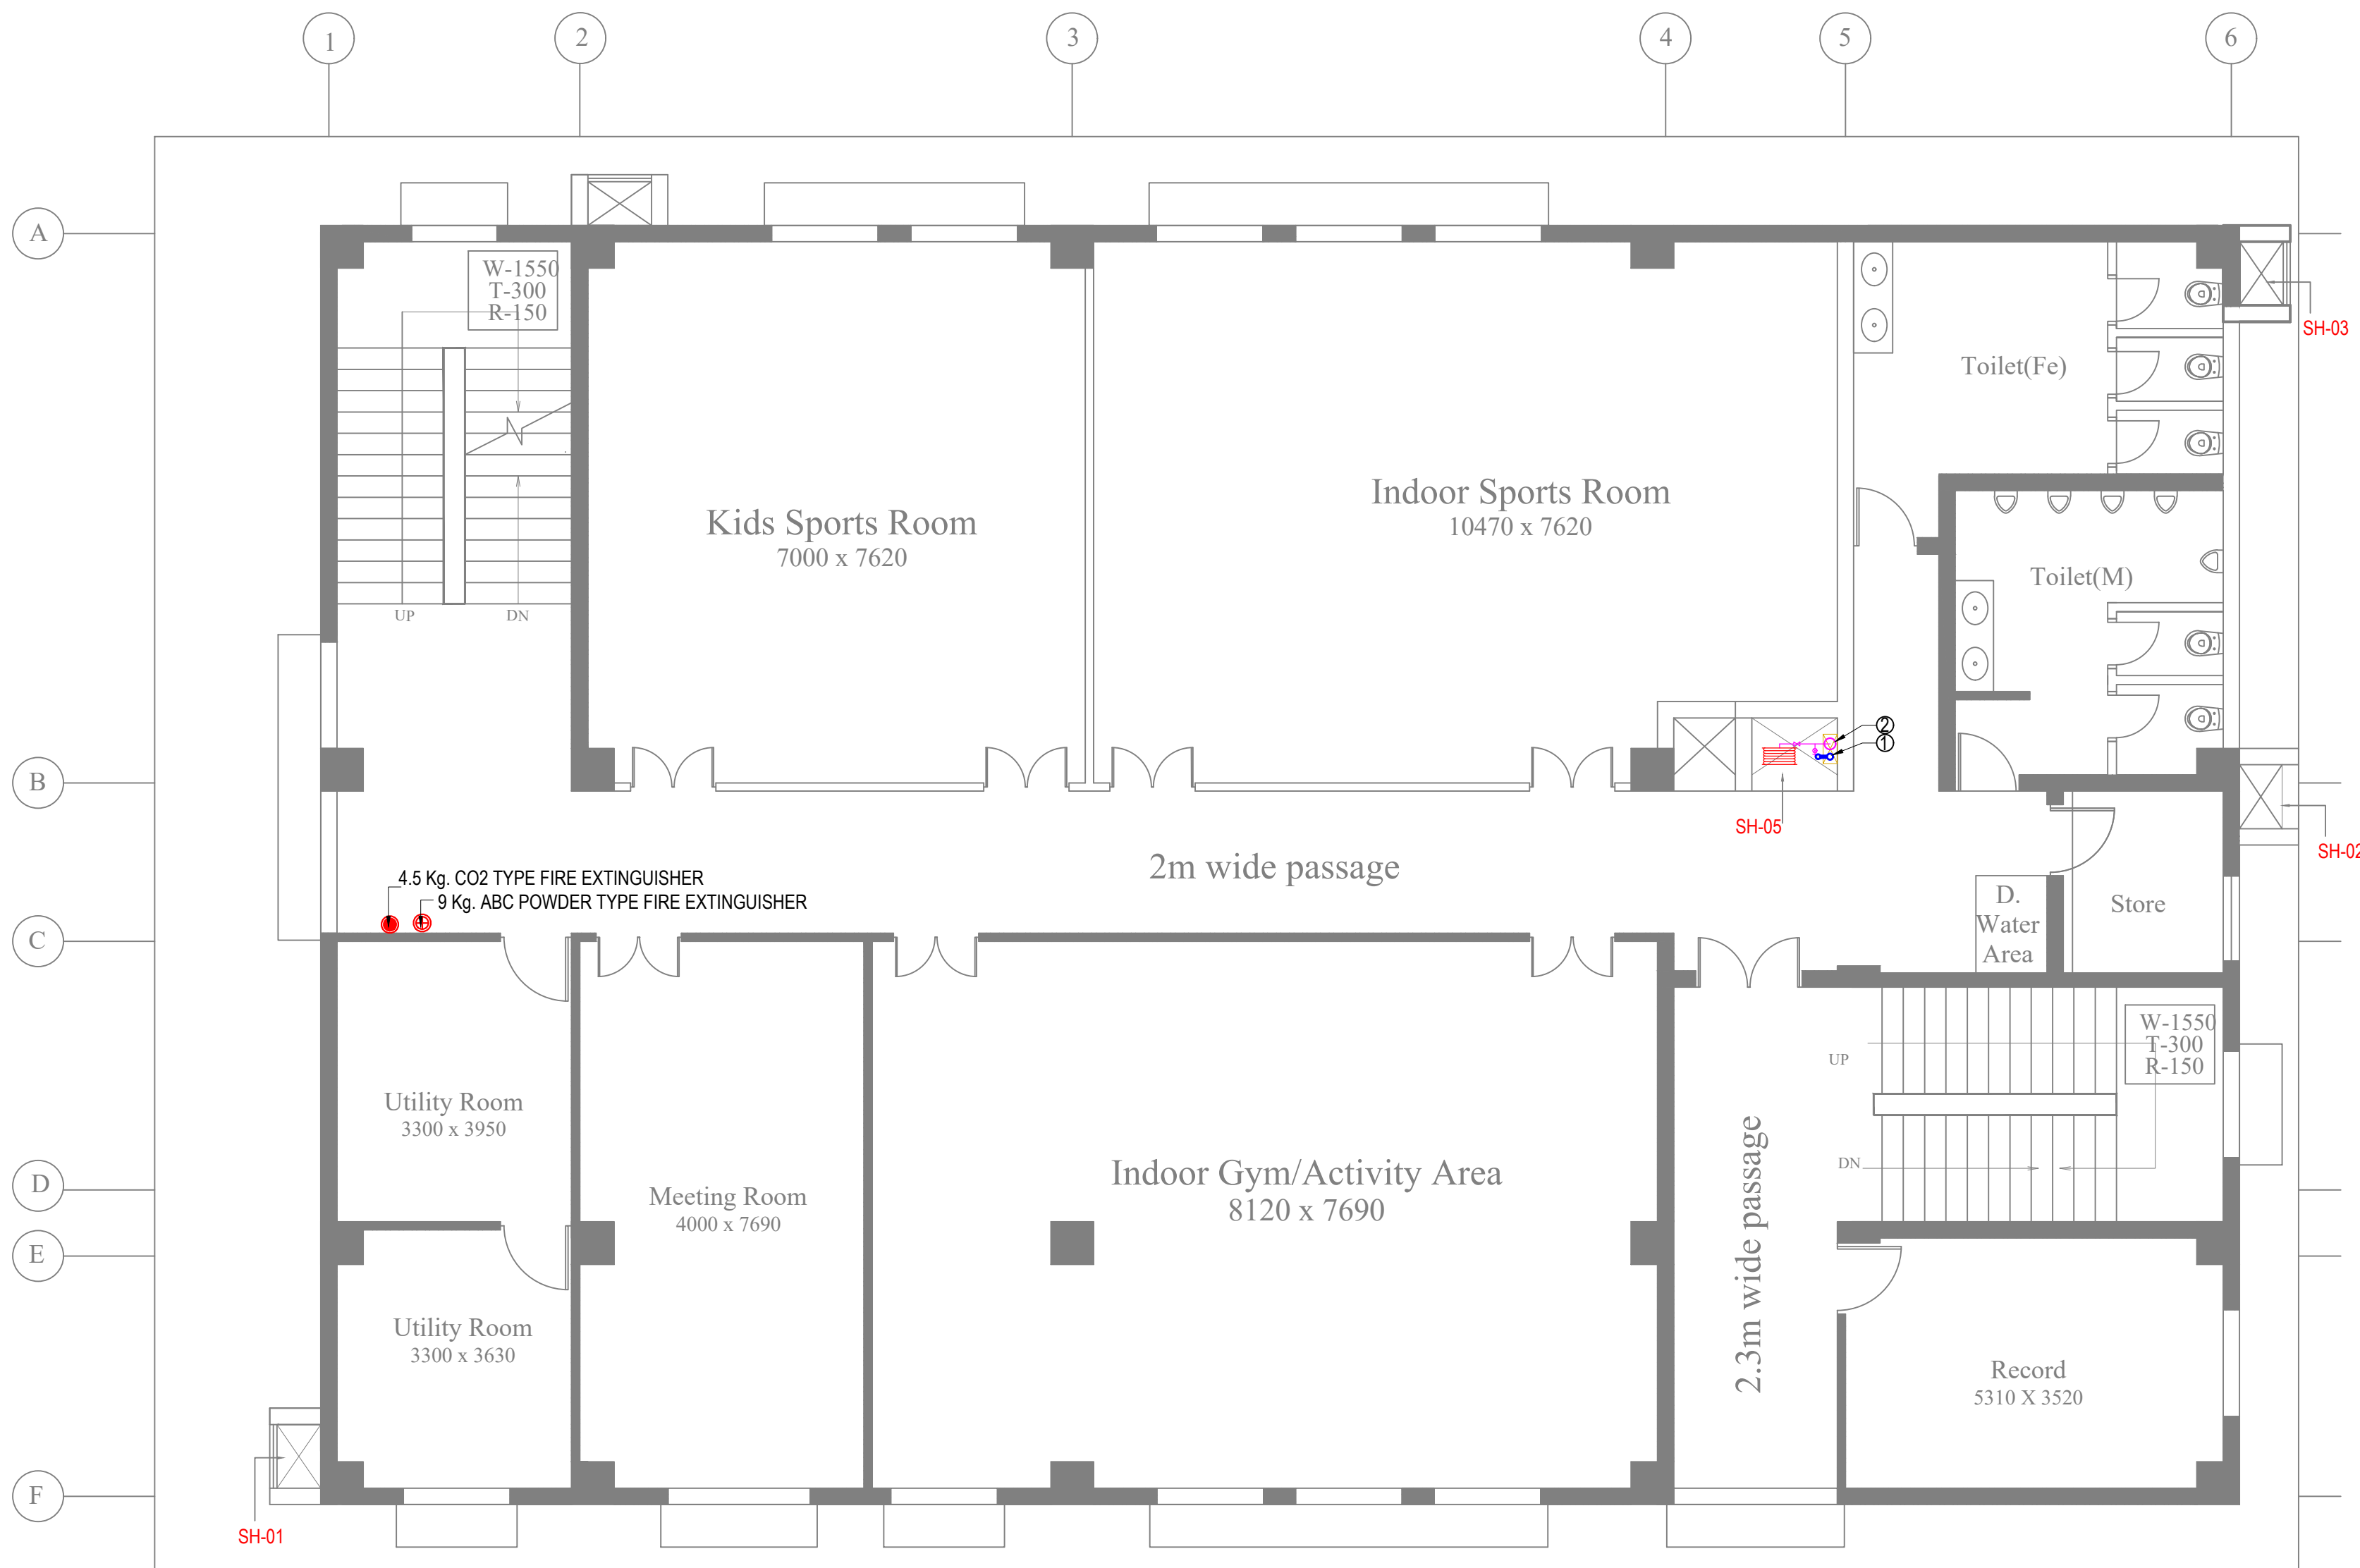

LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	100Ø FIRE HYDRANT DOWNCOMER PIPE	①
3.	65Ø FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	○
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	□
8.	LANDING VALVE (LV)	⌋
9.	PRESSURE GAUGE	⊙

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT



CONSULTANT



MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.



815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in



JOB TITLE

BQ WORKMEN HOUSING


DRAWING TITLE FIRST FLOOR PLAN
COMMUNITY CENTRE
FIRE DRAWING



SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/FF/TEN/512

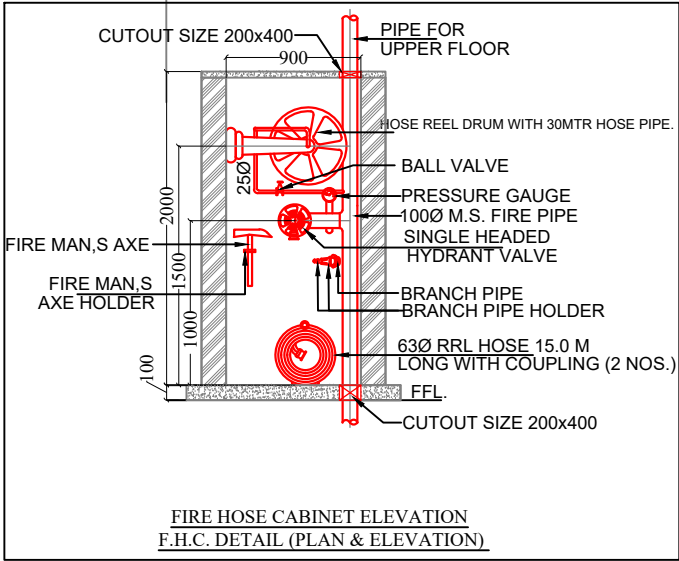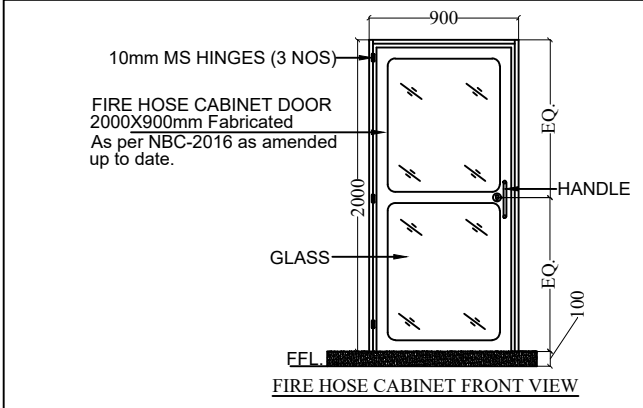

NOTE-
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

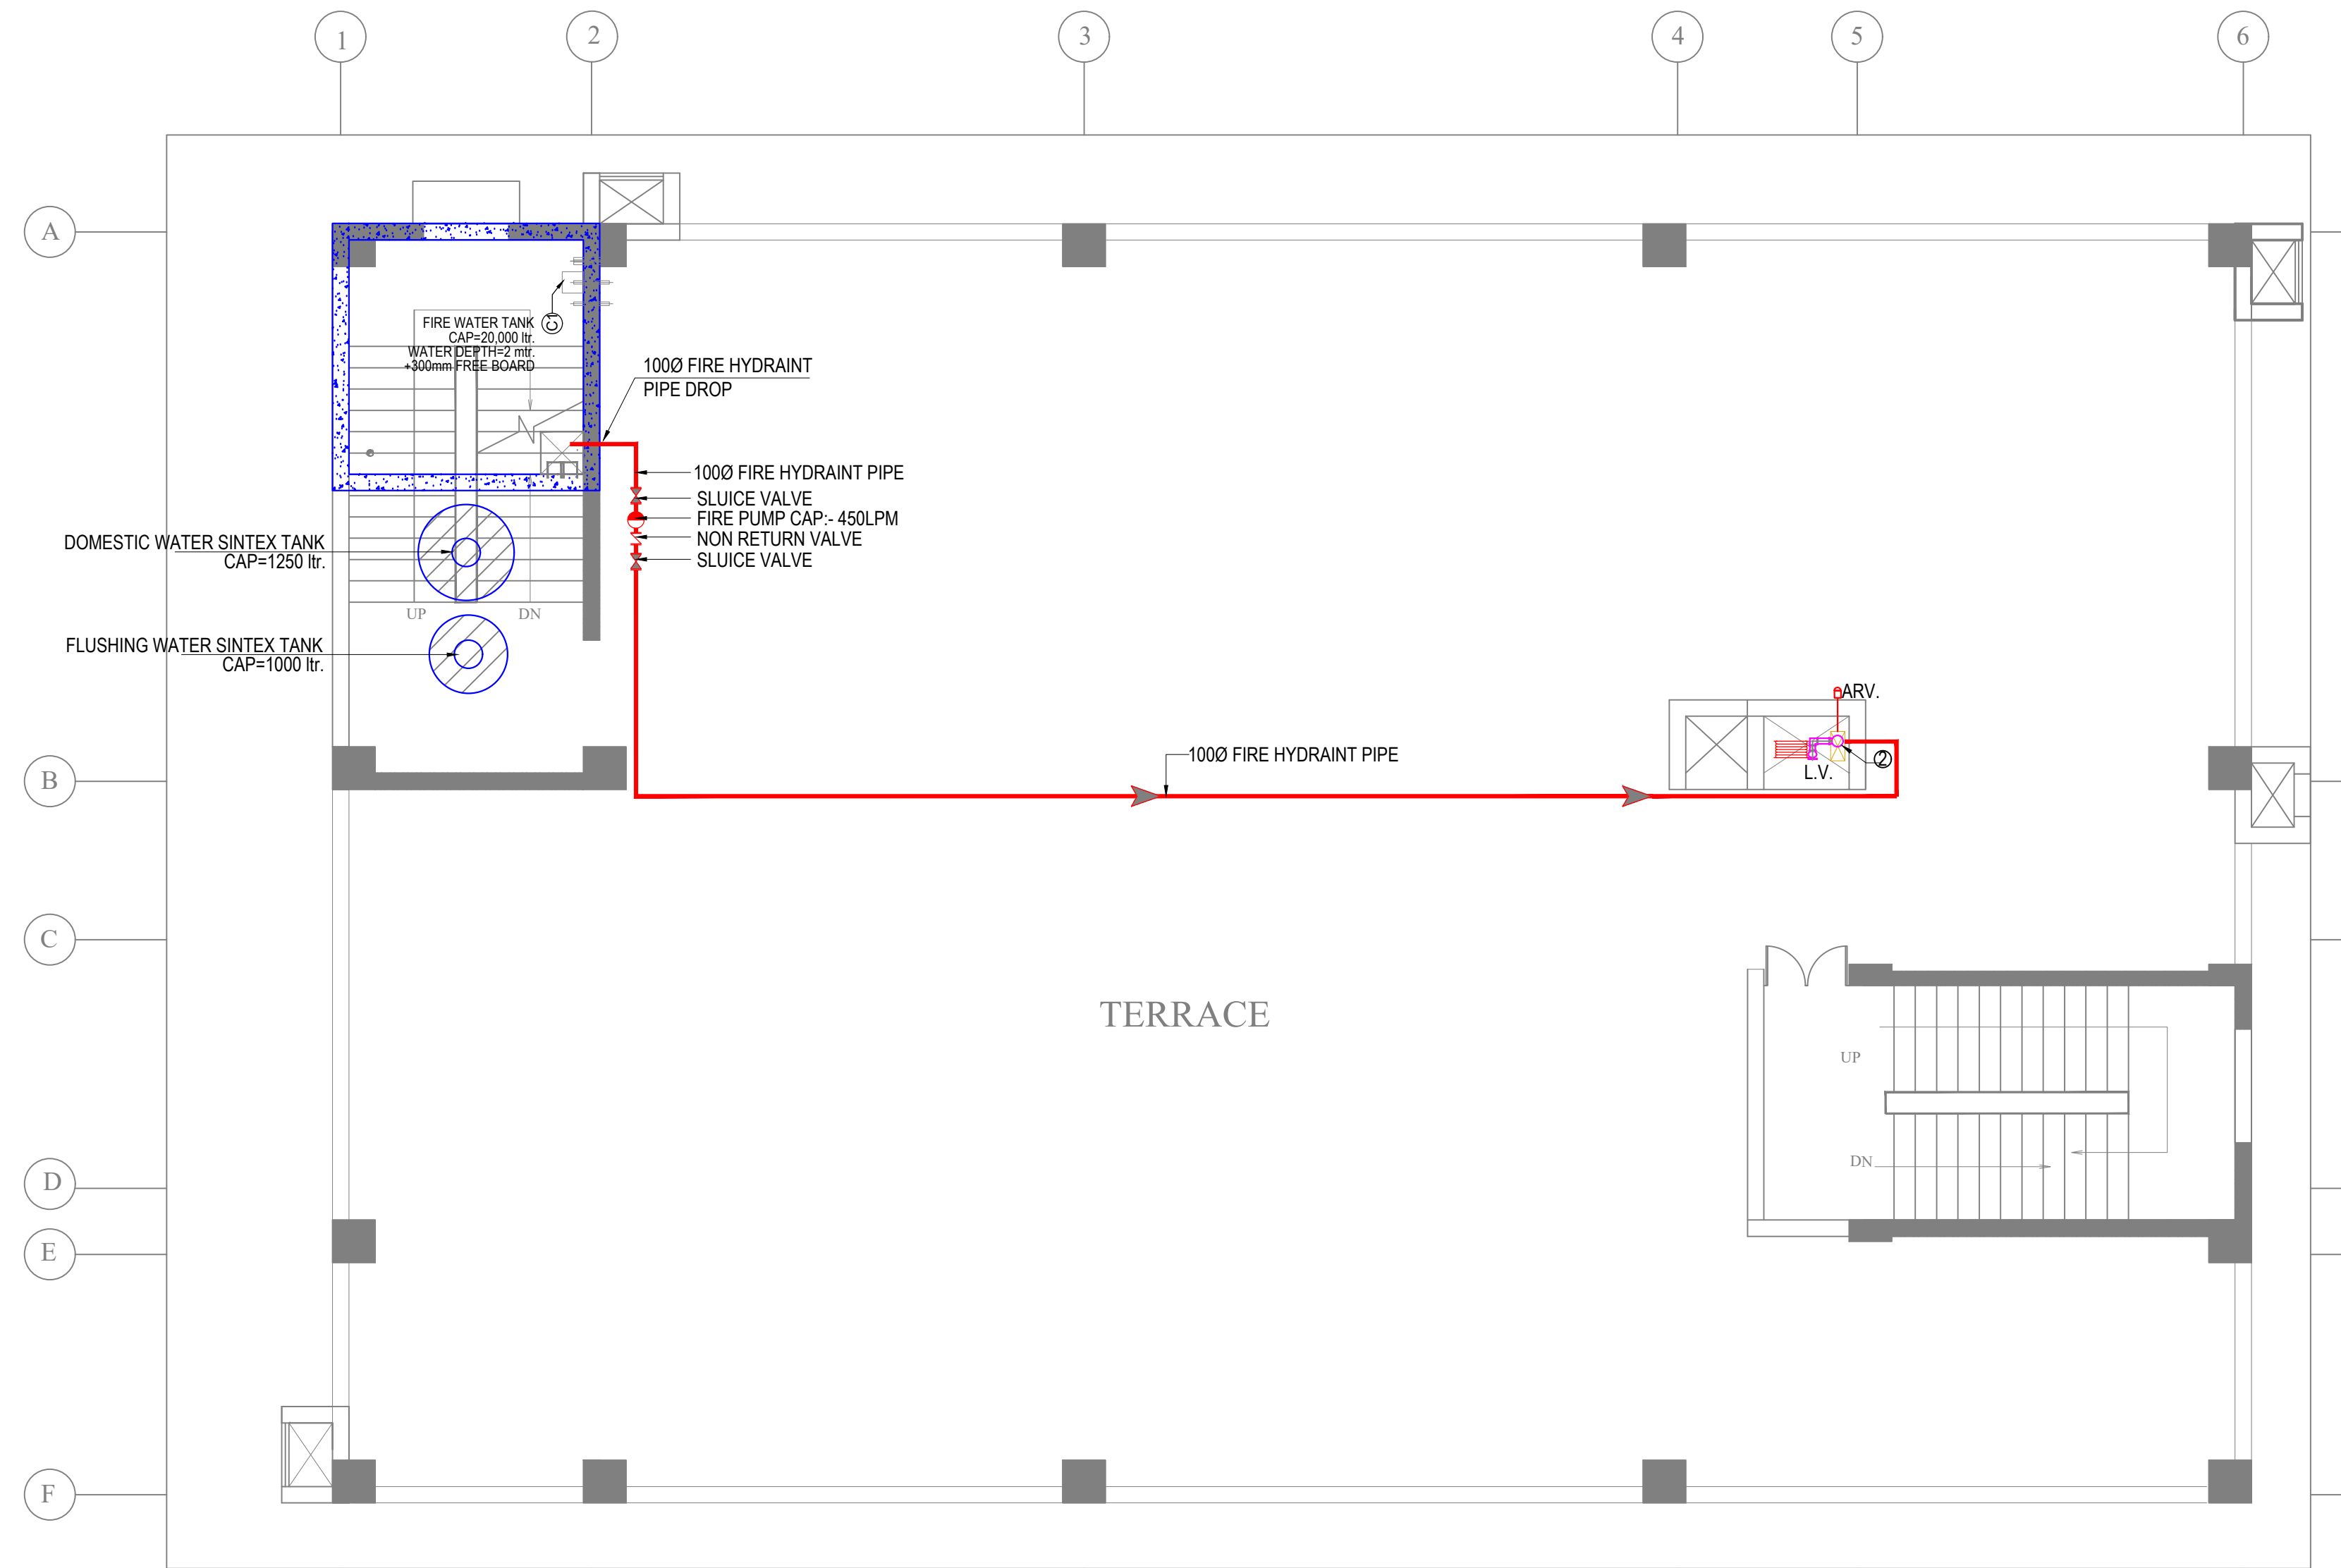

LEGEND:-		
S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REEL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	1000 FIRE HYDRANT DOWNCOMER PIPE	①
3.	650 FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	
6.	9 KG DCP FIRE EXTINGUISHER	
7.	AIR RELEASE VALVE (ARV)	
8.	LANDING VALVE (LV)	
9.	PRESSURE GAUGE	

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT



CONSULTANT



MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE



BQ WORKMEN HOUSING

DRAWING TITLE TERRACE FLOOR PLAN
COMMUNITY CENTRE
FIRE DRAWING




SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/FF/TEN/513

NOTE--
SYNTHETIC FIRE HOSES TYPE-III (63 Ø AND 15M) AS PER IS:636.

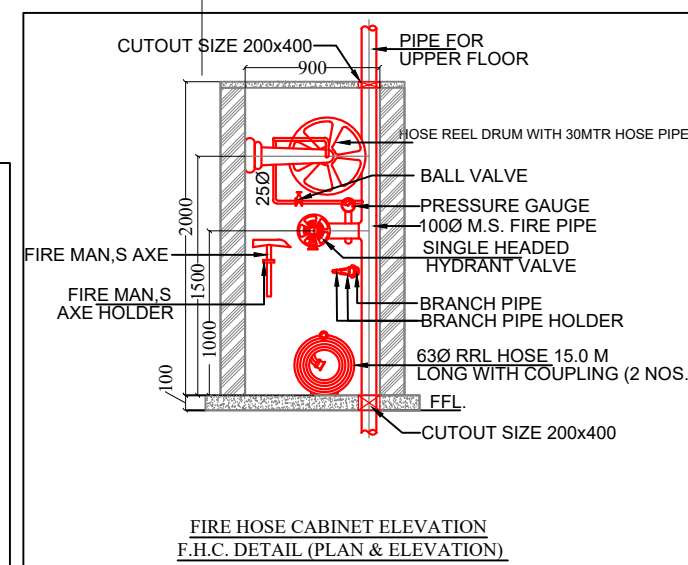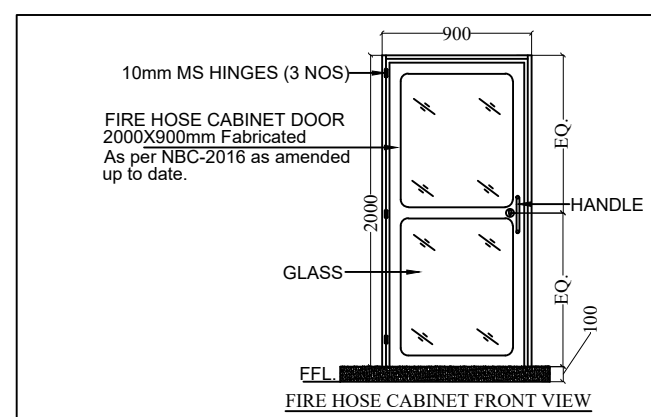

TERRACE FLOOR

COMMUNITY CENTRE

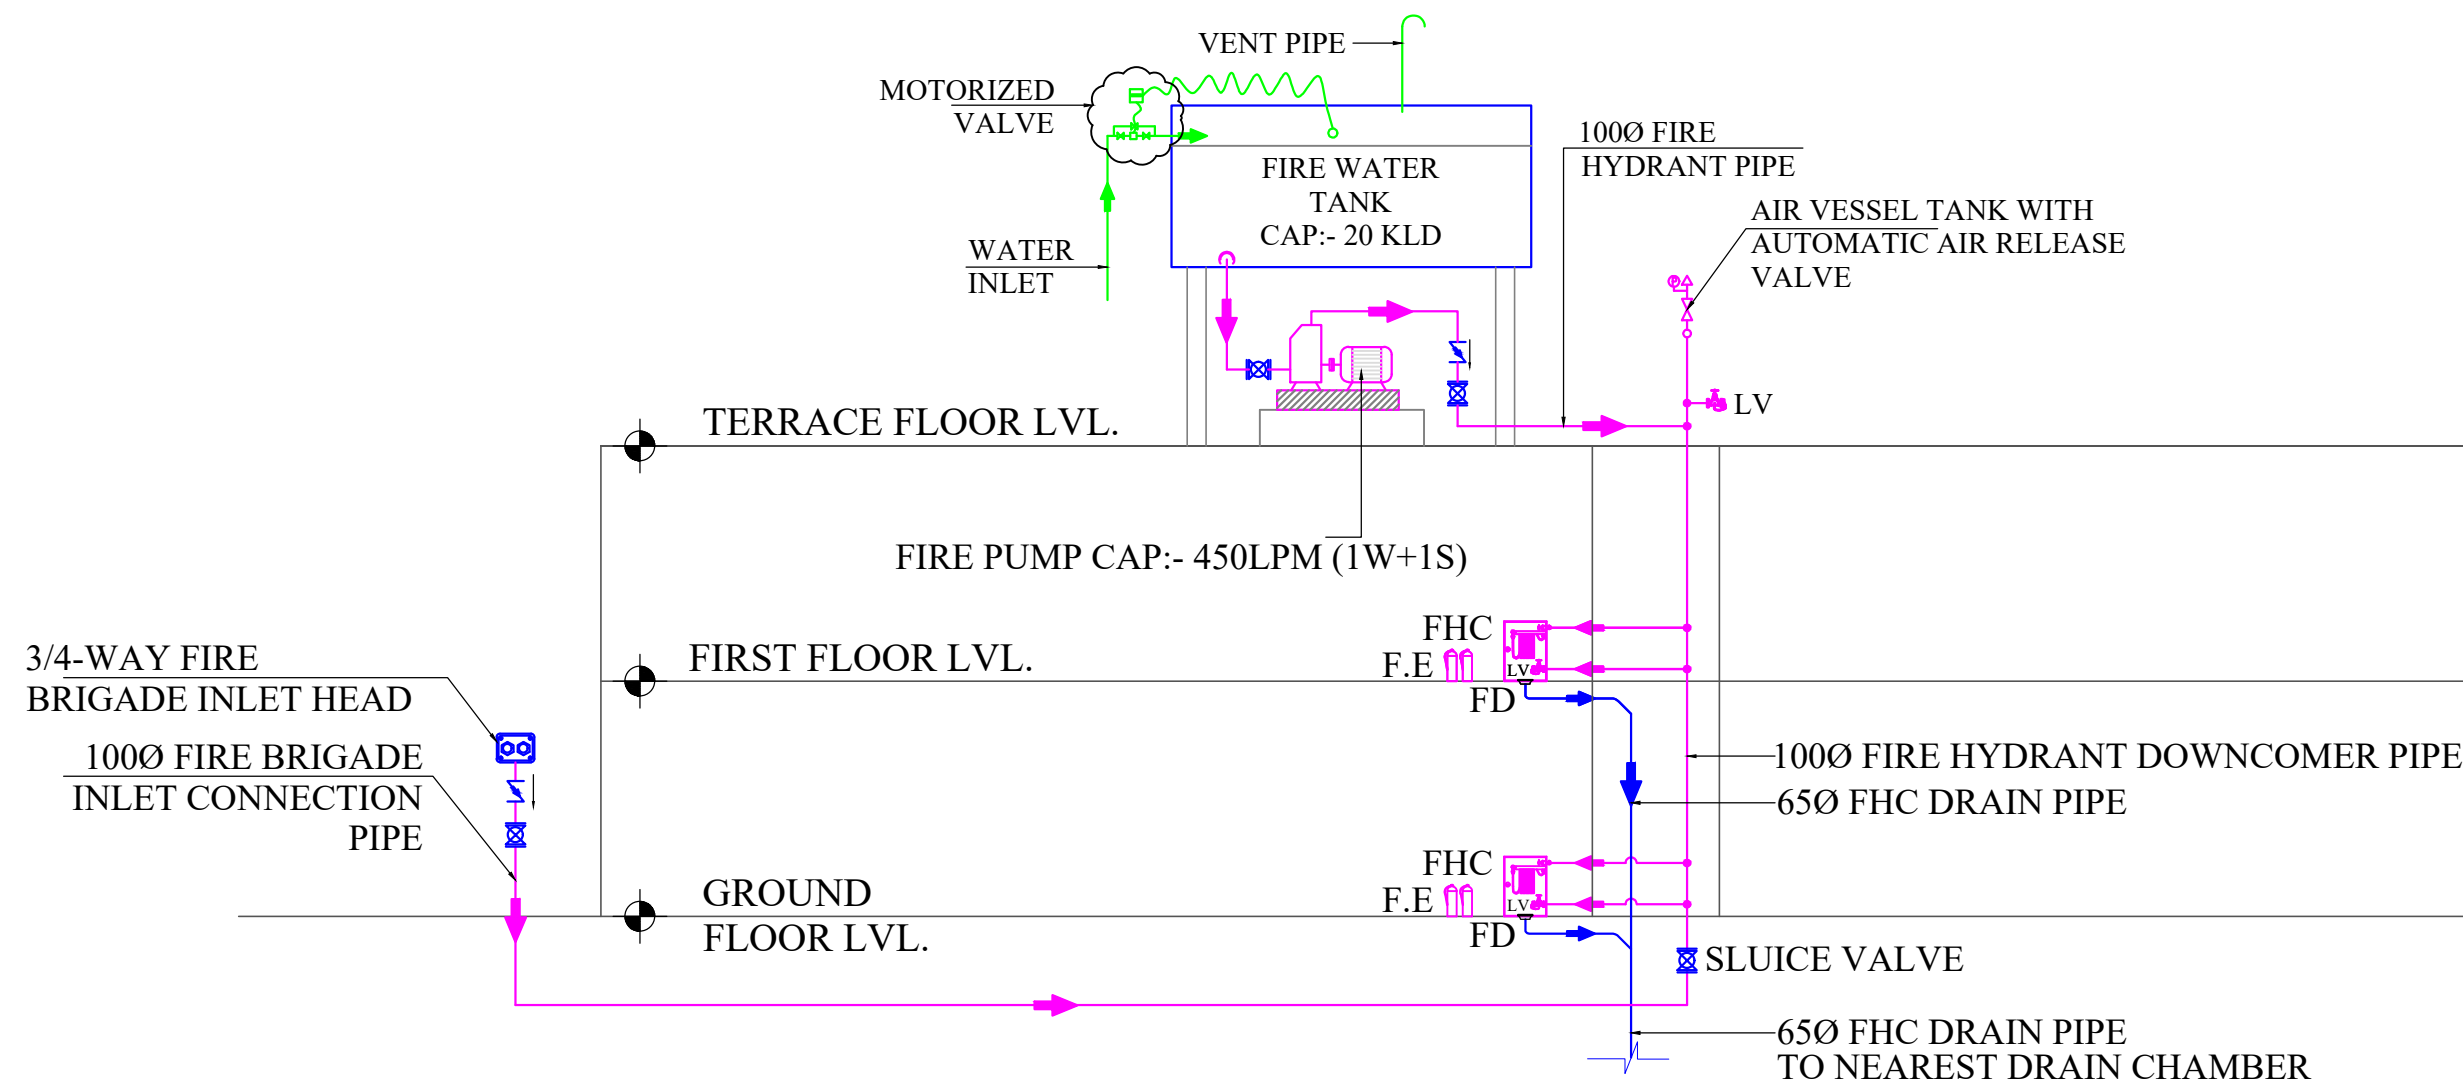



LEGEND:-

S.NO	DESCRIPTION	SYMBOL
1.	FIRE HOSE CABINET FIRE HOSE CABINET COMPRISING OF: a. 1 NO. LANDING VALVE b. 1 NO. HOSE REAL DRUM WITH 30mtr. c. 2 NOS. 15mtr. LONG RRL HOSE. d. 1 NO. BRANCH PIPE.	FHC
2.	100Ø FIRE HYDRANT DOWNCOMER PIPE	①
3.	65Ø FHC DRAIN PIPE	②
4.	DRAIN POINT (DP)	○
5.	4.5 CO2 TYPE FIRE EXTINGUISHER	●
6.	9 KG DCP FIRE EXTINGUISHER	⊕
7.	AIR RELEASE VALVE (ARV)	□
8.	LANDING VALVE (LV)	LV
9.	PRESSURE GAUGE	⊙

LEGEND:-

⊗	SLUICE VALVE
⌋	NON RETURN VALVE
⊕	FIRST AID FIRE HOSE REEL 30m LENGTH x 20 MM Ø
LV	SINGLE OUTLET LANDING VALVE
F.H.C.	FIRE HOSE CABINET
FD	FHC FLOOR DRAIN
F.E.	FIRE EXTINGUISHERS 9 KG DCP FIRE EXTINGUISHER 4.5 CO2 TYPE FIRE EXTINGUISHER

NOTE—
SYNTHETIC FIRE HOSES TYPE—III (63 Ø AND 15M) AS PER IS:636.

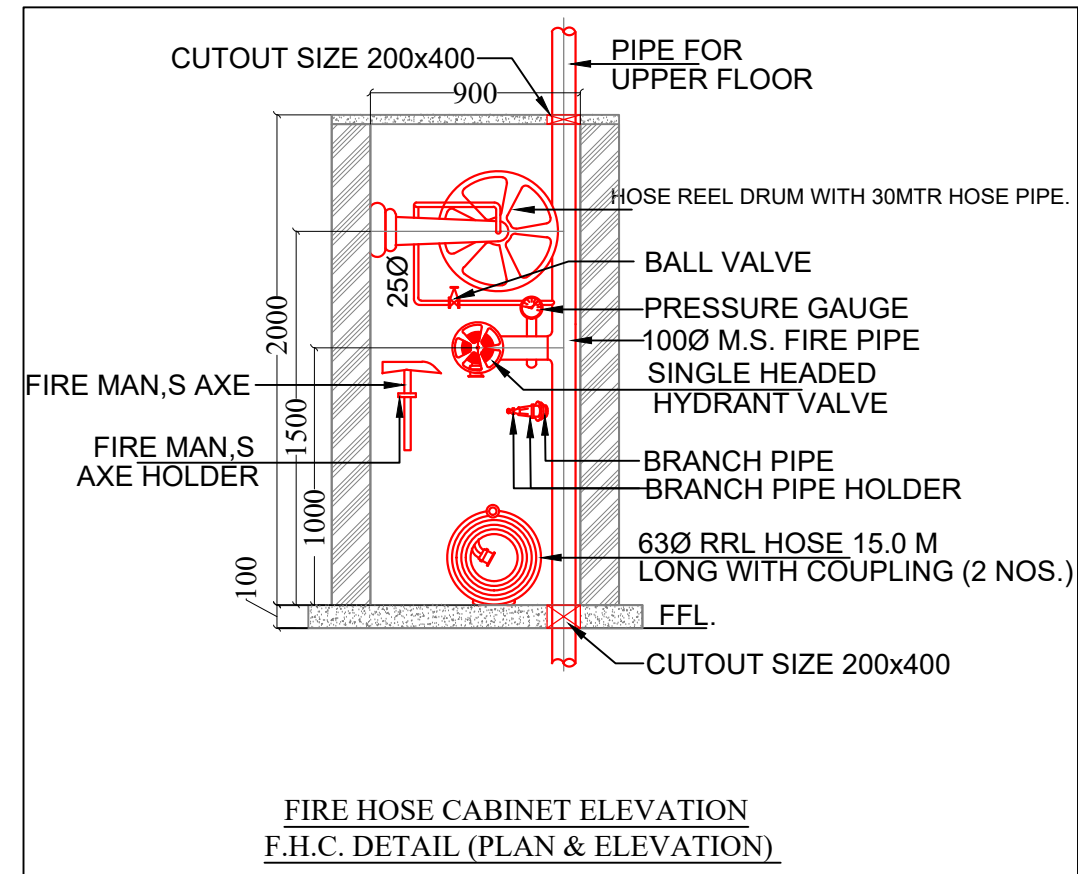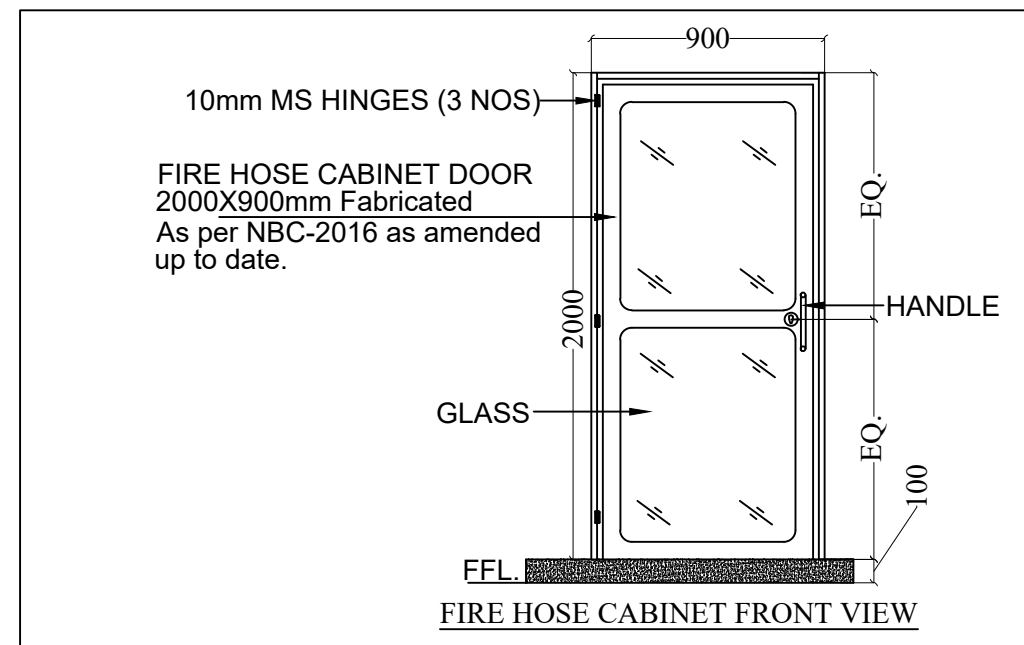

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT



CONSULTANT



MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE

BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE

COMMUNITY CENTRE
FIRE SCHEMATIC



SCALE


NTS

DATE


JULY 2025

DRG. NO.

RITES/BLD/FF/TEN/514

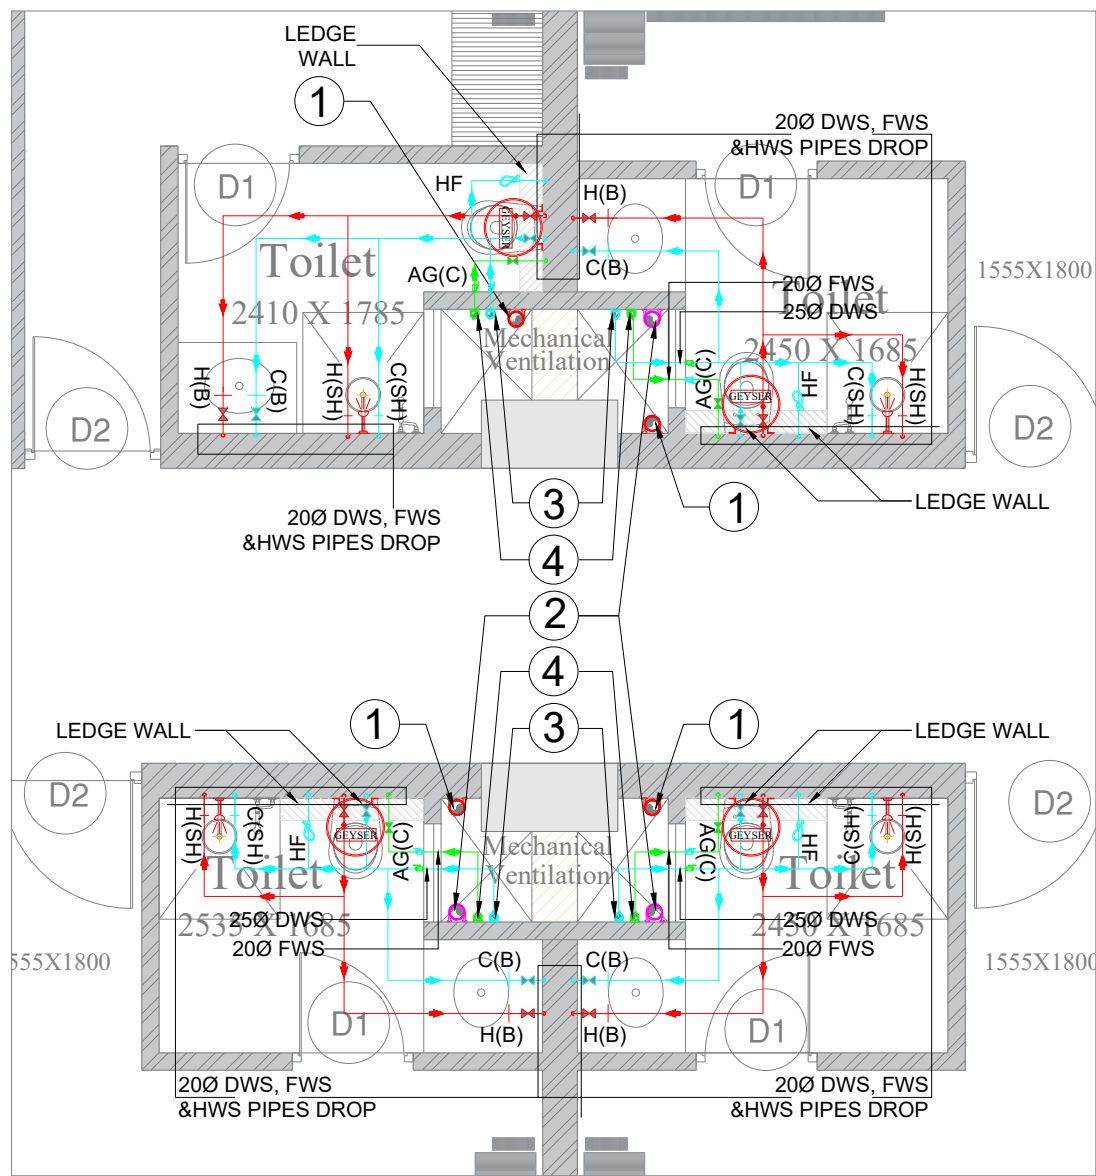

TYPICAL TOILET
WATER SUPPLY LAYOUT

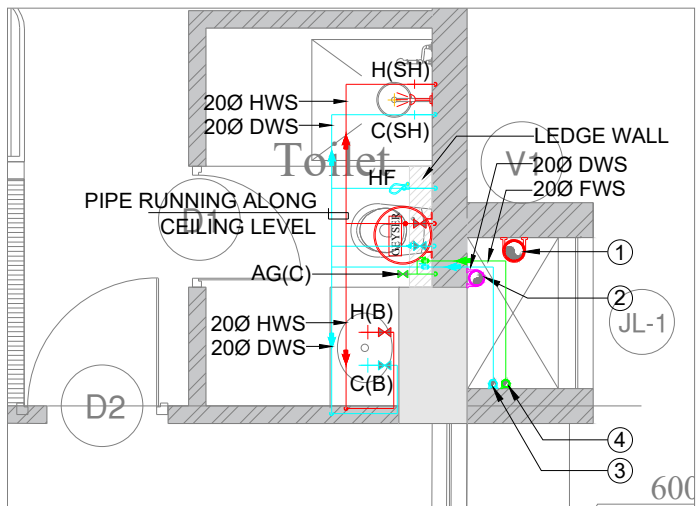


TYPICAL TOILET
WATER SUPPLY LAYOUT


DETAILS OF SANITARY FIXTURES TO BE INSTALLED		
SYMBOL DESCRIPTION	*MOUNTING HEIGHT (MM.)*	*MOUNTING HEIGHT (MM.)*
AG(B)	ANGLE VALVE WITH WALL FLANGE AND CP PIPE FOR BASIN MIXER	450
AG(S)	ANGLE VALVE WITH WALL FLANGE FOR SINK	450
AG(RO)	ANGLE VALVE WITH WALL FLANGE FOR REVERSE OSMOSIS FOR KITCHEN	AS/ARCH.
AG(C)	ANGLE VALVE WITH WALL FLANGE AND CP PIPE FOR CISTERN	450
AG(D)	ANGLE VALVE FOR DRINKING	1200
AG(G)	ANGLE VALVE FOR GEYSER	AS/ARCH.
HF	HEALTH FAUCET	450
TAP	COLD TAP	AS PER ARCH.
	PIPE DROP	
	DOMESTIC WATER SUPPLY(DWS)	
	FLUSHING WATER SUPPLY(FWS)	
	BALL VALVE	
	FLOW DIRECTION	
	HOT WATER SUPPLY (HWS)	
H(S) C(S)	SINK MIXER	AS/ARCH.
H(SH) C(SH)	WALL MIXER FOR OVERHEAD SHOWER	1210
	CONCEALED CEILING MOUNTED SHOWER HEAD	AS PER ARCH.
C(B) H(B)	BASIN MIXER	AS/ARCH.
	GEYSER	AS PER ARCH.

- PLUMBING NOTES:-
- ALL PIPE DIAMETERS ARE IN MM.
 - THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 - MANHOLES SHALL BE CONSTRUCTED AS PER STANDARD DETAILS.
 - SOIL,WASTE,RAIN & VENT PIPE WORK :-
SOIL,WASTE & VENT PIPES WORKS SHALL BE CARRIED OUT IN uPVC PIPES CLASS "B" SOLVENT CEMENT AND FITTINGS CONFORMING TO IS : 13592
 - ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:50 AND NOT STEEPER THAN 1:10 UNLESS SPECIFIED OTHERWISE
 - WATER SUPPLY PIPE WORK :-
WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC (SDR-11) CONFORMING TO ASTM STANDARDS. ALL PIPE FITTINGS SHALL BE OF CPVC OF CLASS SAME AS PIPE CONFORMING TO ASTM STANDARDS SUITABLE FOR SOLVENT CEMENT JOINTS AS PER MFR.
 - NO PIPE WORK SHALL BE CONCEALED IN WALLS OR BURIED IN FLOORS WITHOUT BEING SUBJECTED TO WATER TESTING AS PER THE DIRECTION OF THE SITE ENGINEER.
 - ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR
 - WATER INLETS AND WASTE OUTLETS FROM SANITARY WARE SHALL BE ARRANGED TO SUIT REQUIREMENTS OF SELECTED MAKES AND MODELS.
 - ALL STONEWARE PIPES SHALL BE ENCASED IN 150 MM. THICK 1:5:10 CEMENT CONCRETE ALL AROUND.
 - FLOOR TRAPS:-
ALL FLOOR TRAPS SHALL BE FORMED OF 100X100 MM. DIA 'P' TRAP WITH 100 MM. DIA uPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
 - FLOOR DRAIN:-
DRAIN POINTS SHALL BE FORMED OF 75X75 MM. DIA uPVC ELBOW WITH 75 MM. DIA C.P. GRATING WITH FRAME.


PLUMBING LEGENDS:-	
1. 100Ø uPVC SOIL PIPE	①
2. 100Ø uPVC WASTE PIPE	②
3. DOMESTIC WATER SUPPLY PIPE	③
4. FLUSHING WATER SUPPLY PIPE	④
5. 75Ø uPVC BALCONY WASTE PIPE	⑤
6. 150Ø uPVC RAIN WATER PIPE	⑥
7. DOMESTIC WATER RISER PIPE	⑦
8. FLUSHING WATER RISER PIPE	⑧
9. PNG GAS SUPPLY RISER PIPE	⑨

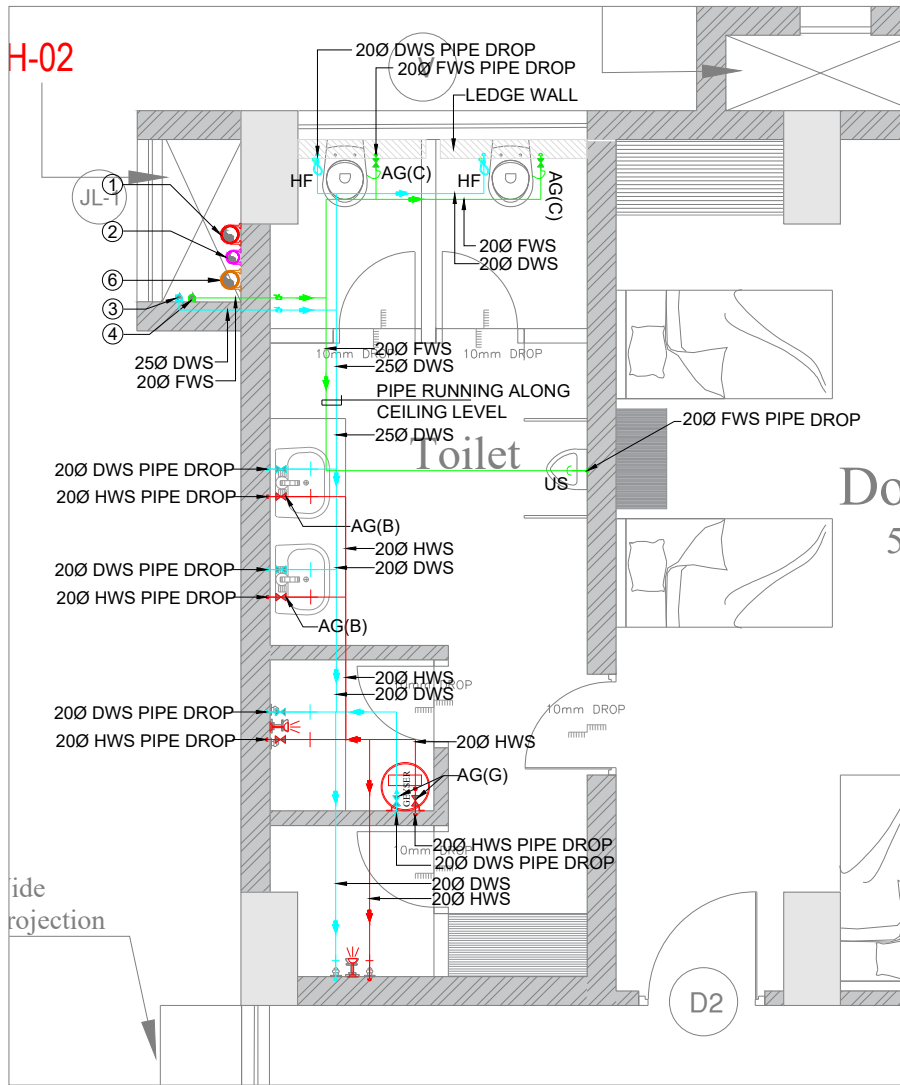

TYPICAL TOILET
WATER SUPPLY LAYOUT

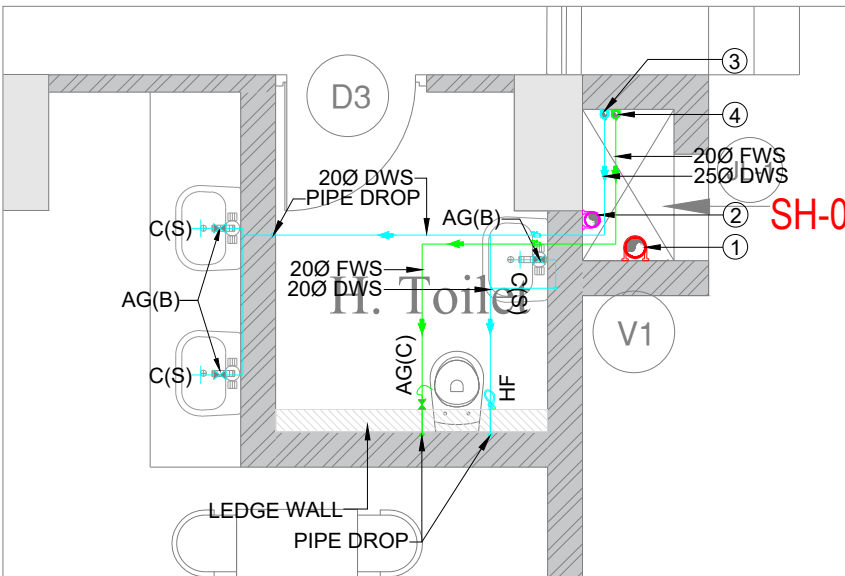

HANDICAP TOILET
WATER SUPPLY LAYOUT

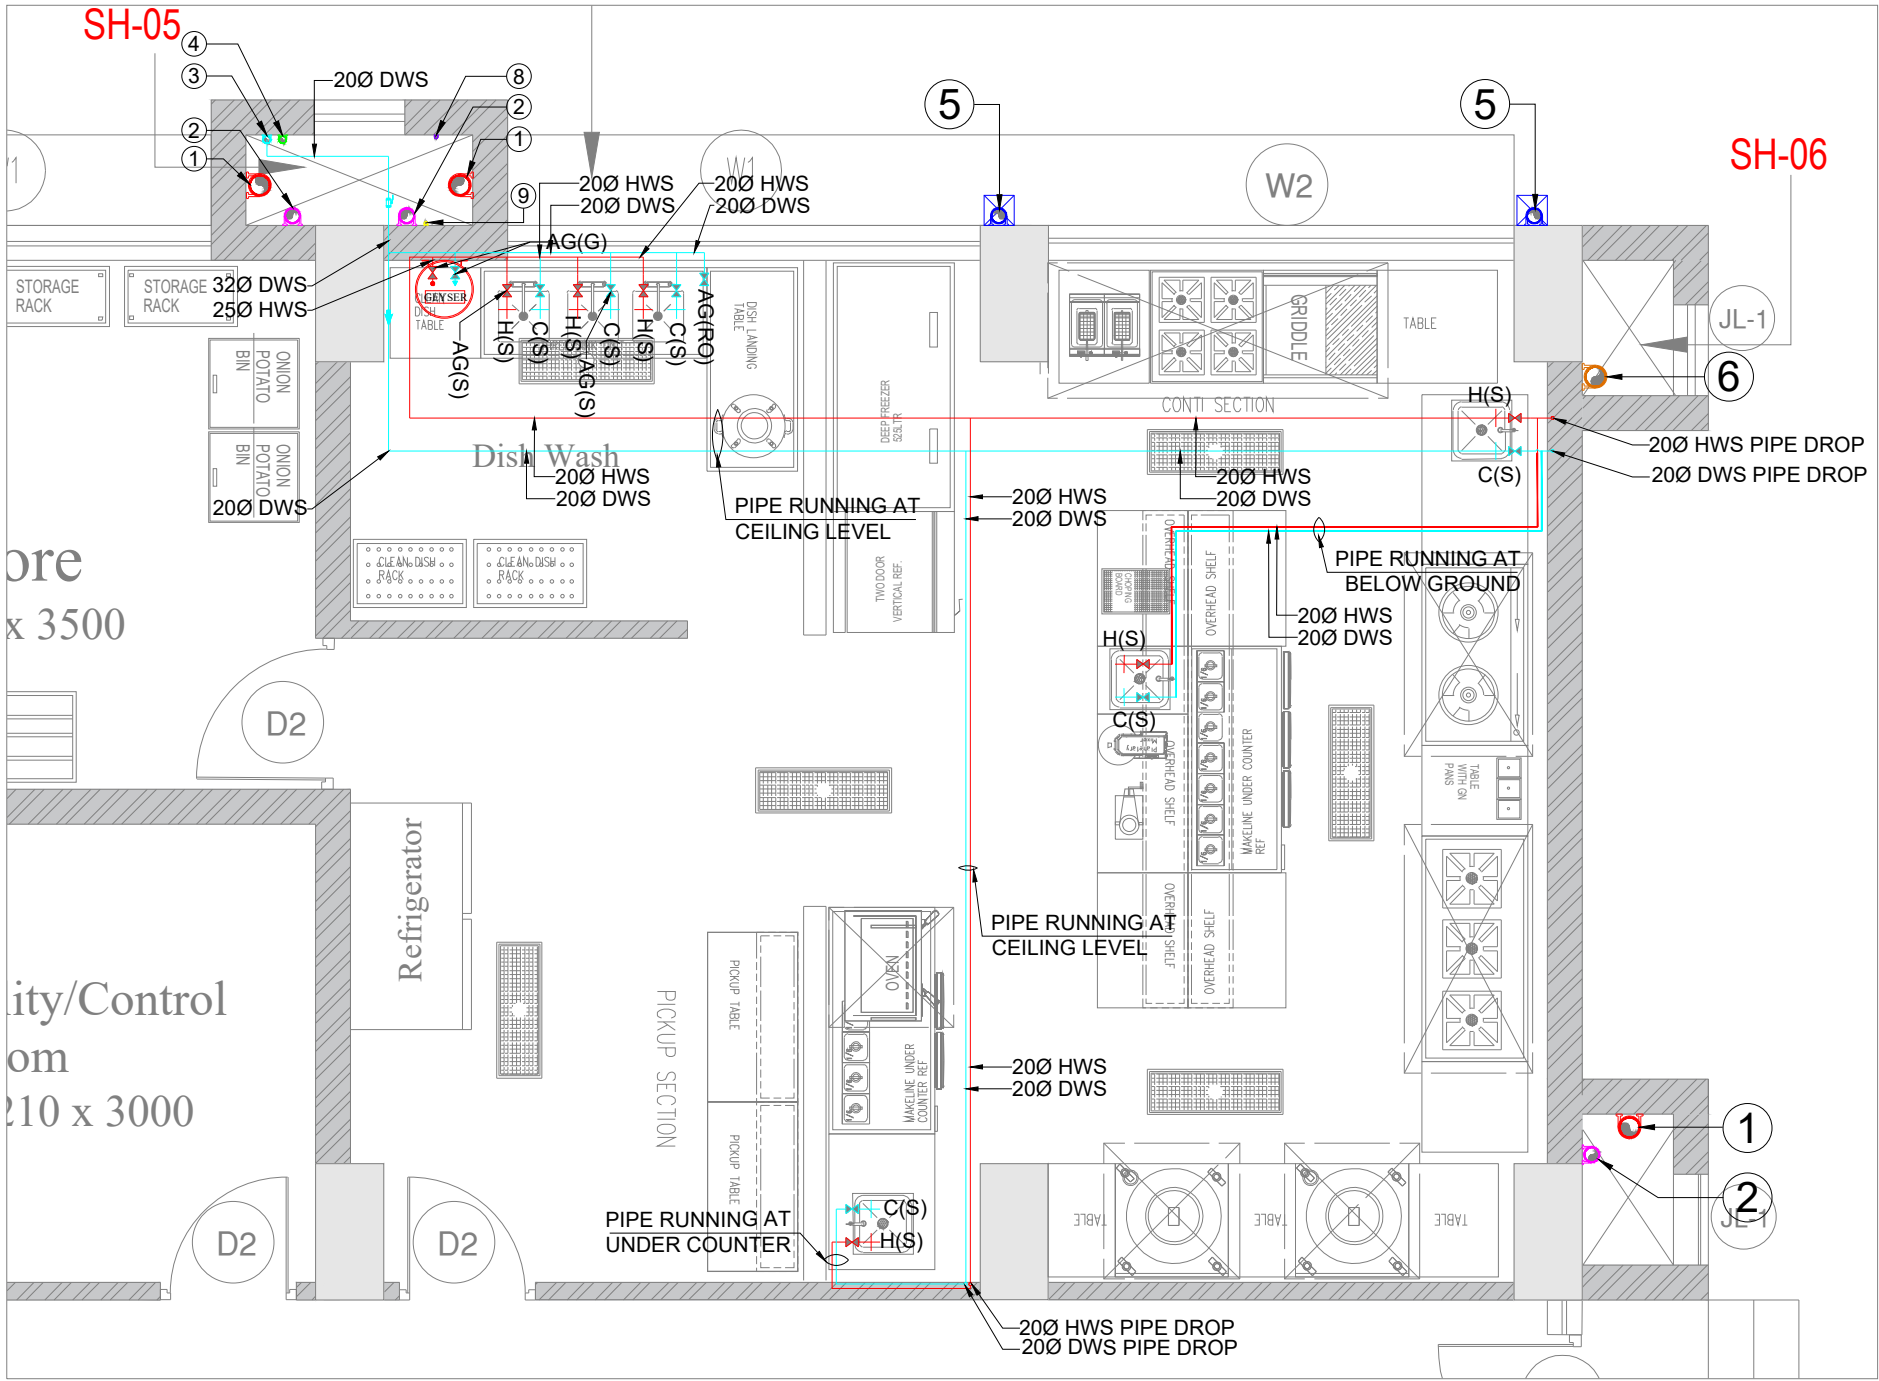

KITCHEN WATER SUPPLY LAYOUT

- NOTES:-
- ALL DIMENSIONS ARE IN MM, UNLESS NOTED OTHERWISE.
 - WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 - ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 - THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 - DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in


JOB TITLE
**BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE
**GUEST HOUSE
TYPICAL TOILET & KITCHEN
WATER SUPPLY LAYOUT**


SCALE
NTS

DATE
JULY 2025

DRG. NO.
RITES/BLD/WS/TEN/602

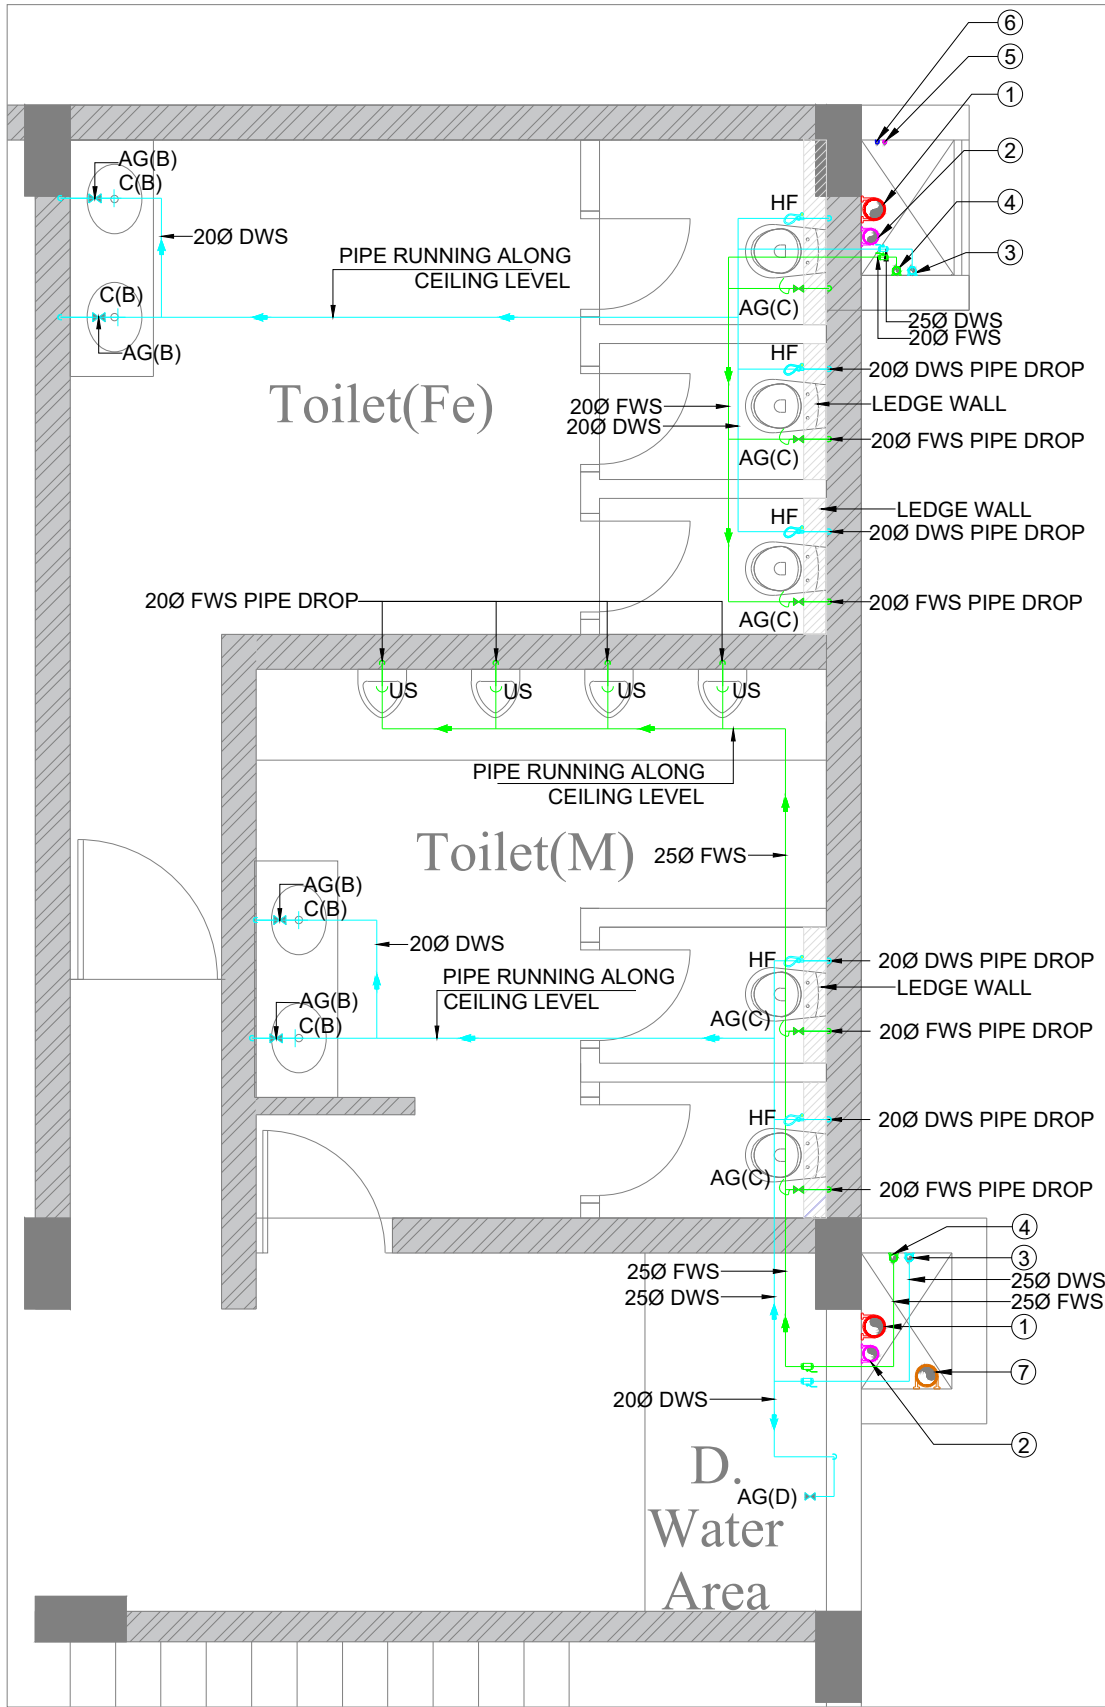

1st FLOOR TOILET WATER SUPPLY LAYOUT

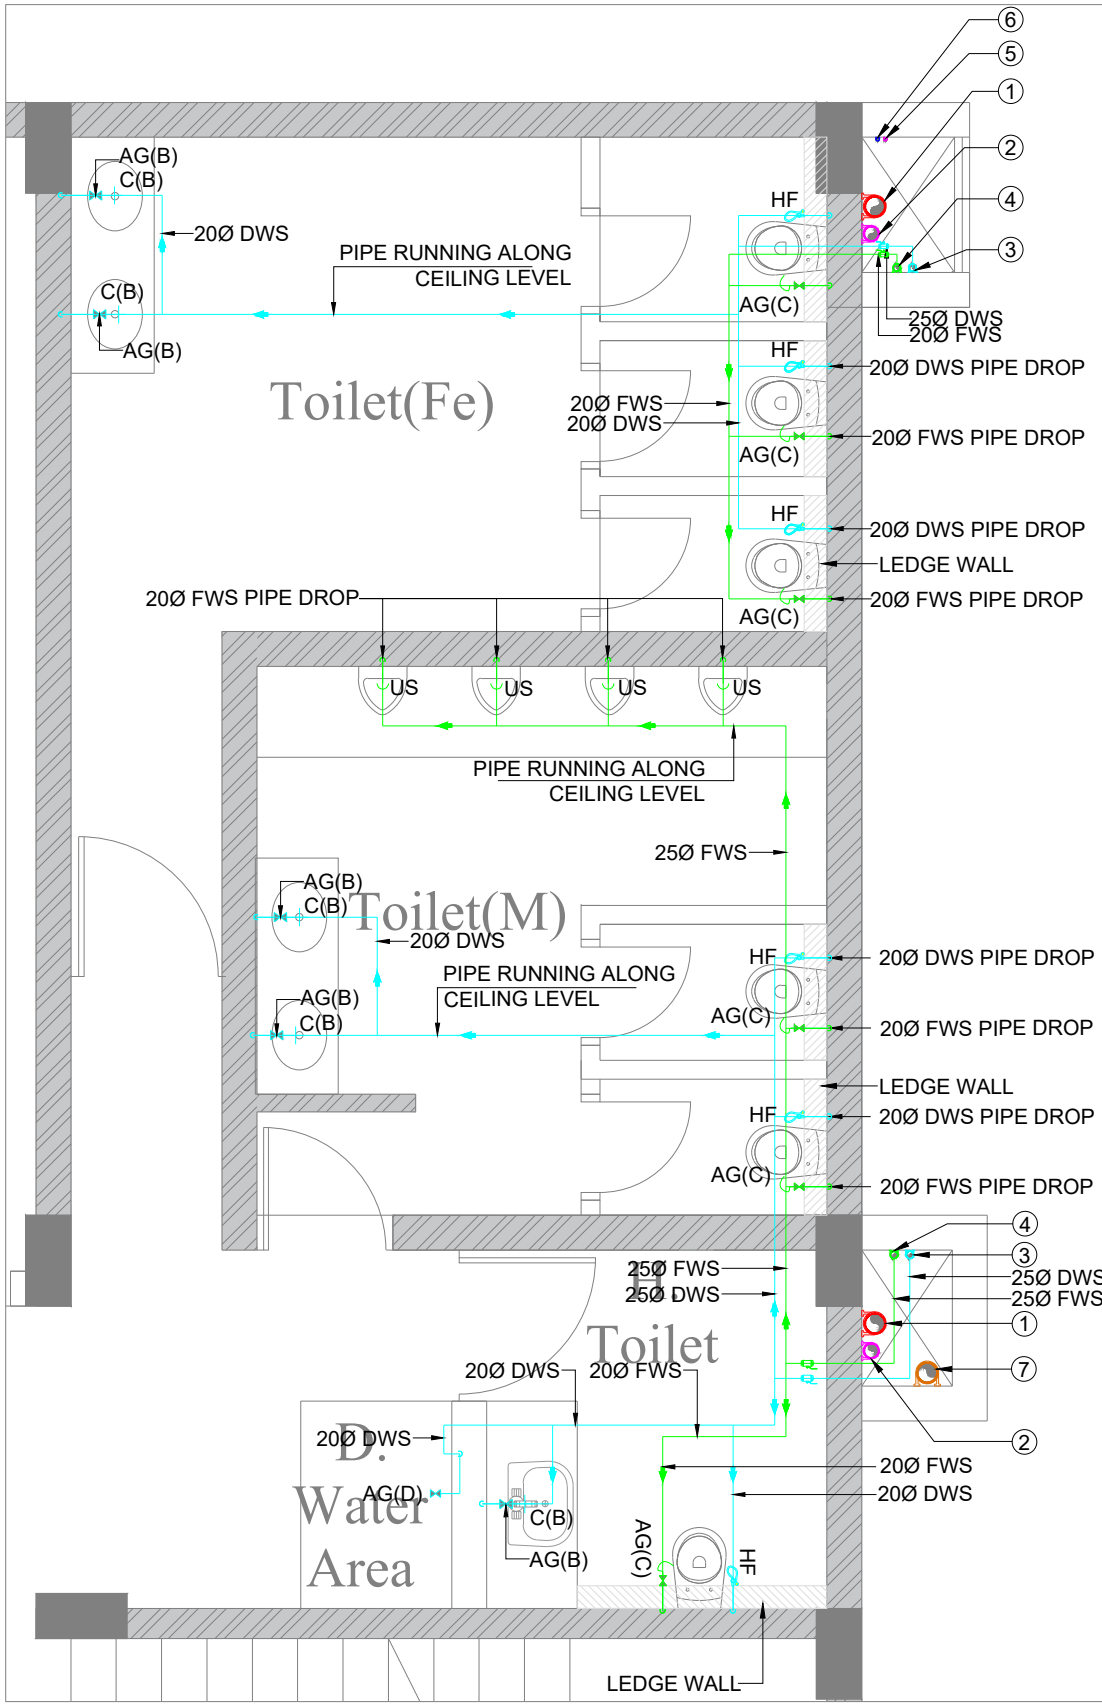

GROUND FLOOR TOILET WATER SUPPLY LAYOUT

- PLUMBING NOTES:-
1. ALL PIPE DIAMETERS ARE IN MM.
 2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 3. MANHOLES SHALL BE CONSTRUCTED AS PER STANDARD DETAILS.
 4. SOIL,WASTE,RAIN & VENT PIPE WORK :-
SOIL,WASTE & VENT PIPE WORK SHALL BE SINGLE LAYER uPVC PIPING SYSTEM AS PER ON IS 13592
 5. ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:50 AND NOT STEEPER THAN 1:10 UNLESS SPECIFIED OTHERWISE
 6. WATER SUPPLY PIPE WORK :-
WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC (SDR-11) CONFORMING TO ASTM STANDARDS. ALL PIPE FITTINGS SHALL BE OF CPVC OF CLASS SAME AS PIPE CONFORMING TO ASTM STANDARDS SUITABLE FOR SOLVENT CEMENT JOINTS AS PER MFR.
 7. NO PIPE WORK SHALL BE CONCEALED IN WALLS OR BURIED IN FLOORS WITHOUT BEING SUBJECTED TO WATER TESTING AS PER THE DIRECTION OF THE SITE ENGINEER.
 8. ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR
 9. WATER INLETS AND WASTE OUTLETS FROM SANITARY WARE SHALL BE ARRANGED TO SUIT REQUIREMENTS OF SELECTED MAKES AND MODELS.
 10. ALL STONEWARE PIPES SHALL BE ENCASED IN 150 MM. THICK 1:5:10 CEMENT CONCRETE ALL AROUND.
 11. FLOOR TRAPS:-
ALL FLOOR TRAPS SHALL BE FORMED OF 100X100 MM. DIA 'P' TRAP WITH 100 MM. DIA uPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
 12. FLOOR DRAIN:-
DRAIN POINTS SHALL BE FORMED OF 75X75 MM. DIA uPVC ELBOW WITH 75 MM. DIA C.P. GRATING WITH FRAME.

SYMBOL	DESCRIPTION	*MOUNTING HEIGHT (MM.)	HEIGHT (MM.)*
AG(B)	ANGLE VALVE WITH WALL FLANGE AND CP PIPE FOR BASIN MIXER		450
AG(S)	ANGLE VALVE WITH WALL FLANGE FOR SINK		450
AG(RO)	ANGLE VALVE WITH WALL FLANGE FOR REVERSE OSMOSIS FOR KITCHEN		AS/ARCH.
AG(C)	ANGLE VALVE WITH WALL FLANGE AND CP PIPE FOR CISTERN		450
AG(D)	ANGLE VALVE FOR DRINKING		1200
AG(G)	ANGLE VALVE FOR GEYSER		AS/ARCH.
HF	HEALTH FAUCET		450
TAP	COLD TAP		AS PER ARCH.
PIPE DROP	PIPE DROP		
DOMESTIC WATER SUPPLY(DWS)	DOMESTIC WATER SUPPLY(DWS)		
FLUSHING WATER SUPPLY(FWS)	FLUSHING WATER SUPPLY(FWS)		
BALL VALVE	BALL VALVE		
FLOW DIRECTION	FLOW DIRECTION		

PLUMBING LEGENDS:-		
1. 100Ø uPVC SOIL PIPE	①	🔴
2. 100Ø uPVC WASTE PIPE	②	🟡
3. DOMESTIC WATER SUPPLY PIPE	③	🟢
4. FLUSHING WATER SUPPLY PIPE	④	🟠
5. DOMESTIC WATER RISER PIPE	⑤	🟡
6. FLUSHING WATER RISER PIPE	⑥	🟠
7. 150Ø uPVC RAIN WATER PIPE	⑦	🟠

NOTES:-

1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS..
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT  **OIL INDIA LIMITED**
(A Govt. of India Enterprise)

CONSULTANT  **IRITES**
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT **PKV CONSULTING ENGINEERS (P) LTD.**
 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE **BO WORKMEN GROUP HOUSING COMPLEX AT DULIAJAN ASSAM**

DRAWING TITLE **COMMUNITY CENTRE GROUND & 1st FLOOR TOILET WATER SUPPLY LAYOUT**

SCALE	DATE	DRG. NO.
NTS	JULY 2025	NTS/BLDWS/TEN/603

SCHEDULE OF INSERTS(FIRE & DOMESTIC TANK) :-

S.NO.	INSERTS	DESCRIPTION	DIA/SIZE(MM)	BOTTOM OF PIPE FROM (+)25.35 (level in mm.)	NO. OF SLEEVE
1.	(A)	FIRE & DOMESTIC WATER INLET	32Ø	+28.45	1
2.	(B)	DOMESTIC WATER OUTLET	100Ø	+26.35	1
3.	(C)	DRAIN PIPE	50Ø	+26.15	2
4.	(C1)	KHURRA 300X300X100mm	300x300mm	+26.15	-
5.	(D)	LIQUID LEVEL CONTROLLER	50Ø	+28.45	2
6.	(E)	FOOT REST	300x270	@300MM c/c ON RCC WALL	-
7.	(F)	FIRE WATER OUTLET	100Ø	+26.35	1
8.	(G)	TANK TO TANK OVER FLOW	100Ø	+28.20	1
9.	(G)	OVER FLOW PIPE FROM TANK	50Ø	+28.25	1
10.	(H)	VENT PIPE	80Ø	TOP OF SLAB	2
11.	(I)	MANHOLE COVER	600X600	TOP OF SLAB	-

WATER LEVEL =(+28.25
B.O.TANK LEVEL =(+26.25

SCHEDULE OF INSERTS(FLUSHING TANK) :-

S.NO.	INSERTS	DESCRIPTION	DIA/SIZE(MM)	BOTTOM OF PIPE FROM (+)25.35 (level in mm.)	NO. OF SLEEVE
1.	(J)	FLUSHING WATER INLET	25Ø	+27.45	1
2.	(K)	FLUSHING WATER OUTLET	65Ø	+26.35	1
3.	(C)	DRAIN PIPE	50Ø	+26.15	1
4.	(C1)	KHURRA 300X300X100mm	300x300mm	+26.15	-
5.	(D)	LIQUID LEVEL CONTROLLER	50Ø	+27.45	1
6.	(E)	FOOT REST	300x270	@300MM c/c ON RCC WALL	-
7.	(G)	OVER FLOW PIPE FROM TANK	50Ø	+27.25	1
8.	(H)	VENT PIPE	80Ø	TOP OF SLAB	1
9.	(I)	MANHOLE COVER	600X600	TOP OF SLAB	-

WATER LEVEL =(+27.25
B.O.TANK LEVEL =(+26.25

* ALL PUDDLE FLANGE SHALL BE HOT DIPPED GALVANIZED AFTER FABRICATION ALSO PAINTED WITH TWO COATS OF EPOXY PAINTS

NOTES:-

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWING.
- FOR EXACT LOCATION OF RESERVOIR REFER SITE LAYOUT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
- THE DIMENSIONS OF STRUCTURAL ELEMENTS (foundation wall slab etc) ARE ONLY INDICATIVE. THESE SHALL BE AS PER STRUCTURAL DRAWINGS.
- BEFORE CONCRETING PROVIDE SLEEVES, PUDDLE FLANGE FOR MAKING PIPE CONNECTIONS AS PER DETAILS.
- PROVIDE GLAZED TILES IN THE WATER TANKS SIZE AND THICKNESS AS PER CIVIL WORK SPECIFICATIONS.

FLUSHING WATER TANK PLAN




SECTION A-A




FIRE & DOMESTIC WATER TANK PLAN




SECTION A-A

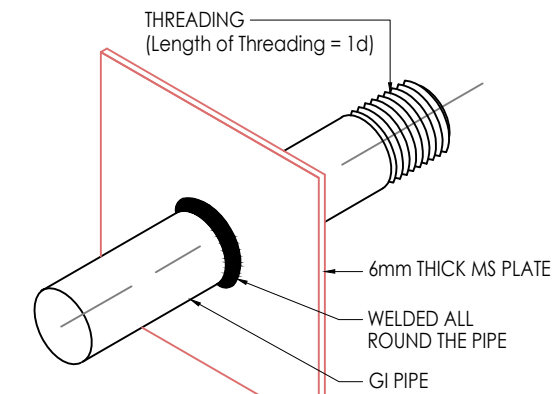


ISOMETRIC PUDDLE FLANGEDETAIL

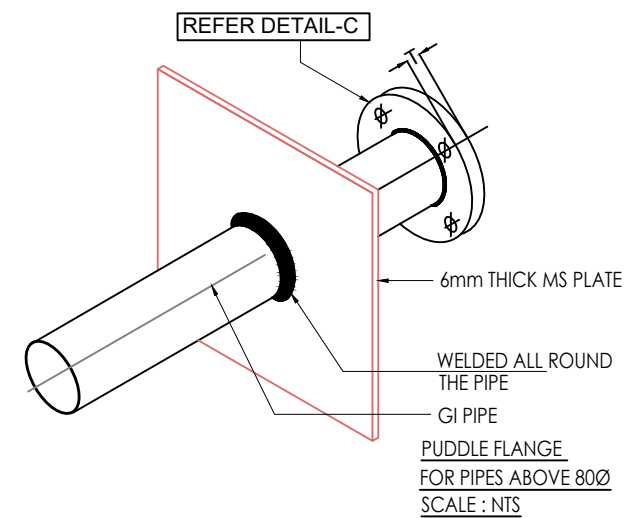

PUDDLE FLANGE FOR PIPES ABOVE 80Ø SCALE: NTS

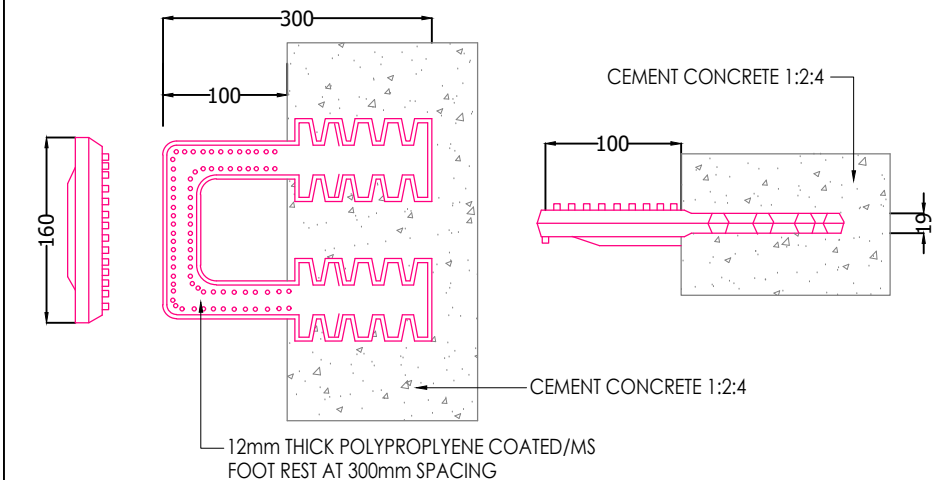


TYPICAL FOOT REST DETAIL

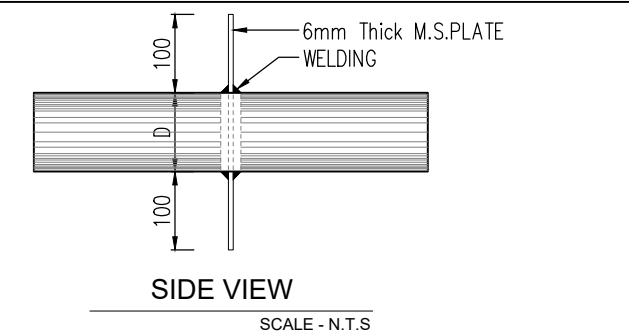

SIDE VIEW

SCALE - N.T.S

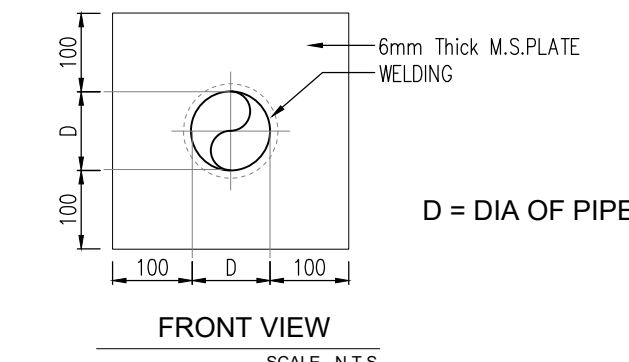


FRONT VIEW

SCALE - N.T.S


PUDDLE FLANGE DETAIL (PIPE SIZE UP TO 80mm DIA)

SCALE - N.T.S

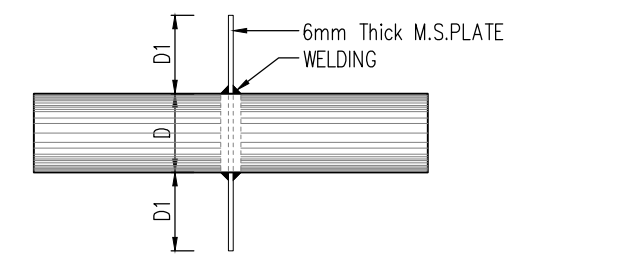

SIDE VIEW

SCALE - N.T.S

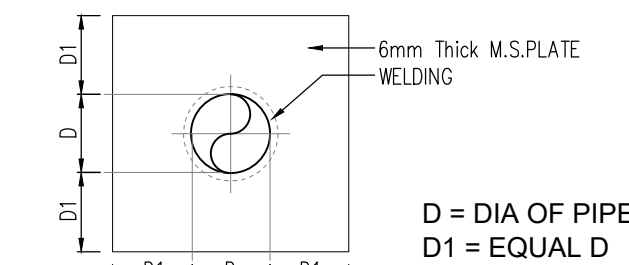

FRONT VIEW

SCALE - N.T.S

PUDDLE FLANGE DETAIL (PIPE SIZE ABOVE 80mm DIA)

SCALE - N.T.S

NOTES:-

- ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
- WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
- ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
- DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT



OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT

IRITES
THE INFRASTRUCTURE PEOPLE
BUILDINGS UNIT
(ISO - 9001 CERTIFIED)

MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.



815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE

BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE

BQ WORKMAN HOUSING BLOCK,
OHT DETAIL



SCALE


DATE

DRG. NO.


NTS.

JULY 2025

IRITES/BLD/WS/TEN/604

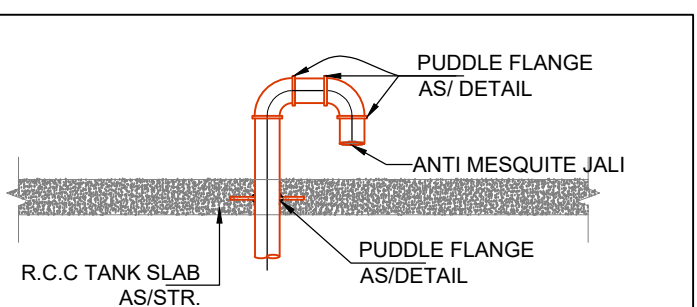


TYPICAL VENT PIPE DETAIL
SCALE=NTS



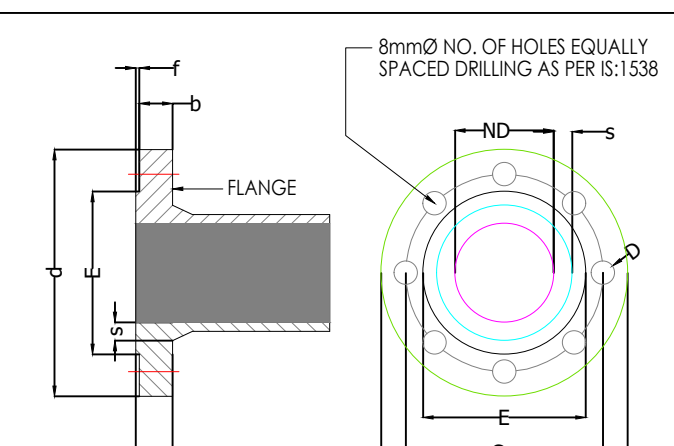


(FLANGE) DETAIL-C

FLANGE TABLE												
NOMINAL DIA	DIMENSIONS IN mm								HOLES	BOLT SIZE		
ND	d(Ø)	E(Ø)	C	b	f	a	s	NO.	DIA(D)	METRIC		
80	200	132	160	19	3	30	15	8	19	M16		
100	235	156	190	19	3	33	15	8	23	M20		
150	300	211	250	20	3	40	16	8	28	M24		
200	360	274	310	22	3	44	17.5	12	28	M24		
250	425	330	370	24.5	3	49	19.5	12	31	M27		

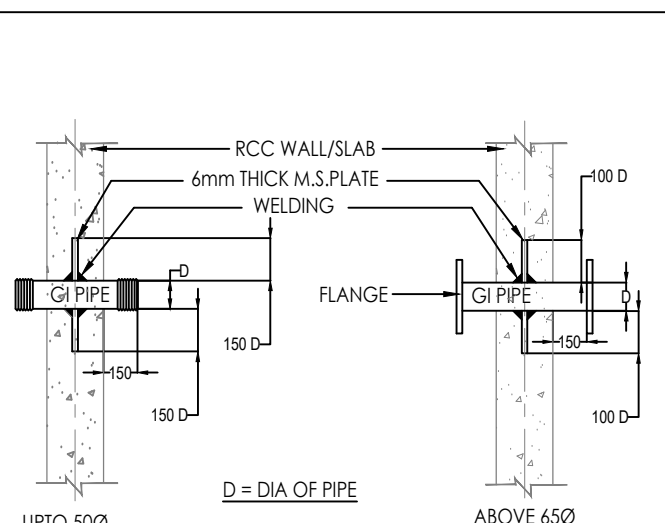

PUDDLE FLANGE DETAIL

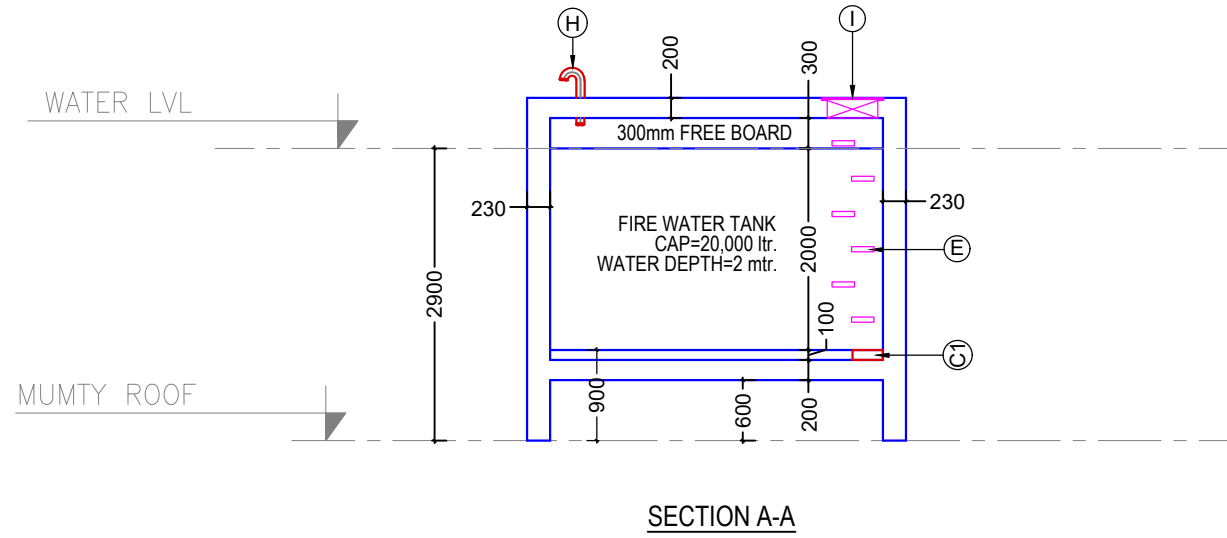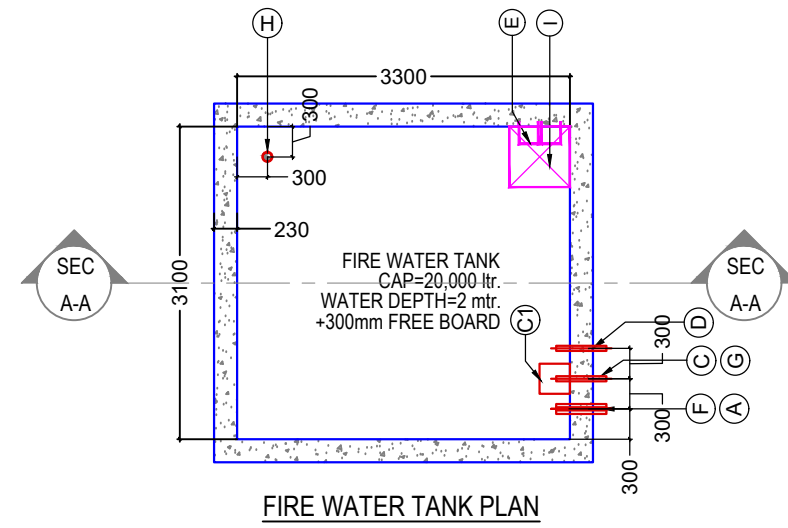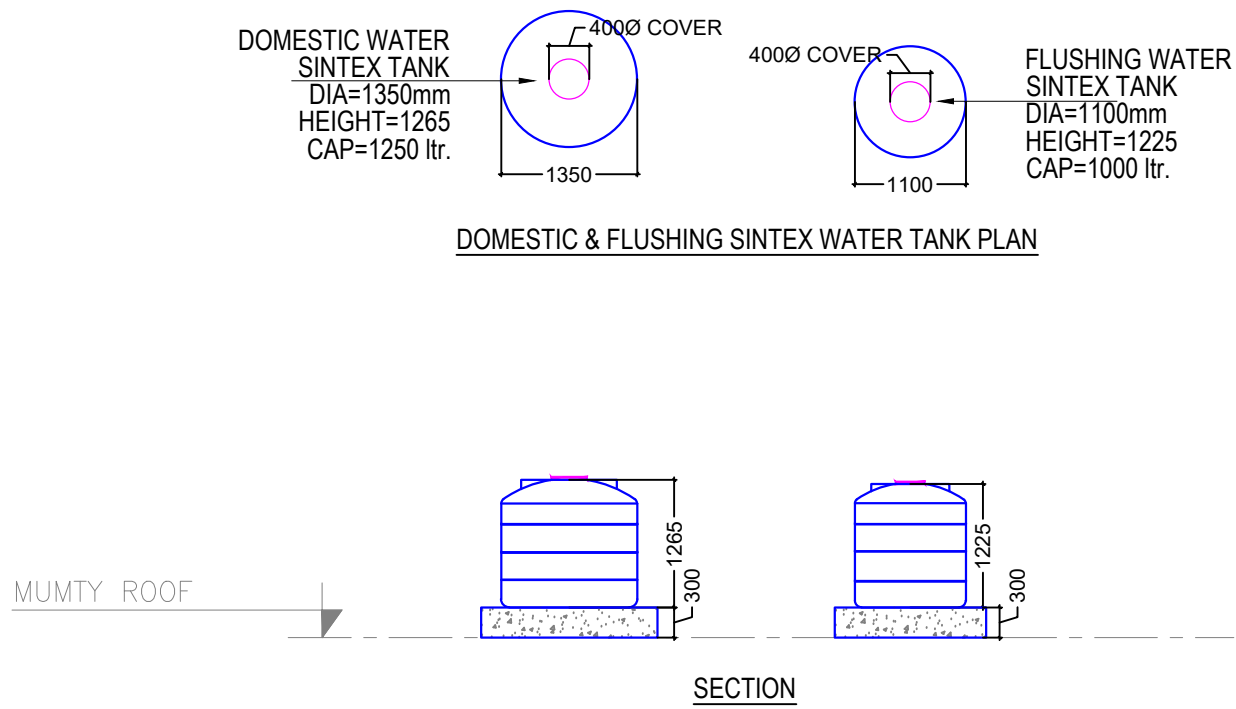

SCHEDULE OF INSERTS(FIRE TANK) :-

S.NO.	INSERTS	DESCRIPTION	DIA/SIZE(MM)	BOTTOM OF PIPE FROM (+)10.65 (level in mm.)	NO. OF SLEEVE
1.	(A)	FIRE WATER INLET	25Ø	+13.75	1
2.	(C)	DRAIN PIPE	50Ø	+11.45	1
3.	(C)	KHURRA 300X300X100mm	300x300mm	+11.45	-
4.	(D)	LIQUID LEVEL CONTROLLER	50Ø	+13.75	1
5.	(E)	FOOT REST	300x270	@300MM c/c ON RCC WALL	-
6.	(F)	FIRE WATER OUTLET	100Ø	+11.65	1
7.	(G)	OVER FLOW PIPE FROM TANK	50Ø	+13.55	1
8.	(H)	VENT PIPE	80Ø	TOP OF SLAB	1
9.	(I)	MANHOLE COVER	600X600	TOP OF SLAB	-

WATER LEVEL = (+)13.55
B.O.TANK LEVEL = (+)11.55

* ALL PUDDLE FLANGE SHALL BE HOT DIPPED GALVANIZED AFTER FABRICATION ALSO PAINTED WITH TWO COATS OF EPOXY PAINTS

- NOTES:-
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWING.
 - FOR EXACT LOCATION OF RESERVOIR REFER SITE LAYOUT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 - THE DIMENSIONS OF STRUCTURAL ELEMENTS (foundation wall slab etc) ARE ONLY INDICATIVE. THESE SHALL BE AS PER STRUCTURAL DRAWINGS.
 - BEFORE CONCRETING PROVIDE SLEEVES, PUDDLE FLANGE FOR MAKING PIPE CONNECTIONS AS PER DETAILS.
 - PROVIDE GLAZED TILES IN THE WATER TANKS SIZE AND THICKNESS AS PER CIVIL WORK SPECIFICATIONS.

- NOTES:-
- ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 - WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 - ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 - THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS, TENDER DOCUMENTS.
 - DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS; THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
IRITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)







MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.

815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
BO WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM


DRAWING TITLE
**COMMUNITY CENTRE,
OHT DETAIL**



SCALE	DRG. NO.	DRG. NO.
NTS	JULY 2025	IRITES/BLD/WS/TEN/606

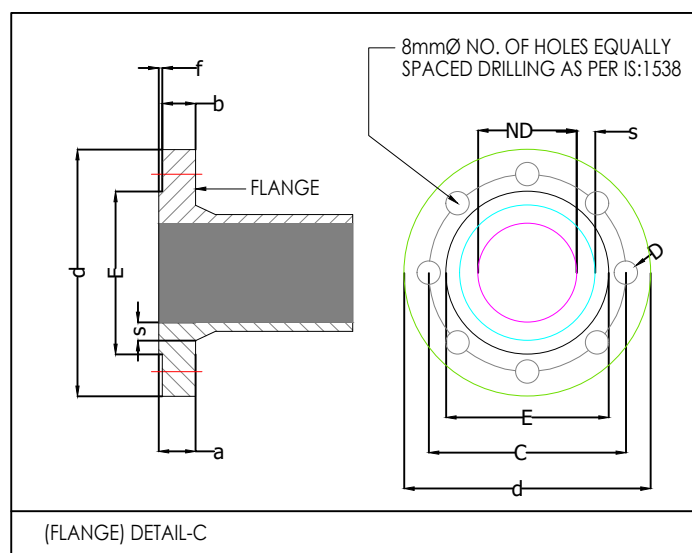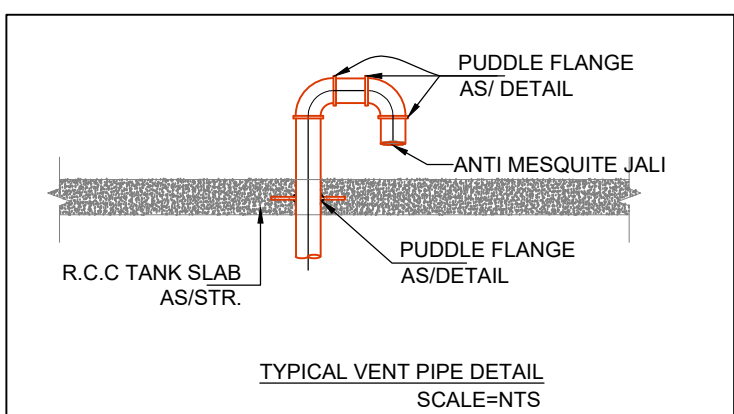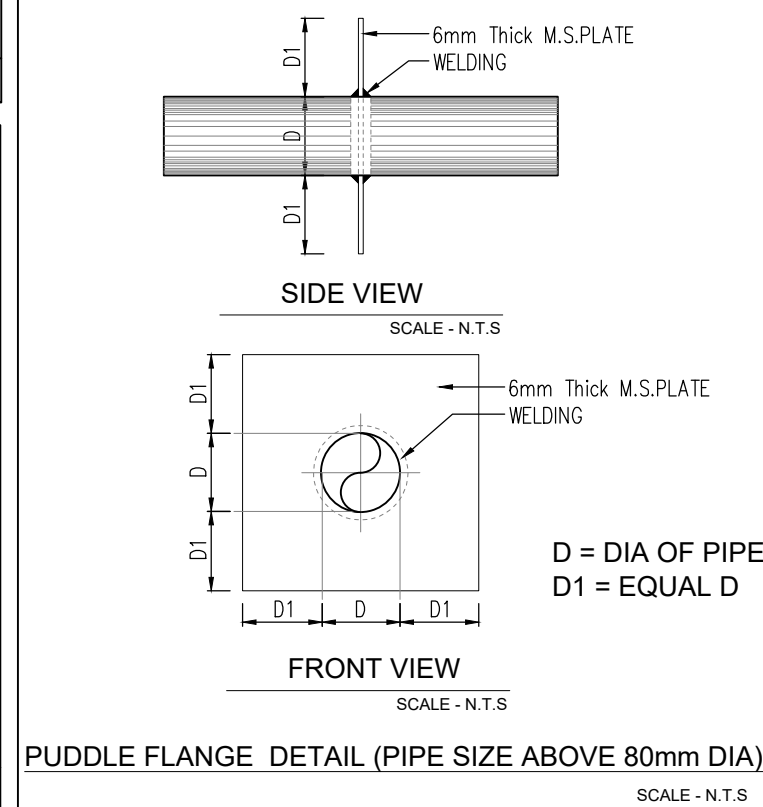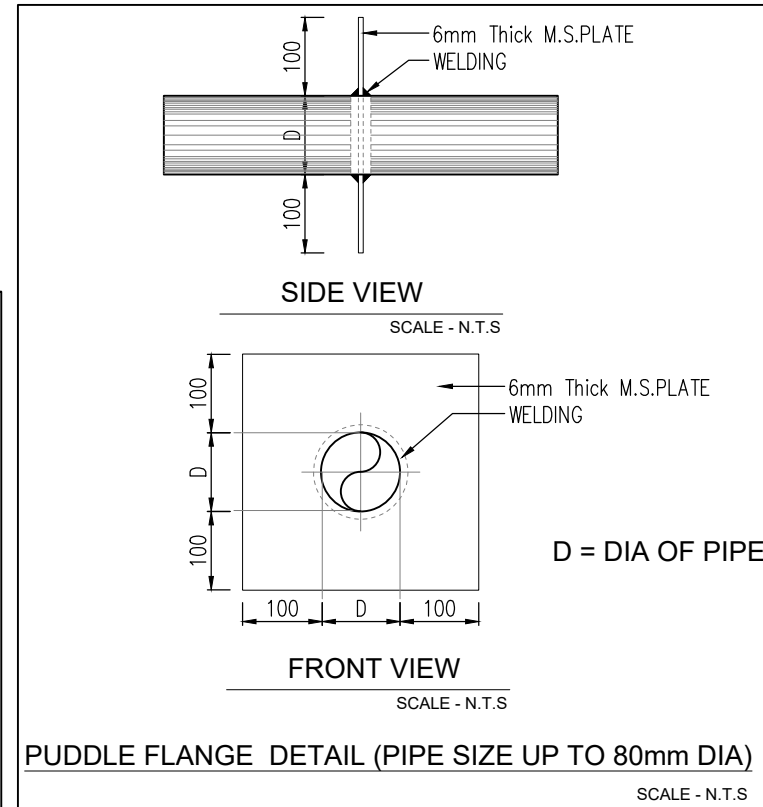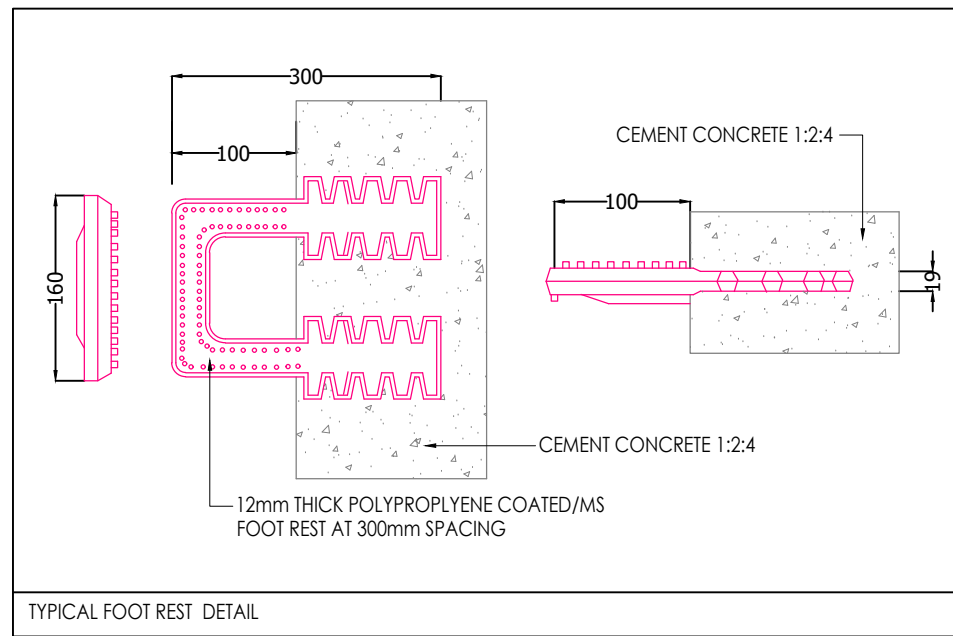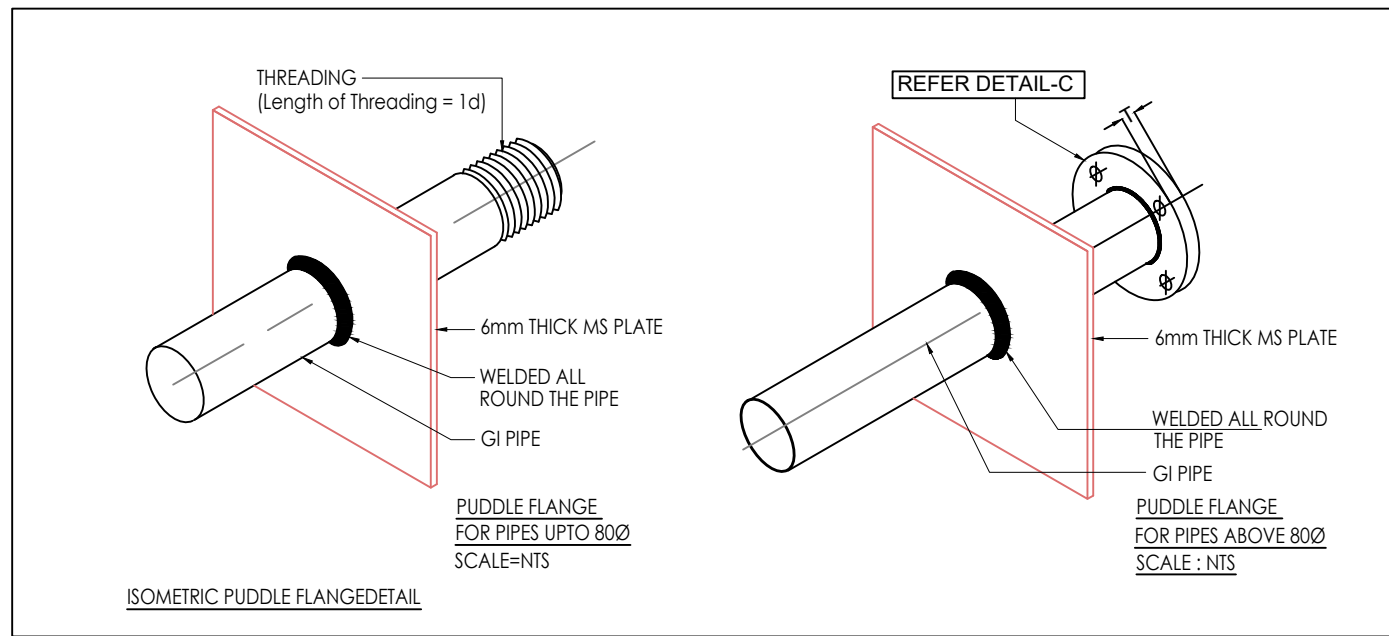

FLANGE TABLE

NOMINAL DIA	DIMENSIONS IN mm							HOLES	BOLT SIZE
ND	d(Ø)	E(Ø)	C	b	f	a	s	NO. DIA(D)	METRIC
80	200	132	160	19	3	30	15	8	19 M16
100	235	156	190	19	3	33	15	8	23 M20
150	300	211	250	20	3	40	16	8	28 M24
200	360	274	310	22	3	44	17.5	12	28 M24
250	425	330	370	24.5	3	49	19.5	12	31 M27

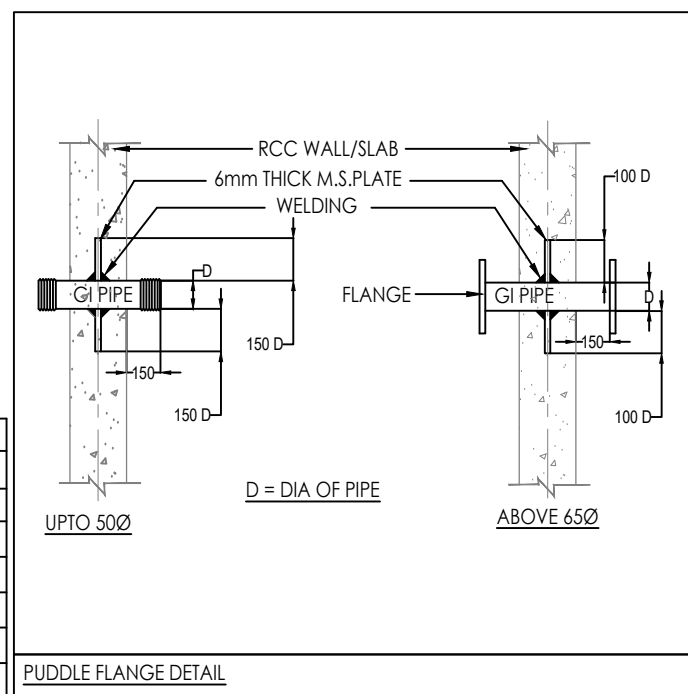

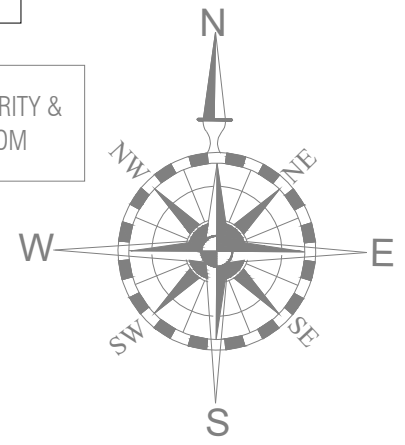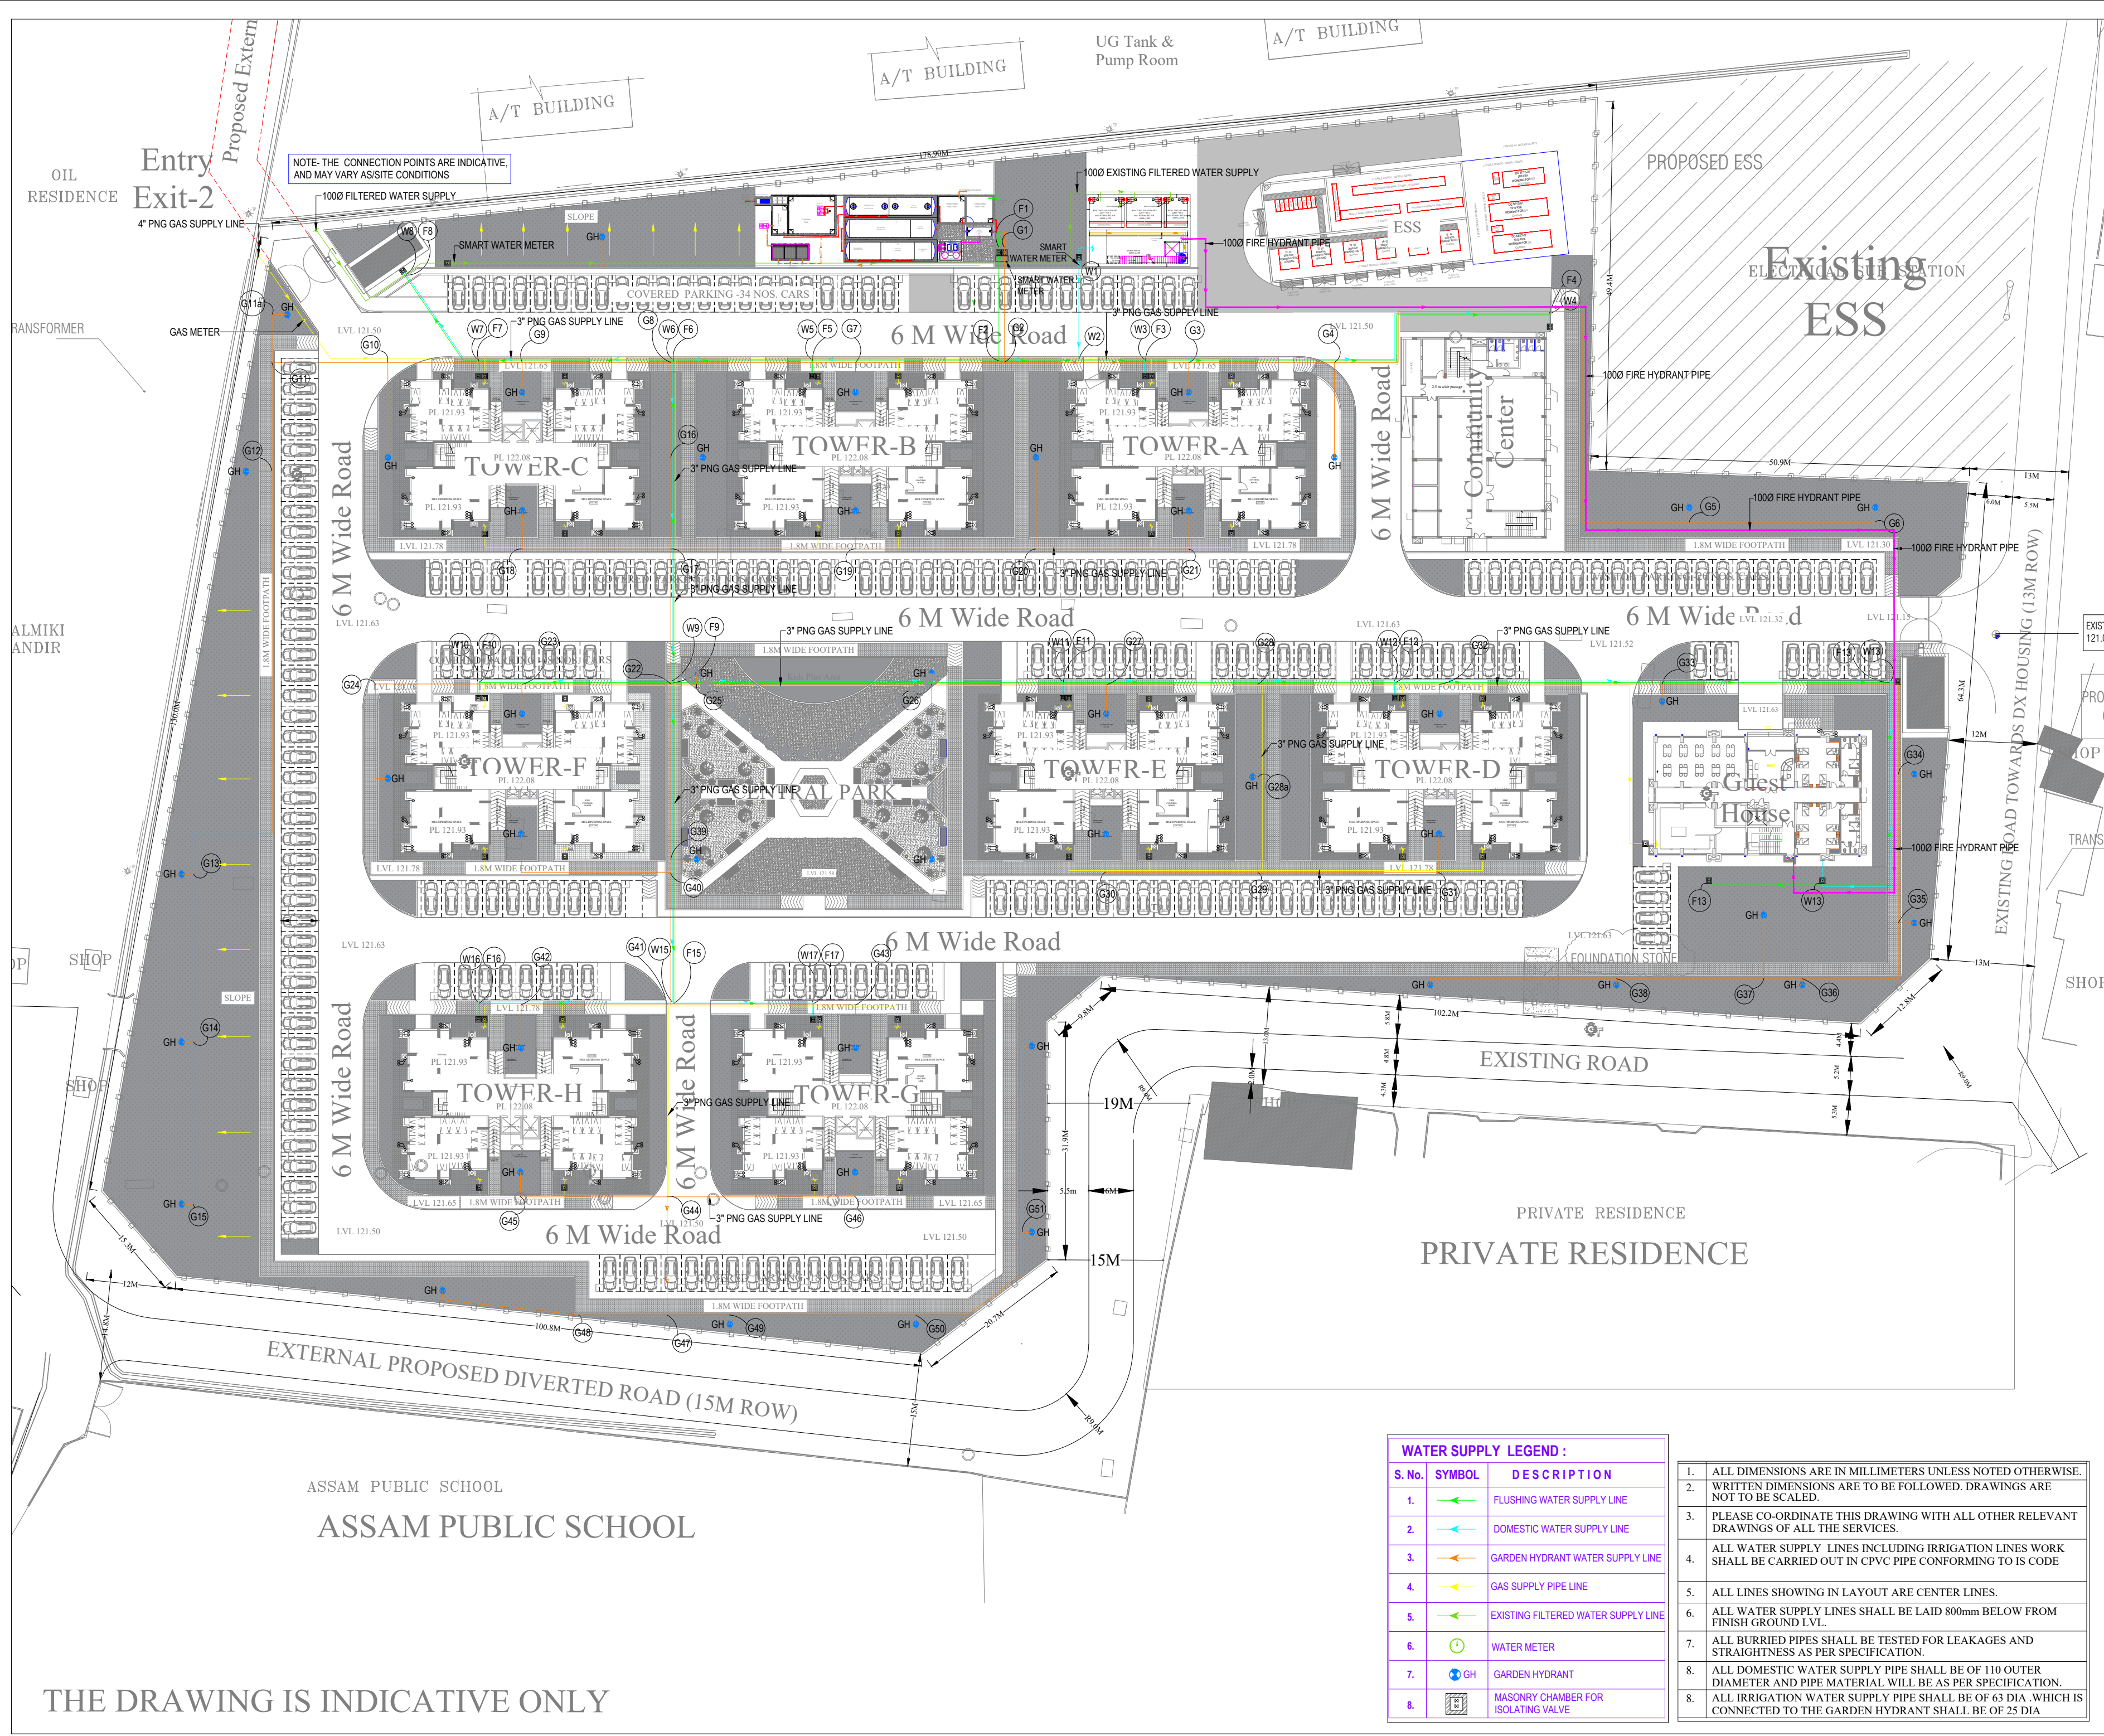

- NOTES:-
- 1. ALL DIMENSIONS ARE IN MM, UNLESS NOTED OTHERWISE.
 - 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 - 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 - 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWING, TENDER DOCUMENT.
 - 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS, THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.
 - 6. WATER SUPPLY AND GAS LINE CONNECTIONS SHALL BE MADE FROM THE NEAREST AVAILABLE SOURCE POINTS AT SITE, AS PER ACTUAL CONDITIONS AND IN COORDINATION WITH LOCAL UTILITY AUTHORITIES.



TENDER DRAWING		
CLIENT	 OIL INDIA LIMITED (A Govt. of India Enterprise)	
CONSULTANT	 RITES THE INFRASTRUCTURE PEOPLE (A Govt. of India Enterprise)	
MEP CONSULTANT	PKV CONSULTING ENGINEERS (P) LTD.  815 - C DDA FLATS EAST OF LONI ROAD DELHI - 110093 email:-info@pkv.co.in	
JOB TITLE	BQ WORKMEN GROUP HOUSING COMPLEX AT DULIAJAN ASSAM	
DRAWING TITLE	EXTERNAL PLUMBING SERVICES DUAL PLUMBING, GAS SUPPLY & FIRE LAYOUT	
SCALE	DATE	DRG. NO.
NTS	JULY 2025	RITES/BLD/DR/TEN/701

WATER SUPPLY LEGEND :		
S.No.	SYMBOL	DESCRIPTION
1.		FLUSHING WATER SUPPLY LINE
2.		DOMESTIC WATER SUPPLY LINE
3.		GARDEN HYDRANT WATER SUPPLY LINE
4.		GAS SUPPLY PIPE LINE
5.		EXISTING FILTERED WATER SUPPLY LINE
6.		WATER METER
7.		GARDEN HYDRANT
8.		MASONRY CHAMBER FOR ISOLATING VALVE

- 1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
- 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
- 3. PLEASE CO-ORDINATE THIS DRAWING WITH ALL OTHER RELEVANT DRAWINGS OF ALL THE SERVICES.
- 4. ALL WATER SUPPLY LINES INCLUDING IRRIGATION LINES WORK SHALL BE CARRIED OUT IN CPVC PIPE CONFORMING TO IS CODE
- 5. ALL LINES SHOWING IN LAYOUT ARE CENTER LINES.
- 6. ALL WATER SUPPLY LINES SHALL BE LAID 800mm BELOW FROM FINISH GROUND LVL.
- 7. ALL BURRIED PIPES SHALL BE TESTED FOR LEAKAGES AND STRAIGHTNESS AS PER SPECIFICATION.
- 8. ALL DOMESTIC WATER SUPPLY PIPE SHALL BE OF 110 OUTER DIAMETER AND PIPE MATERIAL WILL BE AS PER SPECIFICATION.
- 8. ALL IRRIGATION WATER SUPPLY PIPE SHALL BE OF 63 DIA. WHICH IS CONNECTED TO THE GARDEN HYDRANT SHALL BE OF 25 DIA

THE DRAWING IS INDICATIVE ONLY

HOUSING BLOCK

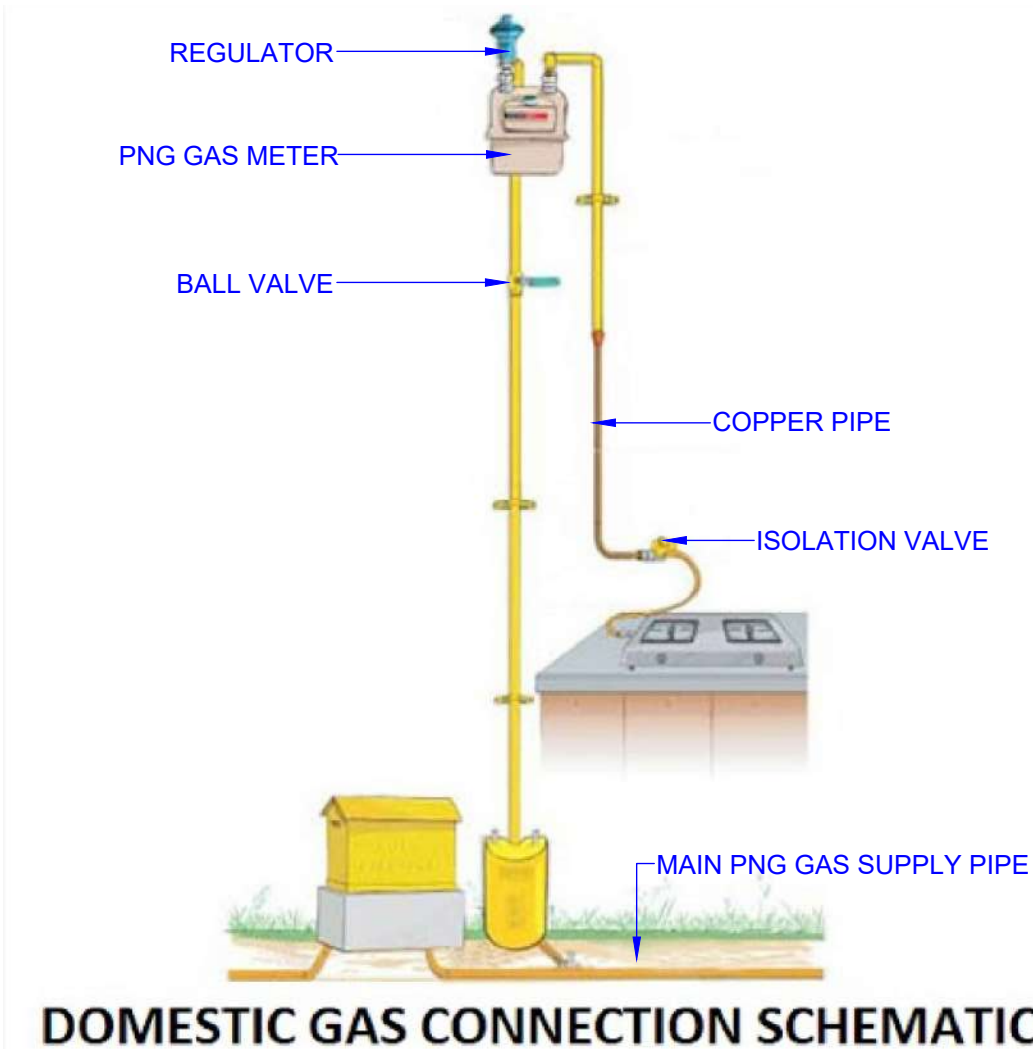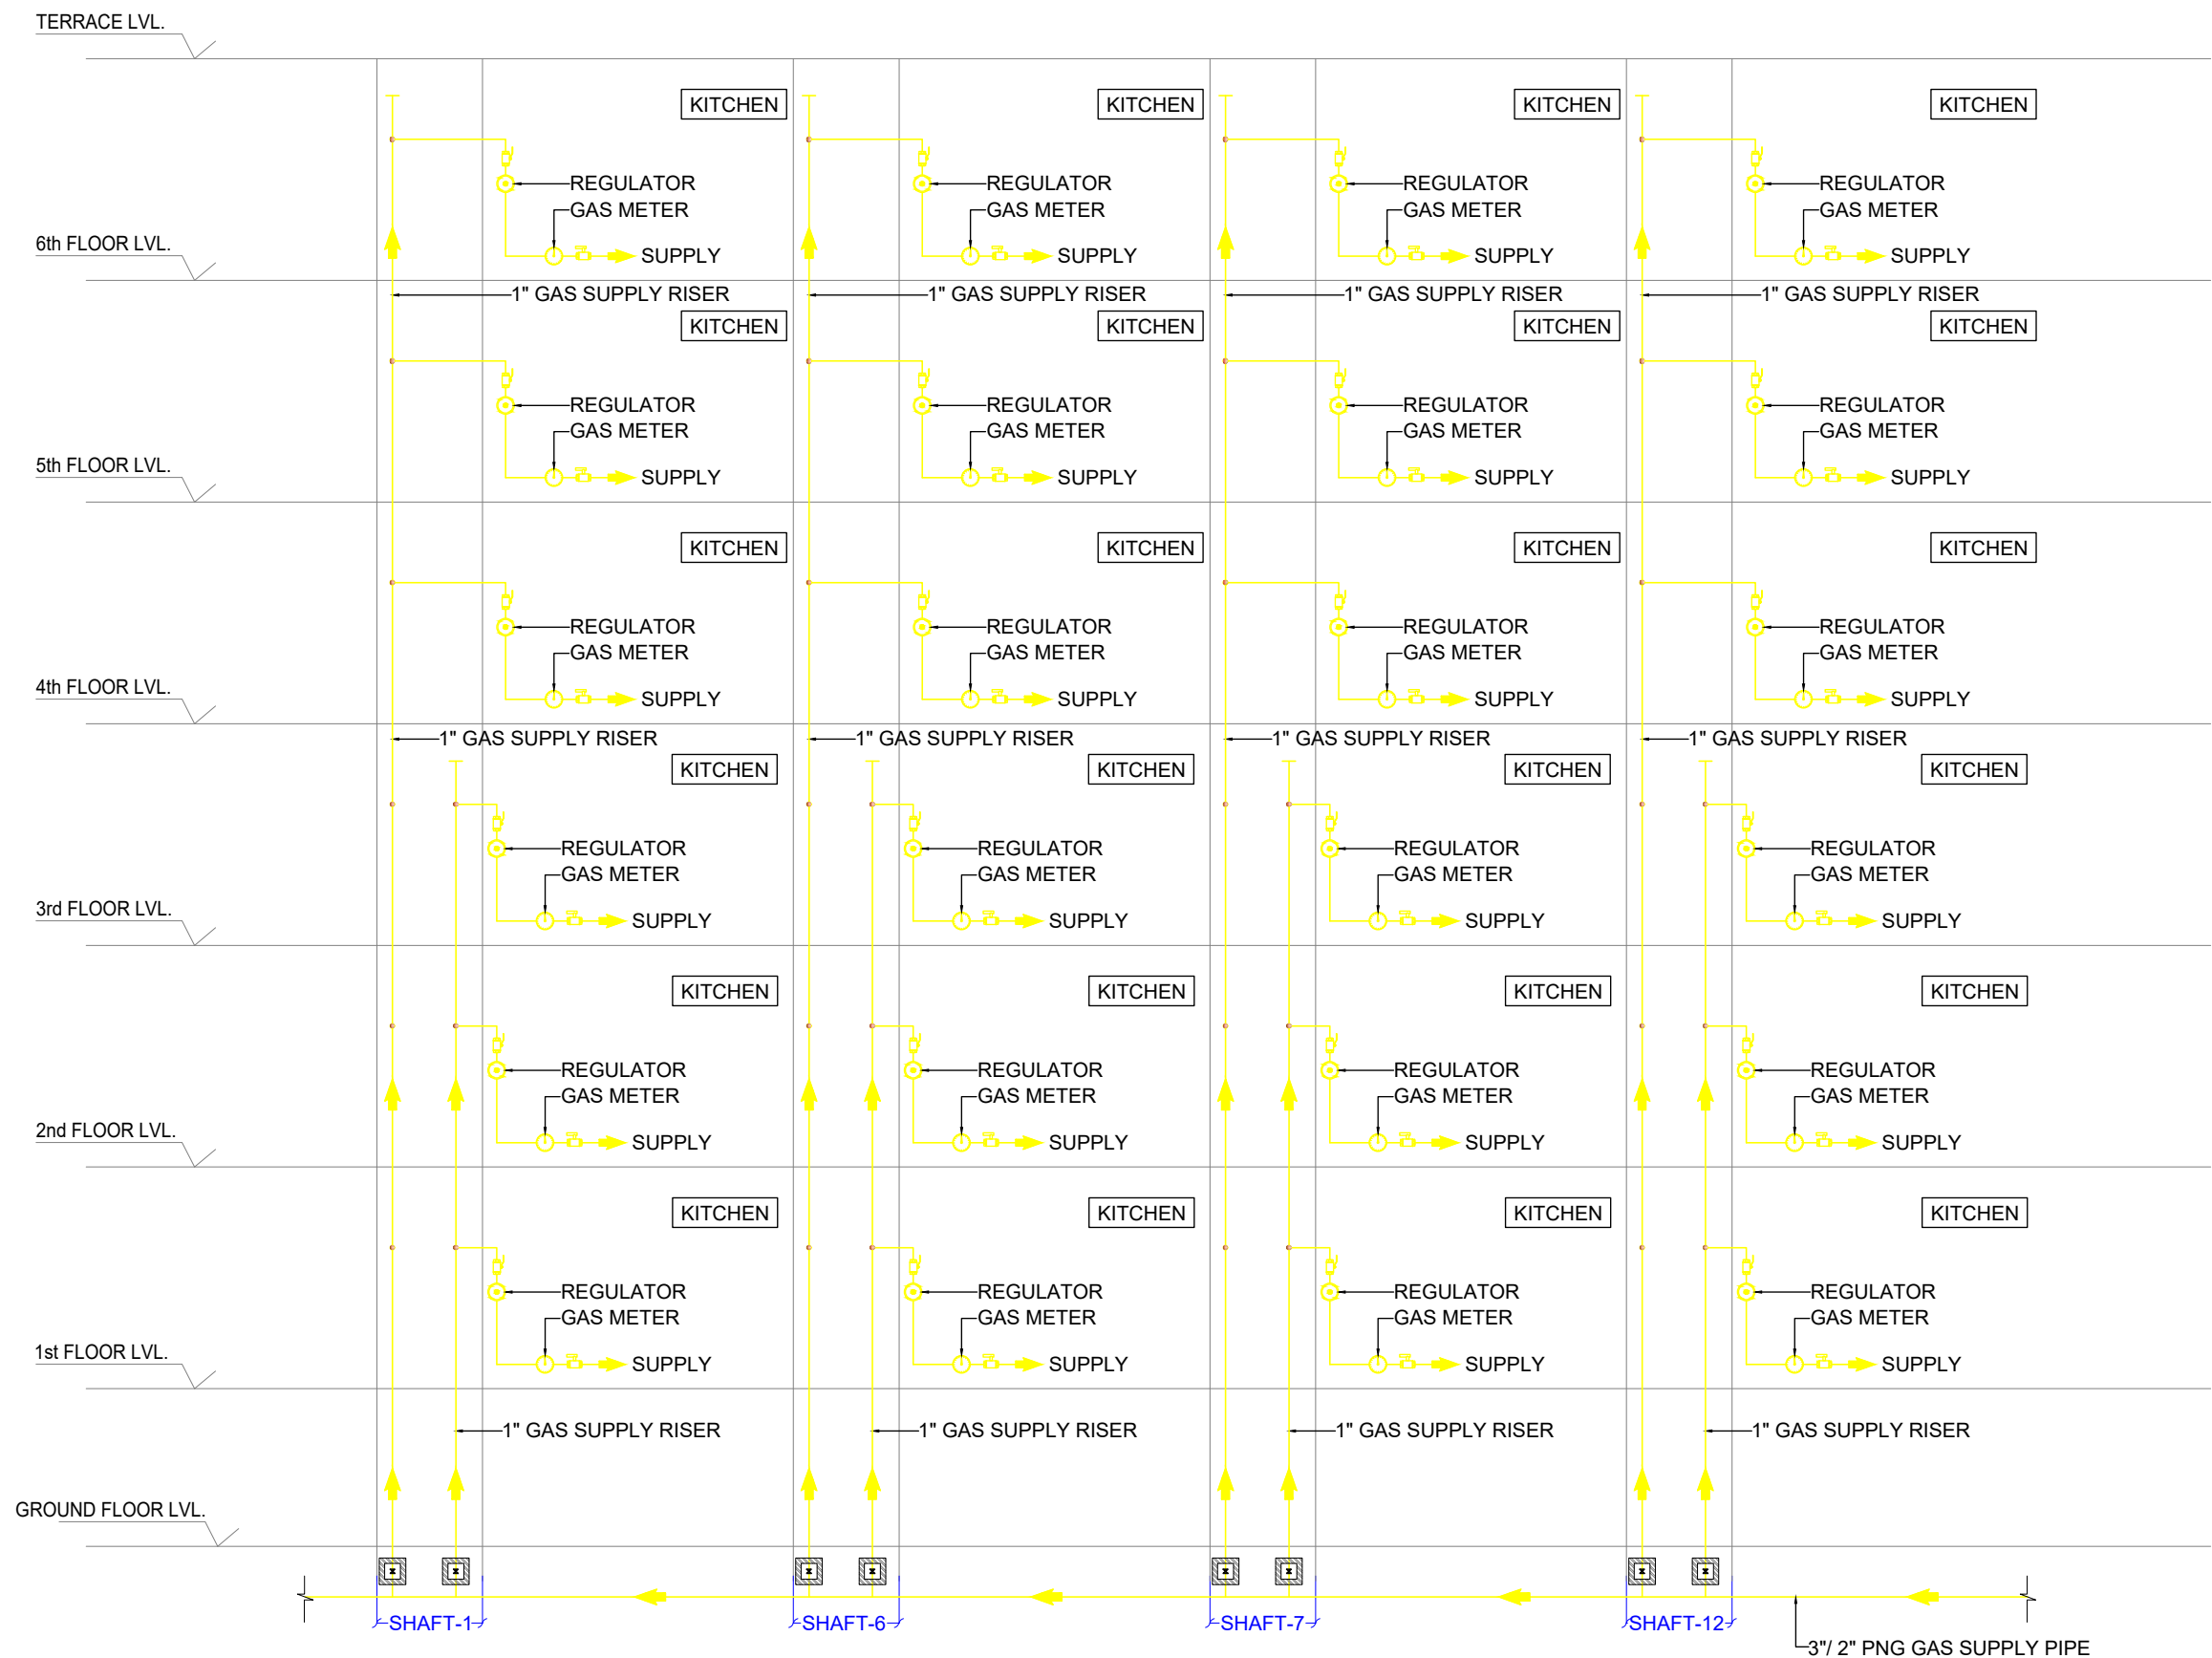

PLUMBING LEGENDS:-		
1.	PNG GAS SUPPLY PIPE	
2.	BALL VALVE	
3.	ISOLATION VALVE	
4.	FLOW DIRECTION	
5.	VALVE WITH CHAMBER	

- NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
 2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
 3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
 4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWING AND CONTRACT DOCUMENTS.
 5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

REVISIONS

CLIENT OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT

PKV CONSULTING ENGINEERS (P) LTD.
 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email: -info@pkv.co.in


JOB TITLE


BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE


HOUSING BLOCK
GAS SUPPLY SCHEMATIC

SCALE	DATE	DRG. NO.
NTS	JUNE 2025	RITES/BLD/GS/TEN/702

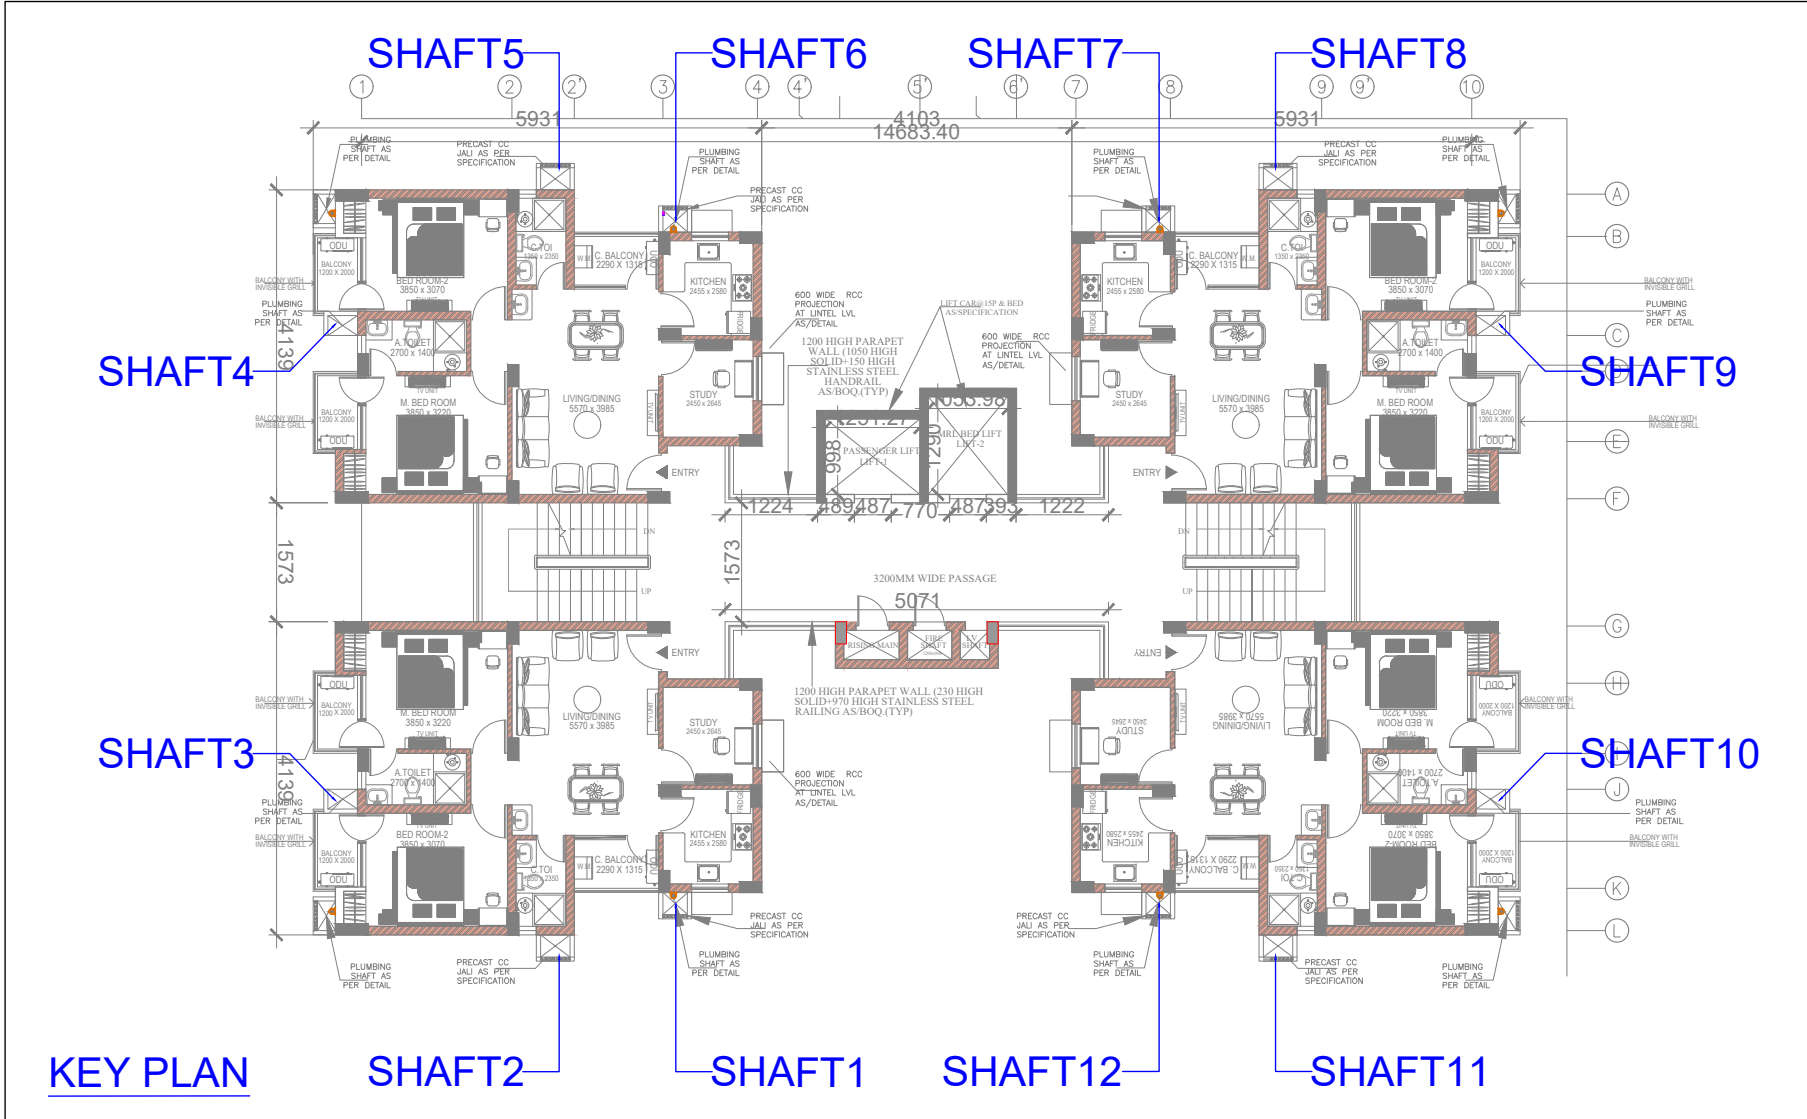


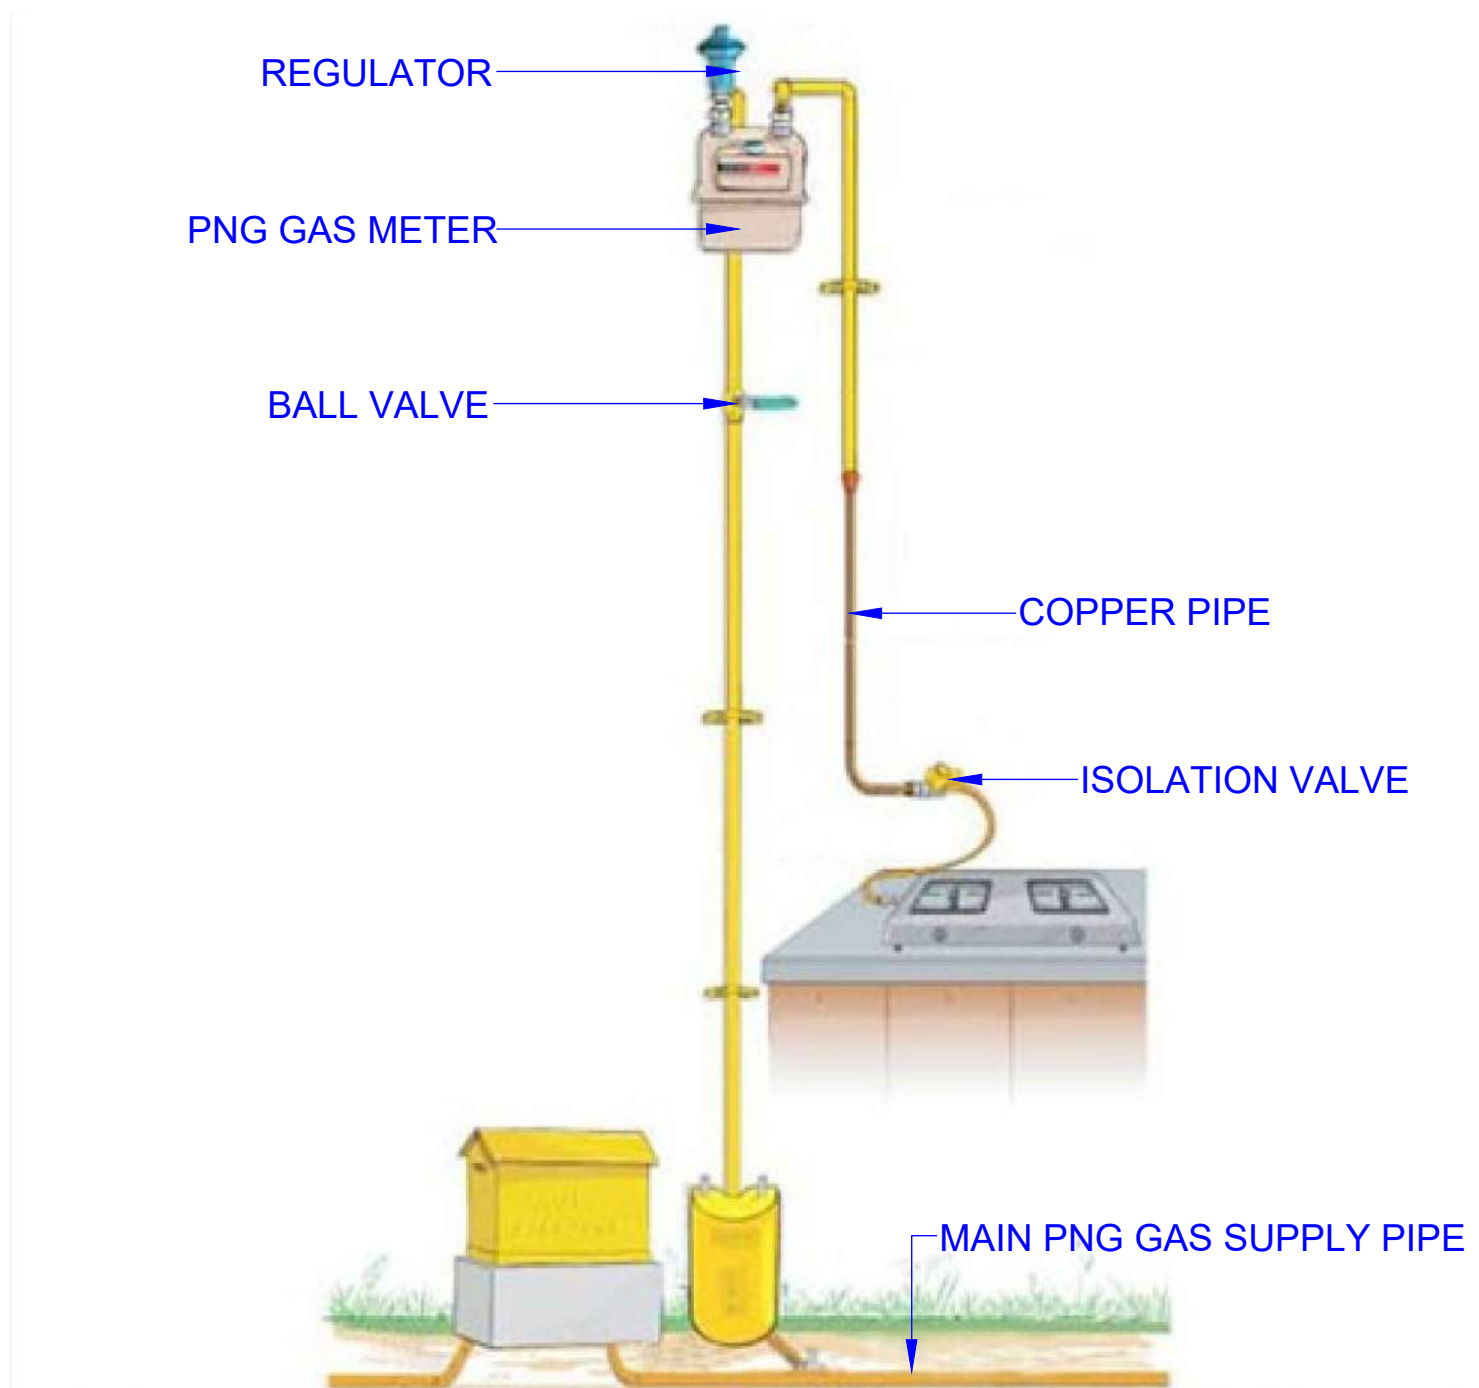

DOMESTIC GAS CONNECTION SCHEMATIC

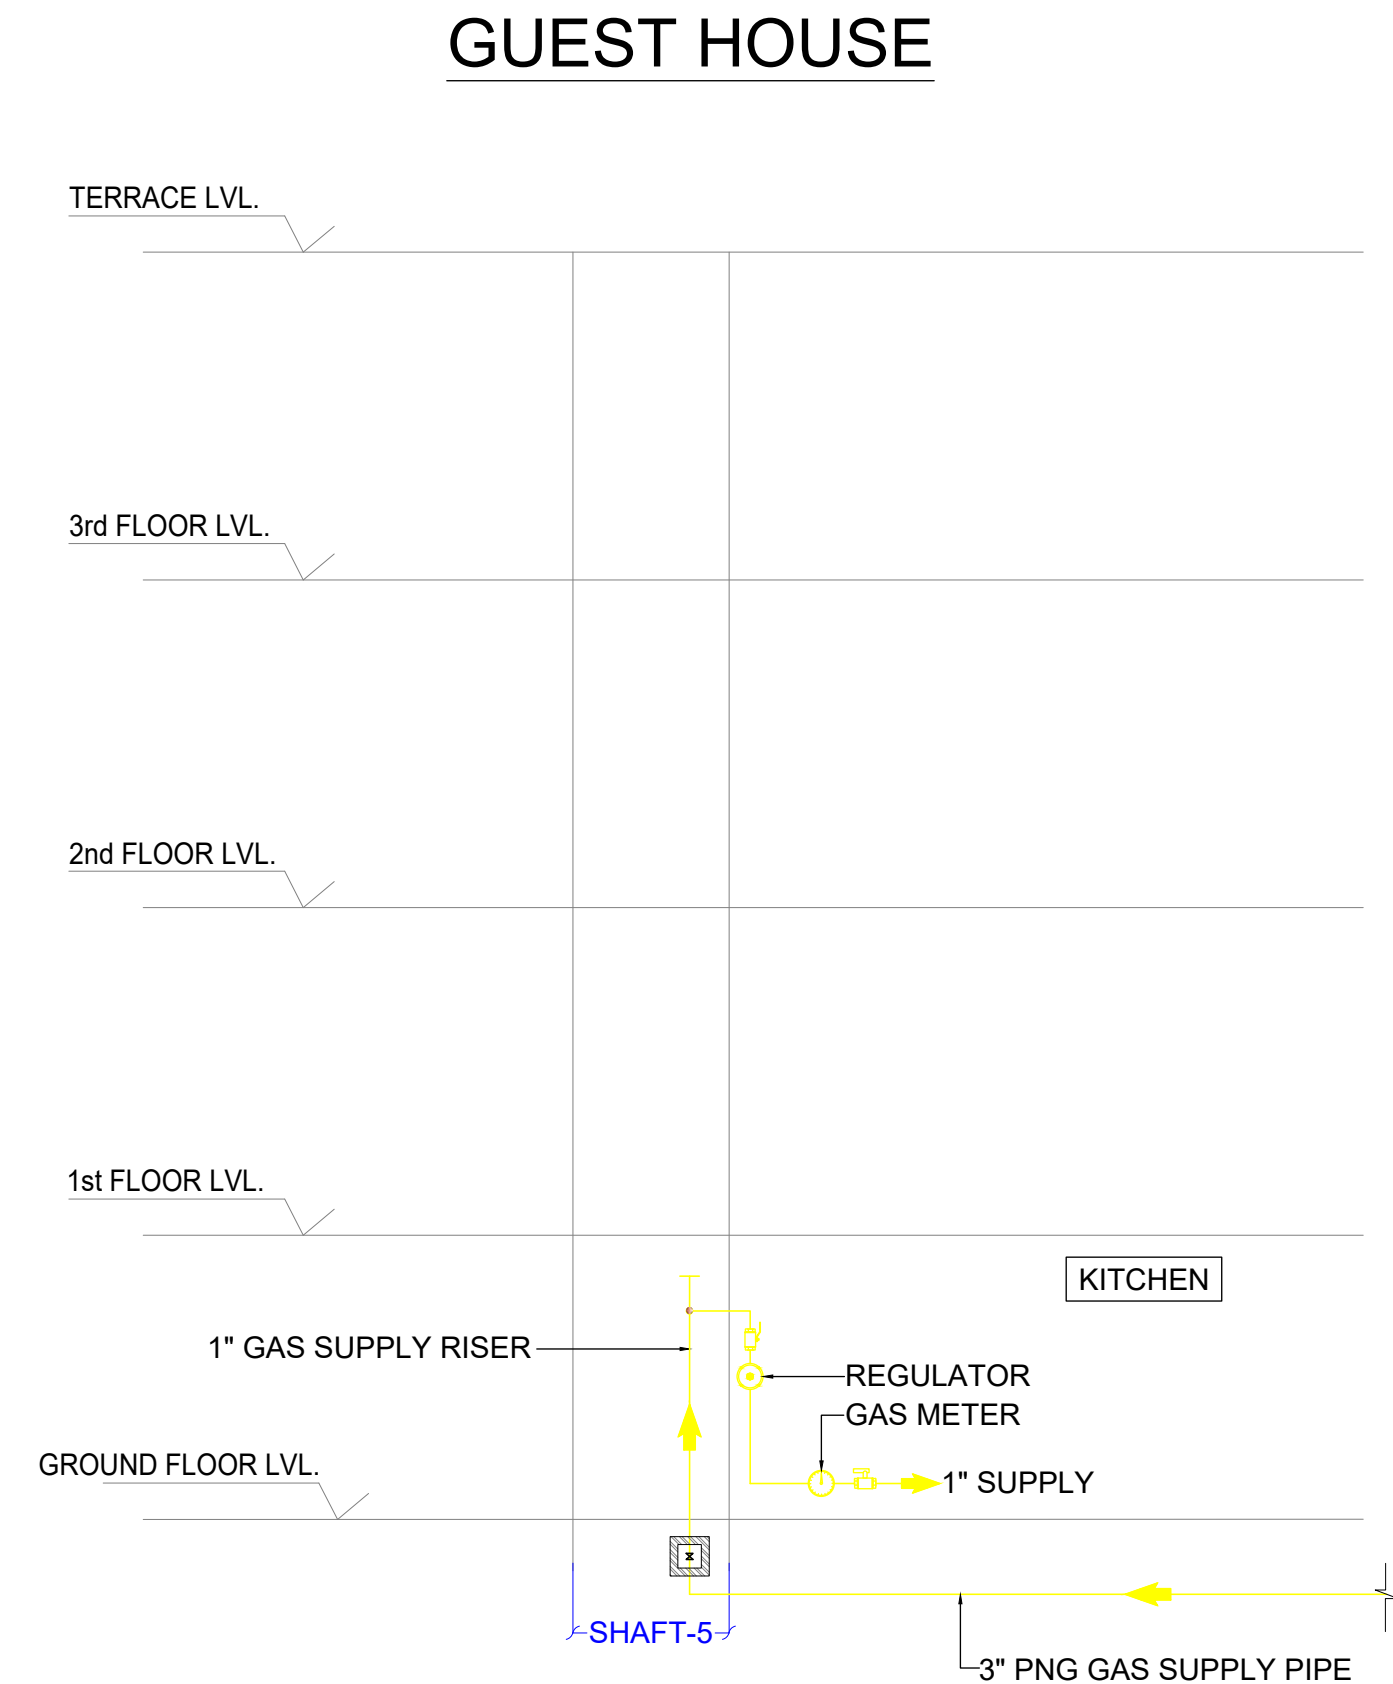

PLUMBING LEGENDS:-		
1.	PNG GAS SUPPLY PIPE	
2.	BALL VALVE	
3.	ISOLATION VALVE	
4.	FLOW DIRECTION	
5.	VALVE WITH CHAMBER	

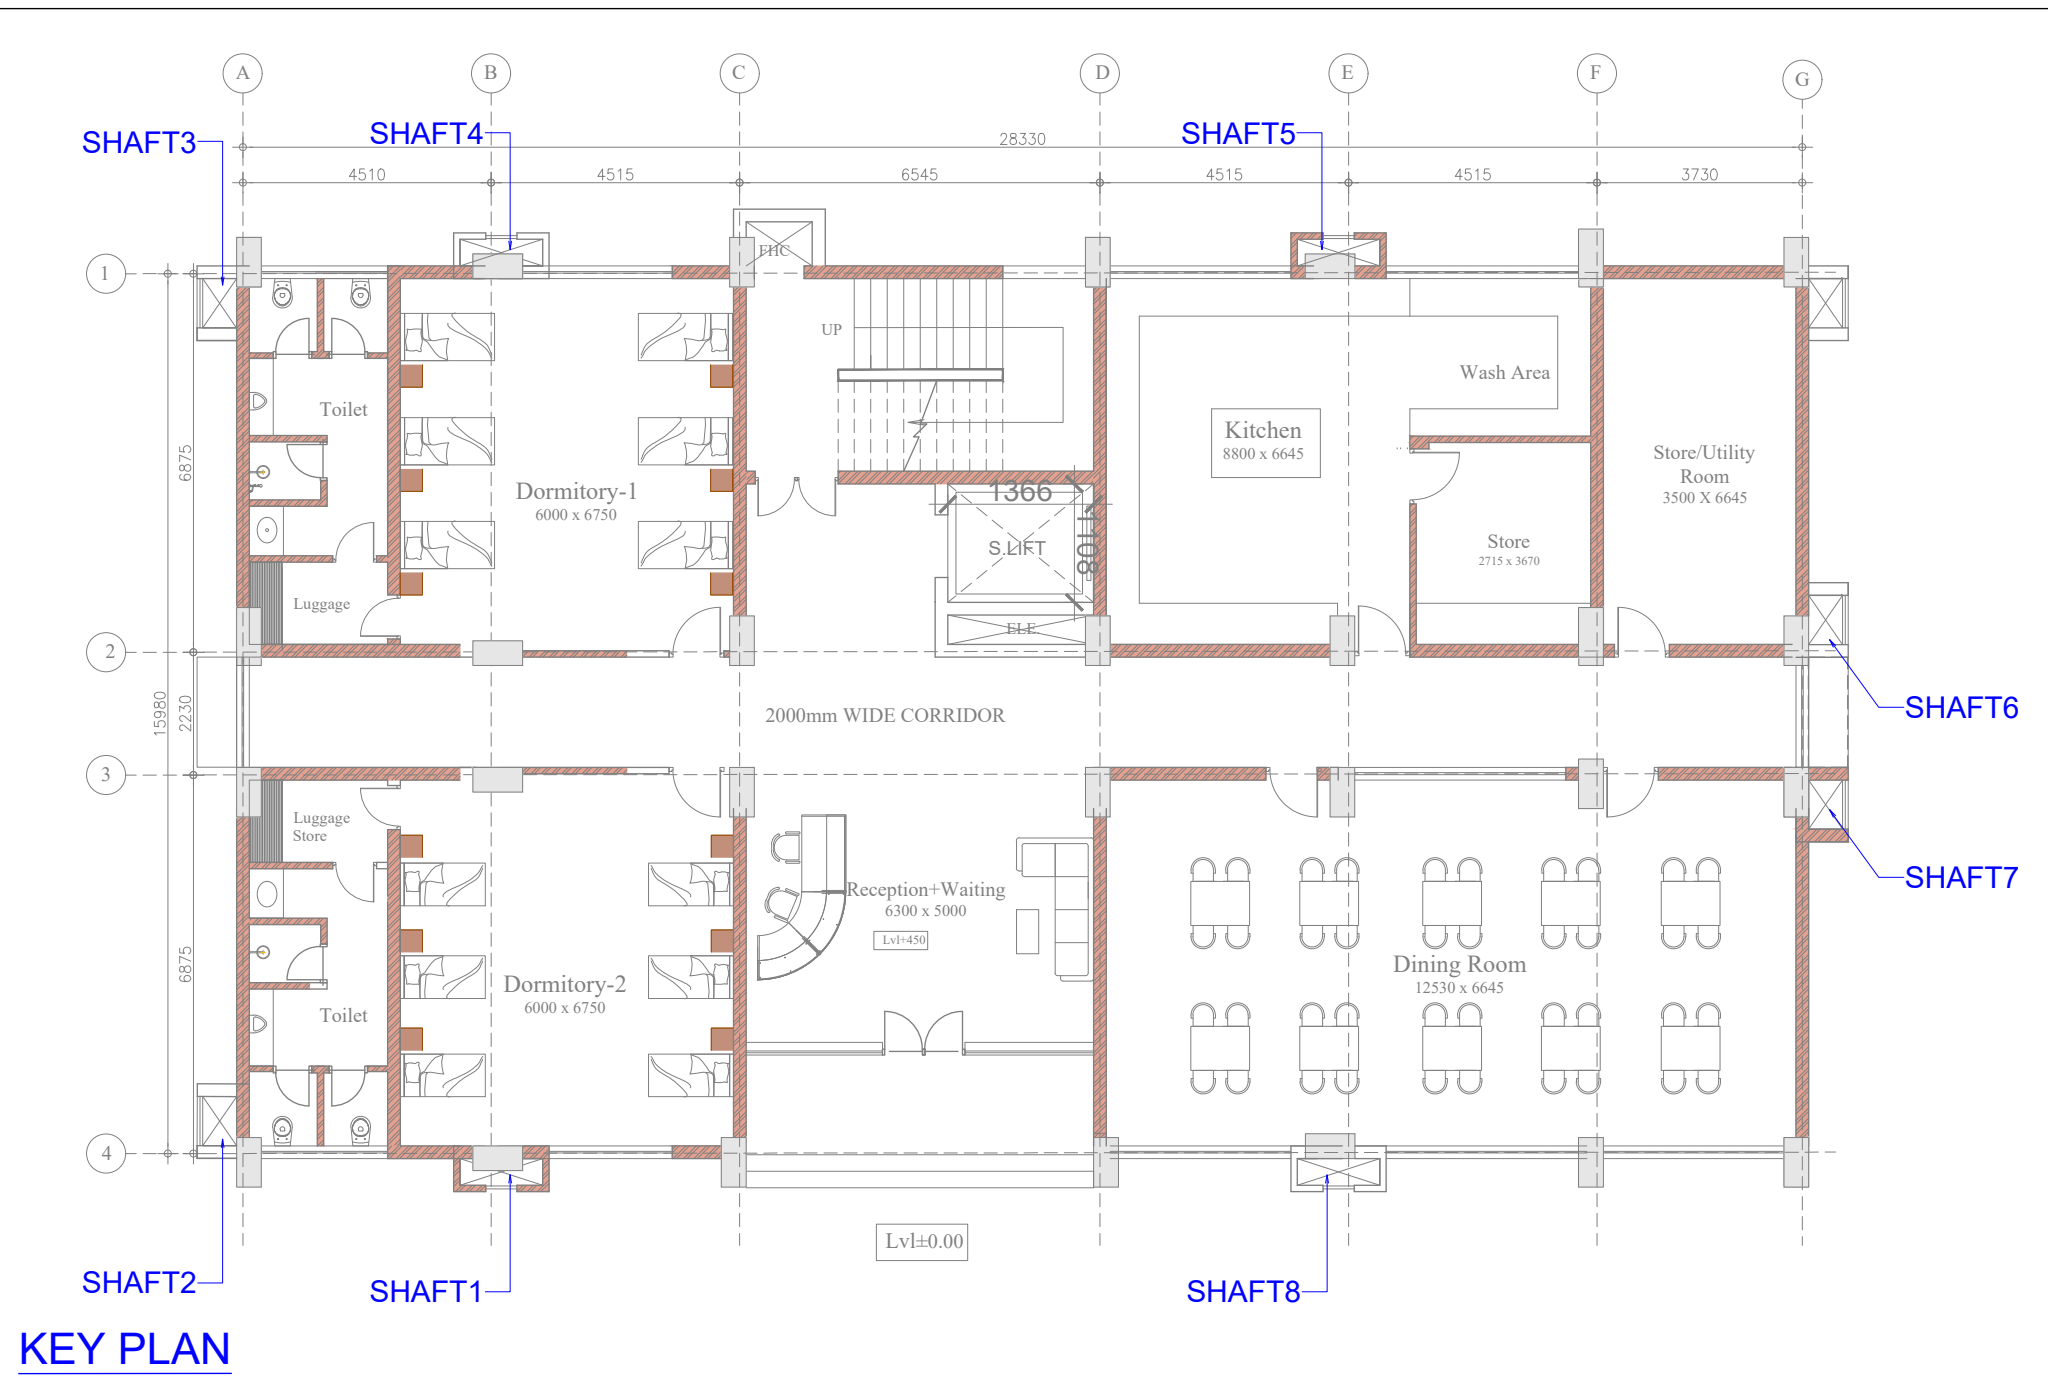

NOTES:-
1. ALL DIMENSIONS ARE IN MM; UNLESS NOTED OTHERWISE.
2. WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BROUGHT TO THE NOTICE OF THE ENGINEER.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS.
5. DRAWINGS ARE INDICATIVE IN NATURE AND REPRESENT THE MINIMUM REQUIREMENTS. THE CONTRACTOR SHALL ENSURE COMPLIANCE WITH ALL APPLICABLE STANDARDS AND SITE CONDITIONS.

TENDER DRAWING

CLIENT
 OIL INDIA LIMITED
(A Govt. of India Enterprise)

CONSULTANT
 RITES
THE INFRASTRUCTURE PEOPLE
(A Govt. of India Enterprise)

MEP CONSULTANT
PKV CONSULTING ENGINEERS (P) LTD.
 815 - C DDA FLATS
EAST OF LONI ROAD DELHI - 110093
email:-info@pkv.co.in

JOB TITLE
BQ WORKMEN GROUP HOUSING
COMPLEX AT DULIAJAN ASSAM

DRAWING TITLE
GUEST HOUSE
GAS SUPPLY SCHEMATIC

SCALE
NTS

DATE
JUNE 2025

DRG. NO.
RITES/BLD/FF/TEN/703