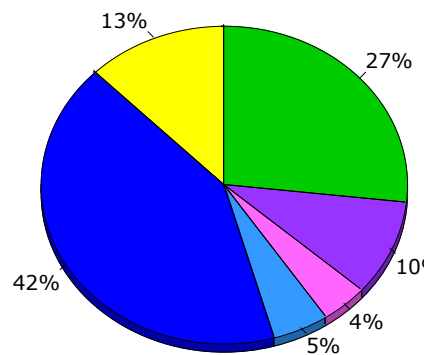


**Annual Peak Demand by Enduse**

|               | Electricity<br>kW | Natural Gas<br>Btu/h | Steam<br>Btu/h | Chilled Water<br>Btu/h |
|---------------|-------------------|----------------------|----------------|------------------------|
| Space Cool    | 333.75            | -                    | -              | -                      |
| Heat Reject.  | 39.11             | -                    | -              | -                      |
| Refrigeration | -                 | -                    | -              | -                      |
| Space Heat    | -                 | -                    | -              | -                      |
| HP Supp.      | -                 | -                    | -              | -                      |
| Hot Water     | -                 | -                    | -              | -                      |
| Vent. Fans    | 33.50             | -                    | -              | -                      |
| Pumps & Aux.  | 76.50             | -                    | -              | -                      |
| Ext. Usage    | -                 | -                    | -              | -                      |
| Misc. Equip.  | 213.34            | -                    | -              | -                      |
| Task Lights   | -                 | -                    | -              | -                      |
| Area Lights   | 99.68             | -                    | -              | -                      |
| <b>Total</b>  | <b>795.88</b>     | <b>-</b>             | <b>-</b>       | <b>-</b>               |

**Electricity**