ELECTRICAL SYMBOL LEGEND (ANSI Y32.9 / NECA 100 STYLE)

SYMBOL	DESCRIPTION
	R - DUPLEX RECEPTACLE; 18 IN AFF CENTER WHERE SILENT
WP	WR / WP OUTDOOR RECEPTACLE
S	SB - SOURCE SWITCH BOX; MECHANISM COUNT NOT ISSUED
S_3	SOURCE MULTIWAY CONTROL - TOPOLOGY HOLD H3
	F - FAN / FIXTURE; 14/3 PREWIRE WHERE MARKED
	RL - SOURCE RECESSED LIGHT
	VL - VANITY LIGHT ABOVE MIRROR
	EF / FL / P - SOURCE EXHAUST, LINEAR, PENDANT
SD	SD - SOURCE SMOKE / CO ALARM LOCATION
	P1 - PROPOSED SIEMENS SN3048L1200, 200A MLO
SN-16	HR - PANEL TO FIRST BOX; ALL 19 ROUTES REACH P1
	ATTIC: SOLID RED (LATER v13t RULE)
	WALL: DASHED RED; SAME WALL / ROOM; NEVER GARAGE
	BLUE - EXACT ARCHITECT SWITCH ARCS
///	14/3 FAN PREWIRE = DOUBLE BLUE; ALARM BLACK/YELLOW

GENERAL NOTES

DRAFT / NOT FOR CONSTRUCTION. SPECIFIC RELEASE HOLDS REMAIN OPEN.
CODE: SOURCE NFPA 70 (2020); FBC 8TH (2023) / PERMIT EDITION / AHJ TO CONFIRM.
SOURCE A2: FLORENCE 1; LIVING 2,325 SF / TOTAL 3,076 SF; CEILING HEIGHTS PER SOURCE TAGS.
SOURCE MODEL / PARCEL VERIFIED; HOUSE NUMBERS PER OWNER TRACKER; SOURCE HOUSE-NUMBER FIELDS BLANK.
OWNER: EXTERIOR MM1 ON GARAGE SIDE; INTERIOR P1 DIRECTLY BACK-TO-BACK.
PRECISE FIELD STATION, HEIGHTS, UTILITY COORDINATION / CLEARANCES TBD.
H1: 200A RISER CONFLICTS WITH QU816D400SL150; ACTUAL SERVICE GEAR HOLD.
P1 NEW SIEMENS SN3048L1200, 200A MLO, 30 PHYSICAL SPACES / 48 MAX CKTS.
EXISTING SQUARE D REQUIRES COMPATIBLE LISTED SQUARE D BREAKERS.
FOUR MAX 15A AREA CIRCUITS. ACTUAL <1,800VA CHECK NOT YET PROVEN.
AREA BASIS 6,975VA; 4 x 1,743.75 ALLOCATION; 1,750VA BUDGETS NOT CONNECTED LOAD.
120V DF PREFERENCE SUBJECT CODE / LISTING. C2 ALARM DF IS HOLD H8.
ONE 14/2 ALARM POWER FEED; 10 SOURCE SD; 9 x 14/3 INTERCONNECT LINKS.
H3 / H4: SOURCE MULTIWAY, ATTIC LIGHT AND BATH / VANITY CONTROL RELATIONSHIPS NOT RELEASED.
H2 / H5: ALL EQUIPMENT NAMEPLATES, WH VOLTAGE, HEAT kW / FEEDS / MANUALS TBD.
FOUR SABC INCLUDING SOURCE FLEX KITCHENETTE; FLEX / EV SCOPE TO CONFIRM.
C16 BATH RECEPTACLES ONLY. C18 GARAGE / PERMITTED OUTDOOR RECEPTACLES ONLY.
15A HOME RUNS FIRST LAND OUTSIDE BATH BOXES; KITCHEN GROUP LOADS HOLD.
RANGE / DRYER 2P GFCI RATING TBD; HVAC EXCEPTION ONLY IF APPLICABLE / APPROVED.
ALL AVAILABLE ELECTRODES REQUIRED; UFER ONLY IF AVAILABLE QUALIFYING ELECTRODE.
NM EDGE PROTECTION / NAIL PLATES PER 300.4; GUARD STRIPS NEAR SCUTTLE.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.
NO ELECTRICAL CIRCUIT MAPPING OR SOURCE DEVICE CHANGES FROM D5. D6 = APPROVED BLUE FRAME / EXJ DATA.

SHEET INDEX

SHEET	TITLE
E-0	LEGEND, GENERAL NOTES & SHEET INDEX
E-1	BRANCH CIRCUIT PLAN - ALL CIRCUITS
E-1S	SOURCE / CONTROL RECONCILIATION
E-2	PANEL SCHEDULE - P1
E-3.1	CIRCUIT P1-1 - RANGE
E-3.2	CIRCUIT P1-2 - MASTER SUITE + ALARM CHAIN
E-3.4	CIRCUIT P1-4 - CENTRAL / STUDY / GARAGE LIGHTING
E-3.5	CIRCUIT P1-5 - DRYER
E-3.6	CIRCUIT P1-6 - BEDROOMS 3 & 4 + BATH 3 LIGHTS
E-3.8	CIRCUIT P1-8 - BEDROOM 2 / FLEX / BATH 2 / ENTRY LIGHTS
E-3.9	CIRCUIT P1-9 - AIR HANDLER / HEAT
E-3.10	CIRCUIT P1-10 - KITCHEN / DINING SABC A + REFRIGERATOR

SHEET	TITLE
E-3.12	CIRCUIT P1-12 - LAUNDRY RECEPTACLES / WASHER / ALTERNATE 120V
E-3.13	CIRCUIT P1-13 - WH VOLTAGE HOLD - TWO SPACES
E-3.14	CIRCUIT P1-14 - KITCHEN / DINING SABC B
E-3.16	CIRCUIT P1-16 - ALL BATHROOM RECEPTACLES - NO LIGHTS
E-3.17	CIRCUIT P1-17 - OUTDOOR A/C CONDENSER
E-3.18	CIRCUIT P1-18 - GARAGE + PERMITTED OUTDOOR RECEPTACLES
E-3.20	CIRCUIT P1-20 - DISHWASHER - INDIVIDUAL PROVISIONAL
E-3.22	CIRCUIT P1-22 - DISPOSAL - INDIVIDUAL PROVISIONAL
E-3.24	CIRCUIT P1-24 - RANGE VENTED MICROWAVE / HOOD - INDIVIDUAL
E-3.26	CIRCUIT P1-26 - FLEX KITCHENETTE SABC A + U.C. REFRIGERATOR
E-3.28	CIRCUIT P1-28 - FLEX KITCHENETTE SABC B

FOOTAGE SUMMARY (FT) - FIELD LENGTHS NOT YET VERIFIED

CABLE / RACEWAY	BEFORE WASTE	AFTER +10%	STATUS
14/2 Cu NM-B	TBD	TBD	HOLD
14/3 Cu NM-B	TBD	TBD	HOLD
12/2 Cu NM-B	TBD	TBD	HOLD
EQUIPMENT / FEEDER	TBD	TBD	HOLD

DEVICE / BOX RECORDS 196; HR 19; SOURCE OUTLETS 98 + ONE MARKED NEW GARAGE R.
ACTUAL SOURCE CONTROL GROUPS 74 / 74; ALL RETAINED.
SWITCHED LOAD PROXIMITY: 52 / 55; EXPLICIT HOLDS 2.VL1, 2.VL3, 4.F4
OWN SOURCE: FLORENCE 1, PARCEL 8005-0758-11. EXJ ROOT PER OWNER TRACKER; NO UNVERIFIED BUILDER LOGO.
NO NAMEPLATE, FOOTAGE, FINAL PHASE BALANCE OR SERVICE RESULT FABRICATED.
DRAFT D6: SELECTED A / v13t SANTIAGO BLUE FRAME. PRIOR REVISIONS PRESERVED.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
LEGEND, GENERAL NOTES & SHEET INDEX

SCALE
NONE


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD

SHEET
E-0

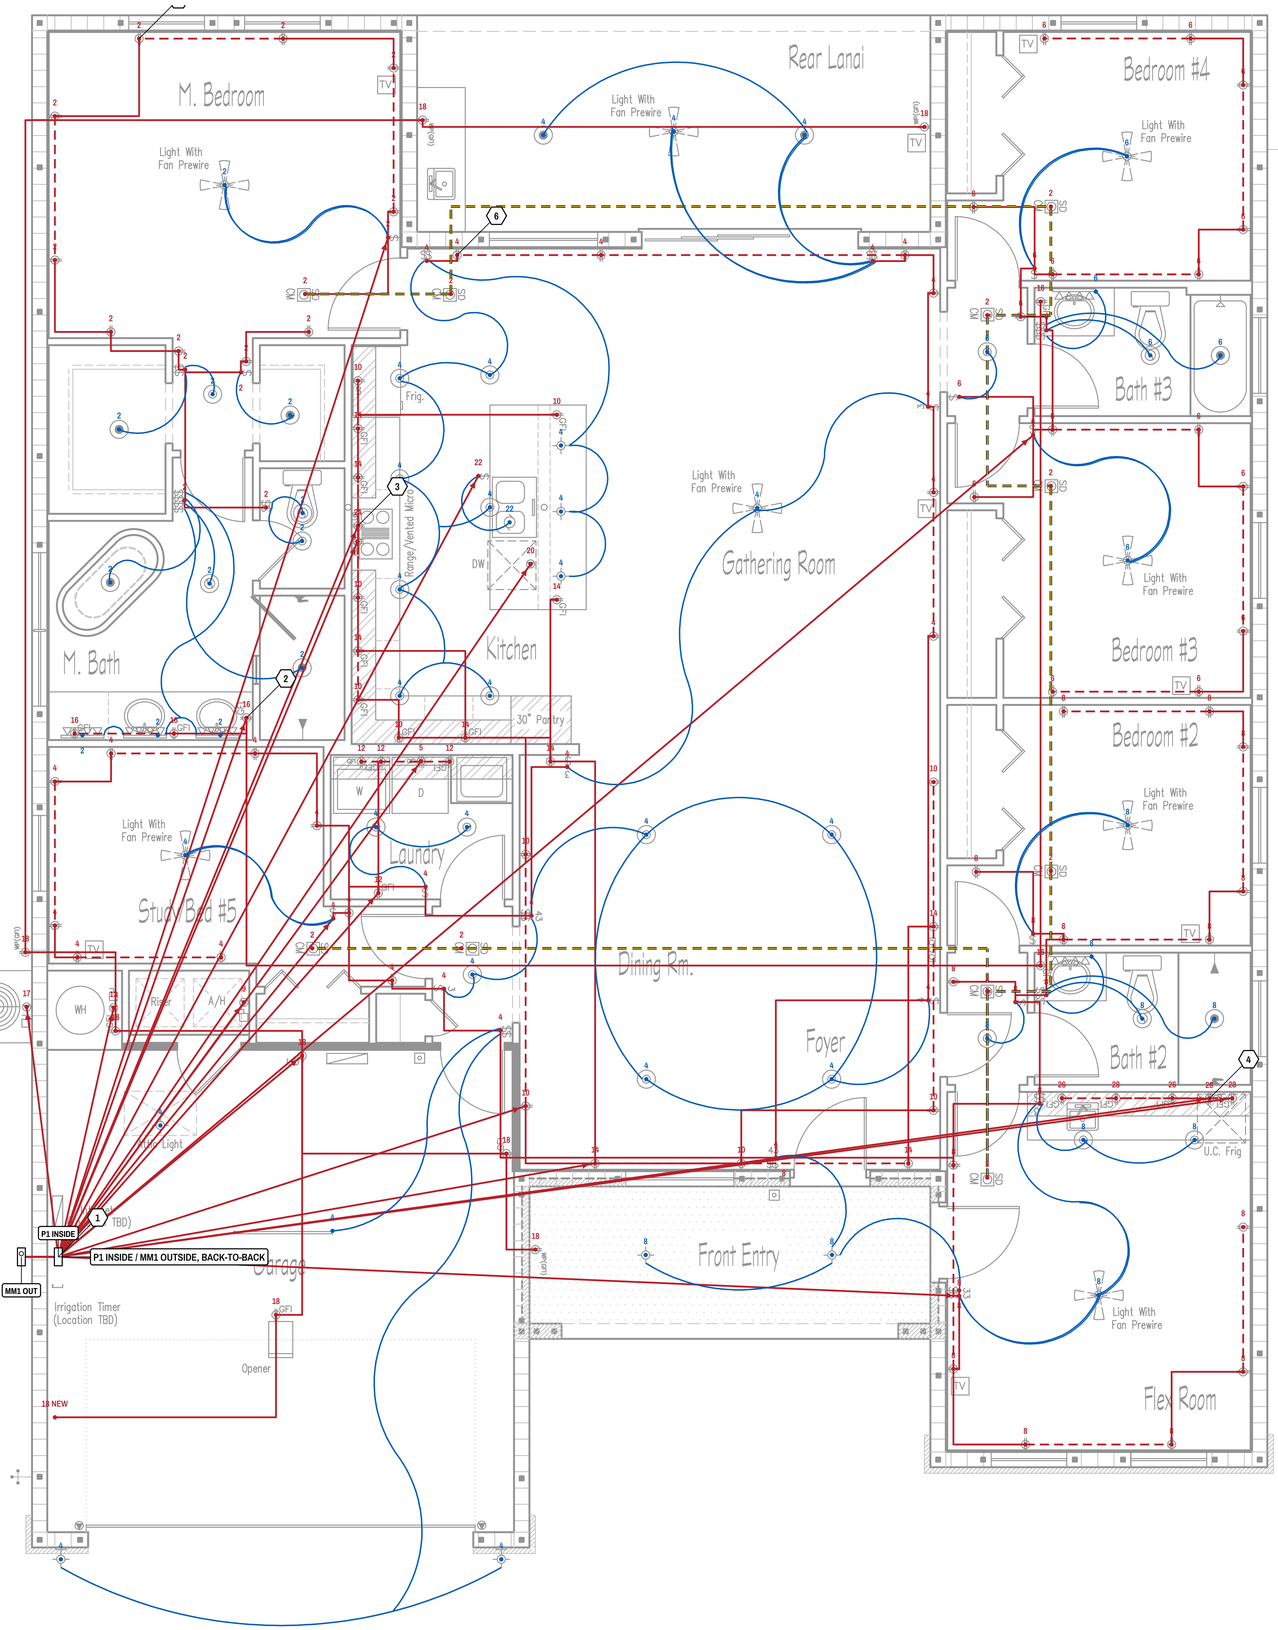

CIRCUIT LEGEND (PANEL P1)

P1-1	TBDA 2P TBD - RANGE
P1-2	15A 1P 14/2+G - MASTER SUITE + ALARM CHAIN
P1-4	15A 1P 14/2+G - CENTRAL / STUDY / GARAGE LIGHTING
P1-5	TBDA 2P TBD - DRYER
P1-6	15A 1P 14/2+G - BEDROOMS 3 & 4 + BATH 3 LIGHTS
P1-8	15A 1P 14/2+G - BEDROOM 2 / FLEX / BATH 2 / ENTRY LIGHTS
P1-9	TBDA 2P TBD - AIR HANDLER / HEAT
P1-10	20A 1P 12/2+G - KITCHEN / DINING SABC A + REFRIGERATOR
P1-12	20A 1P 12/2+G - LAUNDRY RECEPTACLES / WASHER / ALTERNATE
P1-13	TBDA 2P TBD - WH VOLTAGE HOLD - TWO SPACES
P1-14	20A 1P 12/2+G - KITCHEN / DINING SABC B
P1-16	20A 1P 12/2+G - ALL BATHROOM RECEPTACLES - NO LIGHTS
P1-17	TBDA 2P TBD - OUTDOOR A/C CONDENSER
P1-18	20A 1P 12/2+G - GARAGE + PERMITTED OUTDOOR RECEPTACLES
P1-20	20A 1P 12/2+G - DISHWASHER - INDIVIDUAL PROVISIONAL
P1-22	20A 1P 12/2+G - DISPOSAL - INDIVIDUAL PROVISIONAL
P1-24	20A 1P 12/2+G - RANGE VENTED MICROWAVE / HOOD - INDIVIDU
P1-26	20A 1P 12/2+G - FLEX KITCHENETTE SABC A + U.C. REFRIGERA
P1-28	20A 1P 12/2+G - FLEX KITCHENETTE SABC B

KEYED NOTES

1. OWNER CONFIRMS MM1 OUTSIDE / P1 INSIDE GARAGE SIDE DIRECTLY BACK-TO-BACK. PRECISE FIELD OFFSETS / HEIGHTS / UTILITY DETAILS HOLD.
2. C16 BATH RECEPTACLES ONLY. NO 15A HOME RUN LANDS IN A BATH BOX.
3. C24 VENTED MICRO / HOOD. C20 DW / C22 DISPOSAL SEPARATE PROVISIONAL PENDING MANUALS.
4. FLEX KITCHENETTE SABC C26 / C28. CONFIRM FLEX / EV SCOPE BEFORE RELEASE.
5. H8 ALARM LISTING / PROTECTION; H4 MASTER VANITY ENDPOINTS HOLD.
6. H3 MULTIWAY / TRAVELER / NEUTRAL AND ATTIC CONTROL HOLD. BLUE IS ACTUAL SOURCE TRACE.

NOTES

SEE E-0 FOR SYMBOL LEGEND AND GENERAL NOTES.
SEE E-2 FOR PANEL SCHEDULE (P1 = SIEMENS SN3048L1200).
SEE E-3.x: CIRCUIT RUN SCHEDULE / FOOTAGE HOLDS.
OWNER-CONFIRMED GARAGE-SIDE, BACK-TO-BACK EXTERIOR MM1 / INTERIOR P1; FIELD DETAILS HOLD.

GARAGE-SIDE SERVICE RELATIONSHIP - NTS

MM1 EXTERIOR
METER / MAIN

P1 INTERIOR
200A MLO - PROPOSED

OWNER CONFIRMED: SAME GARAGE-SIDE WALL / DIRECTLY BACK-TO-BACK.
SOURCE SIDEWALL STATION RETAINED. NO COMPASS SIDE ASSIGNED.
EXACT FIELD OFFSET / HEIGHTS / CLEARANCES / UTILITY APPROVAL TBD.
FEEDER SIZING / GEAR CONFLICT H1 REMAIN OPEN; NEUTRAL ISOLATED IN P1.

1 BRANCH CIRCUIT PLAN - ALL CIRCUITS

SCALE: NTS (APPROX 1/8" = 1'-0" AT 36x48) SOURCE ORIENTATION RETAINED; NO COMPASS SIDE ASSIGNED

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
BRANCH CIRCUIT PLAN - ALL CIRCUITS

SCALE
DIAGRAMMATIC / NTS

DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD

SHEET
E-1

SOURCE RECONCILIATION / RELEASE HOLDS

DEVICE / BOX RECORDS 196; HR 19; SOURCE OUTLETS 98 + ONE MARKED NEW GARAGE R.

ACTUAL SOURCE CONTROL GROUPS 74 / 74; ALL RETAINED.

SWITCHED LOAD PROXIMITY: 52 / 55; EXPLICIT HOLDS 2.VL1, 2.VL3, 4.F4

OWN SOURCE: FLORENCE 1, PARCEL 8005-0758-11. EXJ ROOT PER OWNER TRACKER; NO UNVERIFIED BUILDER LOGO.

NO NAMEPLATE, FOOTAGE, FINAL PHASE BALANCE OR SERVICE RESULT FABRICATED.

DRAFT D6: SELECTED A / V13T SANTIAGO BLUE FRAME. PRIOR REVISIONS PRESERVED.

H1 / PANEL / SERVICE GEAR: OWNER-CONFIRMED: MM1 EXTERIOR GARAGE-SIDE WALL; P1 DIRECTLY INSIDE, BACK-TO-BACK. SOURCE SIDEWALL DRAWING STATION RETAINED. EXACT FIELD OFFSET, HEIGHTS, WORKING CLEARANCES AND UTILITY APPROVAL REMAIN TO COORDINATE. RISER 200A CONFLICTS WITH QU816D400SL150 REFERENCE.

H2 / EQUIPMENT / HEAT / SCOPE: RANGE, DRYER, WH VOLTAGE, A/C MCA-MOCP, AH AND HEAT-STRIP KW / FEED COUNT / MANUALS NEEDED. CONFIRM EV SCOPE AND WHETHER FLEX IS A KITCHEN OR SLEEPING SUITE.

H3 / MULTIWAY CONTROL TOPOLOGY: SOURCE SHOWS DINING 3-WAY / 4-WAY MARKS AND LOOPS, BUT DOES NOT IDENTIFY A COMPLETE TRAVELER PATH TO EVERY CONTROL. BLUE GEOMETRY IS TRACED, NOT A RELEASED CONDUCTOR SCHEDULE. NEUTRAL AT CONTROLS AND THE SOURCE ATTIC-LIGHT SWITCH LEG MUST BE CLARIFIED.

H4 / MASTER VANITY CONTROLS: THREE VANITY GRAPHICS ARE RETAINED. THE SOURCE CURVES END BESIDE / BETWEEN THE VANITY GRAPHICS AND RECEPTACLES; EXACT BOX CONNECTION / COMMON SWITCHED FEED NEEDS DESIGNER CONFIRMATION. DO NOT SWITCH THE BATH RECEPTACLES.

H5 / LAUNDRY / APPLIANCES: SOURCE HAS ADJACENT 120V POINTS AT W/D PLUS A 240V DRYER. CONFIRM ALTERNATES AND SELECTED APPLIANCES. COMBINED DW/DISPOSAL/HOOD CANNOT BE VALIDATED; SEPARATE C20/C22/C24 DRAFTED PENDING MANUALS.

H6 / CODE-COMPLETION / FIELD: C18.R9 LEFT VEHICLE-BAY RECEPTACLE IS NEW. SOURCE IRRIGATION TIMER, INTERNET POWER AND DOORBELL TRANSFORMER CONNECTION DETAILS ARE NOT SPECIFIED; COORDINATE BEFORE ADDING ANY LOAD. VERIFY SOURCE WATER-CLOSET LIGHT VS COMPANY BATH-LIGHT RULE.

H7 / LOADS / LENGTHS: FOUR 1,750VA AREA BUDGETS ARE NOT CONNECTED LOADS. NEC AREA BASIS IS 6,975VA, ALLOCATED PROVISIONALLY AT 1,743.75VA PER AREA CIRCUIT; ACTUAL LOADS REMAIN TBD. CONNECTED EQUIPMENT, BRANCH BALANCE, DERATING, PHYSICAL CABLE LENGTHS AND SERVICE DEMAND REMAIN OPEN. NO FINAL SERVICE RESULT IS ISSUED.

H8 / ALARM PROTECTION / LISTING: C2 DF PREFERENCE IS ON HOLD PENDING SELECTED ALARM INSTRUCTIONS AND APPLICABLE FIRE-ALARM RULES. SOME KIDDE MANUALS PROHIBIT GFCI SUPPLY. RESOLVE SUPPLY PROTECTION / CIRCUIT ALLOCATION BEFORE PURCHASE OR WIRING; MANUFACTURER INSTRUCTIONS GOVERN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS

FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
SOURCE / CONTROL RECONCILIATION

SCALE
NONE

DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD

SHEET
E-1S

PANEL SCHEDULE - PANEL "P1" SIEMENS SN3048L1200

PANEL	P1 (DWELLING LOAD CENTER)	**VOLTS**	120/240V 1PH 3W + EGC
MODEL	SIEMENS SN3048L1200 (PROPOSED)	**MAINS**	200A MLO - DOWNSTREAM MM1
SPACES	30 (48 CKT MAX); NO TANDEMS ASSUMED	**MAIN OCPD**	MM1 RATING / CATALOG TBD
BUS	200A; TERMINATIONS / MATERIAL VERIFY	**AIC**	TBD; 200A / QU816D400SL150 CONFLICT H1
MOUNTING	INDOOR; SURFACE / FLUSH TBD	**LOCATION**	GARAGE SIDE, BACK-TO-BACK WITH MM1

CKT	DESCRIPTION	WIRE	CAT. NO.	TRIP	P	VA BASIS*	PH A	PH B	VA BASIS*	P	TRIP	CAT. NO.	WIRE	DESCRIPTION	CKT
1	RANGE	TBD	2P GFCI TBD	TBD	2	TBD	TBD		1,743.75	1	15	H8 PROT HOLD	14/2+G	MASTER SUITE + ALARM CHAIN	2
3	(2ND POLE - COMMON TRIP)					TBD		TBD	1,743.75	1	15	Q115DFN	14/2+G	CENTRAL / STUDY / GARAGE LIGHTING	4
5	DRYER	TBD	2P GFCI TBD	TBD	2	TBD	TBD		1,743.75	1	15	Q115DFN	14/2+G	BEDROOMS 3 & 4 + BATH 3 LIGHTS	6
7	(2ND POLE - COMMON TRIP)					TBD		TBD	1,743.75	1	15	Q115DFN	14/2+G	BEDROOM 2 / FLEX / BATH 2 / ENTRY LIGHTS	8
9	AIR HANDLER / HEAT	TBD	TBD	TBD	2	TBD	TBD		1,500	1	20	Q120DFN	12/2+G	KITCHEN / DINING SABC A + REFRIGERATOR	10
11	(2ND POLE - COMMON TRIP)					TBD		TBD	1,500	1	20	Q120DFN	12/2+G	LAUNDRY RECEPTACLES / WASHER / ALTERNATE 120V DR	12
13	WH VOLTAGE HOLD - TWO SPACES	TBD	TBD	TBD	R	TBD	TBD		1,500	1	20	Q120DFN	12/2+G	KITCHEN / DINING SABC B	14
15	(WH TWO-SPACE RESERVATION)					TBD		TBD	TBD	1	20	Q120DFN	12/2+G	ALL BATHROOM RECEPTACLES - NO LIGHTS	16
17	OUTDOOR A/C CONDENSER	TBD	TBD	TBD	2	TBD	TBD		TBD	1	20	Q120DFN	12/2+G	GARAGE + PERMITTED OUTDOOR RECEPTACLES	18
19	(2ND POLE - COMMON TRIP)					TBD		TBD	TBD	1	20	Q120DFN	12/2+G	DISHWASHER - INDIVIDUAL PROVISIONAL	20
21	HEAT FEED HOLD					TBD	TBD		TBD	1	20	Q120DFN	12/2+G	DISPOSAL - INDIVIDUAL PROVISIONAL	22
23	HEAT FEED HOLD					TBD		TBD	TBD	1	20	Q120DFN	12/2+G	RANGE VENTED MICROWAVE / HOOD - INDIVIDUAL	24
25	SPACE						1,500		1,500	1	20	Q120DFN	12/2+G	FLEX KITCHENETTE SABC A + U.C. REFRIGERATOR	26
27	SPACE							1,500	1,500	1	20	Q120DFN	12/2+G	FLEX KITCHENETTE SABC B	28
29	SPACE						0							SPACE	30
ACTUAL PHASE TOTALS - HOLD							**TBD**	**TBD**	**CONNECTED VA / FINAL BALANCE TBD. CODE BASIS* 14,475 VA; SEE CALC / HOLDS BELOW.**						

LOAD BASIS SUMMARY - CONNECTED TBD

LOAD CATEGORY	CIRCUITS	VA
AREA CODE BASIS*	P1-2, P1-4, P1-6, P1-8	6,975
SMALL APPLIANCE	P1-10, P1-14, P1-26, P1-28	6,000
LAUNDRY	P1-12	1,500
FIXED EQUIPMENT	P1-1, P1-5, P1-13, P1-20, P1-22, P1-24	TBD
HVAC	P1-9, P1-17	TBD
TOTAL CONNECTED		TBD

SPACES

ITEM	VALUE
POPULATED	22 PROPOSED SPACES
HELD	4 (13/15 WH; 21/23 HEAT)
SPARE	4 (25,27,29,30)
PHASING	A/B ROWS; WH VOLTAGE HOLD

DWELLING LOAD CALCULATION - NEC 2020 STANDARD METHOD / INCOMPLETE

NO	LOAD	NEC	VA	BASIS
1	GENERAL AREA: 2,325 SF x 3 VA	220.12	6,975	SOURCE A2
2	4 PROPOSED SABC x 1,500 VA	220.52(A)	6,000	CODE / SCOPE HOLD
3	LAUNDRY: ONE x 1,500 VA	220.52(B)	1,500	CODE
4	GENERAL BASIS SUBTOTAL		14,475	NOT ALL CONNECTED
5	RANGE C1	220.55	TBD	NAMEPLATE
6	ELECTRIC DRYER C5 / ALT C12	220.54	TBD	SELECTION / MAX RULE
7	WATER HEATER C13	422 / 220	TBD	VOLTAGE / WATTS
8	DISHWASHER C20	422 / 220	TBD	NAMEPLATE / MANUAL
9	DISPOSAL C22	430 / 220	TBD	NAMEPLATE / MANUAL
10	VENTED MICRO / HOOD C24	422 / 220	TBD	NAMEPLATE / MANUAL
11	AIR HANDLER / HEAT C9	424 / 440	TBD	HEAT kW / FEED COUNT
12	A/C CONDENSER C17	440 / 220	TBD	MCA / MOCP
	ACTUAL CONNECTED TOTAL		TBD	UNKNOWN IS NOT ZERO

DEMAND (220.42 + OPEN INPUTS)	VA / A
FIRST 3,000 VA OF GENERAL BASIS @ 100%	3,000
REMAINDER 11,475 VA @ 35%	4,016.25
PARTIAL GENERAL DEMAND ONLY	7,016.25
ELIGIBLE FIXED APPLIANCE DEMAND / 220.53	TBD
RANGE DEMAND / 220.55	TBD
DRYER DEMAND / 220.54	TBD
GOVERNING HVAC / HEAT / 220.60	TBD
APPLICABLE MOTOR / CONTINUOUS ADDITIONS	TBD
FINAL CALCULATED SERVICE LOAD	TBD VA
FINAL SERVICE CURRENT = FINAL VA / 240	TBD A
RESULT	INCOMPLETE / HOLD

* VA BASIS = CODE ALLOCATION, NOT ACTUAL CONNECTED NAMEPLATES. GENERAL AREA 6,975VA / 4 = 1,743.75 EACH; FOUR 1,750VA BUDGETS NOT ADDED.
GENERAL RECEPTACLES INCLUDING BATH / GARAGE ARE WITHIN AREA BASIS; ACTUAL BRANCH LOADS TBD. UNKNOWN LOADS ARE NOT ZERO.
PARTIAL 7,016.25VA IS NOT FINAL SERVICE DEMAND. NO 200A ADEQUACY RESULT. EQUIPMENT / MOTOR / CONTINUOUS FACTORS AND BALANCE TBD.
CODE ALLOCATION PHASES ONLY: A 7,987.50VA / B 6,487.50VA = 14,475VA. ACTUAL CONNECTED PHASES AND BALANCE TBD.

SCHEDULE NOTES

1. PHYSICAL SPACES: ODD LEFT / EVEN RIGHT; A/B ALTERNATES VERTICALLY. 2P COMMON TRIP 1/3, 5/7, 9/11, 17/19. WH 13/15 VOLTAGE HOLD.
2. 22 PROPOSED POPULATED + 4 HELD (13/15 WH; 21/23 POSSIBLE HEAT) + 4 SPARE = 30. NO TANDEMS / NEW EV / EXTRA MW ASSUMED.
3. Q115DFN / Q120DFN ONLY IF LISTED FOR ACTUAL GEAR / LOAD. C2 PROTECTION HOLD H8. EQUIPMENT BREAKER / CONDUCTOR / NAMEPLATE TBD.
4. SOURCE 200A / QU816D400SL150 GEAR DISCREPANCY HOLD H1. MM1 EXTERIOR / P1 INTERIOR GARAGE SIDE BACK-TO-BACK; EXACT FIELD DETAILS TBD.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
PANEL SCHEDULE - P1

SCALE
NONE


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-2

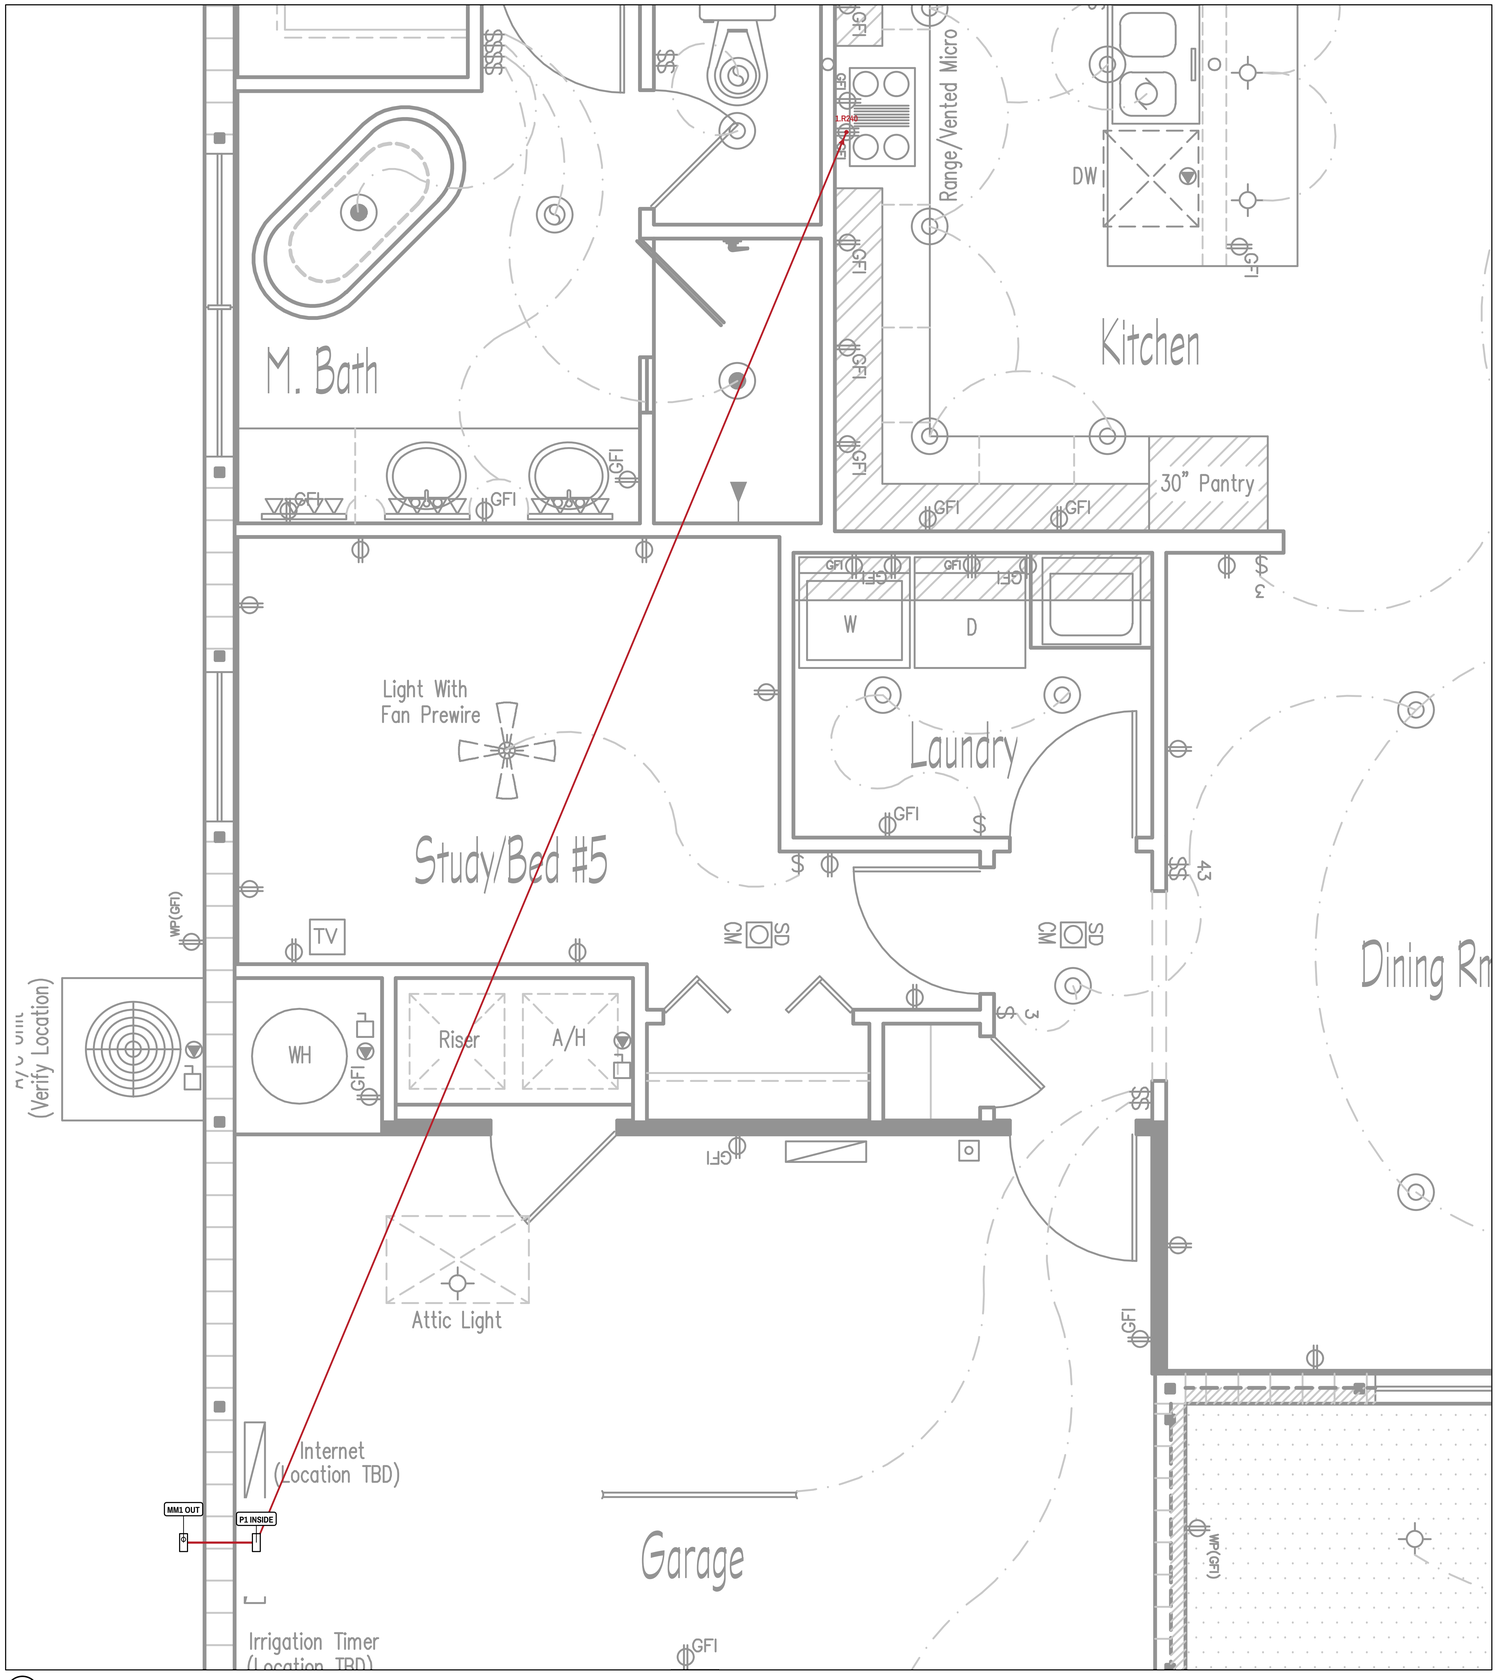

1 CIRCUIT P1-1 - RANGE

SCALE: NTS | TBDA 2P SIEMENS 2P GFCI TBD, TBD | PANEL SPACE 1/3

KEY PLAN

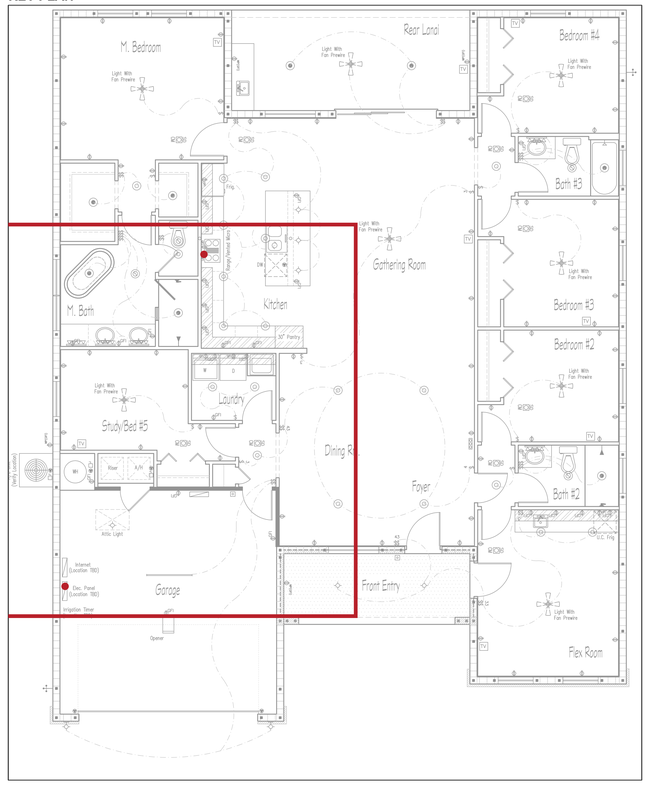

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	1.R240	ATTIC	TBD	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
TBD	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 1.R240; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
EQUIPMENT BREAKER / CONDUCTOR / NAMEPLATE TBD; NO FINAL EQUIPMENT SIZE ISSUED.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-1 - RANGE

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.1

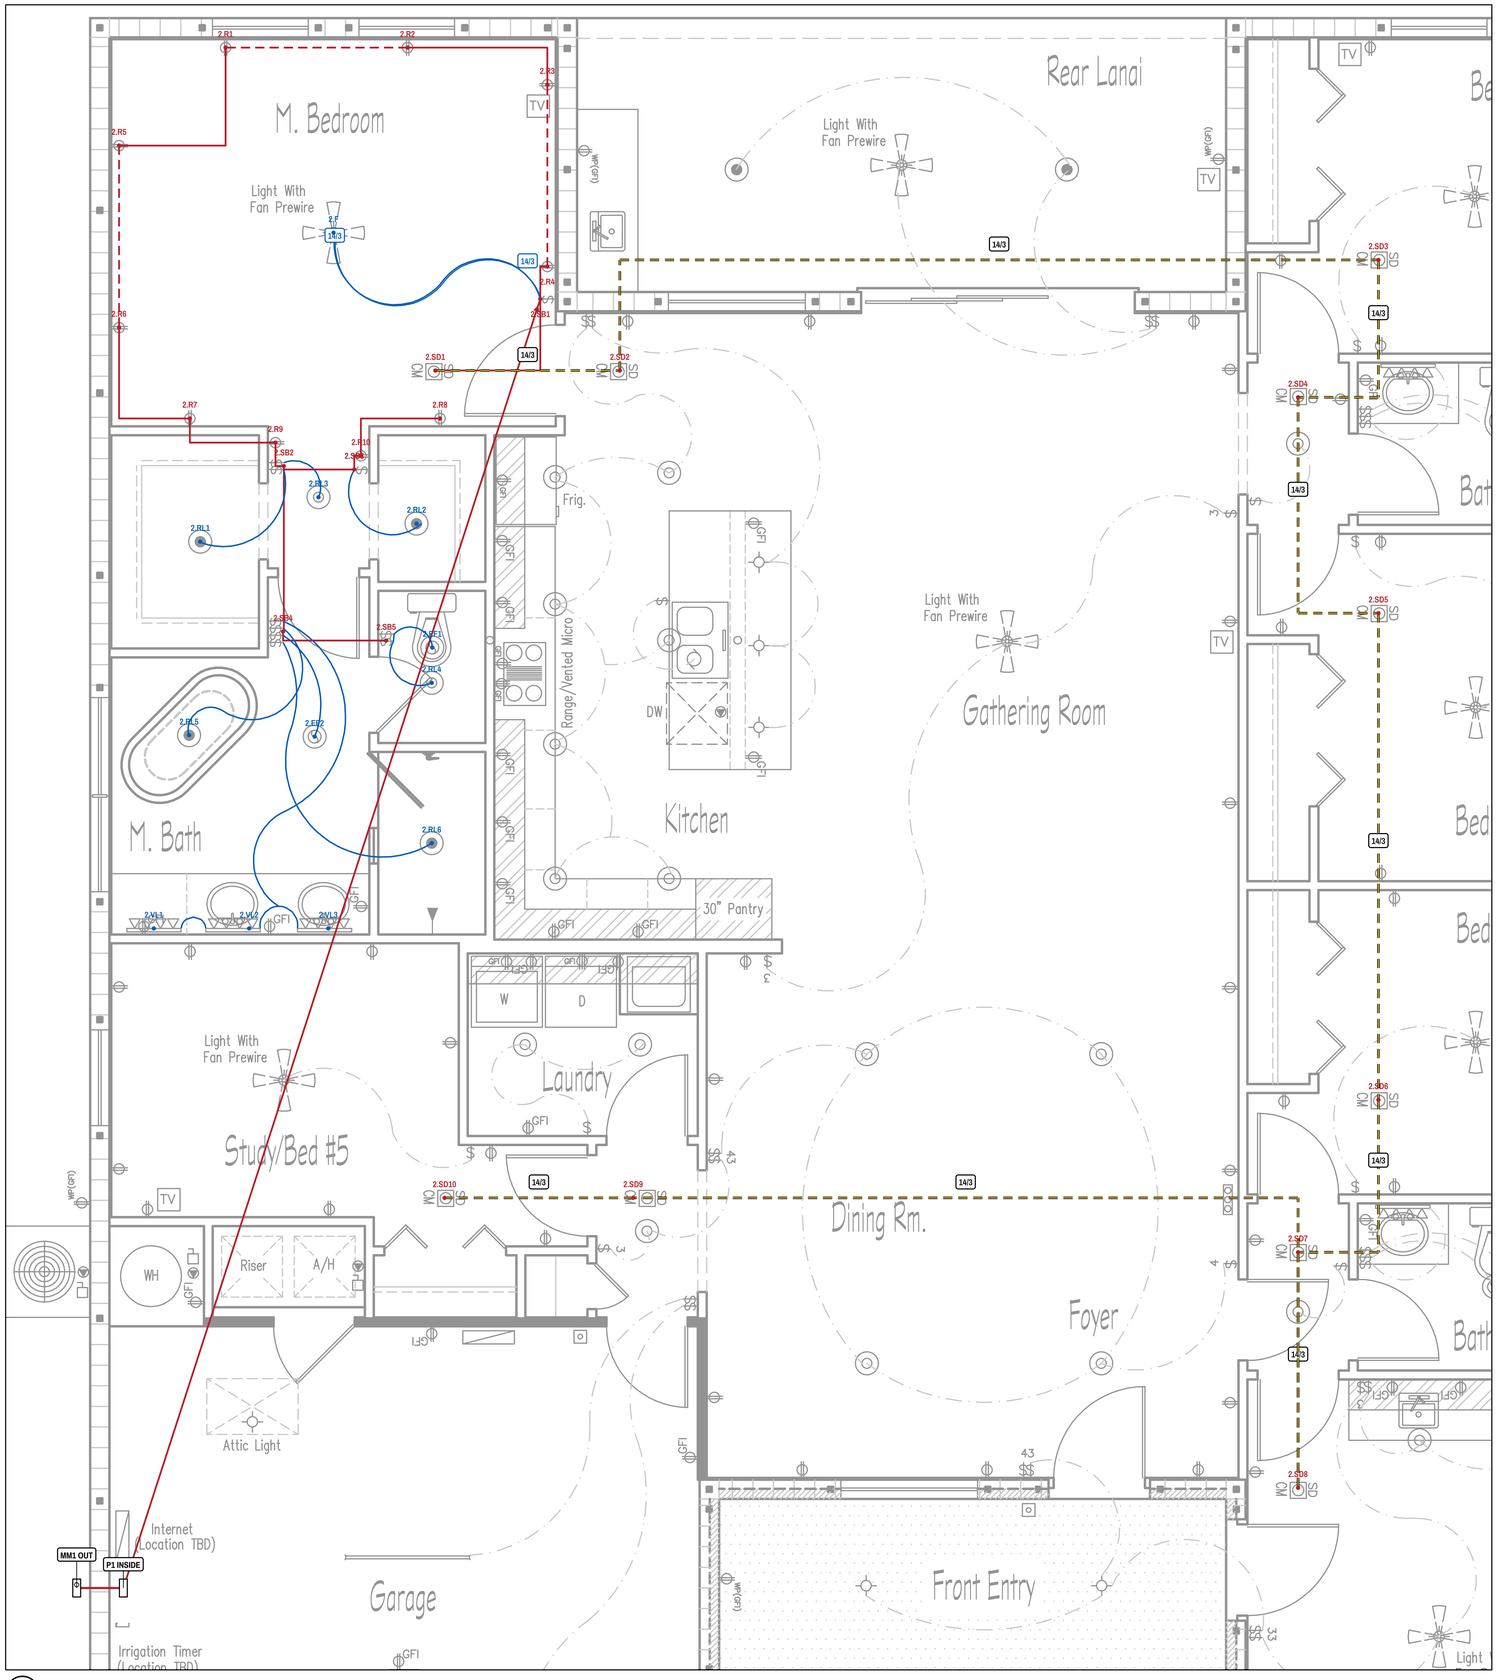

1 CIRCUIT P1-2 - MASTER SUITE + ALARM CHAIN

SCALE: NTS | 15A 1P SIEMENS H8 PROT HOLD, 14/2+G | PANEL SPACE 2

KEY PLAN

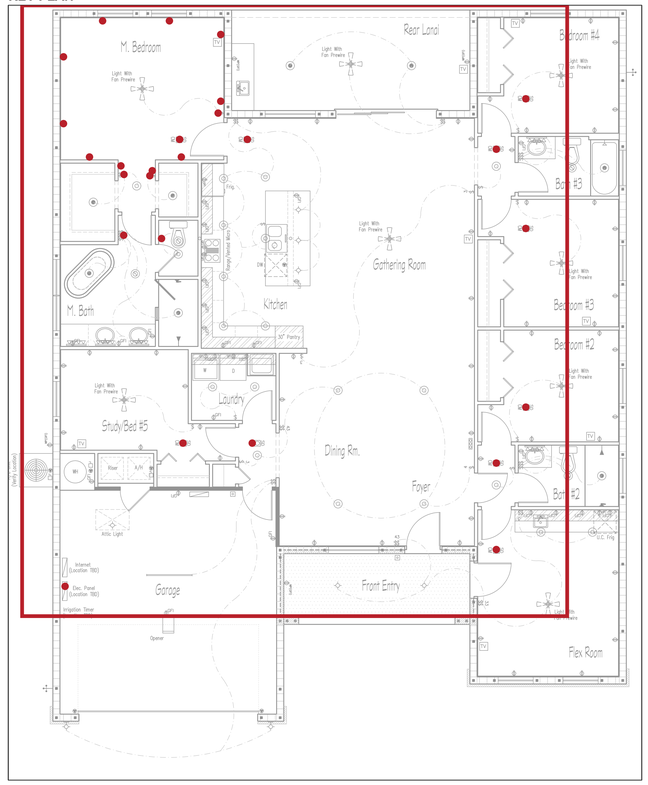

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	2.SB1	ATTIC	14/2+G	TBD
2	2.SB1	2.R4	ATTIC	14/2+G	TBD
3	2.R4	2.R3	IN-WALL	14/2+G	TBD
4	2.R3	2.R2	ATTIC	14/2+G	TBD
5	2.R2	2.R1	IN-WALL	14/2+G	TBD
6	2.R1	2.R5	ATTIC	14/2+G	TBD
7	2.R5	2.R6	IN-WALL	14/2+G	TBD
8	2.R6	2.R7	ATTIC	14/2+G	TBD
9	2.R7	2.R9	ATTIC	14/2+G	TBD
10	2.R9	2.SB2	ATTIC	14/2+G	TBD
11	2.SB2	2.SB3	ATTIC	14/2+G	TBD
12	2.SB3	2.R10	ATTIC	14/2+G	TBD
13	2.R10	2.R8	ATTIC	14/2+G	TBD
14	2.SB2	2.SB4	ATTIC	14/2+G	TBD
15	2.SB4	2.SB5	ATTIC	14/2+G	TBD
16	2.SB1	2.SD1	ATTIC	14/2+G	TBD
17	2.SD1	2.SD2	ATTIC	14/3	TBD
18	2.SD2	2.SD3	ATTIC	14/3	TBD
19	2.SD3	2.SD4	ATTIC	14/3	TBD
20	2.SD4	2.SD5	ATTIC	14/3	TBD
21	2.SD5	2.SD6	ATTIC	14/3	TBD
22	2.SD6	2.SD7	ATTIC	14/3	TBD
23	2.SD7	2.SD8	ATTIC	14/3	TBD
24	2.SD8	2.SD9	ATTIC	14/3	TBD
25	2.SD9	2.SD10	ATTIC	14/3	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
14/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 2.SB1; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.

H8 ALARM / DF PROTECTION HOLD: ONE 14/2 FEED; 9 x 14/3 LINKS; 10 SOURCE ALARMS. H4 VANITY / BATH CONTROLS HOLD. AREA CODE ALLOCATION 1,743.75 VA; 1,750 VA BUDGET. ACTUAL CONNECTED LOAD TBD; VERIFY <1,800 VA.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-2 - MASTER SUITE + ALARM CHAIN

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596


DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD

SHEET
E-3.2

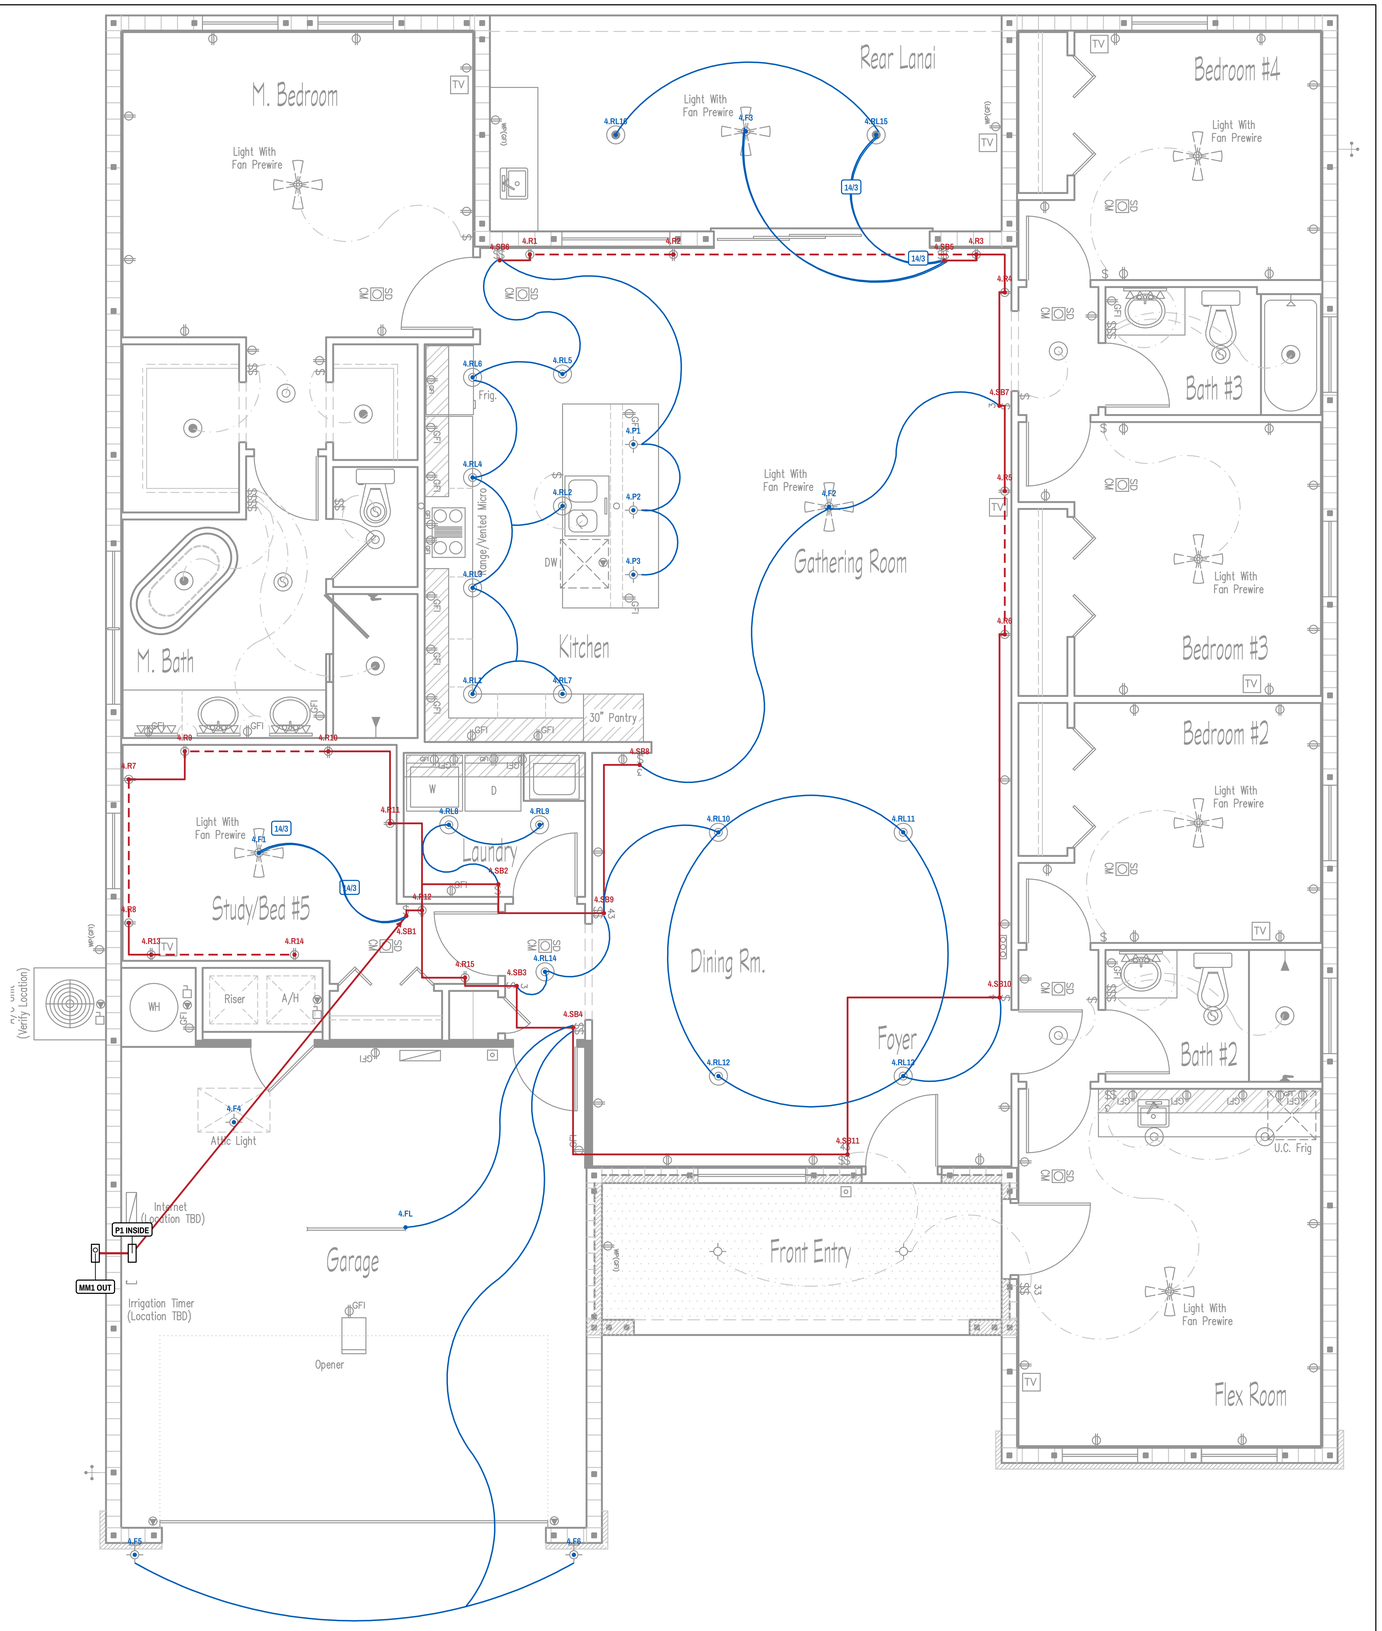

KEY PLAN

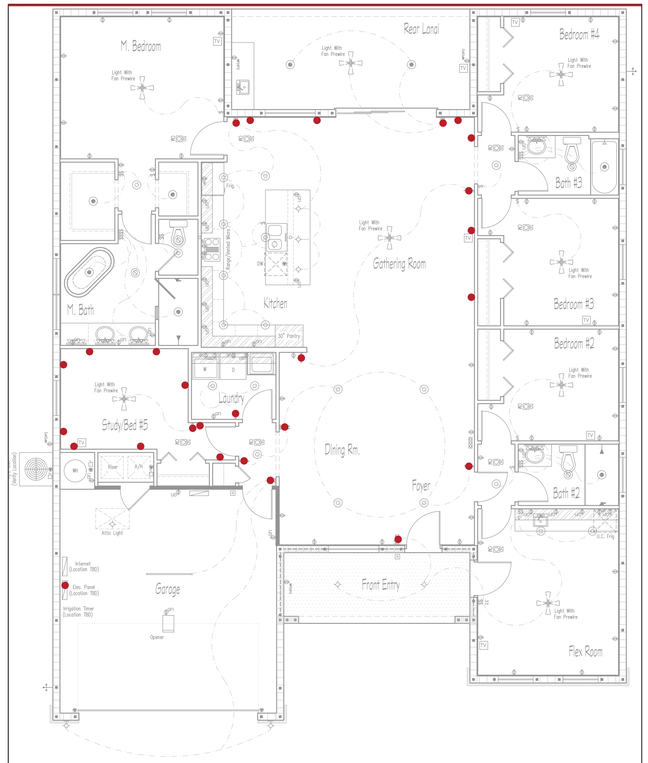

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	4.SB1	ATTIC	14/2+G	TBD
2	4.SB1	4.R12	ATTIC	14/2+G	TBD
3	4.R12	4.R15	ATTIC	14/2+G	TBD
4	4.R15	4.SB3	ATTIC	14/2+G	TBD
5	4.SB3	4.SB4	ATTIC	14/2+G	TBD
6	4.R12	4.SB2	ATTIC	14/2+G	TBD
7	4.R12	4.R11	ATTIC	14/2+G	TBD
8	4.R11	4.R10	ATTIC	14/2+G	TBD
9	4.R10	4.R9	IN-WALL	14/2+G	TBD
10	4.R9	4.R7	ATTIC	14/2+G	TBD
11	4.R7	4.R8	IN-WALL	14/2+G	TBD
12	4.R8	4.R13	ATTIC	14/2+G	TBD
13	4.R13	4.R14	IN-WALL	14/2+G	TBD
14	4.SB2	4.SB9	ATTIC	14/2+G	TBD
15	4.SB9	4.SB8	ATTIC	14/2+G	TBD
16	4.SB4	4.SB11	ATTIC	14/2+G	TBD
17	4.SB11	4.SB10	ATTIC	14/2+G	TBD
18	4.SB10	4.R6	ATTIC	14/2+G	TBD
19	4.R6	4.R5	IN-WALL	14/2+G	TBD
20	4.R5	4.SB7	ATTIC	14/2+G	TBD
21	4.SB7	4.R4	ATTIC	14/2+G	TBD
22	4.R4	4.R3	ATTIC	14/2+G	TBD
23	4.R3	4.SB5	ATTIC	14/2+G	TBD
24	4.R3	4.R2	IN-WALL	14/2+G	TBD
25	4.R2	4.R1	IN-WALL	14/2+G	TBD
26	4.R1	4.SB6	ATTIC	14/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
14/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 4.SB1; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.

H3 MULTIWAY / NEUTRAL AND SOURCE ATTIC-LIGHT ENDPOINTS HOLD. TRACED ARCS ARE NOT A RELEASED CABLE TOPOLOGY. AREA CODE ALLOCATION 1,743.75 VA; 1,750 VA BUDGET. ACTUAL CONNECTED LOAD TBD; VERIFY <1,800 VA.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

1 CIRCUIT P1-4 - CENTRAL / STUDY / GARAGE LIGHTING

SCALE: NTS | 15A 1P SIEMENS Q115DFN, 14/2+G | PANEL SPACE 4

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-4 - CENTRAL / STUDY / GARAGE LIGHTING

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.4

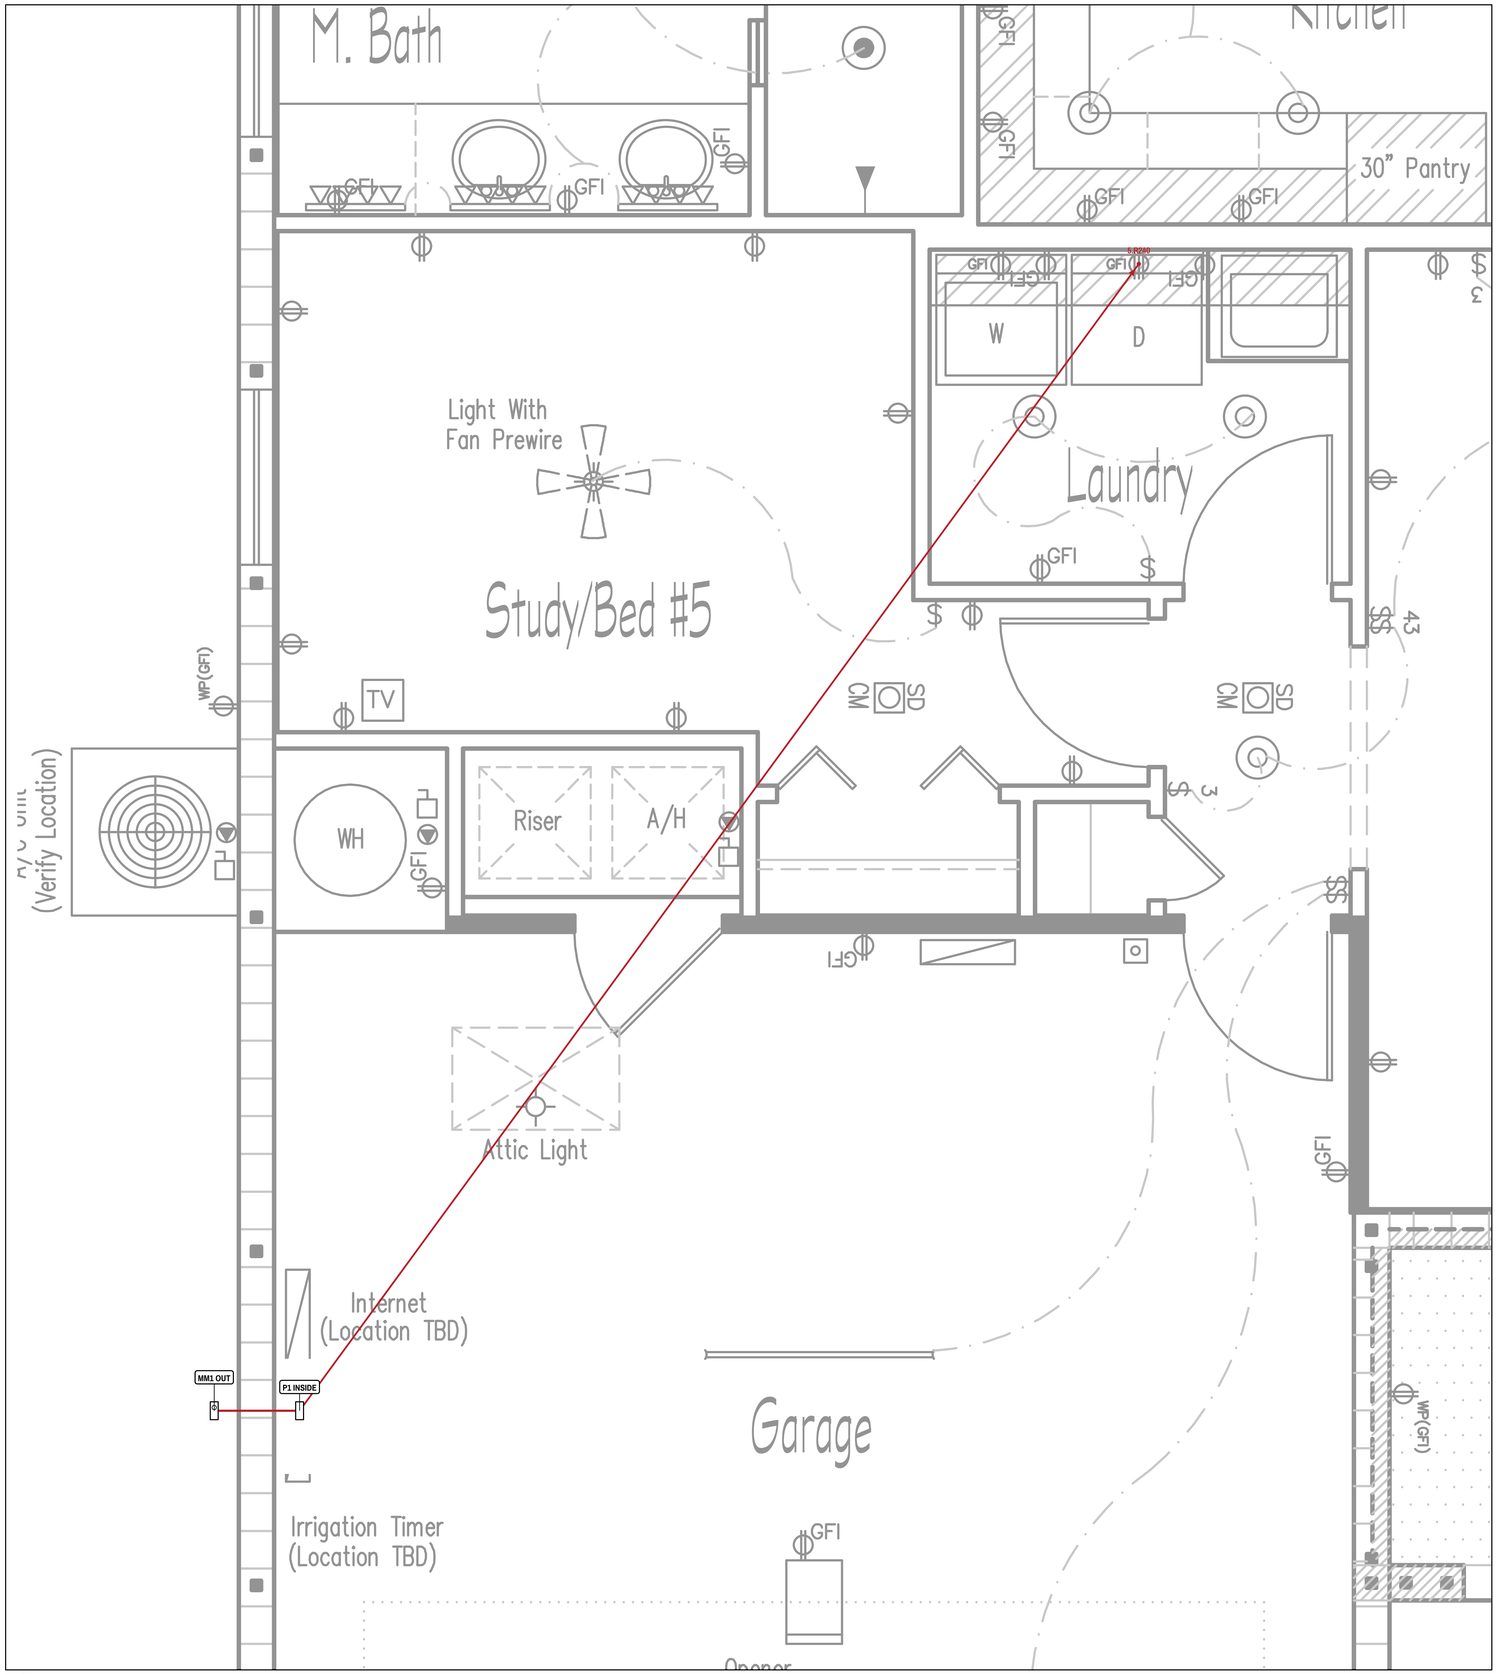

1 **CIRCUIT P1-5 - DRYER**

SCALE: NTS | TBDA 2P SIEMENS 2P GFCI TBD, TBD | PANEL SPACE 5/7

KEY PLAN

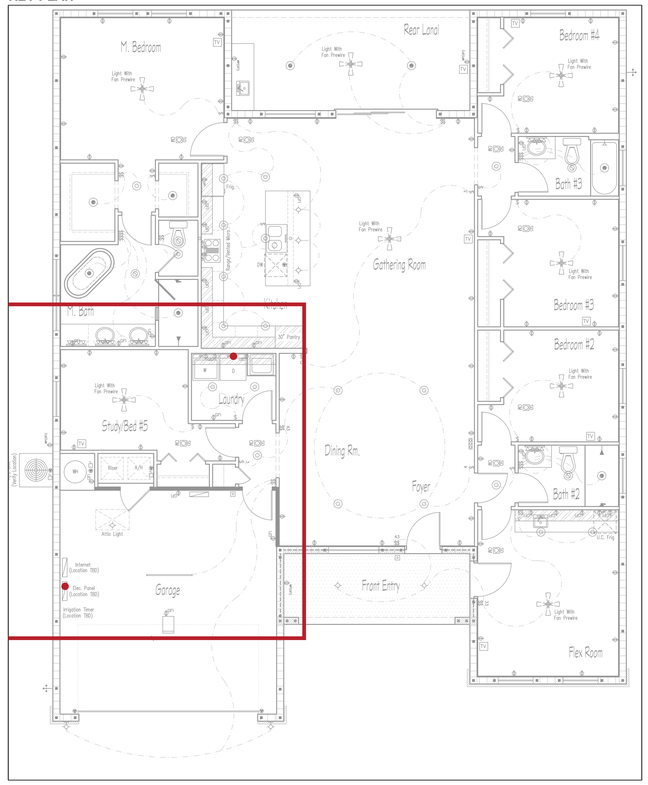

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	5.R240	ATTIC	TBD	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
TBD	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 5.R240; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
EQUIPMENT BREAKER / CONDUCTOR / NAMEPLATE TBD; NO FINAL EQUIPMENT SIZE ISSUED.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-5 - DRYER

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.5

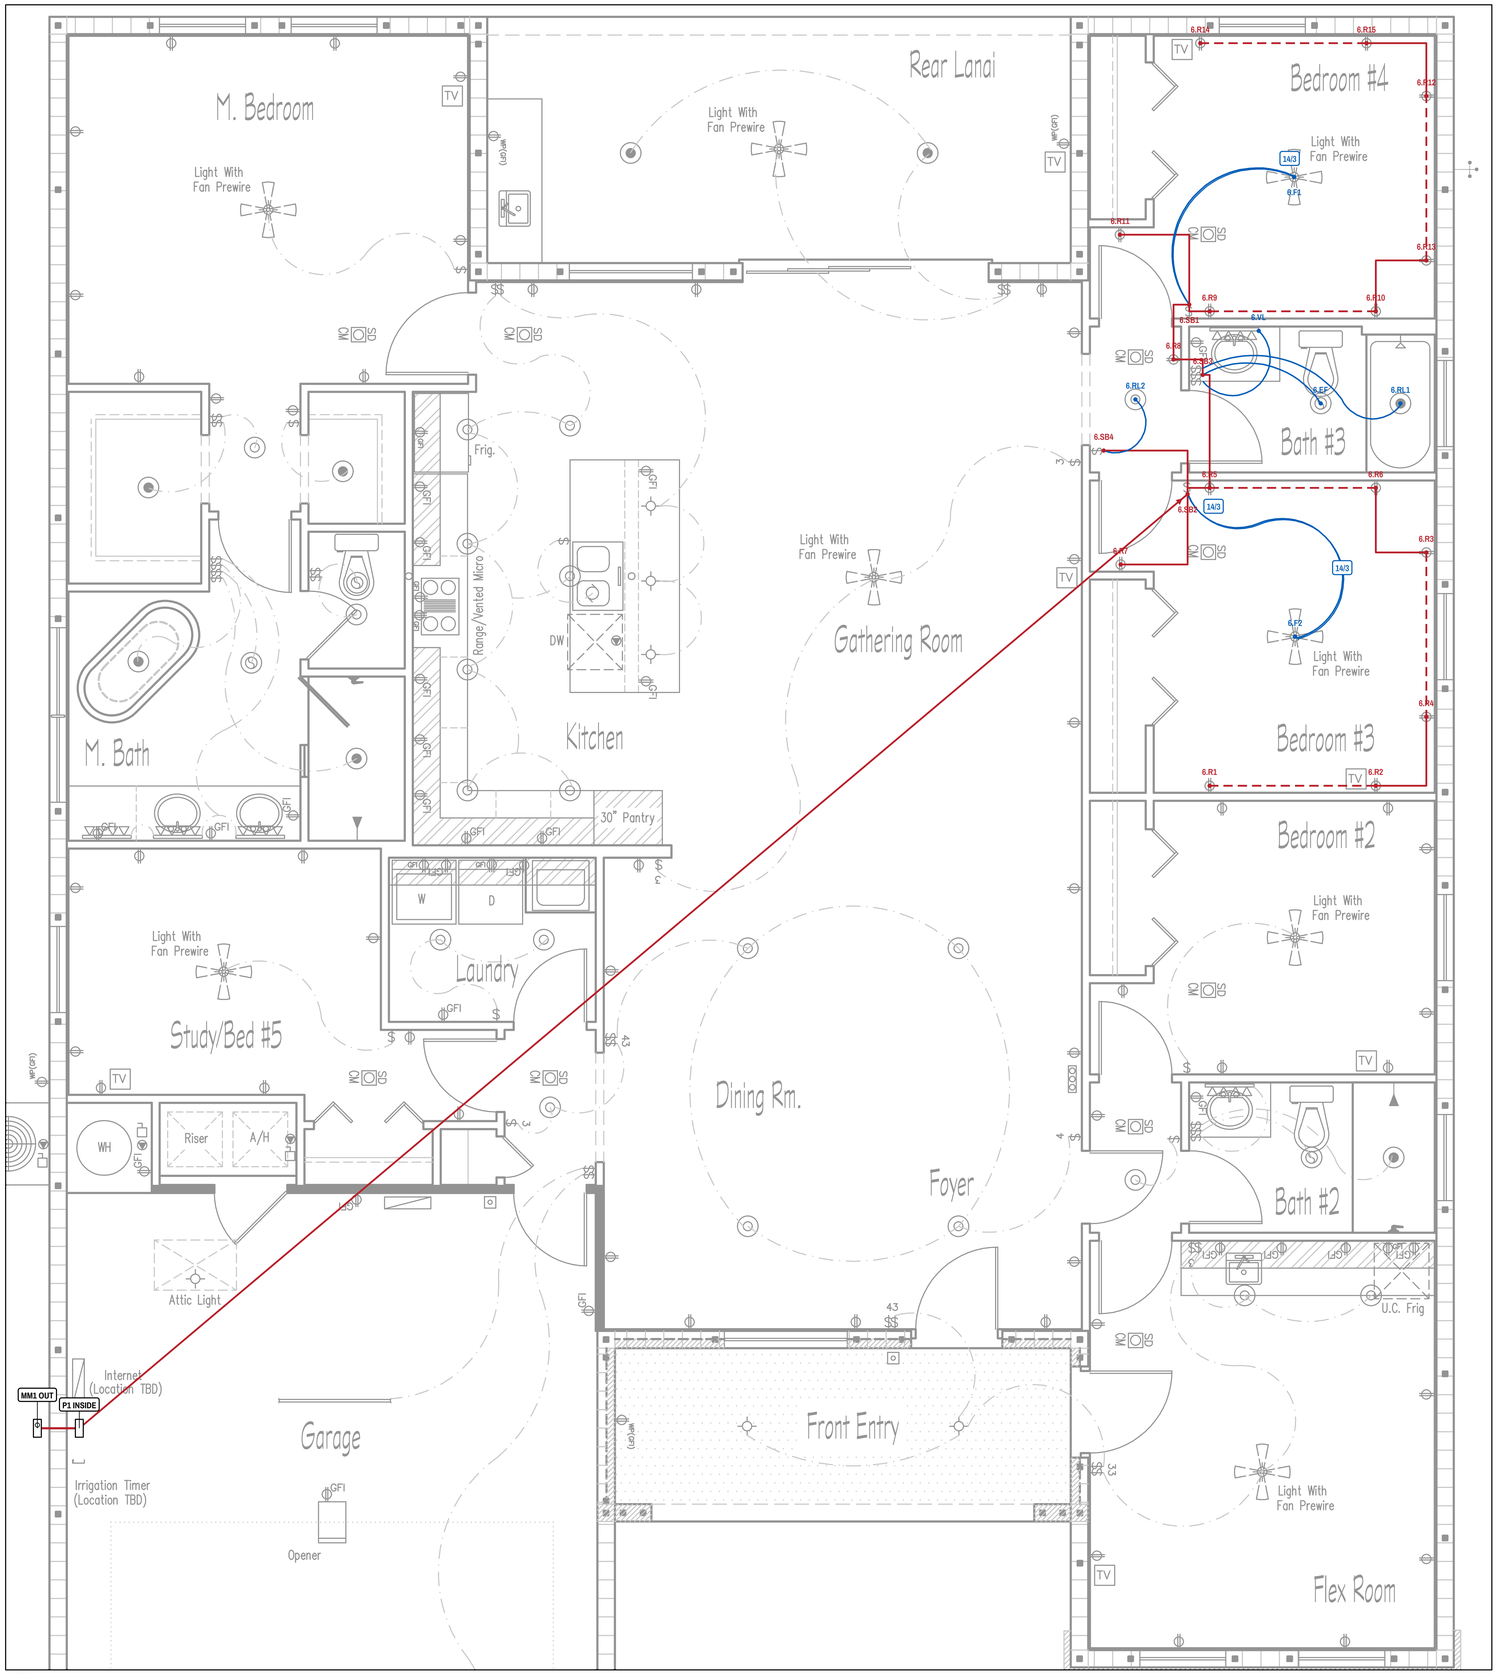

1 **CIRCUIT P1-6 - BEDROOMS 3 & 4 + BATH 3 LIGHTS**

SCALE: NTS | 15A 1P SIEMENS Q115DFN, 14/2+G | PANEL SPACE 6

KEY PLAN

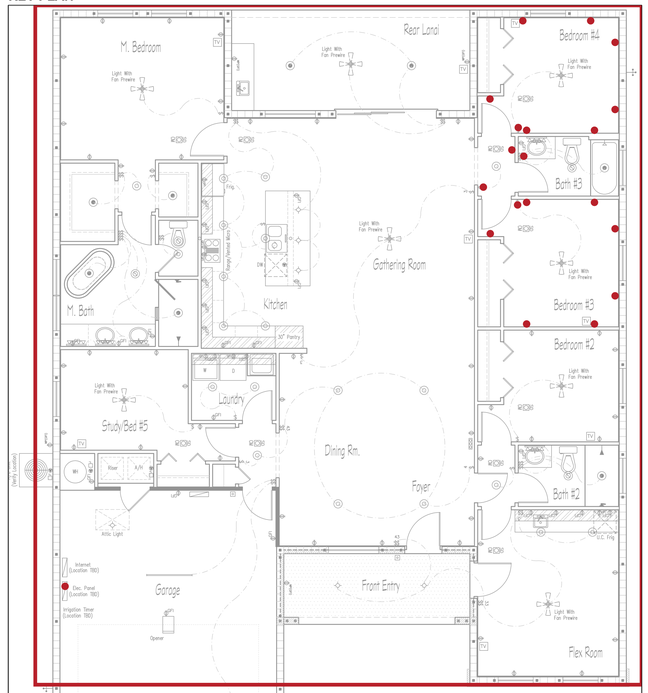

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	6.SB2	ATTIC	14/2+G	TBD
2	6.SB2	6.R5	ATTIC	14/2+G	TBD
3	6.SB2	6.SB4	ATTIC	14/2+G	TBD
4	6.SB2	6.R7	ATTIC	14/2+G	TBD
5	6.R5	6.R6	IN-WALL	14/2+G	TBD
6	6.R6	6.R3	ATTIC	14/2+G	TBD
7	6.R3	6.R4	IN-WALL	14/2+G	TBD
8	6.R4	6.R2	ATTIC	14/2+G	TBD
9	6.R2	6.R1	IN-WALL	14/2+G	TBD
10	6.R5	6.SB3	ATTIC	14/2+G	TBD
11	6.SB3	6.R8	ATTIC	14/2+G	TBD
12	6.R8	6.SB1	ATTIC	14/2+G	TBD
13	6.SB1	6.R9	ATTIC	14/2+G	TBD
14	6.SB1	6.R11	ATTIC	14/2+G	TBD
15	6.R9	6.R10	IN-WALL	14/2+G	TBD
16	6.R10	6.R13	ATTIC	14/2+G	TBD
17	6.R13	6.R12	IN-WALL	14/2+G	TBD
18	6.R12	6.R15	ATTIC	14/2+G	TBD
19	6.R15	6.R14	IN-WALL	14/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
14/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 6.SB2; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.

AREA CODE ALLOCATION 1,743.75 VA; 1,750 VA BUDGET. ACTUAL CONNECTED LOAD TBD; VERIFY <1,800 VA.

WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS

FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-6 - BEDROOMS 3 & 4 + BATH 3 LIGHTS

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596


DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD

SHEET
E-3.6

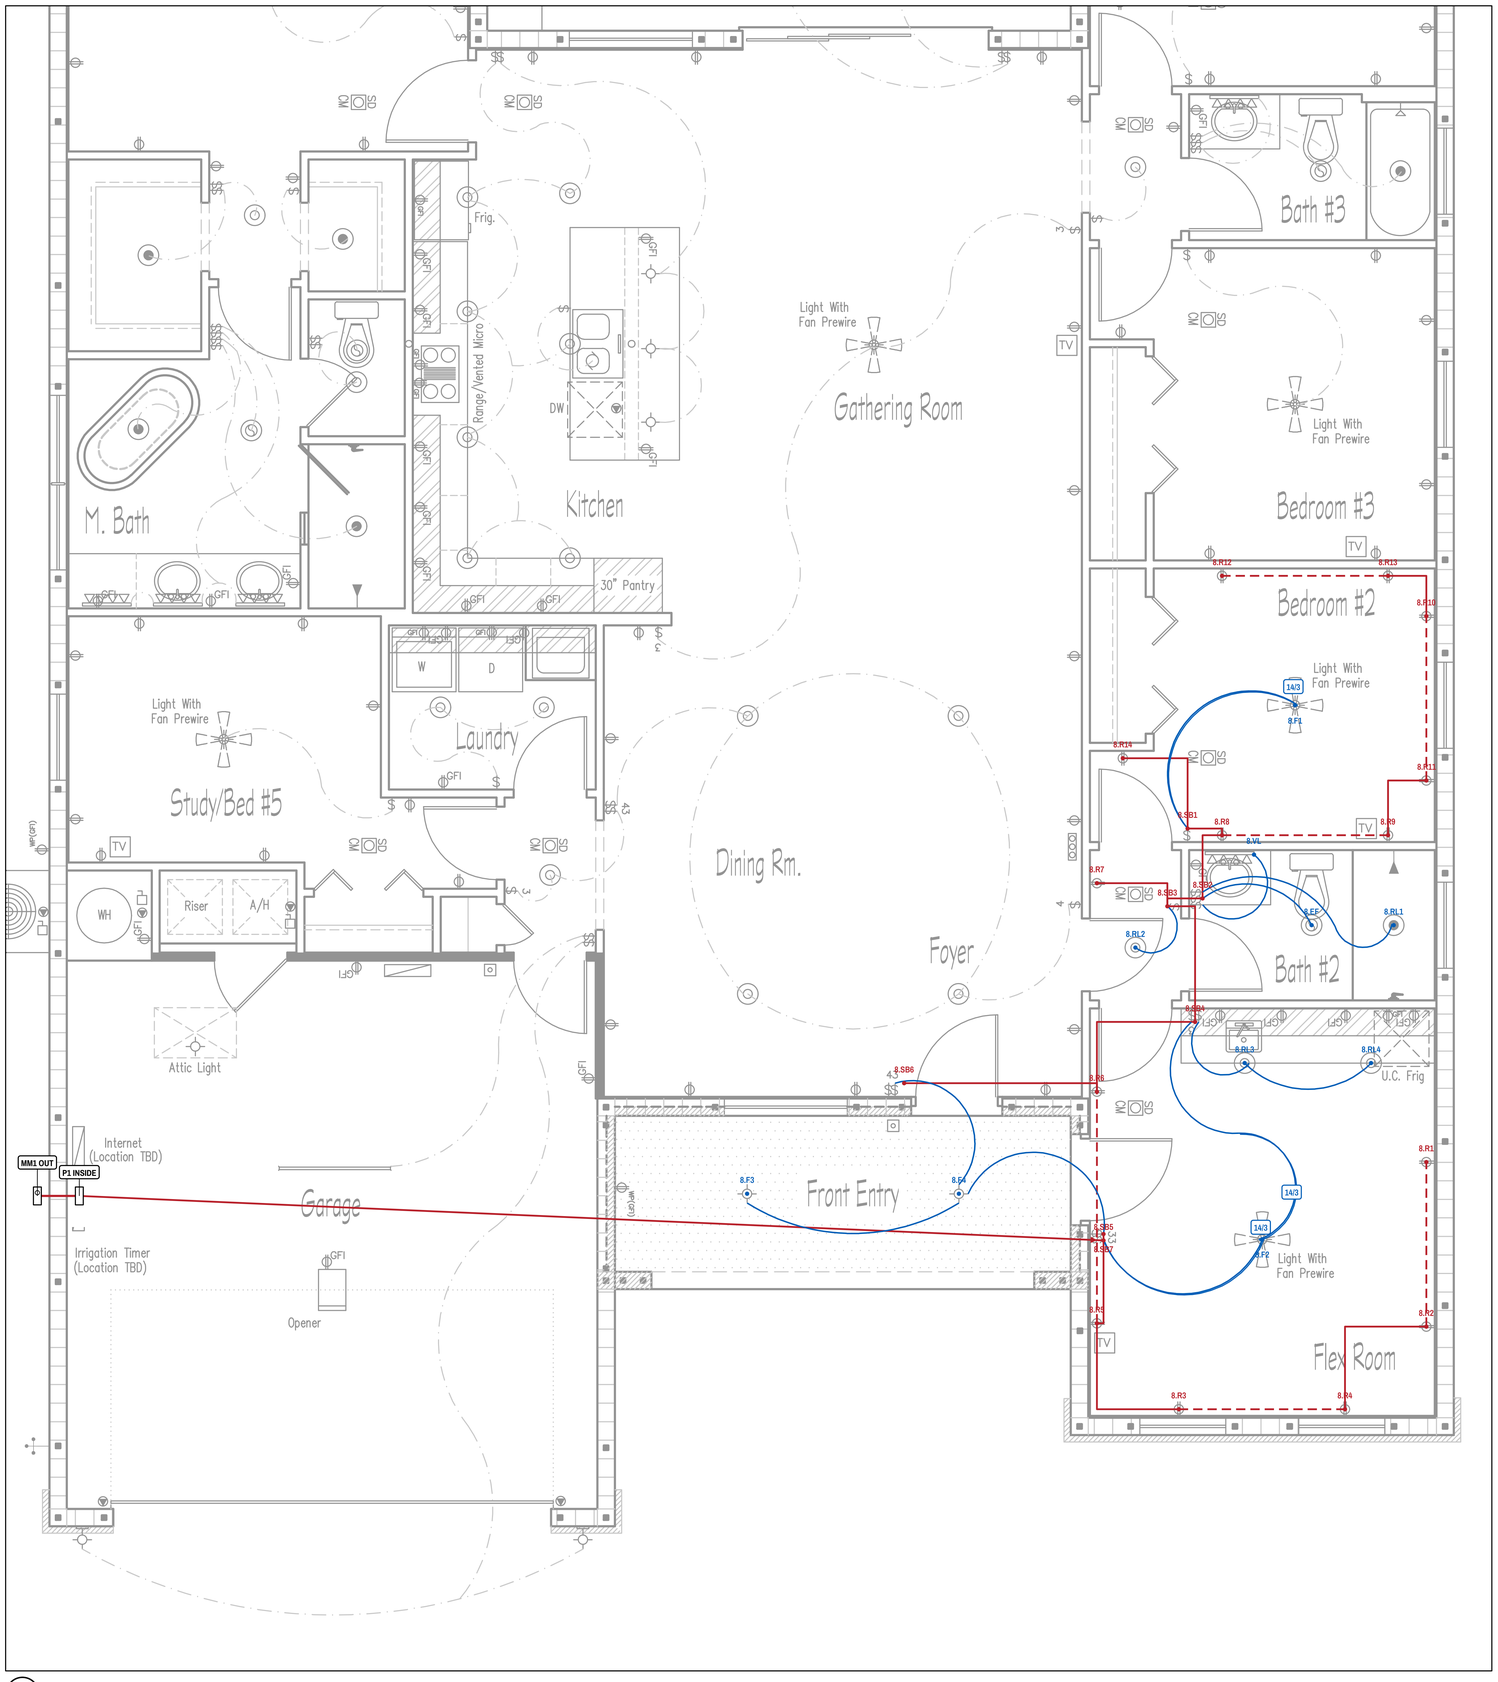

KEY PLAN

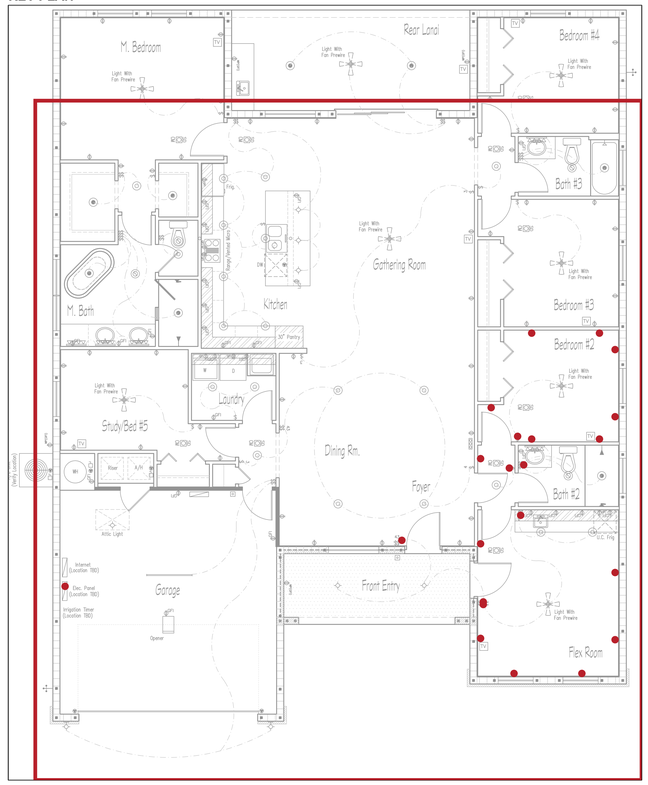

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	8.SB5	ATTIC	14/2+G	TBD
2	8.SB5	8.SB7	ATTIC	14/2+G	TBD
3	8.SB5	8.R5	ATTIC	14/2+G	TBD
4	8.R5	8.R3	ATTIC	14/2+G	TBD
5	8.R3	8.R4	IN-WALL	14/2+G	TBD
6	8.R4	8.R2	ATTIC	14/2+G	TBD
7	8.R2	8.R1	IN-WALL	14/2+G	TBD
8	8.R5	8.R6	IN-WALL	14/2+G	TBD
9	8.R6	8.SB4	ATTIC	14/2+G	TBD
10	8.SB4	8.SB3	ATTIC	14/2+G	TBD
11	8.SB3	8.SB2	ATTIC	14/2+G	TBD
12	8.SB2	8.R8	ATTIC	14/2+G	TBD
13	8.R8	8.SB1	ATTIC	14/2+G	TBD
14	8.SB3	8.R7	ATTIC	14/2+G	TBD
15	8.SB1	8.R14	ATTIC	14/2+G	TBD
16	8.R8	8.R9	IN-WALL	14/2+G	TBD
17	8.R9	8.R11	ATTIC	14/2+G	TBD
18	8.R11	8.R10	IN-WALL	14/2+G	TBD
19	8.R10	8.R13	ATTIC	14/2+G	TBD
20	8.R13	8.R12	IN-WALL	14/2+G	TBD
21	8.R6	8.SB6	ATTIC	14/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
14/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 8.SB5; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.

H3 MULTIWAY / NEUTRAL AND SOURCE ATTIC-LIGHT ENDPOINTS HOLD. TRACED ARCS ARE NOT A RELEASED CABLE TOPOLOGY. AREA CODE ALLOCATION 1,743.75 VA; 1,750 VA BUDGET. ACTUAL CONNECTED LOAD TBD; VERIFY <1,800 VA.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

1 CIRCUIT P1-8 - BEDROOM 2 / FLEX / BATH 2 / ENTRY LIGHTS

SCALE: NTS | 15A 1P SIEMENS Q115DFN, 14/2+G | PANEL SPACE 8

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-8 - BEDROOM 2 / FLEX / BATH 2 / ENTRY LIGHTS

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.8

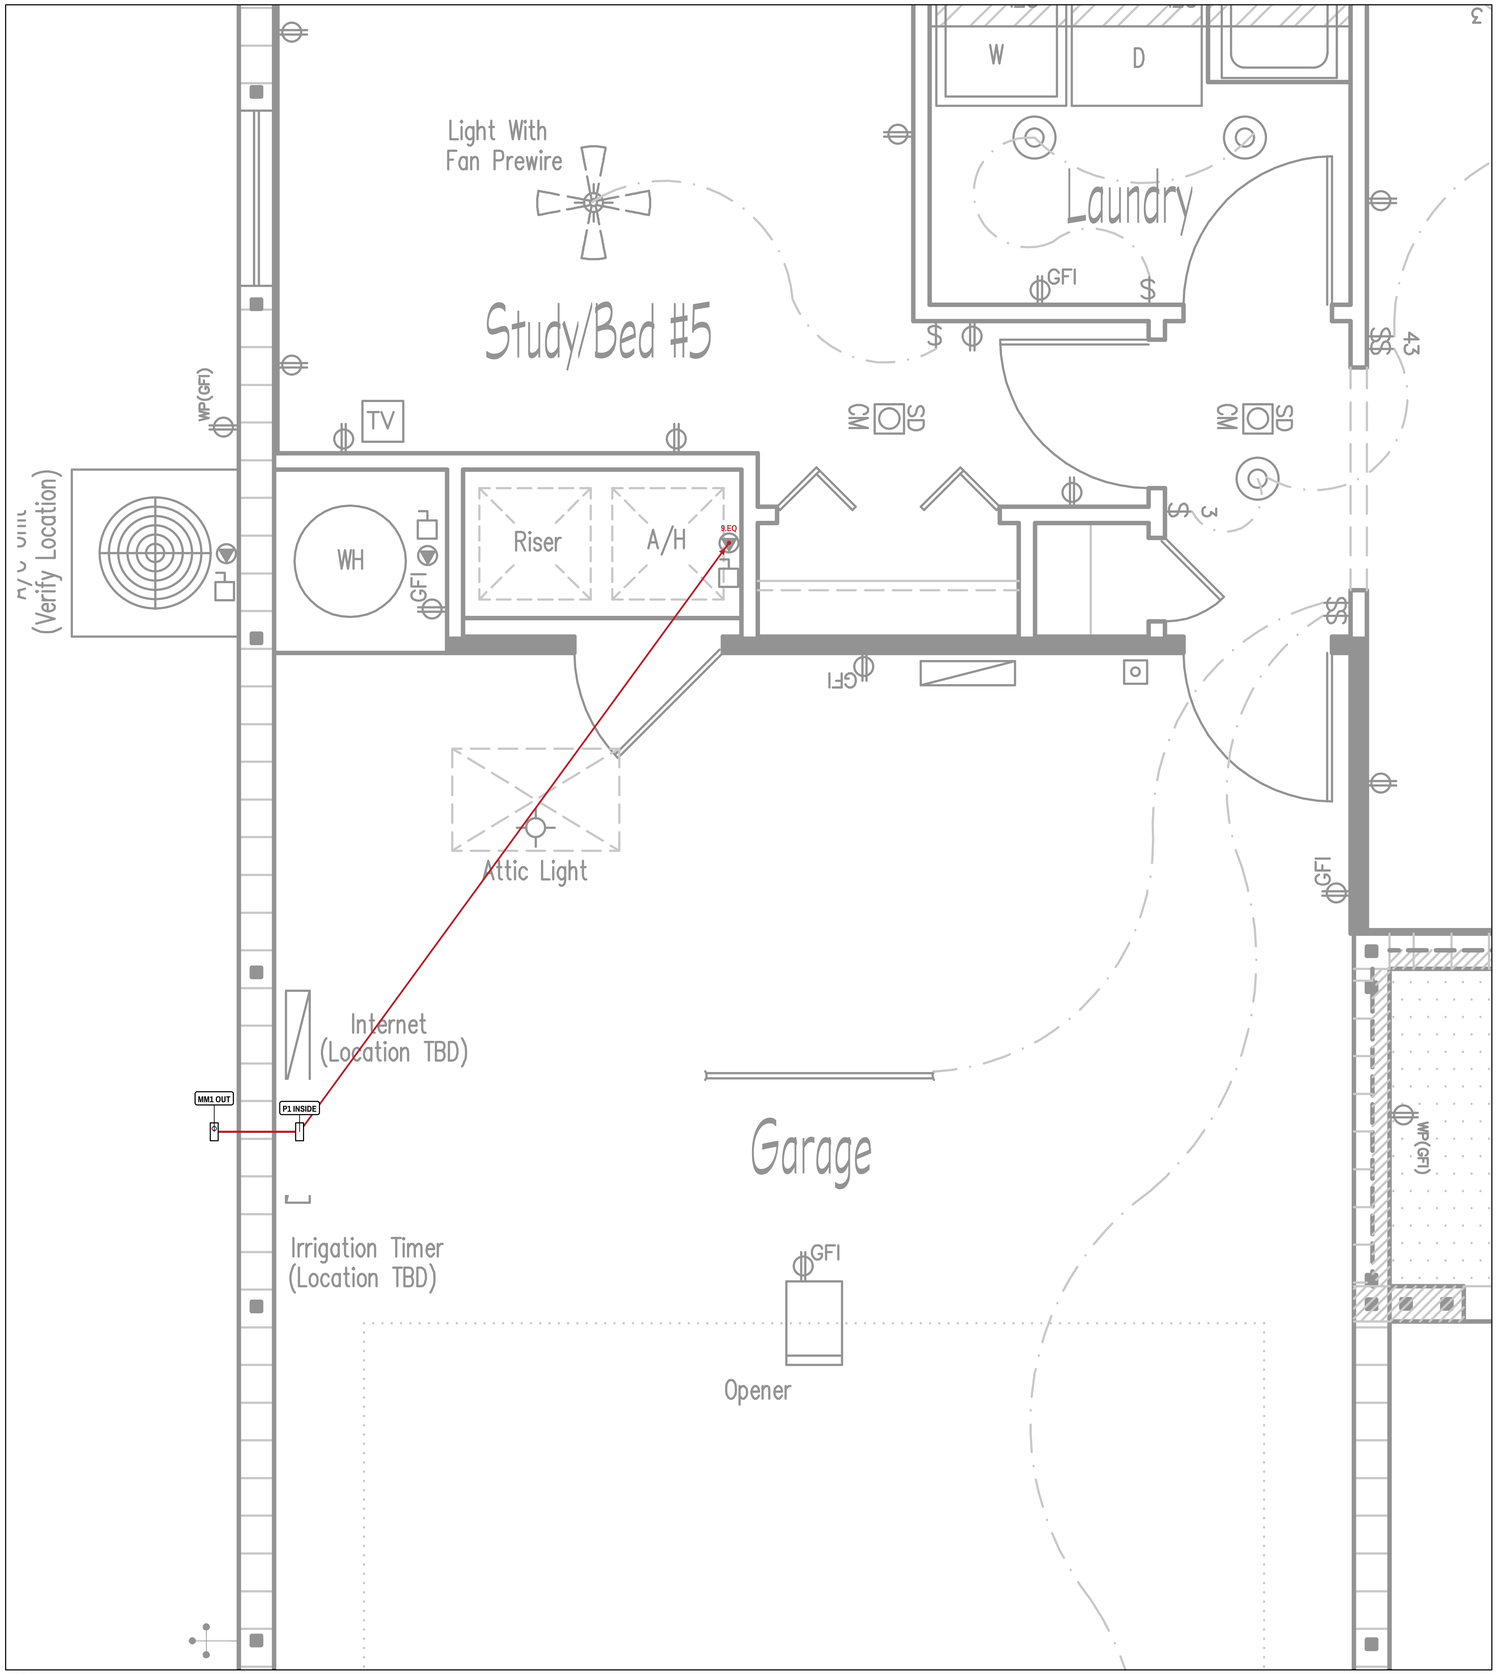

1 **CIRCUIT P1-9 - AIR HANDLER / HEAT**

SCALE: NTS | TBDA 2P SIEMENS TBD, TBD | PANEL SPACE 9/11

KEY PLAN

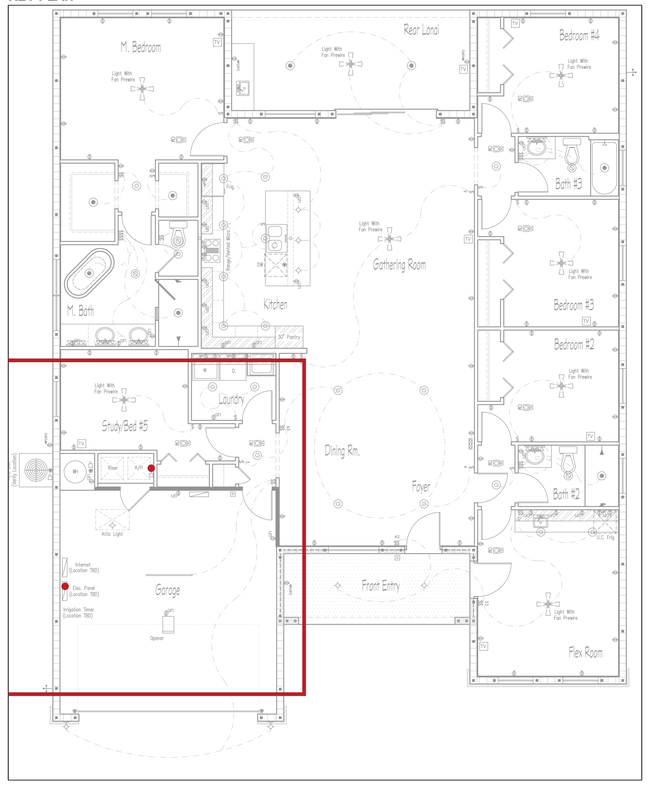

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	9.EQ	ATTIC	TBD	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
TBD	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 9.EQ; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.

EQUIPMENT BREAKER / CONDUCTOR / NAMEPLATE TBD; NO FINAL EQUIPMENT SIZE ISSUED.

WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS

FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-9 - AIR HANDLER / HEAT

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.9

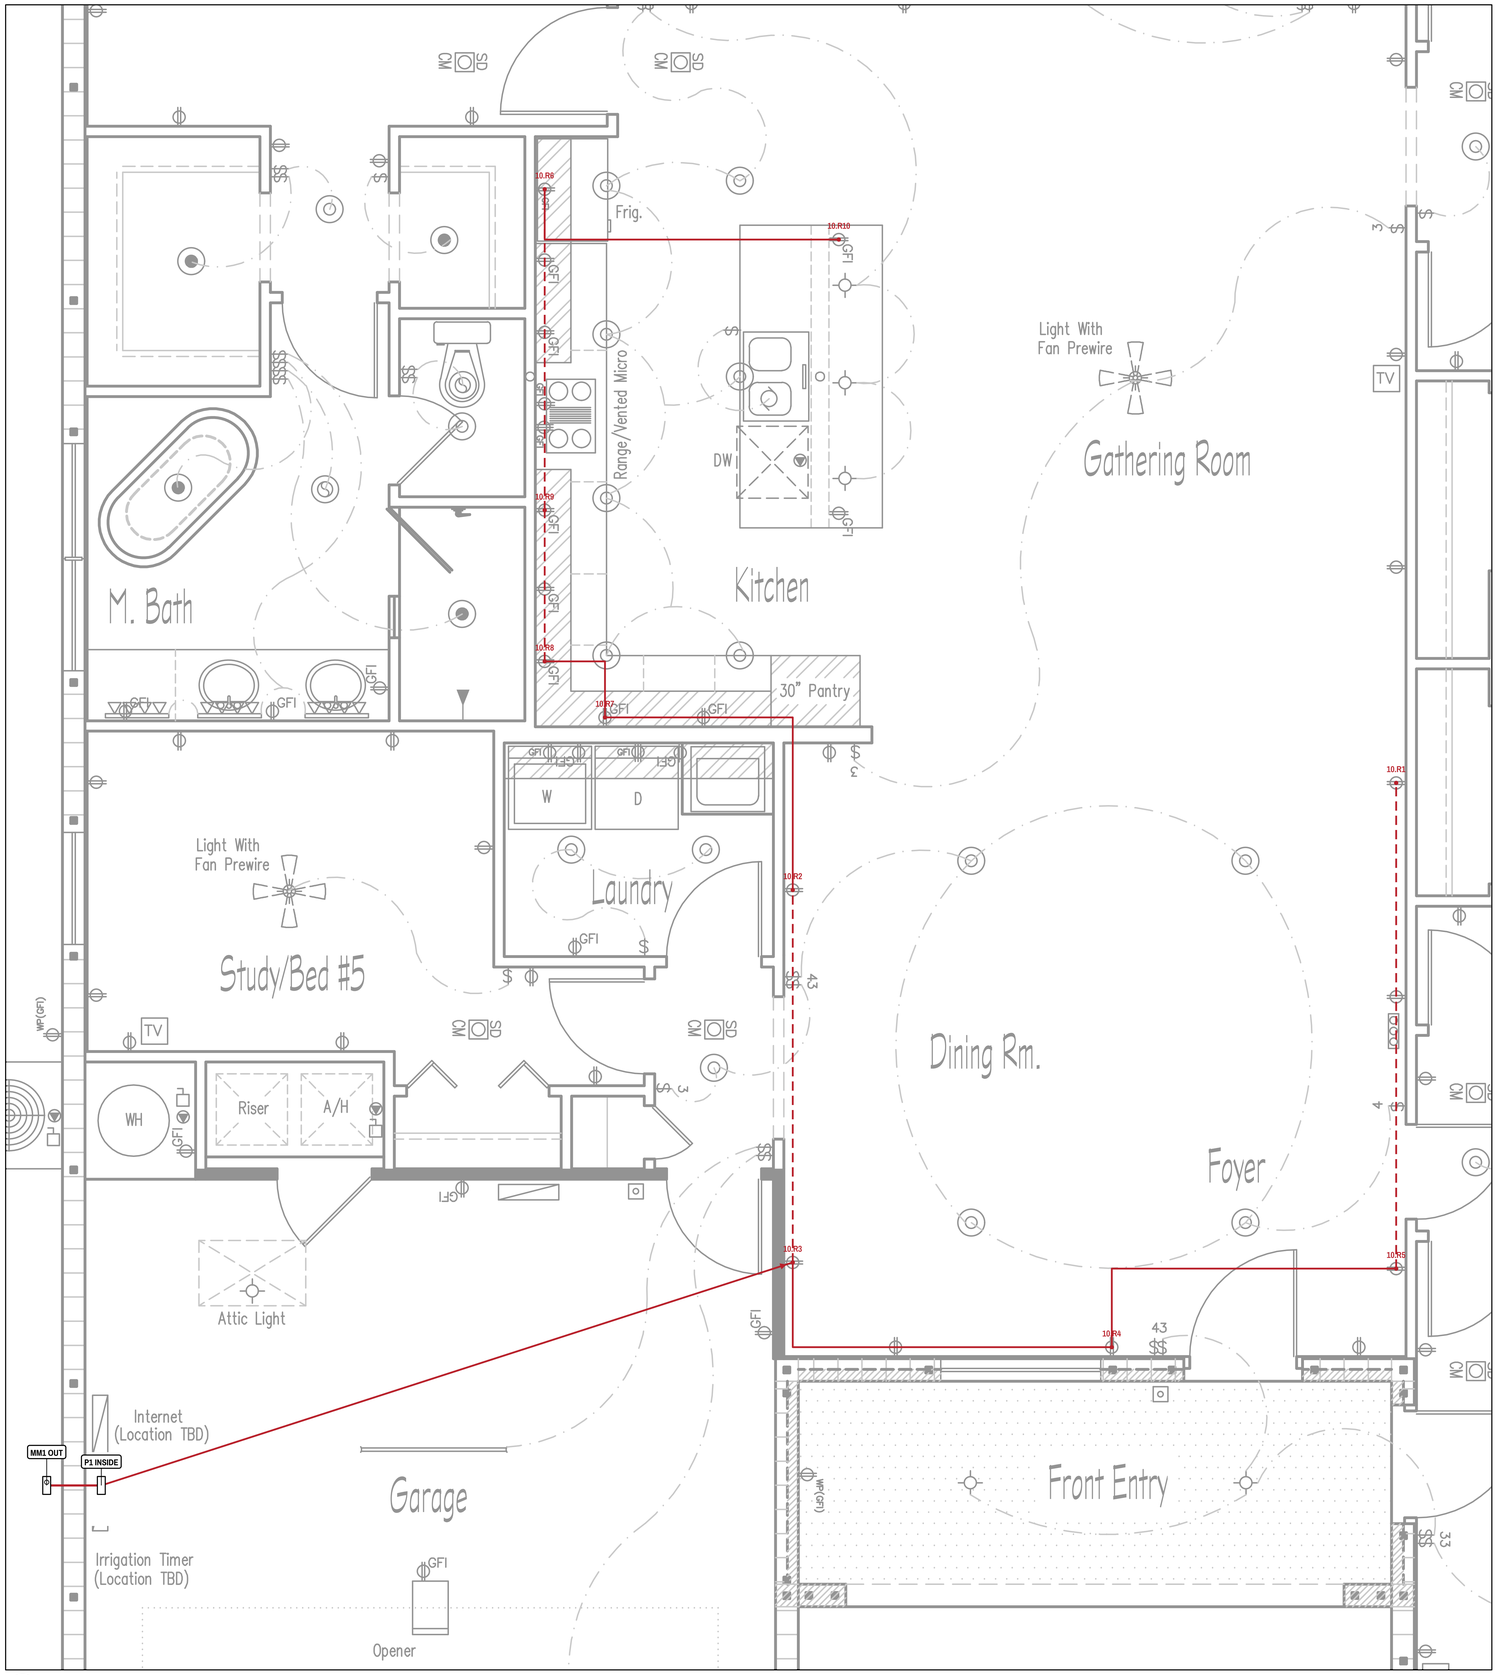

1 **CIRCUIT P1-10 - KITCHEN / DINING SABC A + REFRIGERATOR**

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 10

KEY PLAN

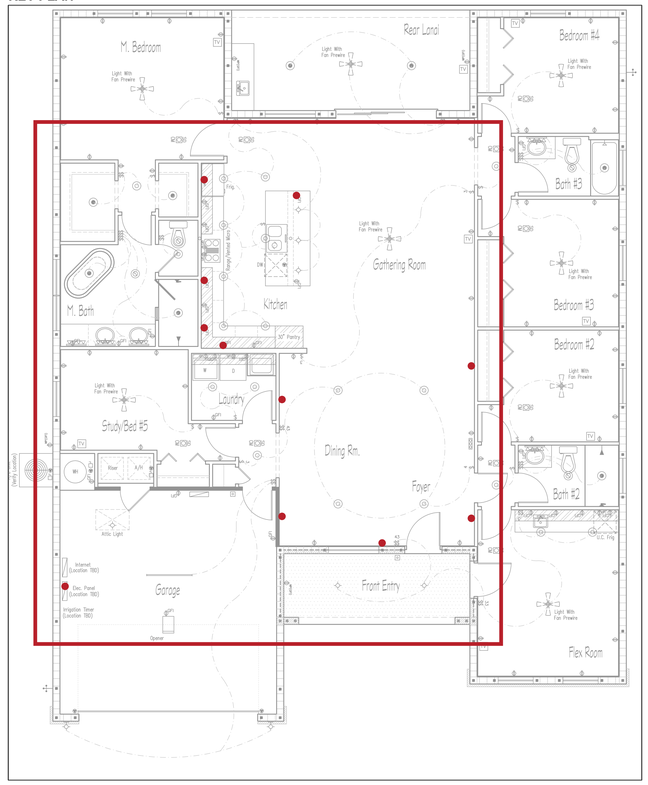

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	10.R3	ATTIC	12/2+G	TBD
2	10.R3	10.R2	IN-WALL	12/2+G	TBD
3	10.R2	10.R7	ATTIC	12/2+G	TBD
4	10.R7	10.R8	ATTIC	12/2+G	TBD
5	10.R8	10.R9	IN-WALL	12/2+G	TBD
6	10.R9	10.R6	IN-WALL	12/2+G	TBD
7	10.R6	10.R10	ATTIC	12/2+G	TBD
8	10.R3	10.R4	ATTIC	12/2+G	TBD
9	10.R4	10.R5	ATTIC	12/2+G	TBD
10	10.R5	10.R1	IN-WALL	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 10.R3; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-10 - KITCHEN / DINING SABC A + REFRIGERATOR

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.10

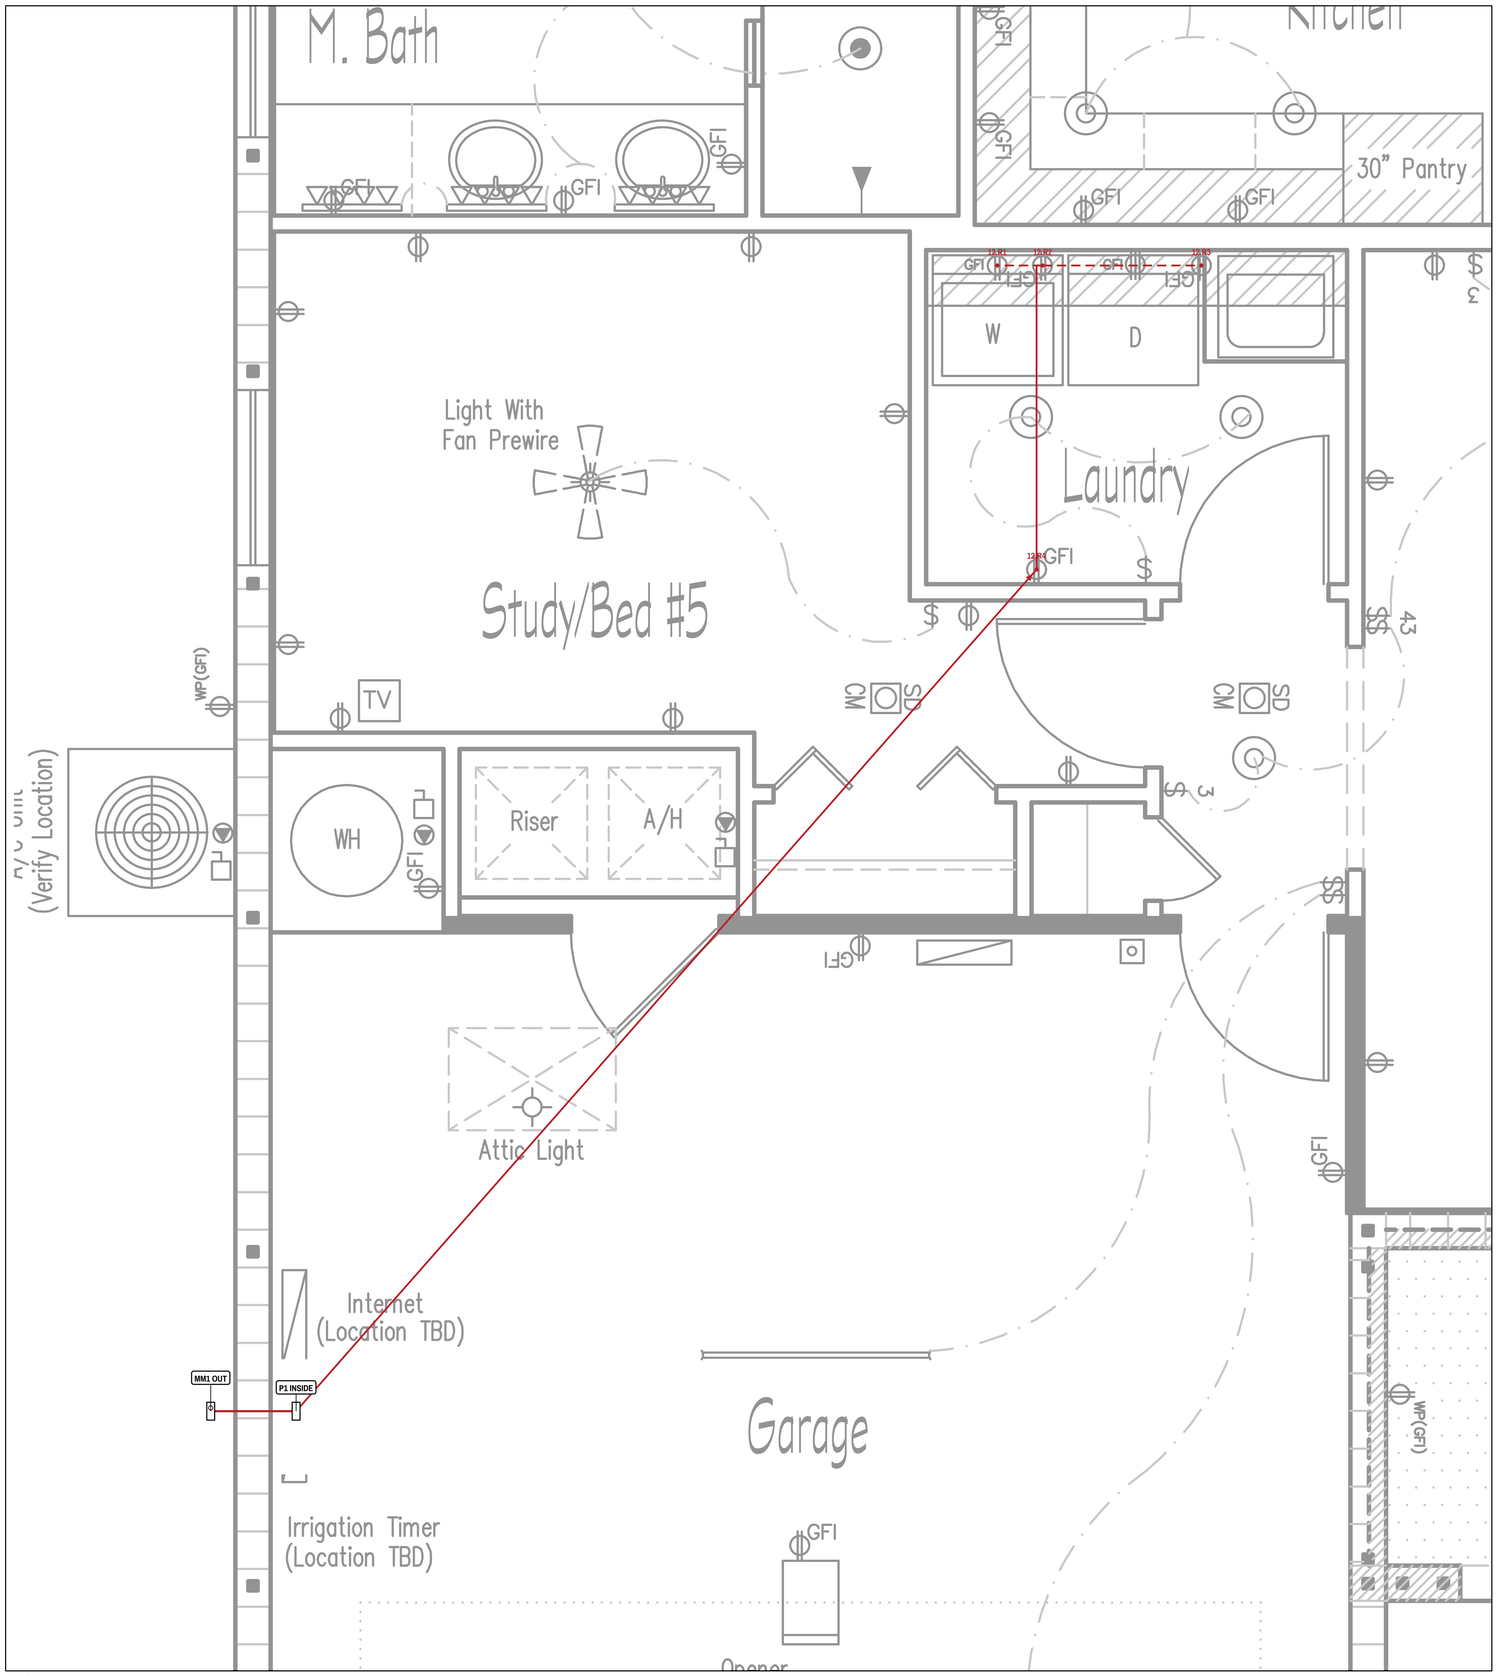

1 **CIRCUIT P1-12 - LAUNDRY RECEPTACLES / WASHER / ALTERNATE 120V DRYER**

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 12

KEY PLAN

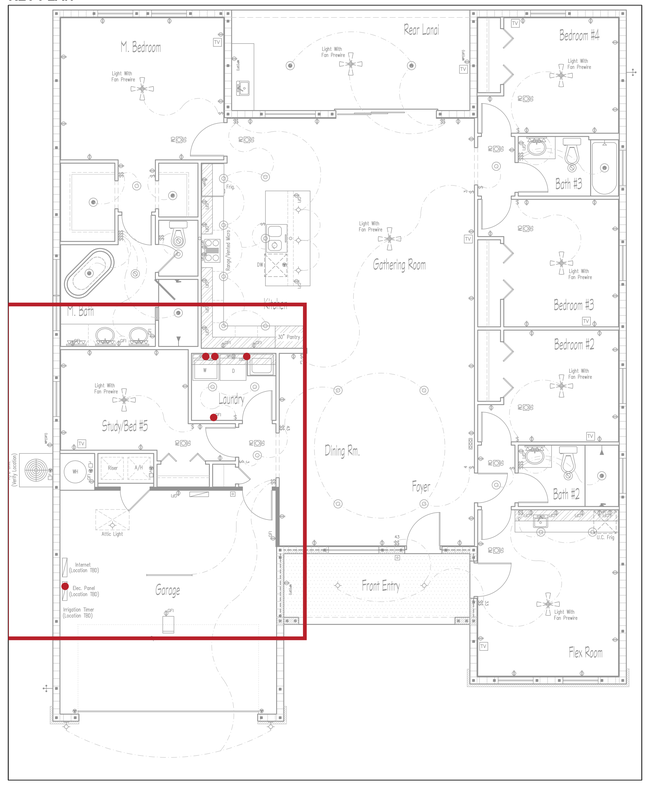

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	12.R4	ATTIC	12/2+G	TBD
2	12.R4	12.R2	ATTIC	12/2+G	TBD
3	12.R2	12.R1	IN-WALL	12/2+G	TBD
4	12.R2	12.R3	IN-WALL	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 12.R4; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-12 - LAUNDRY RECEPTACLES / WASHER / ALTERNATE 120V DRYER

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.12

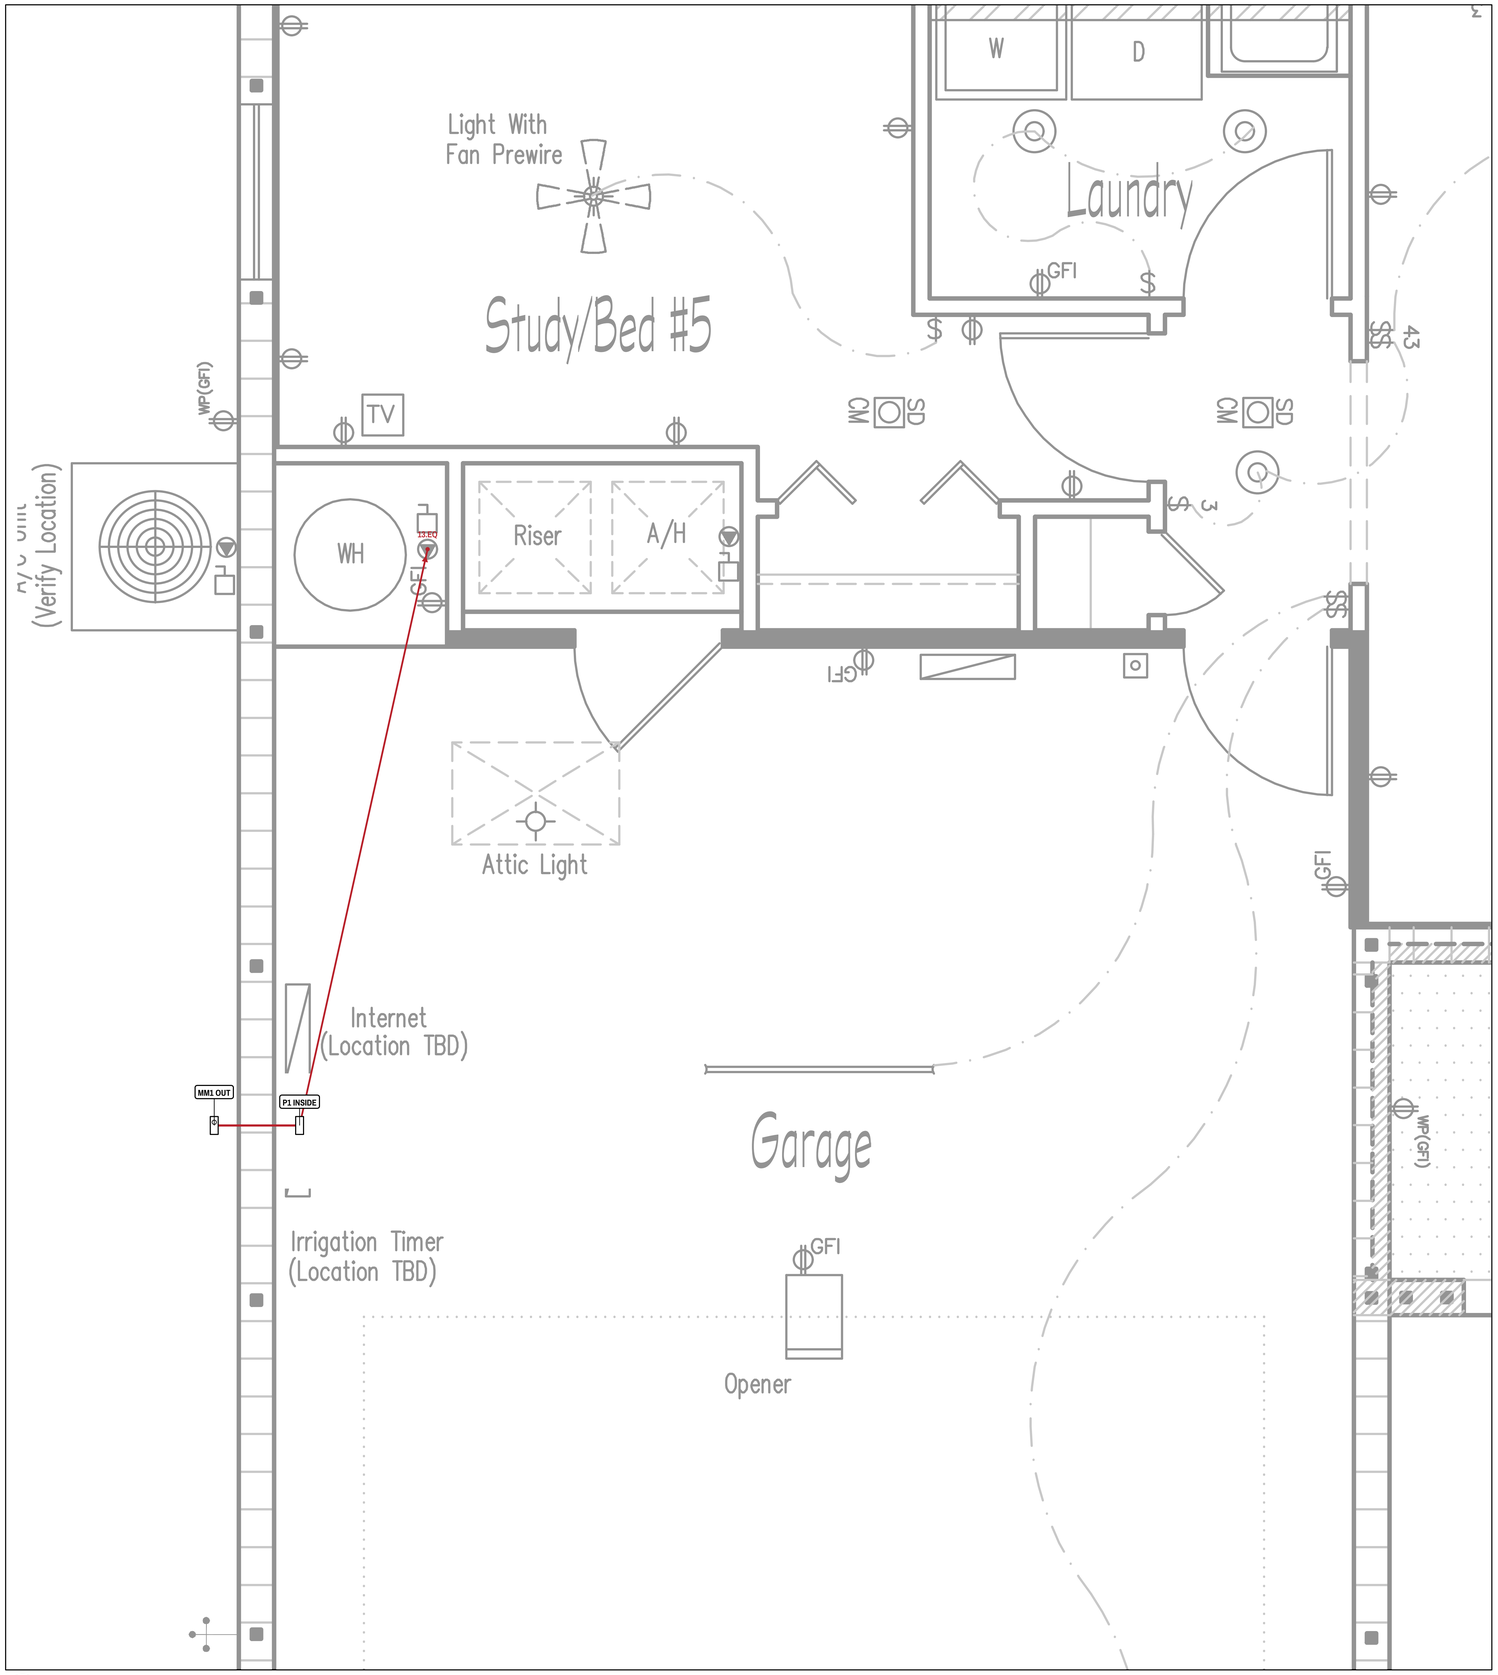

1 **CIRCUIT P1-13 - WH VOLTAGE HOLD - TWO SPACES**

SCALE: NTS | TBDA 2P SIEMENS TBD, TBD | PANEL SPACE 13/15

KEY PLAN

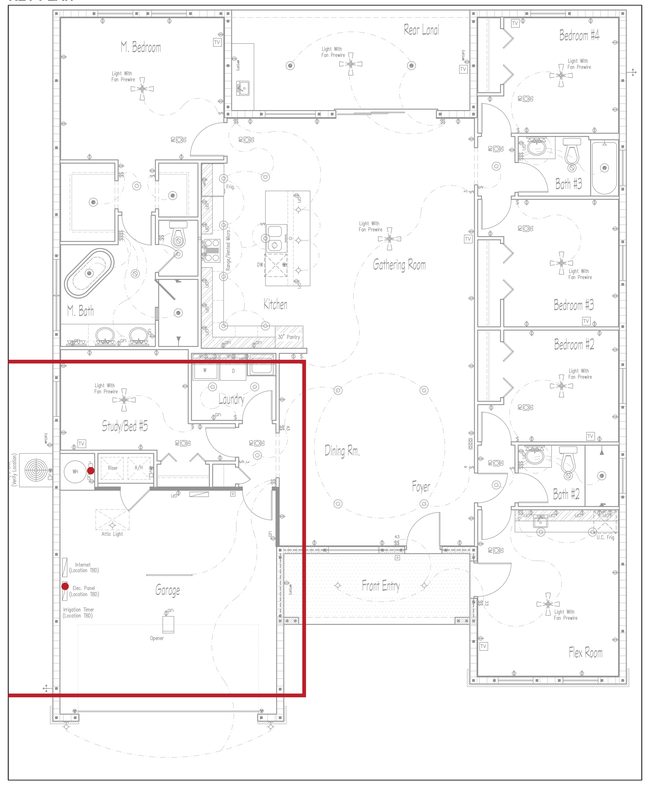

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	13.EQ	ATTIC	TBD	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
TBD	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 13.EQ; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.

WH VOLTAGE HOLD: 13/15 RESERVED; NOT AN ISSUED 2P BREAKER. EQUIPMENT BREAKER / CONDUCTOR / NAMEPLATE TBD; NO FINAL EQUIPMENT SIZE ISSUED.

WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-13 - WH
VOLTAGE HOLD - TWO
SPACES

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.13

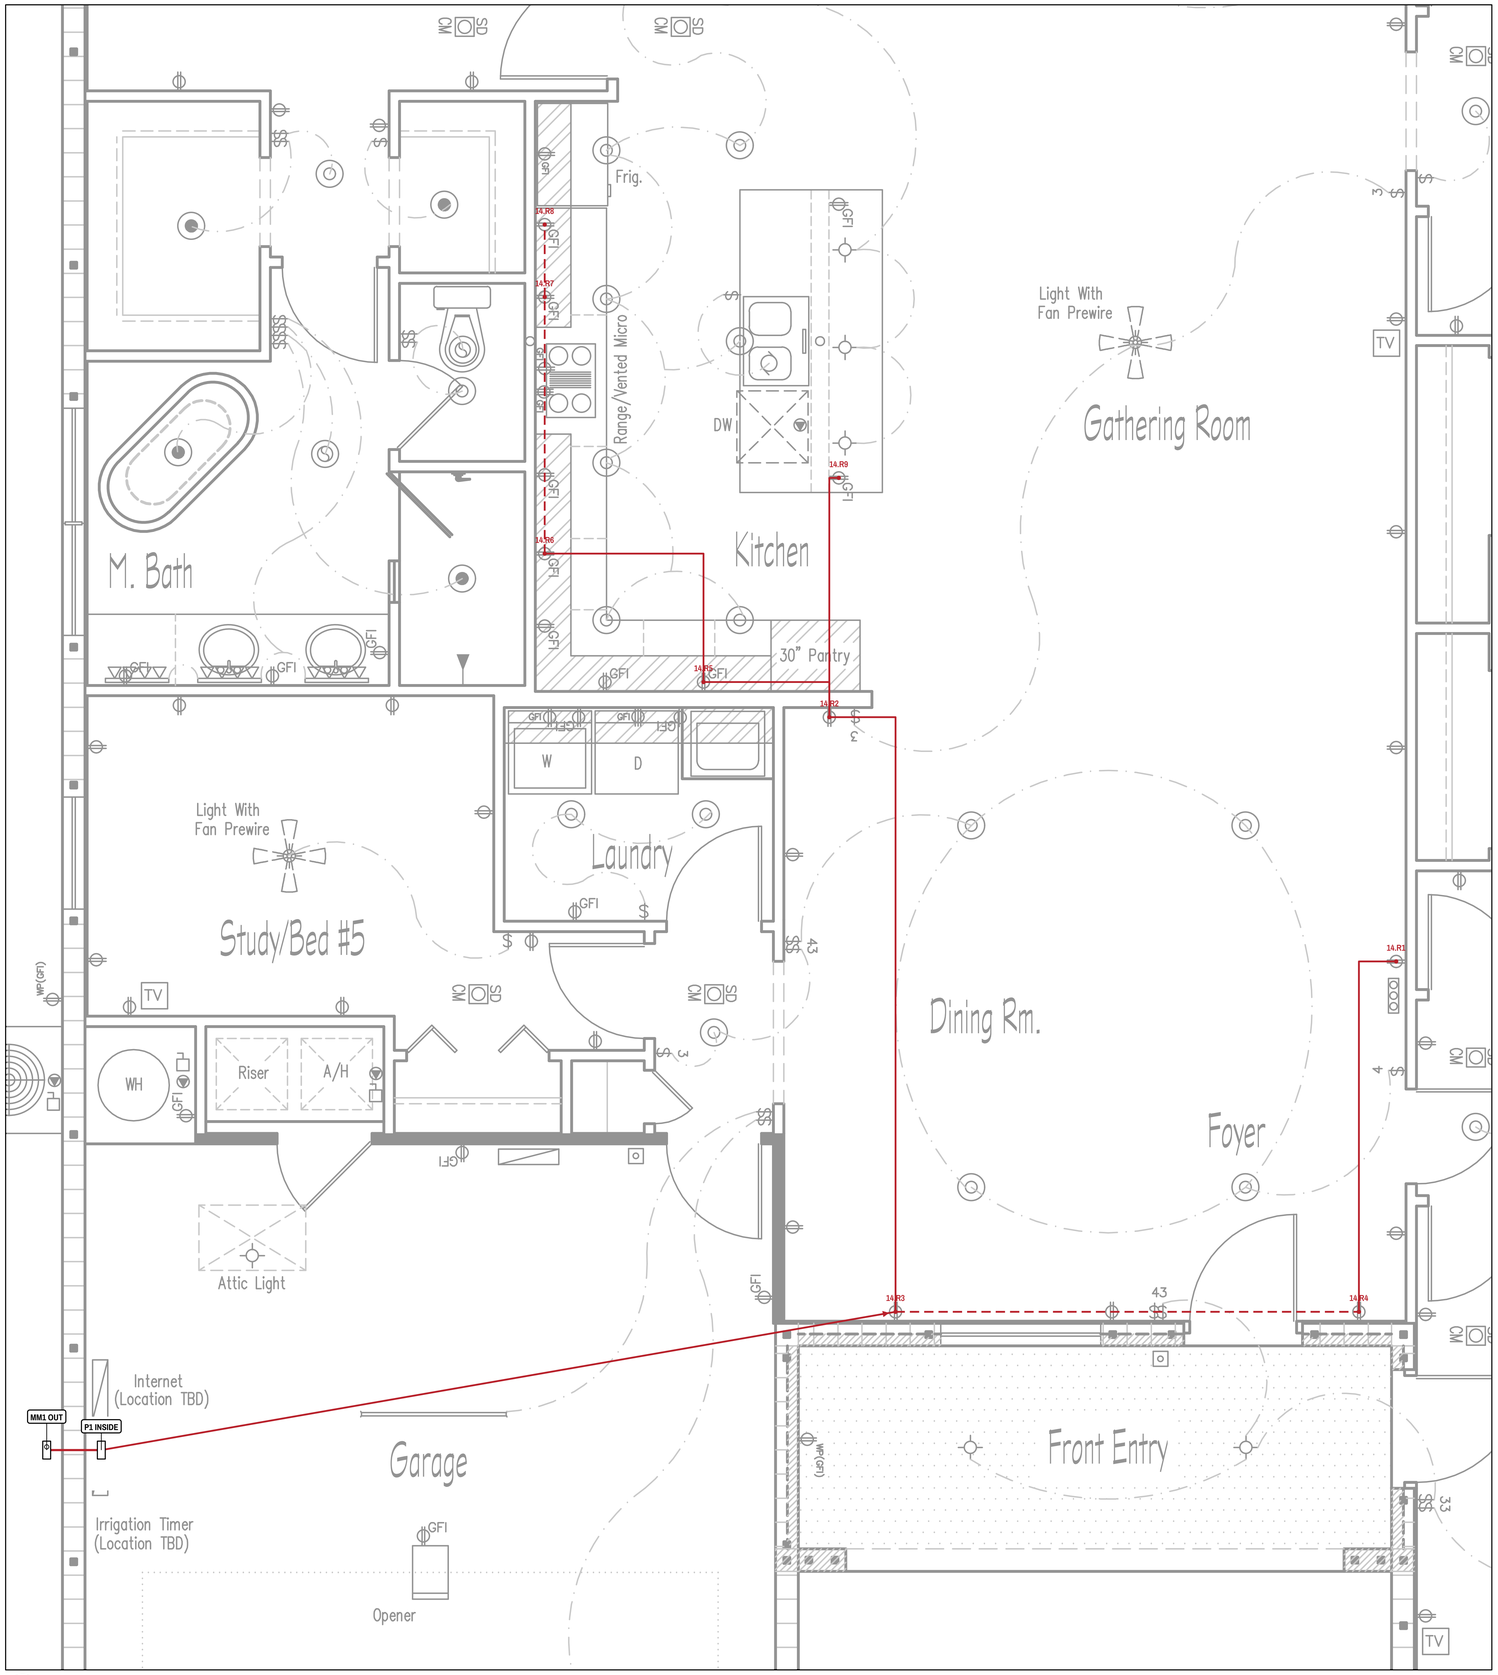

1 **CIRCUIT P1-14 - KITCHEN / DINING SABC B**

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 14

KEY PLAN

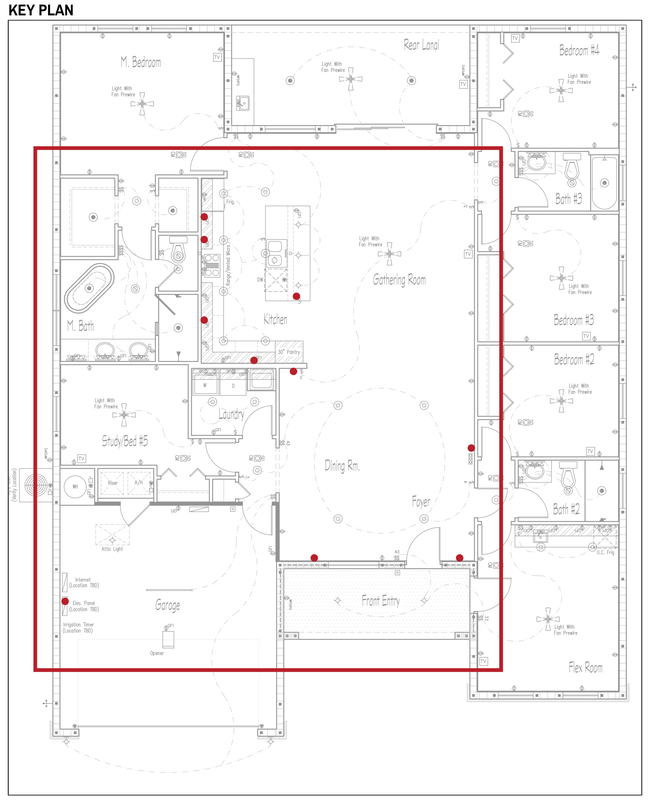

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	14.R3	ATTIC	12/2+G	TBD
2	14.R3	14.R4	IN-WALL	12/2+G	TBD
3	14.R4	14.R1	ATTIC	12/2+G	TBD
4	14.R3	14.R2	ATTIC	12/2+G	TBD
5	14.R2	14.R5	ATTIC	12/2+G	TBD
6	14.R5	14.R6	ATTIC	12/2+G	TBD
7	14.R6	14.R7	IN-WALL	12/2+G	TBD
8	14.R7	14.R8	IN-WALL	12/2+G	TBD
9	14.R2	14.R9	ATTIC	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 14.R3; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-14 - KITCHEN / DINING SABC B

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.14

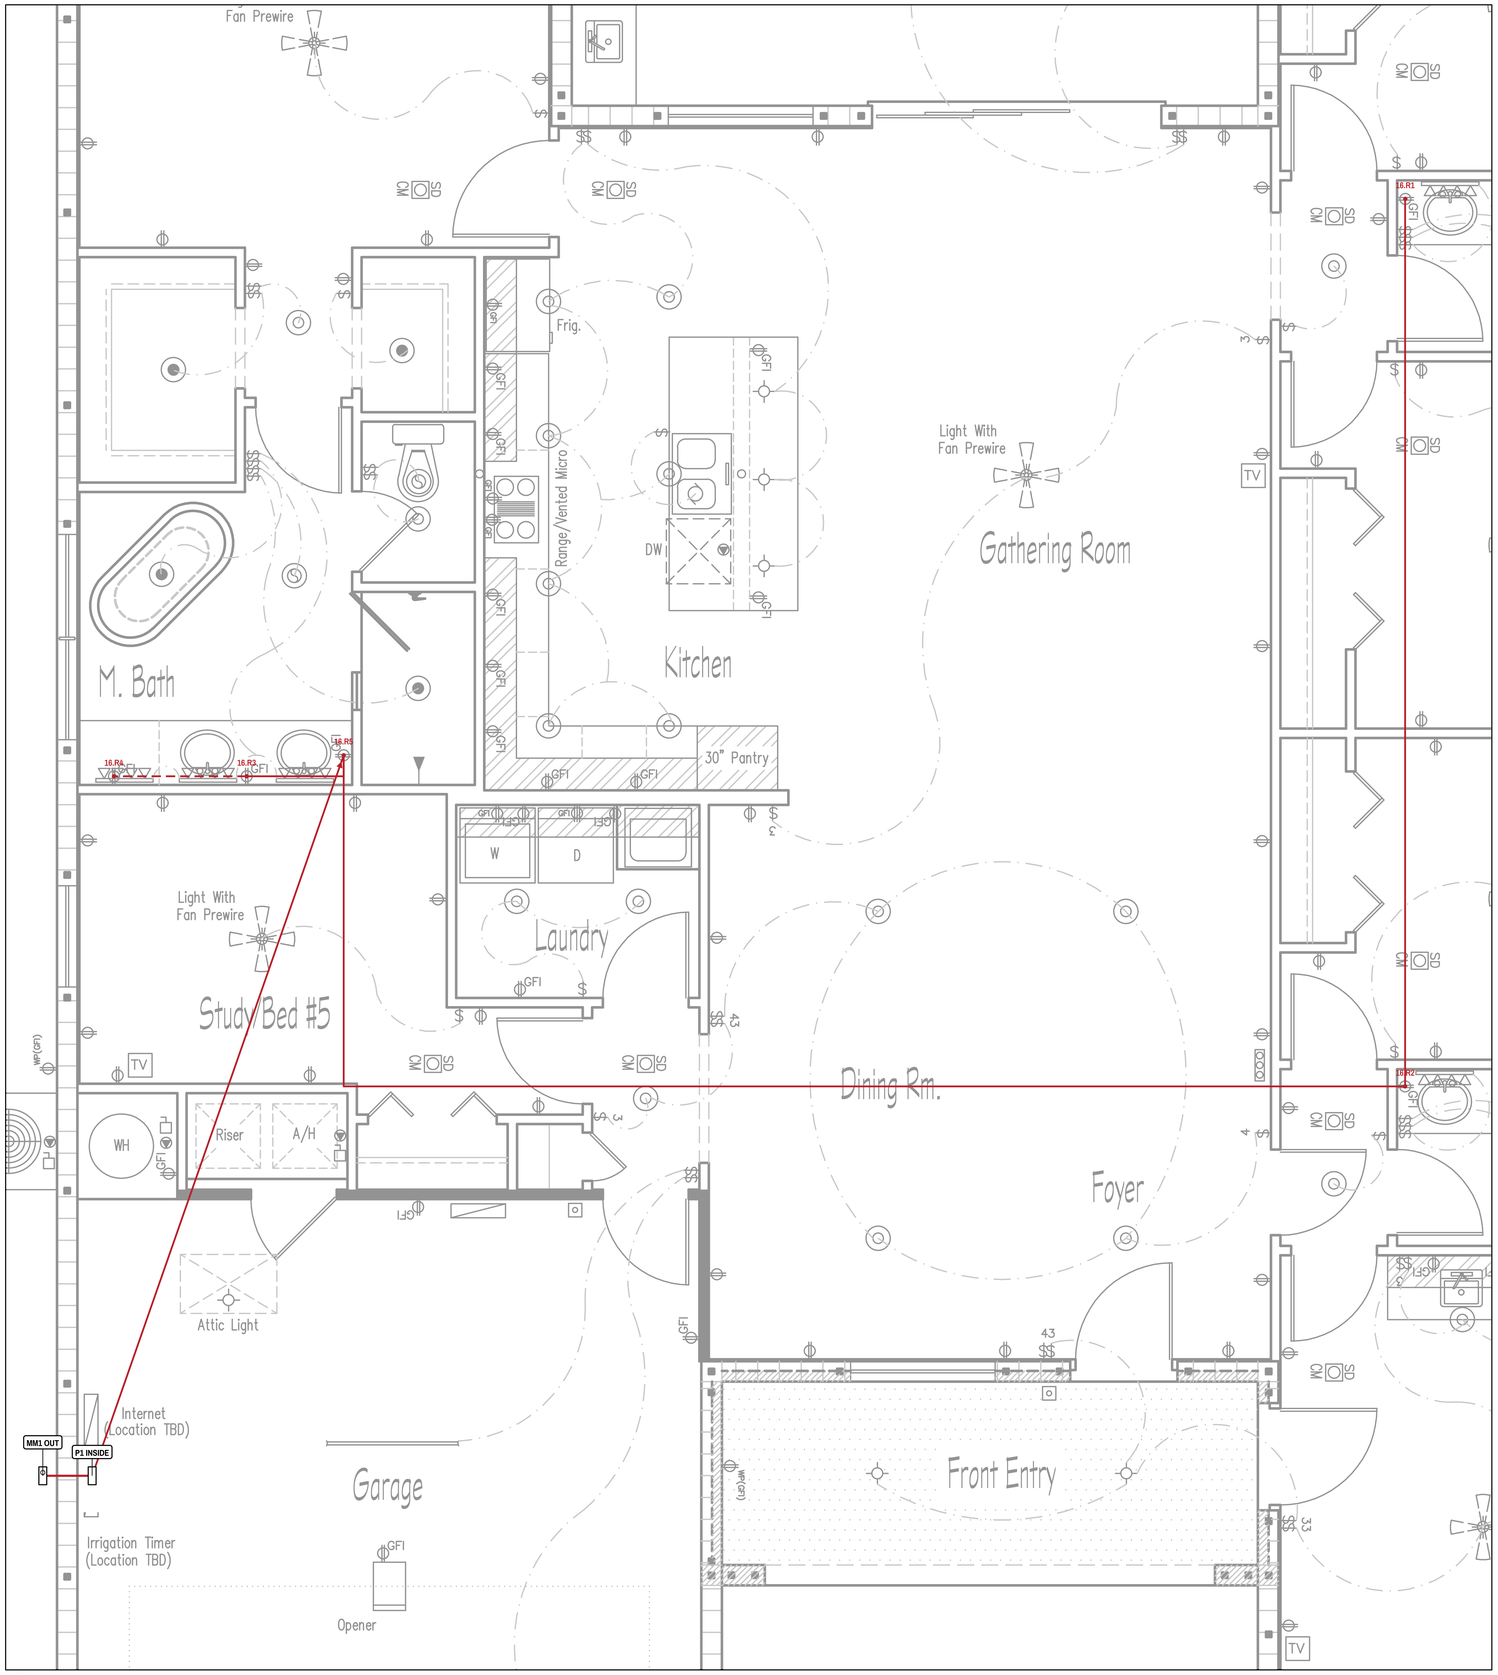

1 CIRCUIT P1-16 - ALL BATHROOM RECEPTACLES - NO LIGHTS

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 16

KEY PLAN

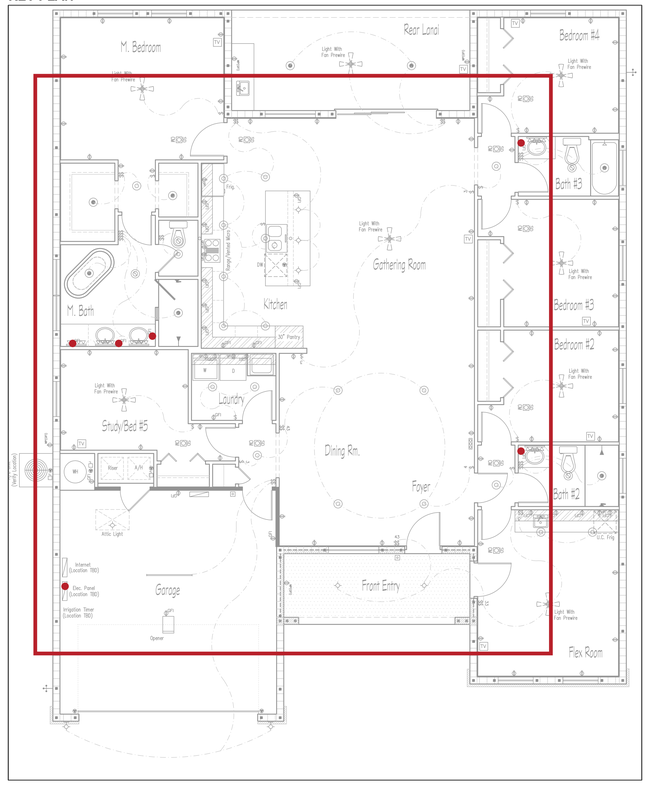

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	16.R5	ATTIC	12/2+G	TBD
2	16.R5	16.R3	ATTIC	12/2+G	TBD
3	16.R3	16.R4	IN-WALL	12/2+G	TBD
4	16.R5	16.R2	ATTIC	12/2+G	TBD
5	16.R2	16.R1	ATTIC	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 16.R5; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-16 - ALL BATHROOM RECEPTACLES - NO LIGHTS

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.16

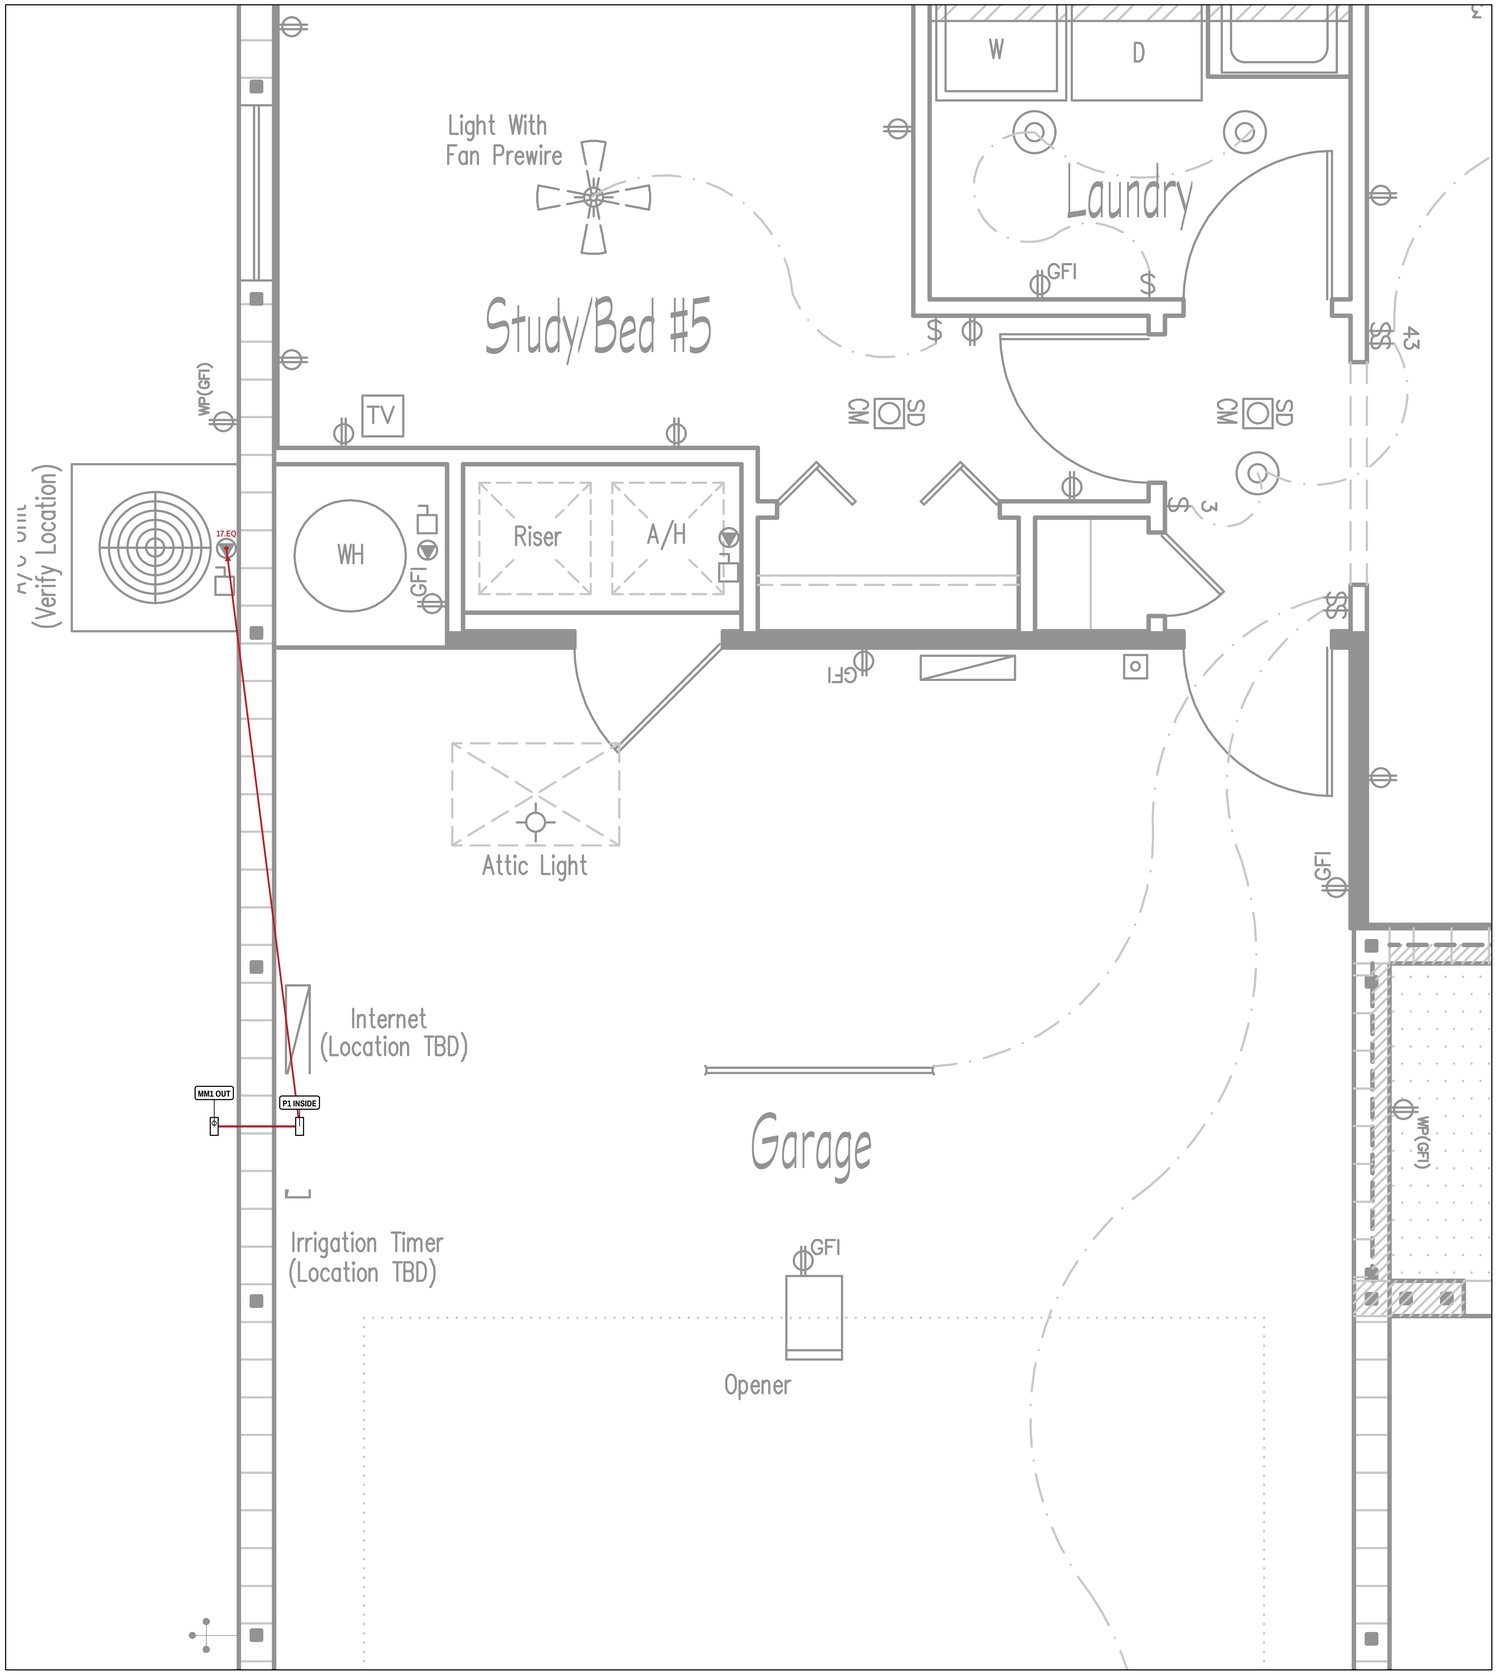

1 **CIRCUIT P1-17 - OUTDOOR A/C CONDENSER**

SCALE: NTS | TBDA 2P SIEMENS TBD, TBD | PANEL SPACE 17/19

KEY PLAN

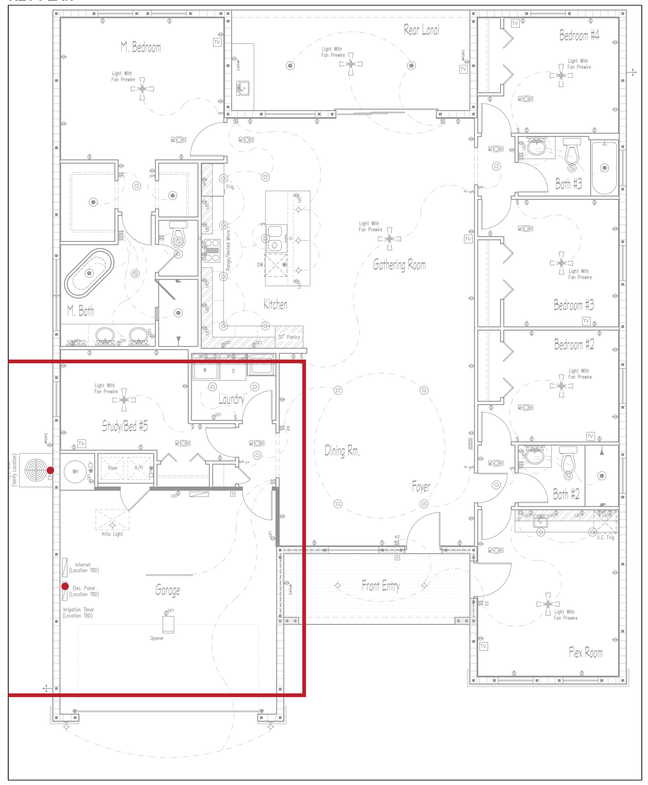

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	17.EQ	ATTIC	TBD	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
TBD	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 17.EQ; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
EQUIPMENT BREAKER / CONDUCTOR / NAMEPLATE TBD; NO FINAL EQUIPMENT SIZE ISSUED.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-17 - OUTDOOR A/C CONDENSER

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.17

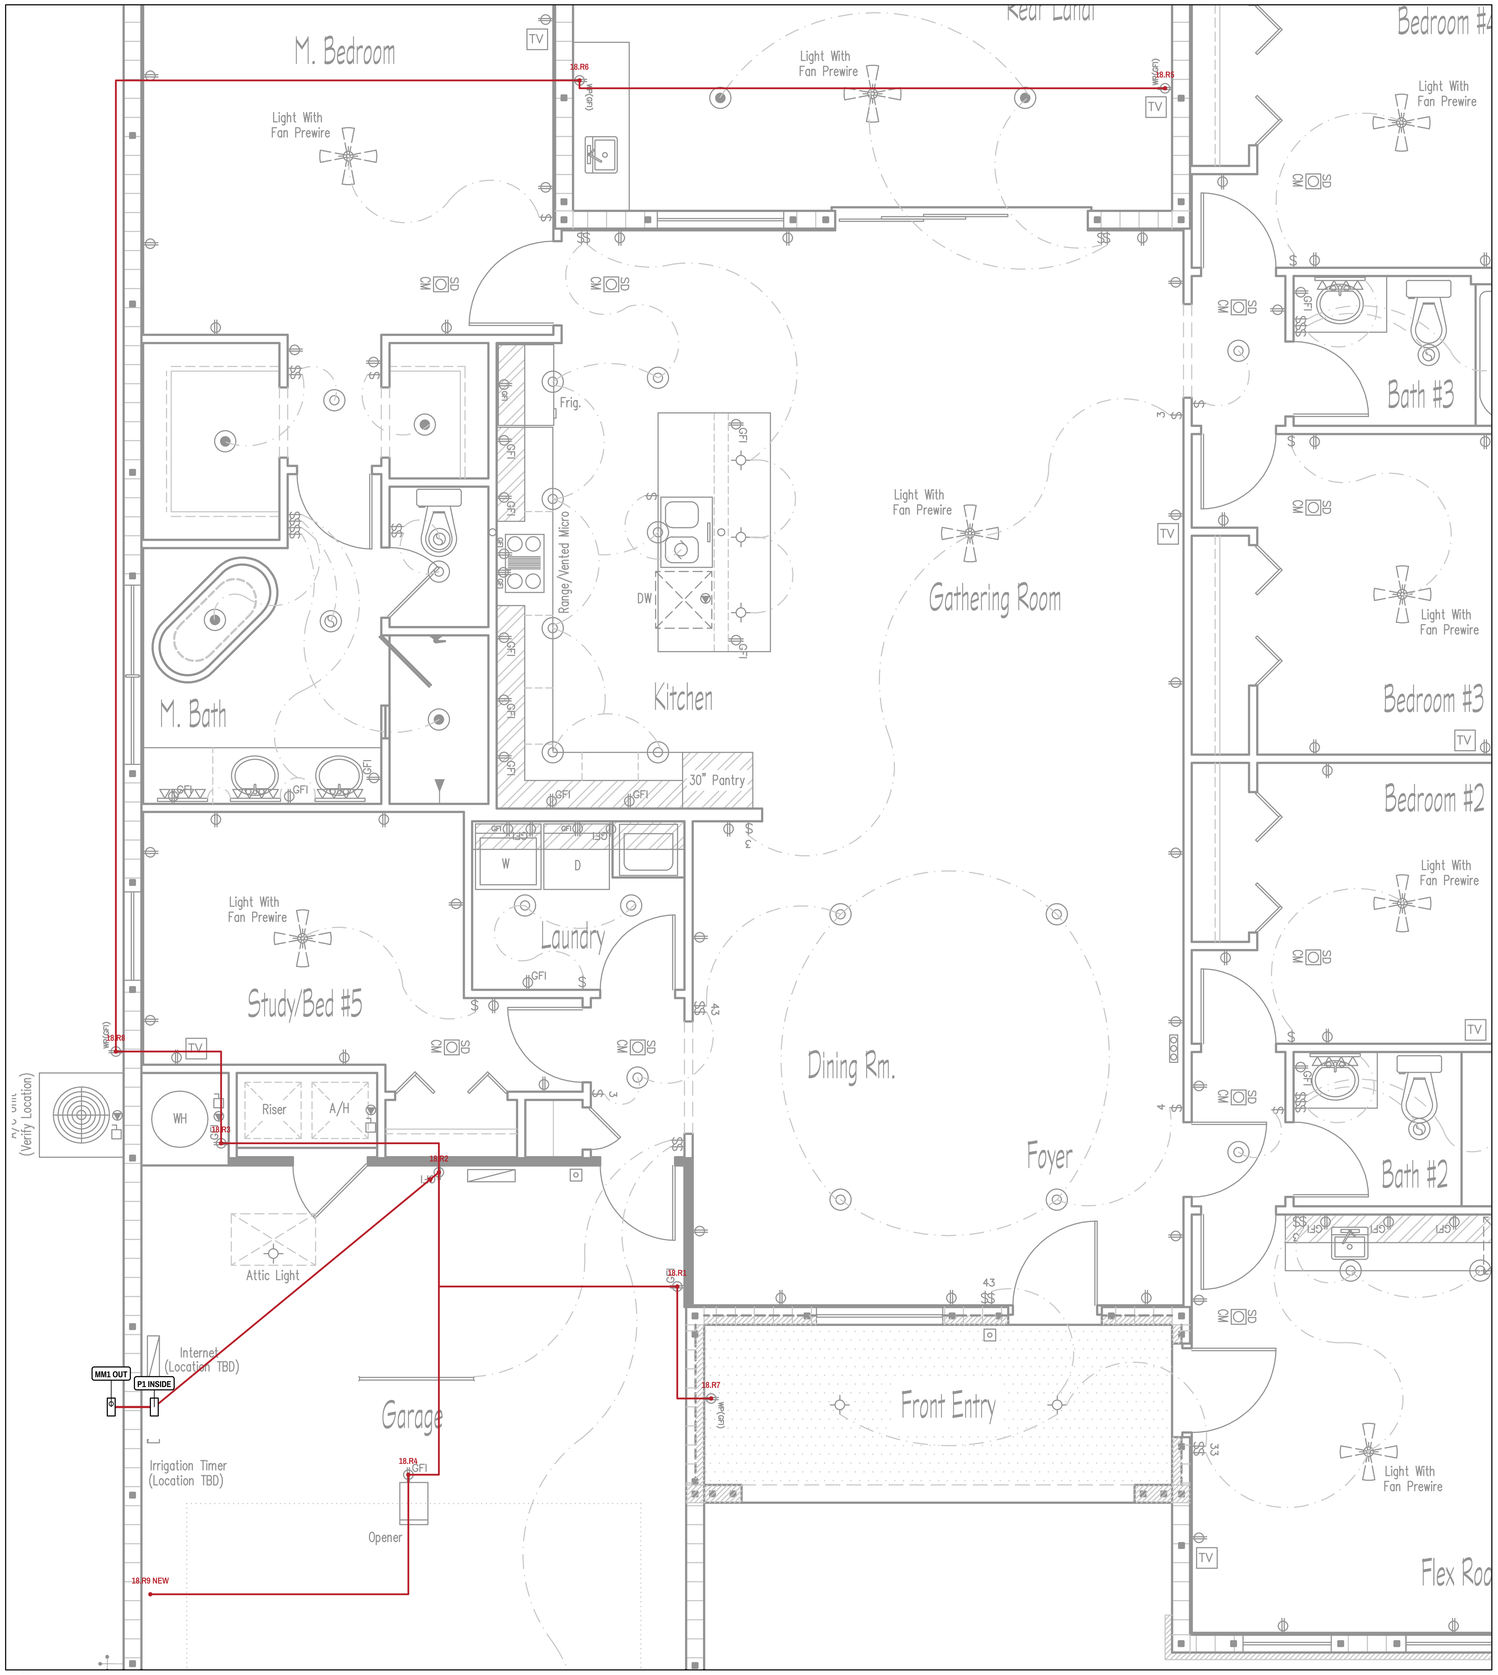

1 **CIRCUIT P1-18 - GARAGE + PERMITTED OUTDOOR RECEPTACLES**

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 18

KEY PLAN

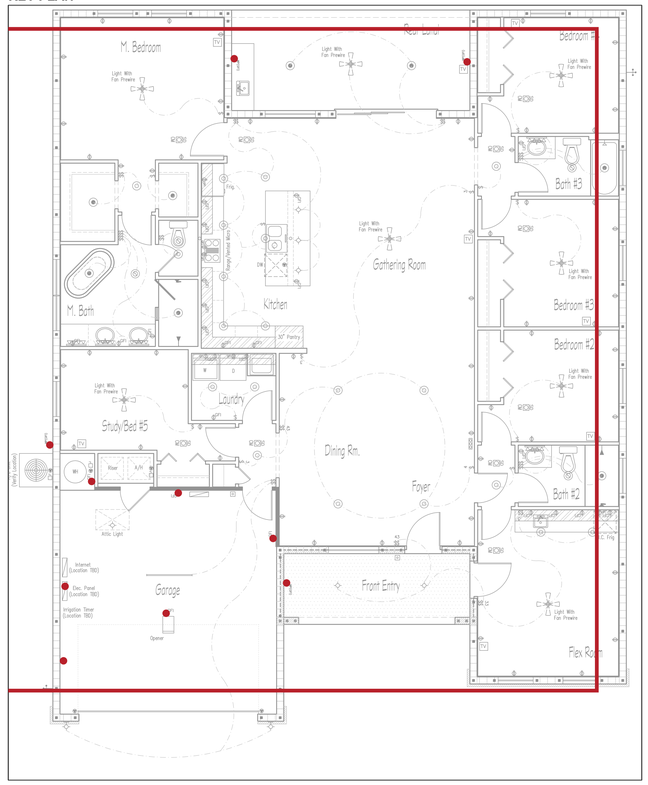

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	18.R2	ATTIC	12/2+G	TBD
2	18.R2	18.R3	ATTIC	12/2+G	TBD
3	18.R3	18.R8	ATTIC	12/2+G	TBD
4	18.R2	18.R1	ATTIC	12/2+G	TBD
5	18.R1	18.R7	ATTIC	12/2+G	TBD
6	18.R2	18.R4	ATTIC	12/2+G	TBD
7	18.R4	18.R9	ATTIC	12/2+G	TBD
8	18.R8	18.R6	ATTIC	12/2+G	TBD
9	18.R6	18.R5	ATTIC	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 18.R2; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.

WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS

FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-18 - GARAGE + PERMITTED OUTDOOR RECEPTACLES

SCALE
DIAGRAMMATIC / NTS

DATE
2026-11-07 EST / D6


ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD

SHEET


E-3.18

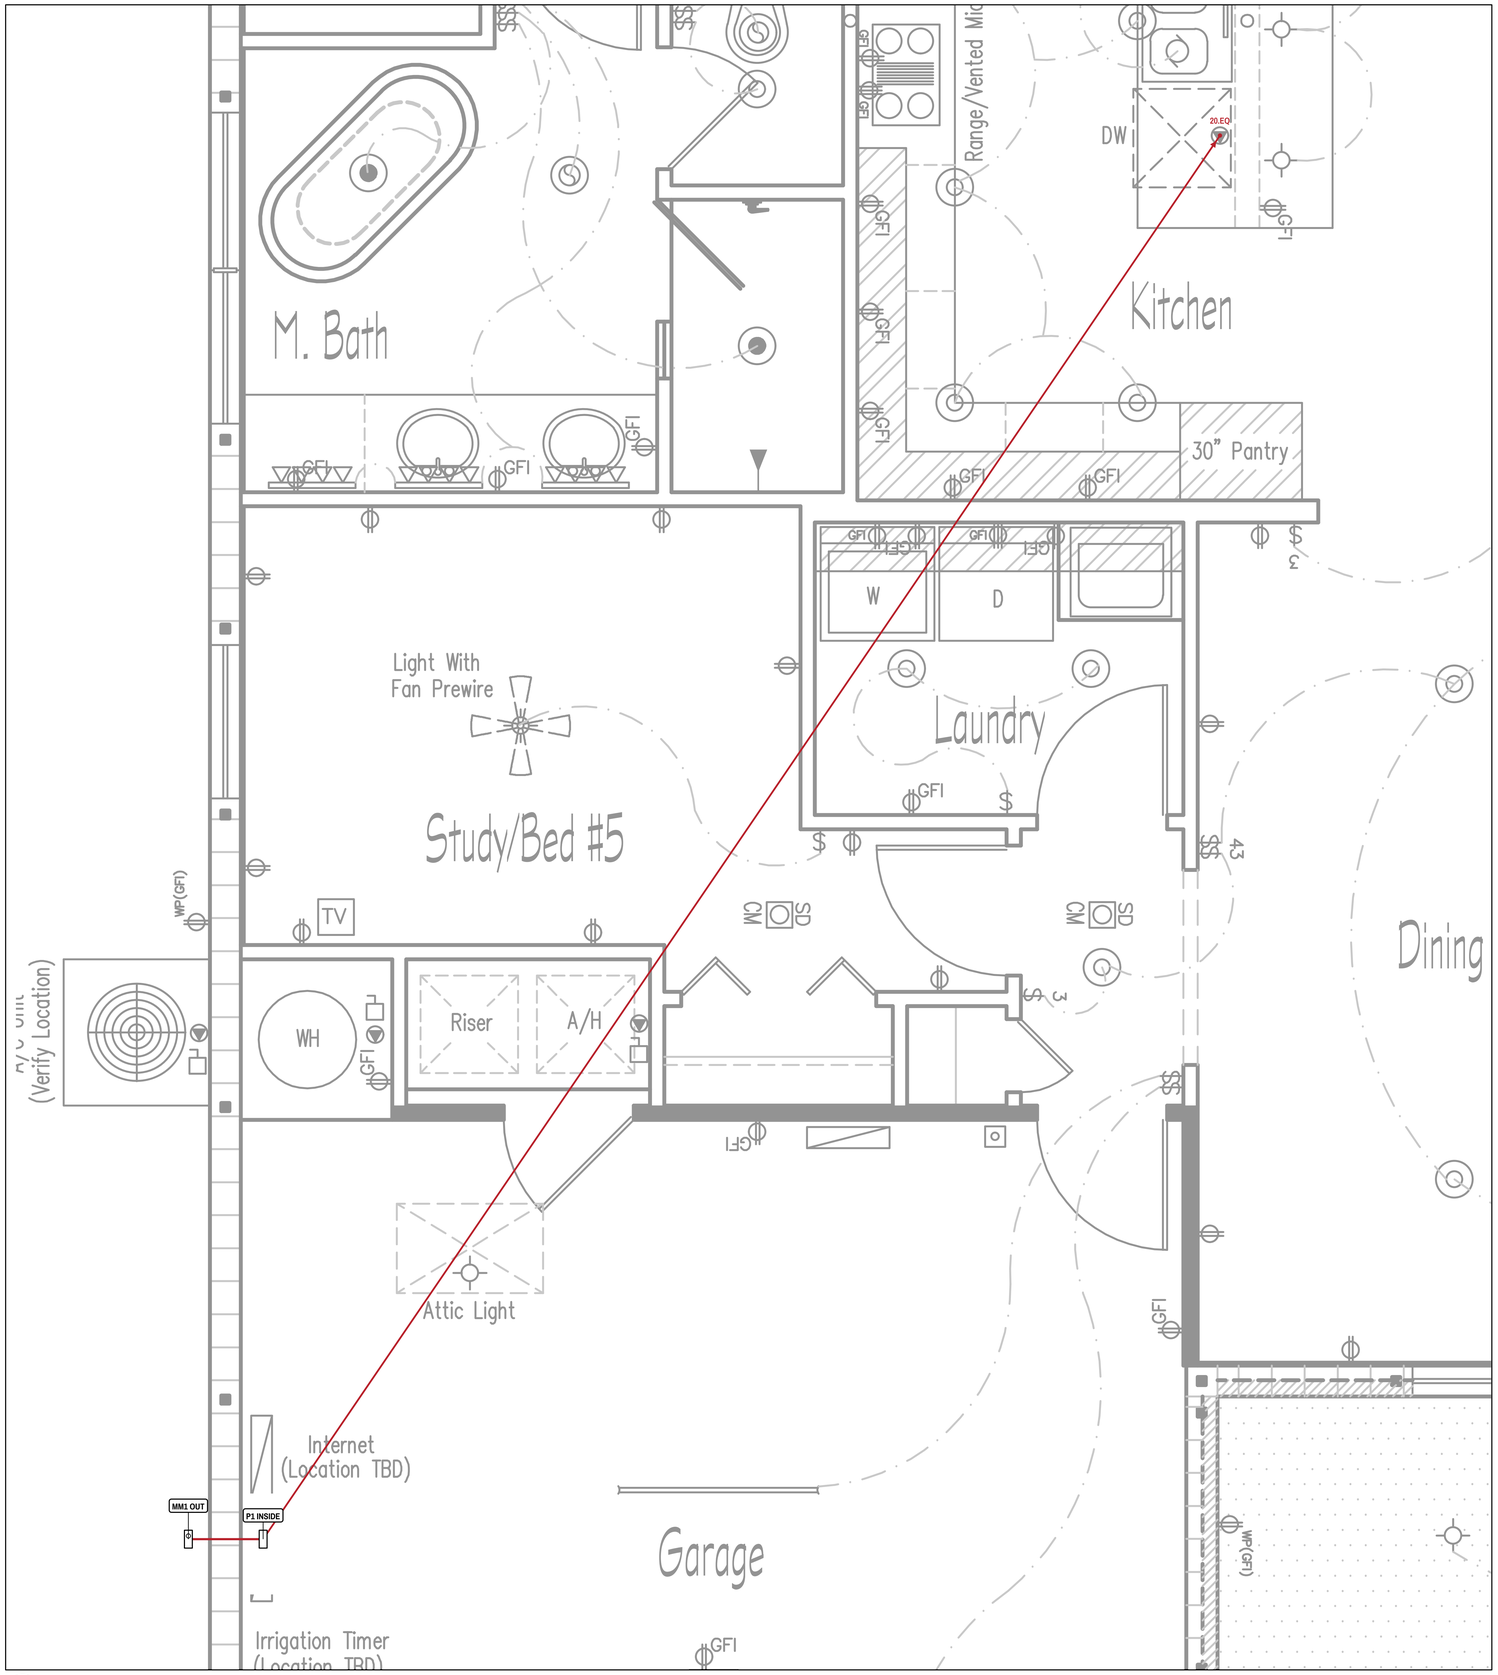

1 **CIRCUIT P1-20 - DISHWASHER - INDIVIDUAL PROVISIONAL**

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 20

KEY PLAN

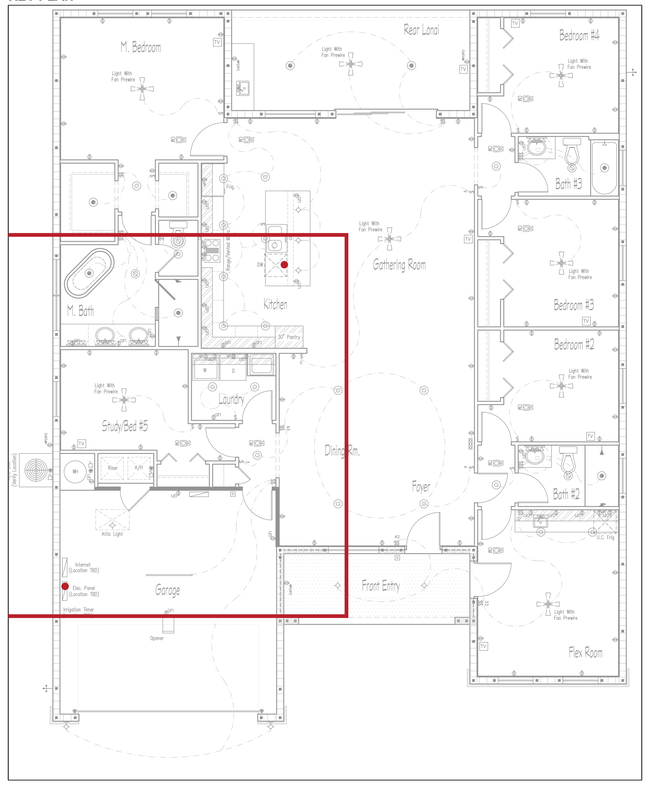

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	20.EQ	ATTIC	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 20.EQ; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-20 - DISHWASHER - INDIVIDUAL PROVISIONAL

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.20

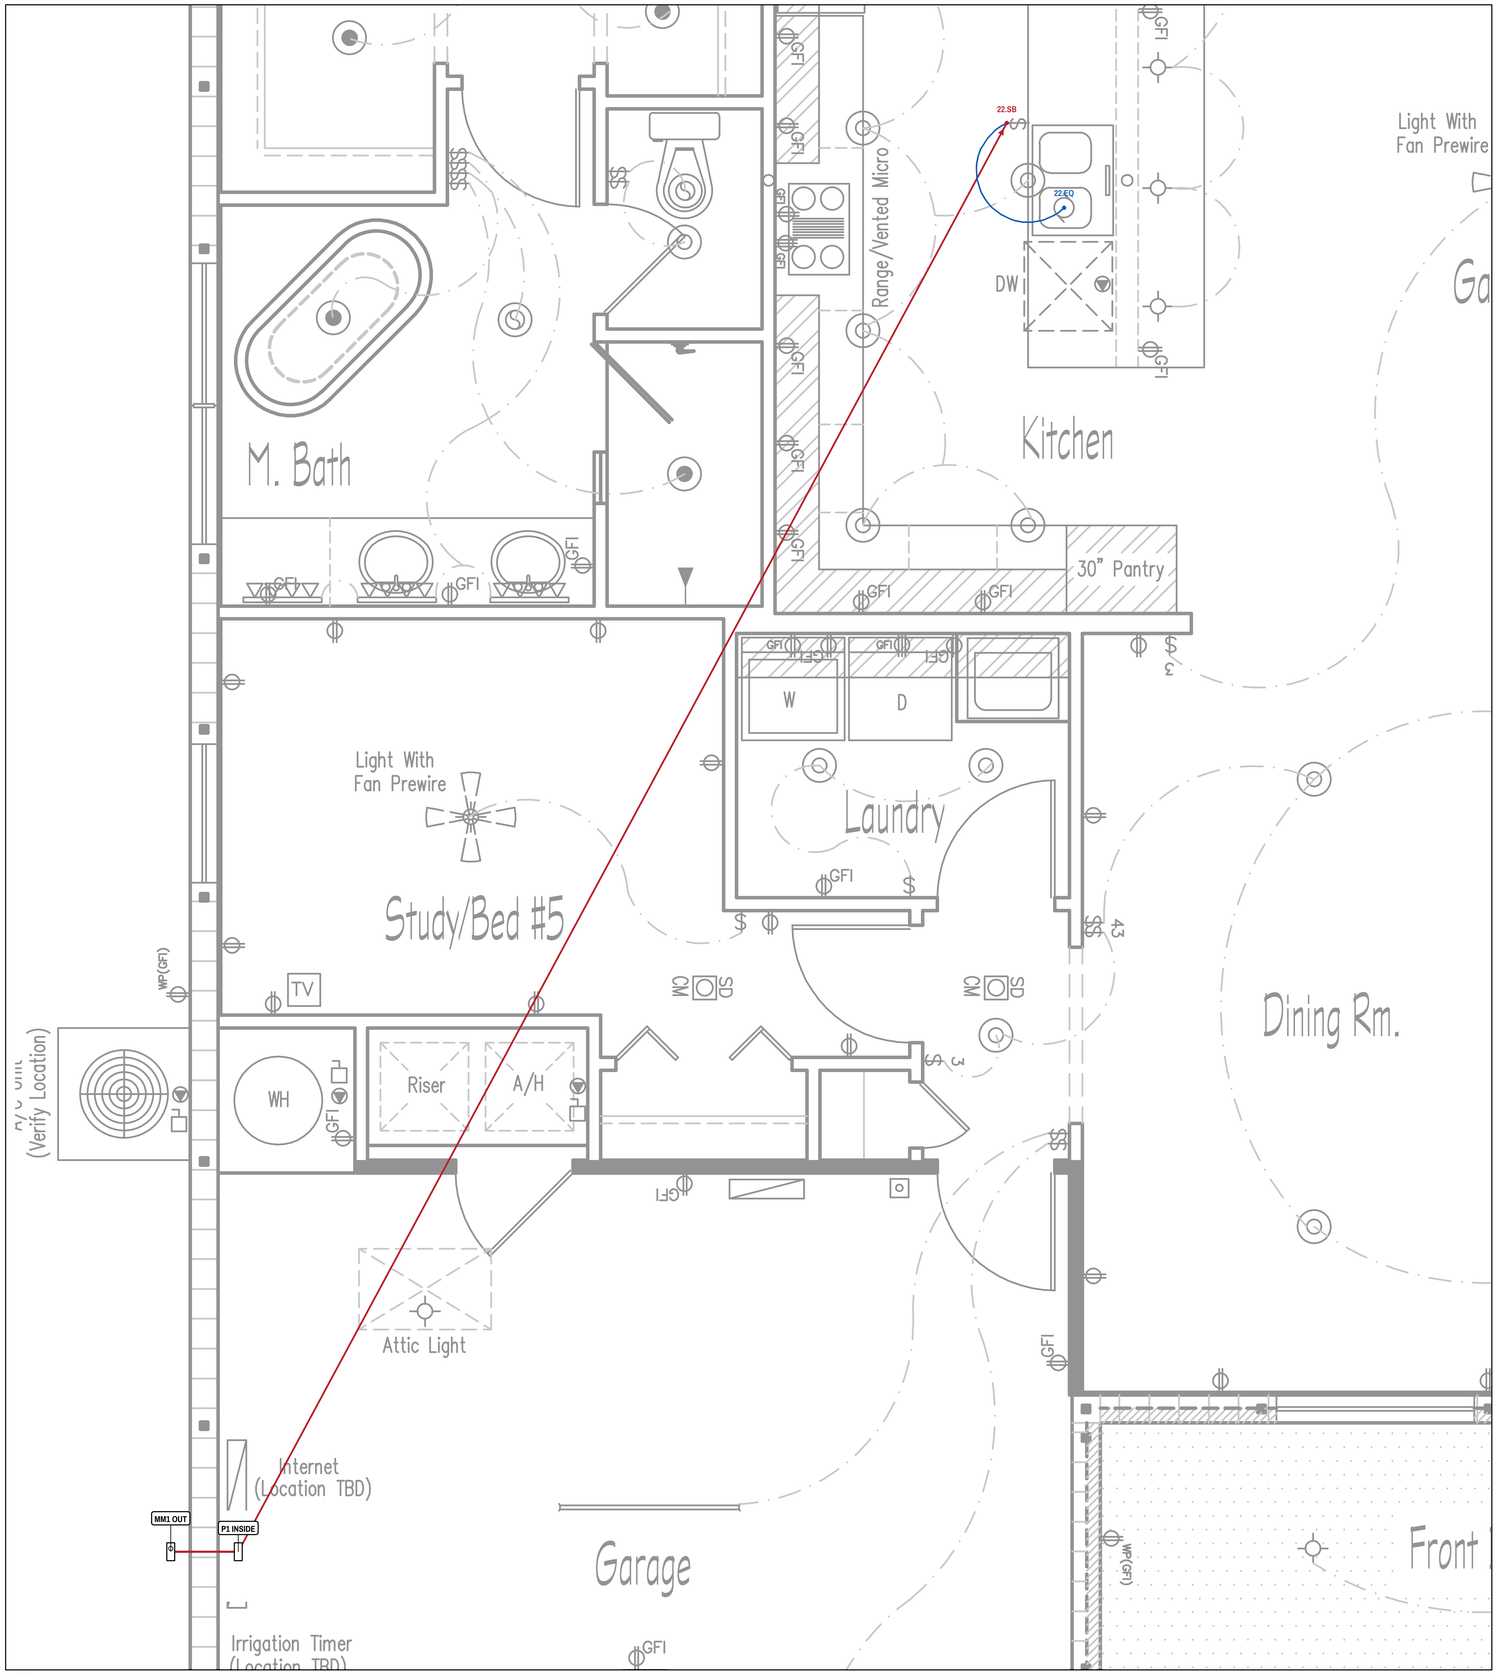

1 **CIRCUIT P1-22 - DISPOSAL - INDIVIDUAL PROVISIONAL**

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 22

KEY PLAN

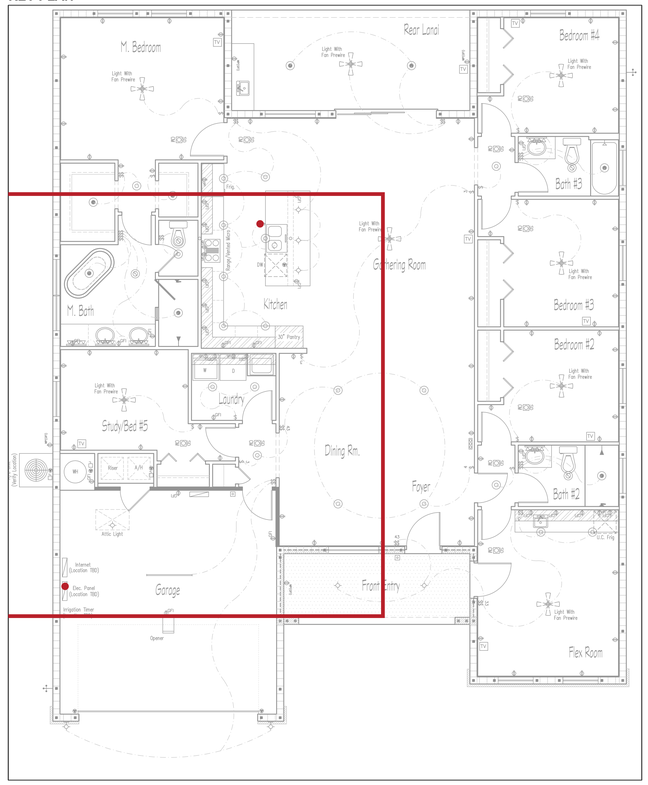

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	22.SB	ATTIC	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 22.SB; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS

FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-22 - DISPOSAL - INDIVIDUAL PROVISIONAL

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.22
20 OF 23

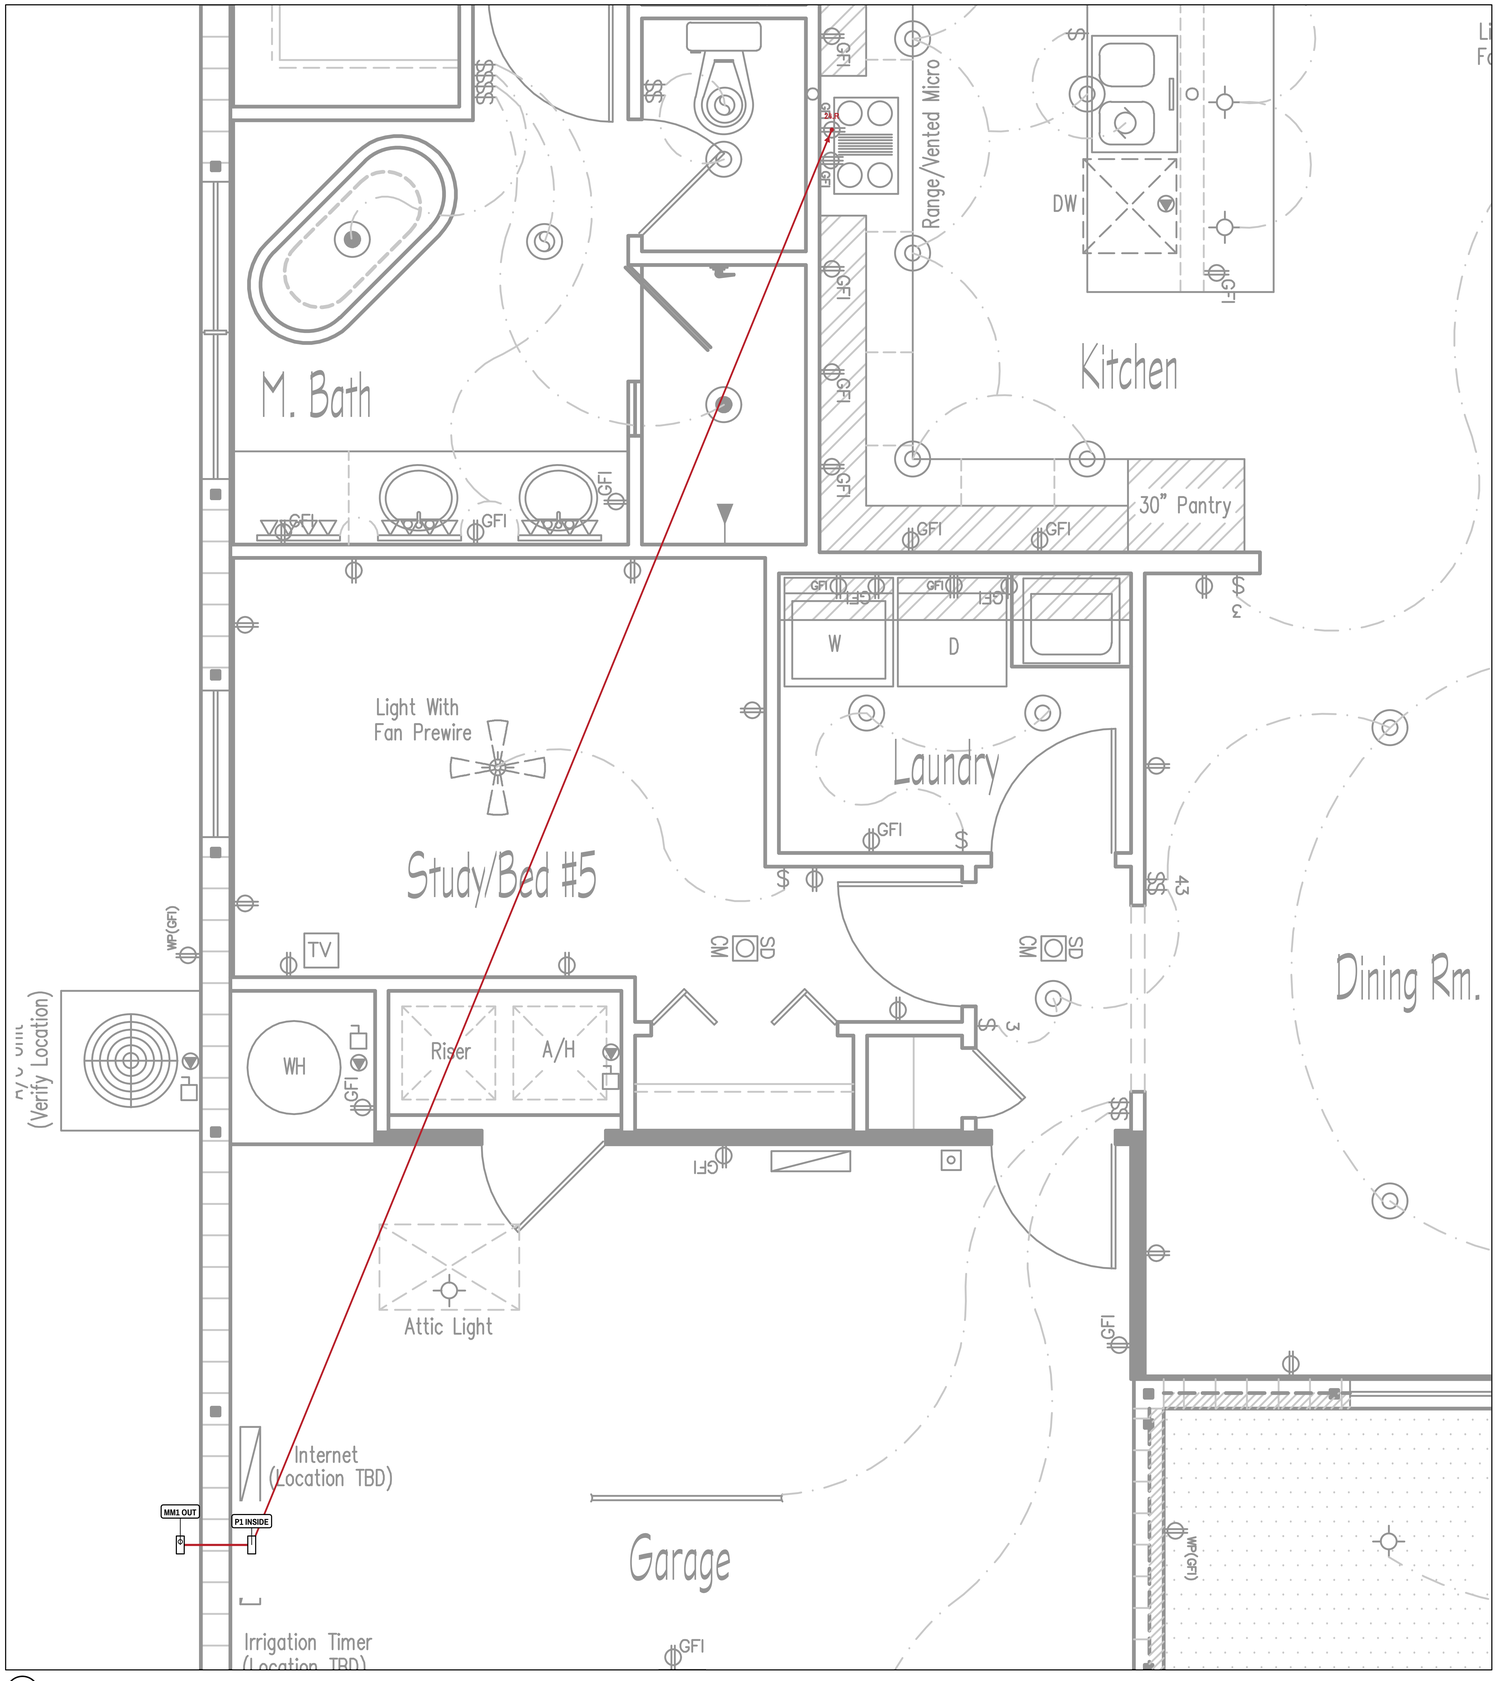

1 CIRCUIT P1-24 - RANGE VENTED MICROWAVE / HOOD - INDIVIDUAL

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 24

KEY PLAN

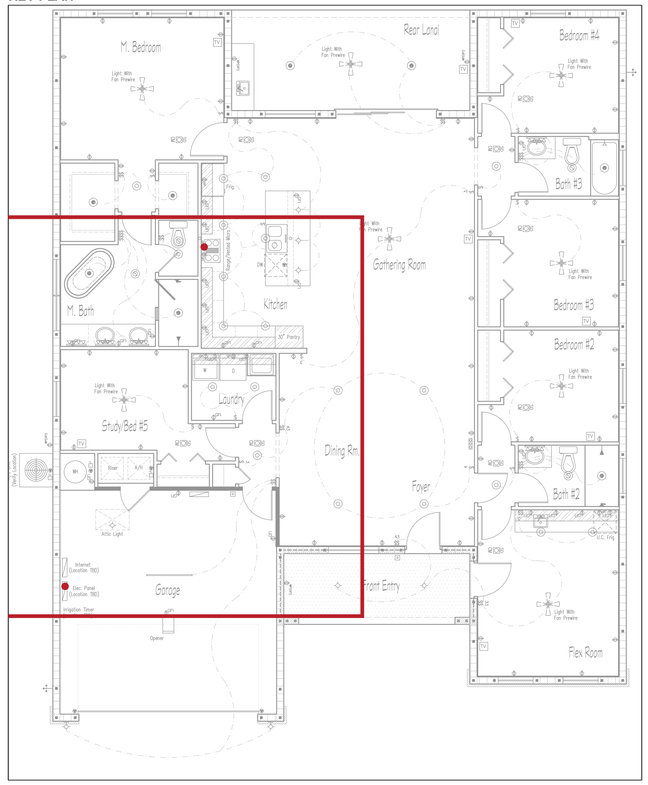

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	24.R	ATTIC	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 24.R; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-24 - RANGE VENTED MICROWAVE / HOOD - INDIVIDUAL

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.24

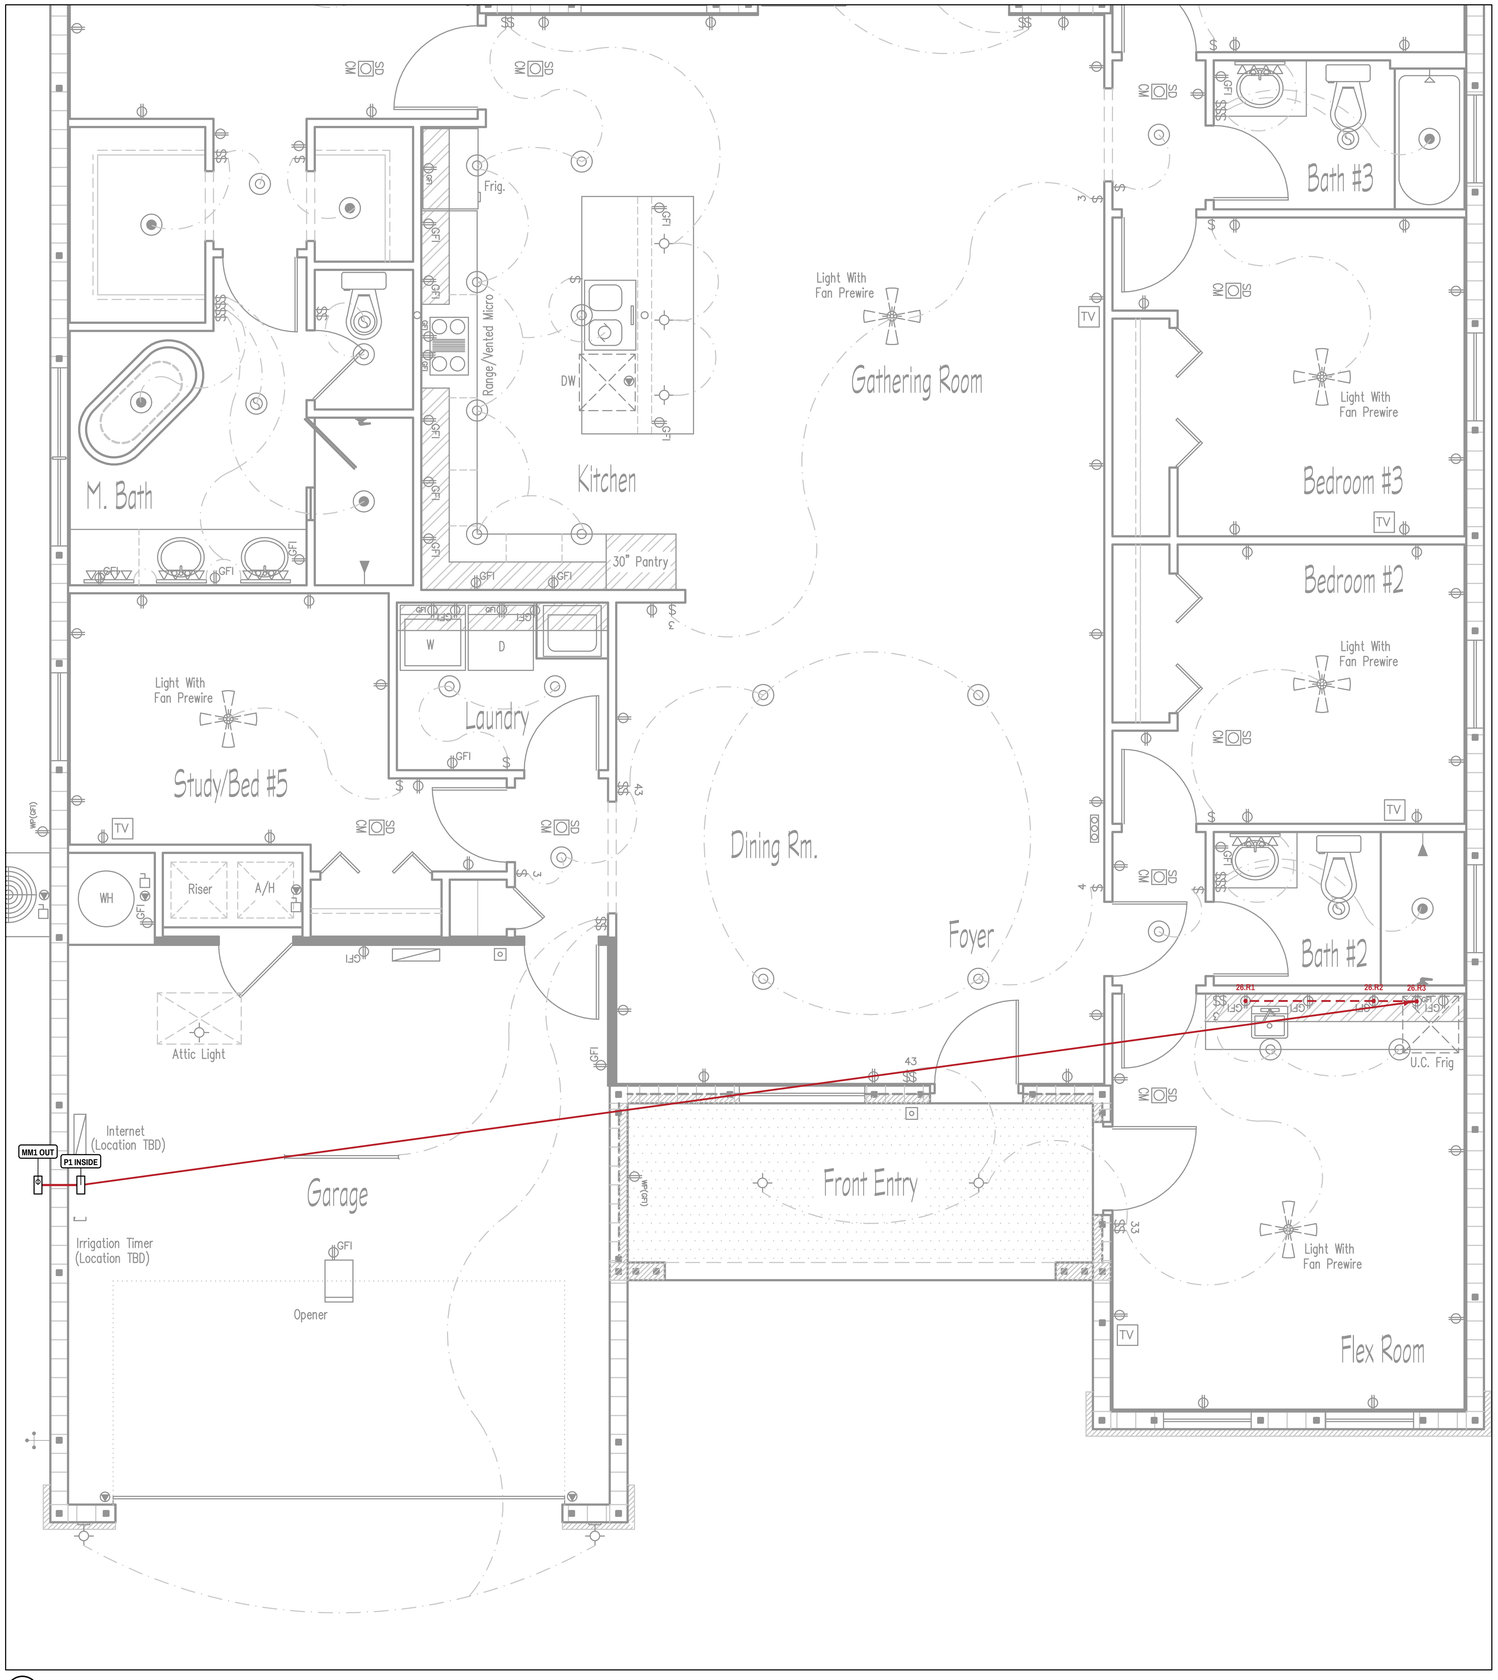

1 CIRCUIT P1-26 - FLEX KITCHENETTE SABC A + U.C. REFRIGERATOR

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 26

KEY PLAN

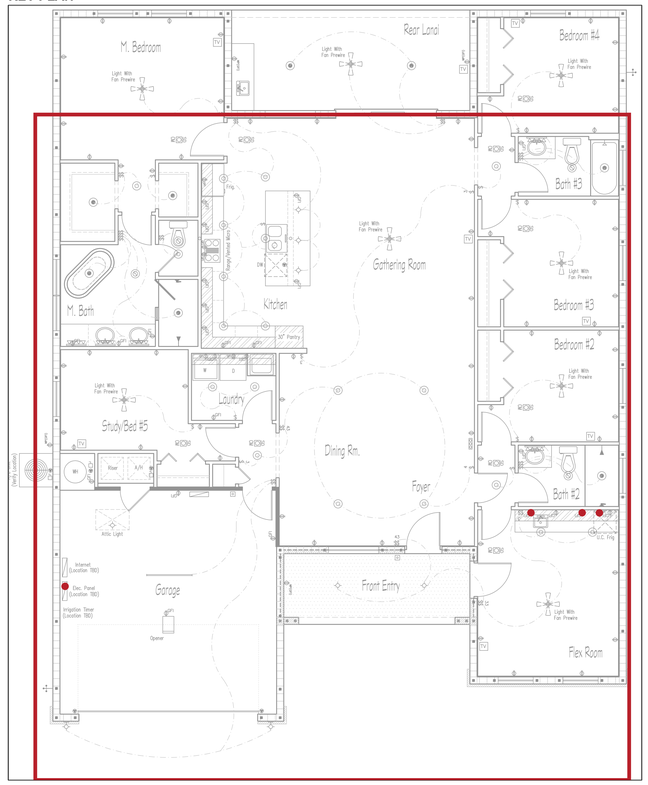

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	26.R3	ATTIC	12/2+G	TBD
2	26.R3	26.R2	IN-WALL	12/2+G	TBD
3	26.R2	26.R1	IN-WALL	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 26.R3; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1.5 / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS
FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-26 - FLEX KITCHENETTE SABC A + U.C. REFRIGERATOR

SCALE
DIAGRAMMATIC / NTS


DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD


SHEET
E-3.26

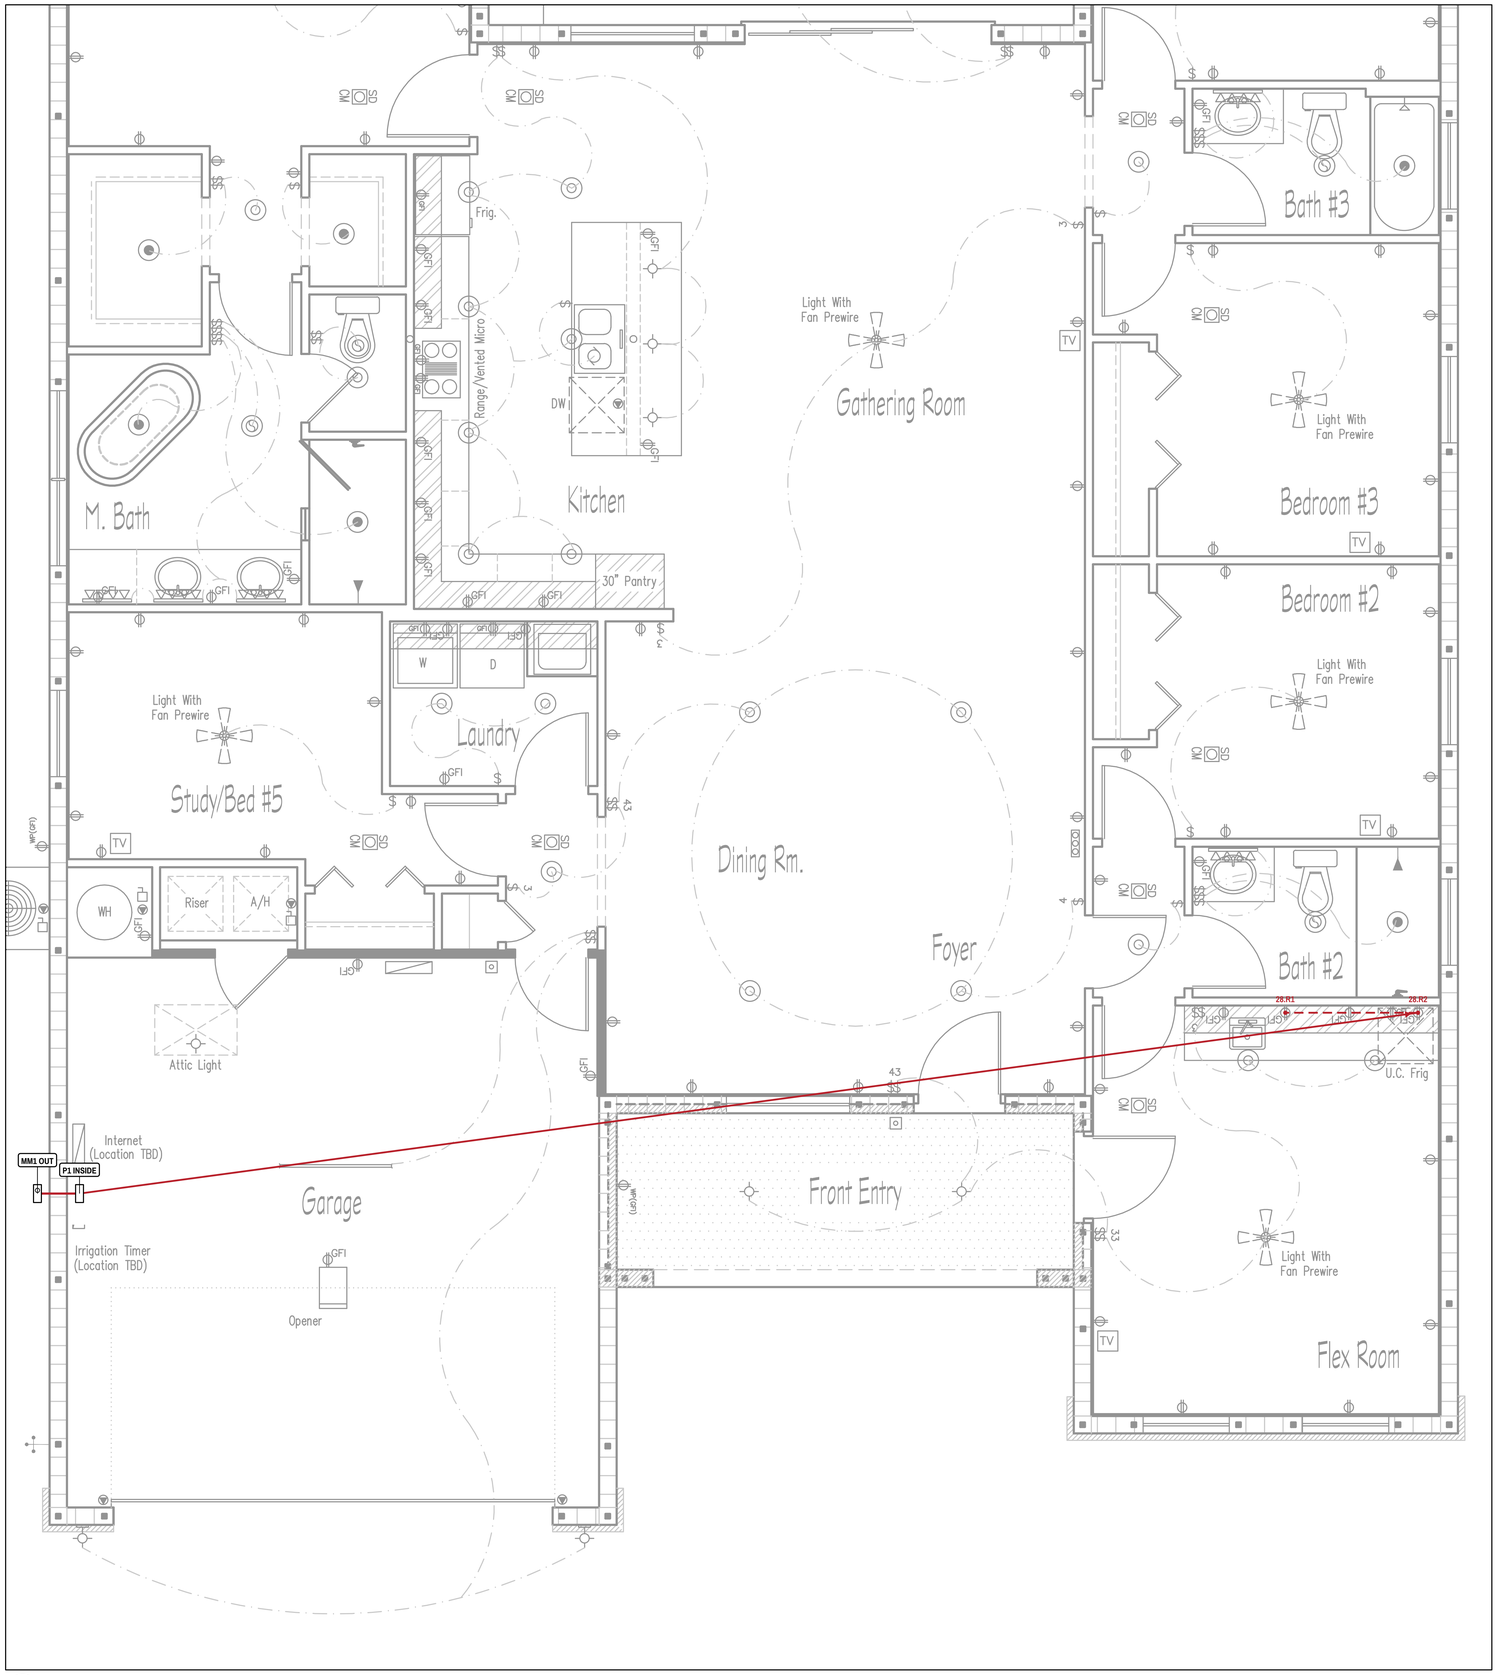

1 **CIRCUIT P1-28 - FLEX KITCHENETTE SABC B**

SCALE: NTS | 20A 1P SIEMENS Q120DFN, 12/2+G | PANEL SPACE 28

KEY PLAN

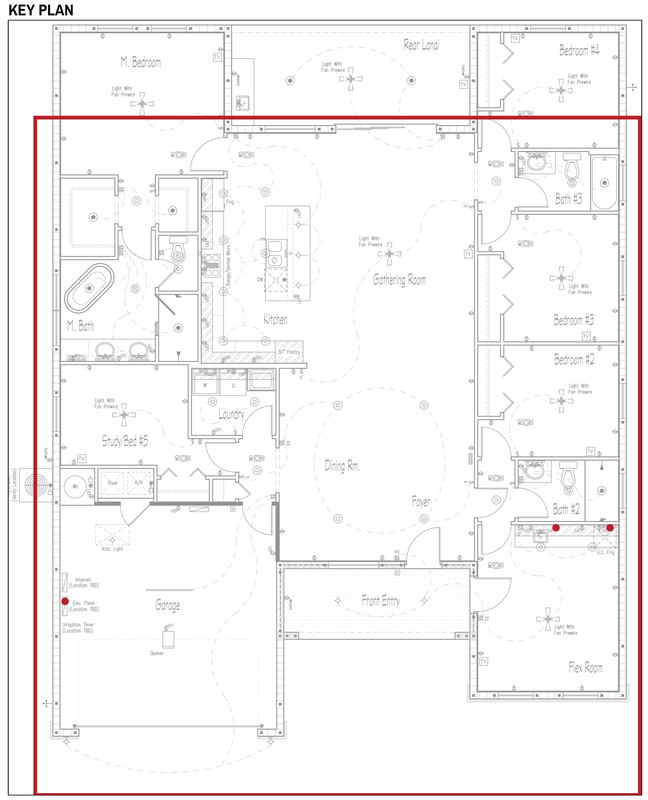

RUN SCHEDULE

#	FROM	TO	ROUTE	CABLE	FT
1	P1	28.R2	ATTIC	12/2+G	TBD
2	28.R2	28.R1	IN-WALL	12/2+G	TBD

FOOTAGE (FT) - UNKNOWN / NOT ZERO

CABLE	BEFORE	AFTER +10%	STATUS
12/2+G	TBD	TBD	HOLD

SHEET NOTES

1. HR: P1 GARAGE SIDE TO 28.R2; LENGTH TBD.
2. RED POWER; BLUE ACTUAL SOURCE CONTROLS. SOLID ATTIC / DASHED SAME WALL + ROOM; NEVER GARAGE.
3. EQUIPMENT / FOOTAGE / FINAL LOAD / RELEASE HOLDS: E-0 / E-1S / E-2.
WALL R 18 IN AFF CENTER WHERE SILENT; OTHER HEIGHTS PLAN / FOREMAN.

ELECTRICAL POWER DESIGN PREPARED BY:

SHARMA ELECTRIC & HVAC

SHARMA ELECTRIC & HVAC
6117 ARBOR WATCH LOOP, ORLANDO, FL 32829
407-881-9076 | OFFICE@SHARMAELECTRIC.COM
ELECTRICAL CONTRACTOR EC13013924
CERTIFIED AIR CONTRACTOR CAC1823596

PROJECT

ADDRESS

FLORENCE 1
212 MARION OAKS GOLF WAY
OCALA, FL 34473
PARCEL: 8005-0758-11

CLIENT

EXJ ROOT
BUILDER - OWNER TRACKER

SHEET

TITLE
CIRCUIT P1-28 - FLEX KITCHENETTE SABC B

SCALE
DIAGRAMMATIC / NTS

DATE
2026-11-07 EST / D6

ELECTRICAL CONTRACTOR EC13013924 | CERTIFIED AIR CONTRACTOR CAC1823596

DRAFT / NOT FOR CONSTRUCTION

NOT FOR BUILDING DEPARTMENT RECORD

SHEET
E-3.28
23 OF 23