

Water Quality Full Report


Generated: 2026-02-09 10:18:49.046027

Latest pH: 7.04

Turbidity: 8.52

TDS: 362.81

Temperature: 27.69

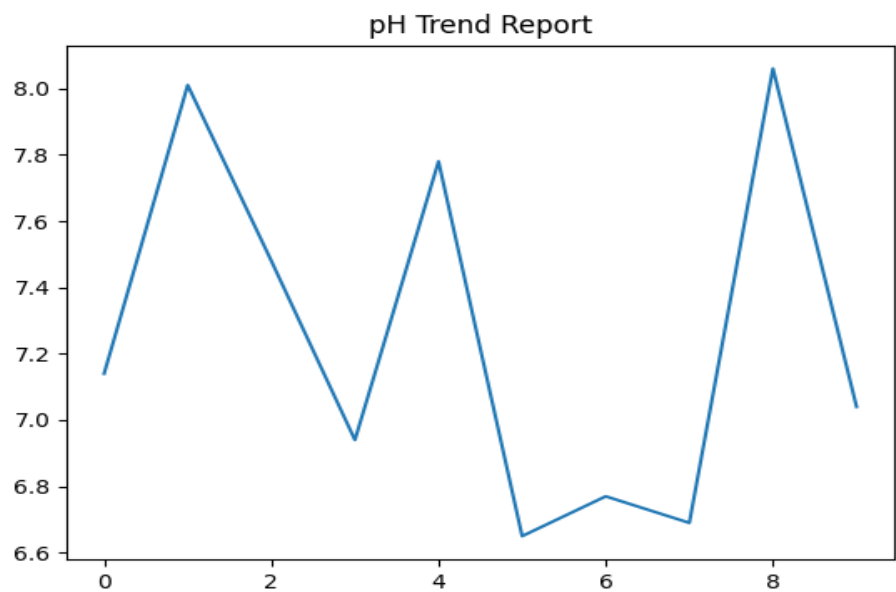

Graph: Last 10 pH Readings

System: Water Quality Management Prototype