

Water Quality Full Report


Generated: 2026-02-13 00:05:14.008591

Latest pH: 6.9

Turbidity: 9.6

TDS: 355.17

Temperature: 20.8

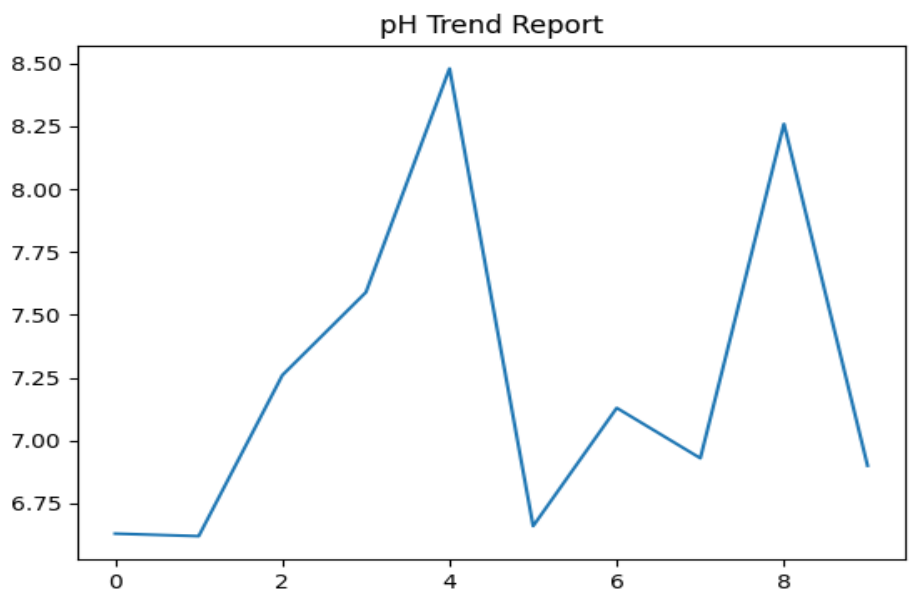

Graph: Last 10 pH Readings

System: Water Quality Management Prototype