
bsds_2018 | Controlled module ablation


Original RGB



GT union (display only)

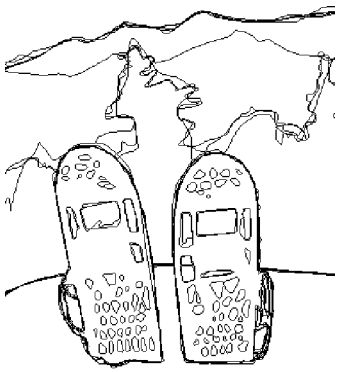


Gray FFT

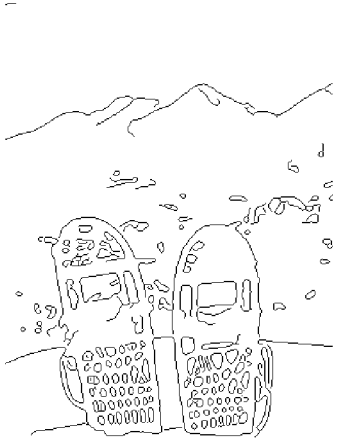


P 73.9% | R 80.9% | F1 77.2%

Gray FFT + phase

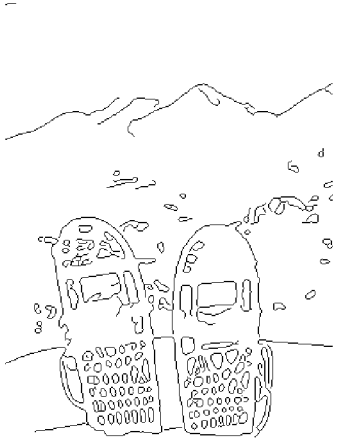


P 75.4% | R 79.9% | F1 77.6%

RGB FFT

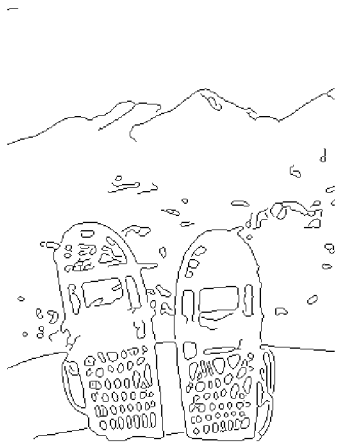


P 74.2% | R 80.9% | F1 77.4%

RGB FFT + phase

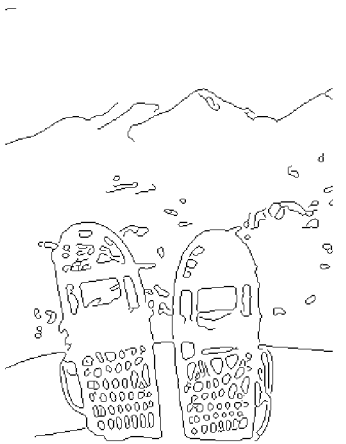

P 75.4% | R 79.2% | F1 77.2%

RGB + phase + weak gate

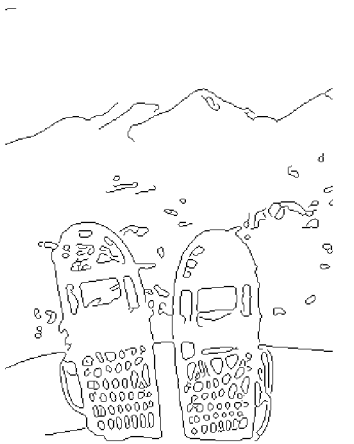

P 76.2% | R 79.2% | F1 77.6%

GT union is display-only. All scores use individual original annotations and the official matcher.