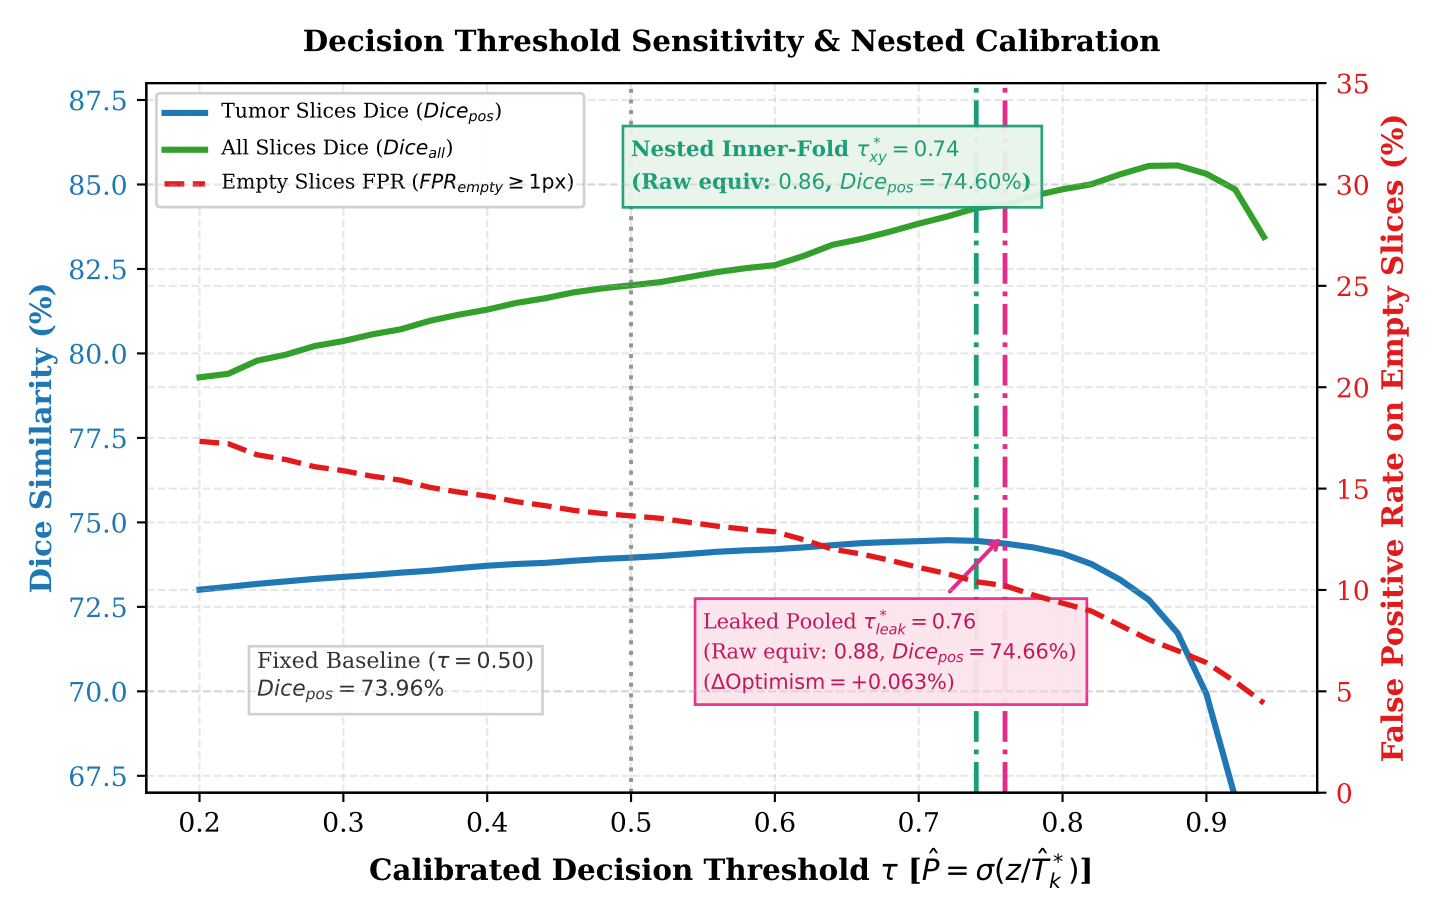
Decision Threshold Sensitivity & Nested Calibration
Tumor Slices Dice ($Dice_{pos}$)
All Slices Dice ($Dice_{all}$)
Empty Slices FPR ($FPR_{empty} \geq 1$px)
Nested Inner-Fold $\tau^*_{xy} = 0.74$
(Raw equiv: 0.86, $Dice_{pos} = 74.60\%$)
Leaked Pooled $\tau^*_{leak} = 0.76$
(Raw equiv: 0.88, $Dice_{pos} = 74.66\%$)
(ΔOptimism = +0.063%)
Fixed Baseline ($\tau = 0.50$)
$Dice_{pos} = 73.96\%$
Dice Similarity (%)
False Positive Rate on Empty Slices (%)
Calibrated Decision Threshold τ [$\hat{P} = \sigma(z/\hat{T}^*_k)$]
87.5
85.0
82.5
80.0
77.5
75.0
72.5
70.0
67.5
35
30
25
20
15
10
5
0
0.2
0.3
0.4
0.5
0.6
0.7
0.8
0.9