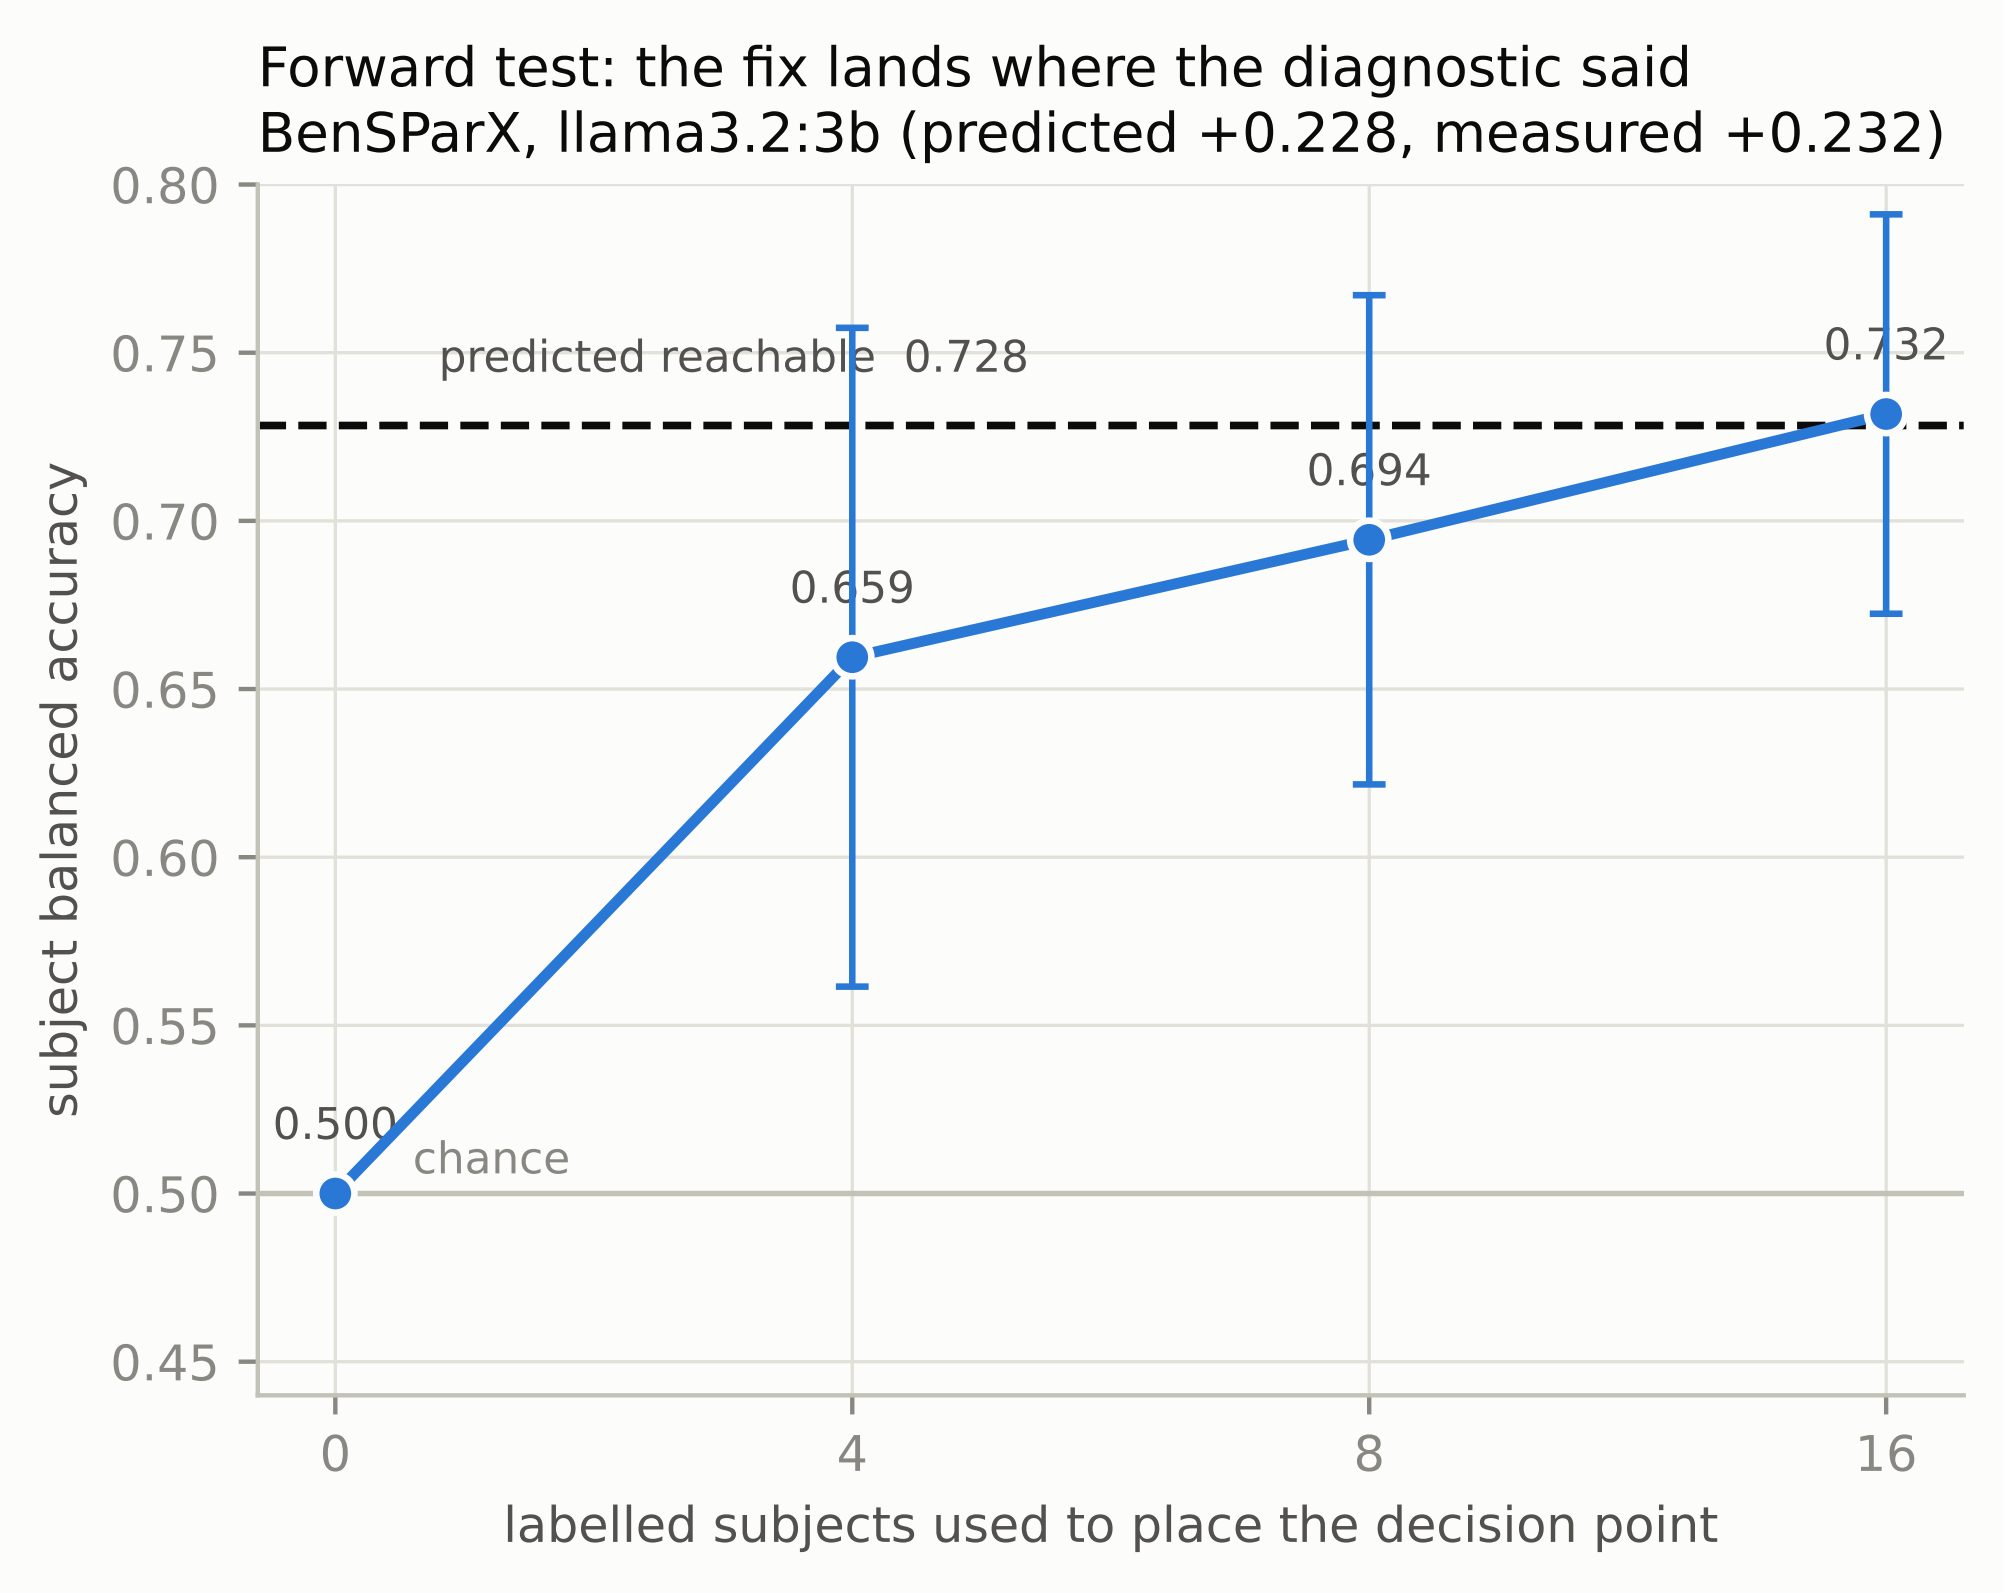
Forward test: the fix lands where the diagnostic said
BenSParX, llama3.2:3b (predicted +0.228, measured +0.232)
0.80
0.75
0.70
0.65
0.60
0.55
0.50
0.45
subject balanced accuracy
predicted reachable 0.728
0.500
chance
0.659
0.694
0.732
0
4
8
16
labelled subjects used to place the decision point