



Contactor connected externally to board through lead wiring to allow for greater isolation between HV and LV sides. The board connection of the contactors is seen through the 3 pin connections below, each containing a separate power connection to adhere to the 300V rating limit of the connectors.

HV Power Connections:

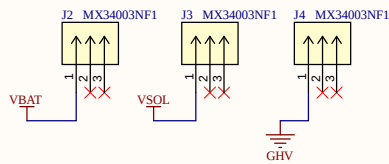


LV Power Connection:




Ittransient = 100 mA
 $\Delta t = 1 \text{ ms}$
 Allowed drop = 0.5 V
 $C = (0.1 \times 0.001) / 0.5 = 200 \mu\text{F}$
 Standard value is 220uF - 50V rated

Status LED to make sure atleast 100mW of power is drawn from the converter.
 $(V_{\text{supply}} - V_f) / I_f = R$
 $R = (5 - 2.2) / 0.02$
 $R = 140 \Omega$

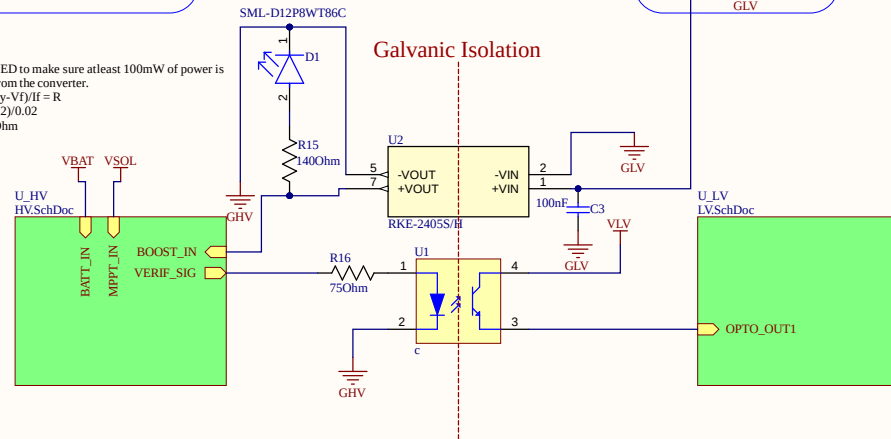

Title: *		Revision:*	
Project:		Design Engineer:	
Size: A3	Sheet 1 of 3		
Date: 27/04/2026			
File:			

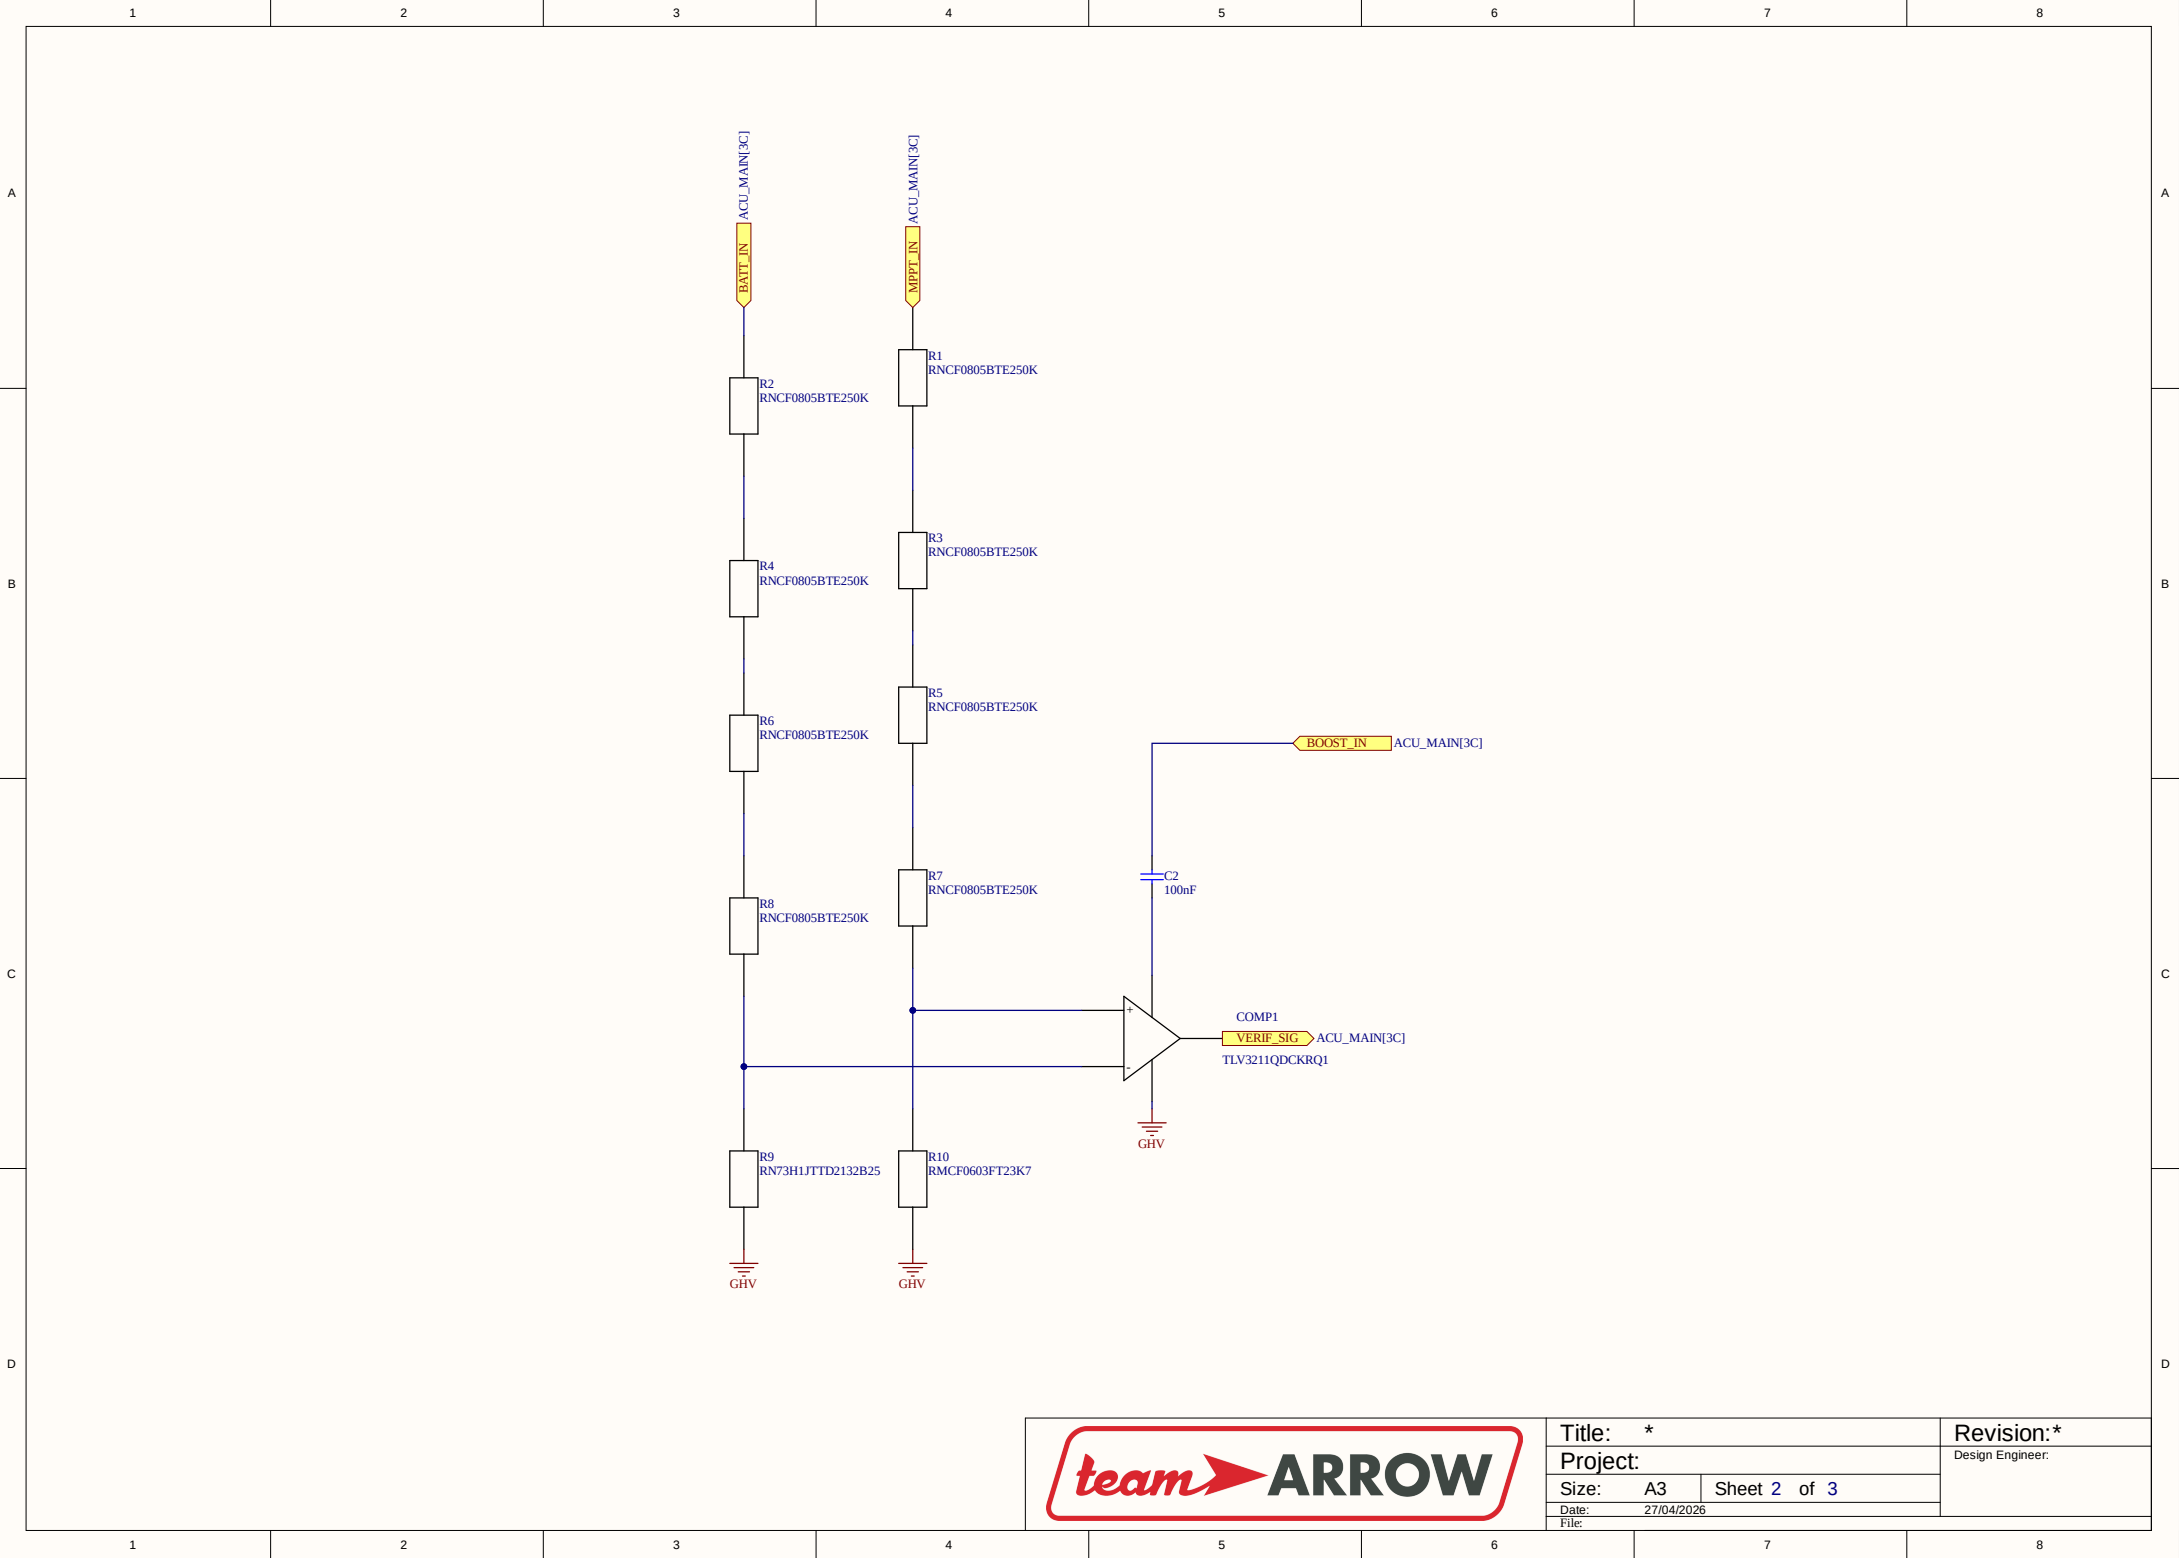

Title: *		Revision:*		
Project:		Design Engineer:		
Size:	A3			Sheet 2 of 3
Date:	27/04/2026			
File:				



Title: *		Revision:*
Project:		Design Engineer:
Size: A3	Sheet 3 of 3	
Date:	27/04/2026	
File:		

Board Stack Report