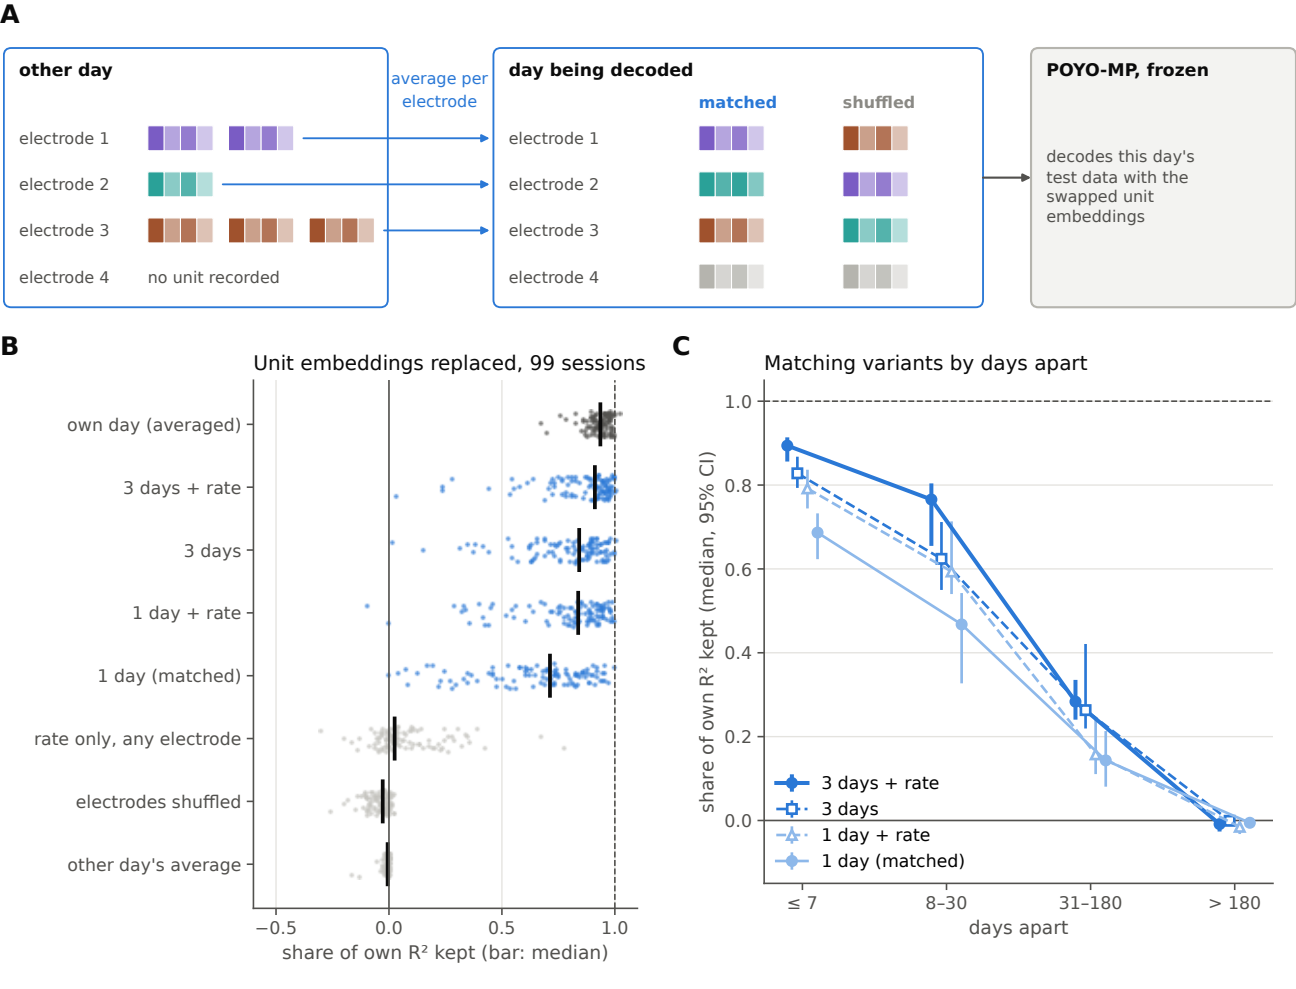
A
other day
electrode 1
electrode 2
electrode 3
electrode 4
no unit recorded
average per electrode
day being decoded
matched
shuffled
electrode 1
electrode 2
electrode 3
electrode 4
POYO-MP, frozen
decodes this day's test data with the swapped unit embeddings
B
Unit embeddings replaced, 99 sessions
own day (averaged)
3 days + rate
3 days
1 day + rate
1 day (matched)
rate only, any electrode
electrodes shuffled
other day's average
−0.5
0.0
0.5
1.0
share of own R² kept (bar: median)
C
Matching variants by days apart
share of own R² kept (median, 95% CI)
1.0
0.8
0.6
0.4
0.2
0.0
3 days + rate
3 days
1 day + rate
1 day (matched)
≤ 7
8–30
31–180
> 180
days apart