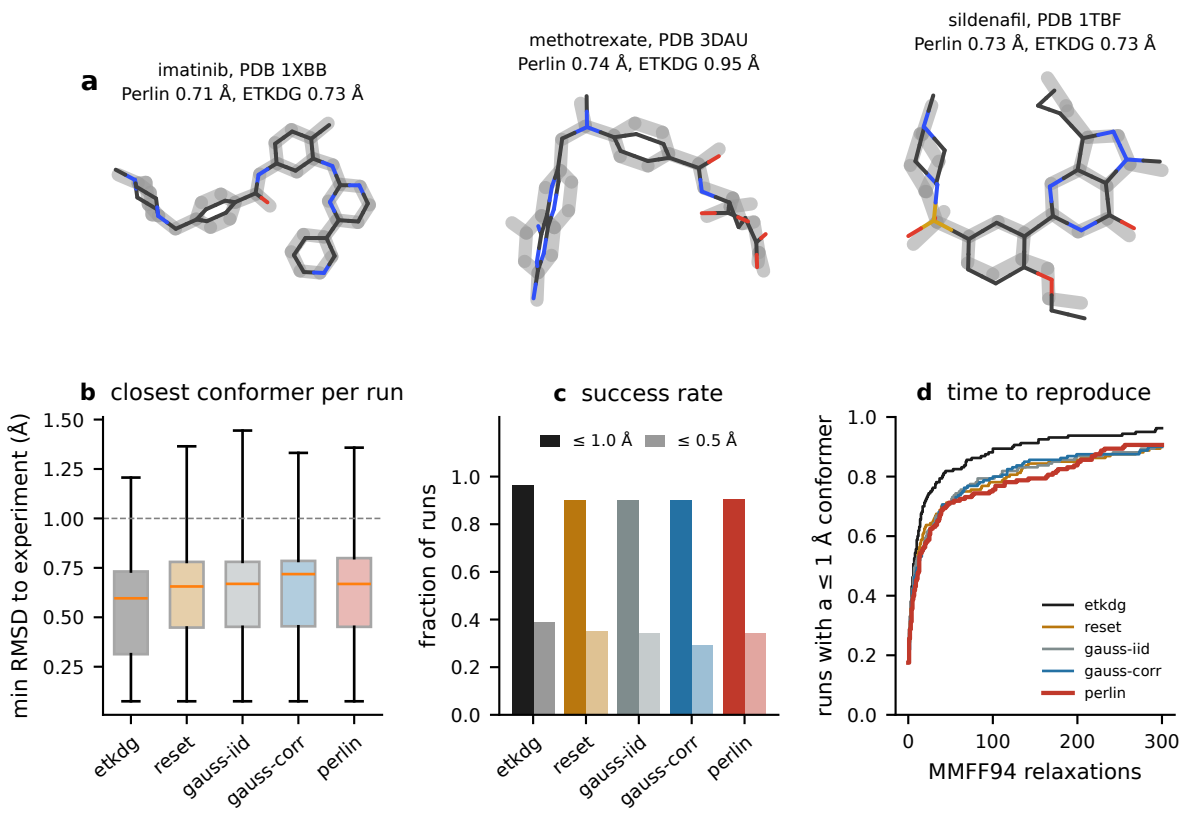
a
imatinib, PDB 1XBB
Perlin 0.71 Å, ETKDG 0.73 Å
methotrexate, PDB 3DAU
Perlin 0.74 Å, ETKDG 0.95 Å
sildenafil, PDB 1TBF
Perlin 0.73 Å, ETKDG 0.73 Å
b closest conformer per run
min RMSD to experiment (Å)
1.50
1.25
1.00
0.75
0.50
0.25
etkdg
reset
gauss-iid
gauss-corr
perlin
c success rate
≤ 1.0 Å
≤ 0.5 Å
fraction of runs
1.0
0.8
0.6
0.4
0.2
0.0
etkdg
reset
gauss-iid
gauss-corr
perlin
d time to reproduce
runs with a ≤ 1 Å conformer
1.0
0.8
0.6
0.4
0.2
0.0
etkdg
reset
gauss-iid
gauss-corr
perlin
0
100
200
300
MMFF94 relaxations