
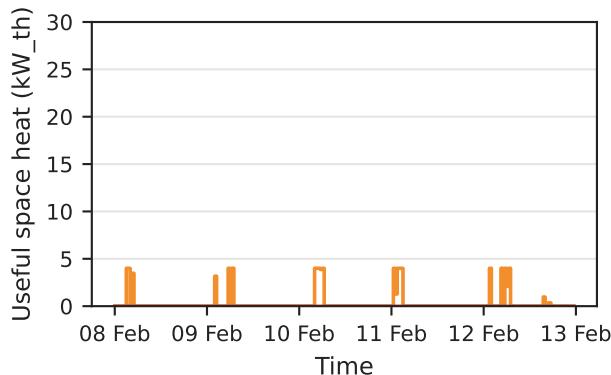


Representative HHP operation in high- and low-thermal-resistance dwellings



A. High thermal resistance

Dwelling 55: $R=0.0209$ K/W, $HTC=47.8$ W/K

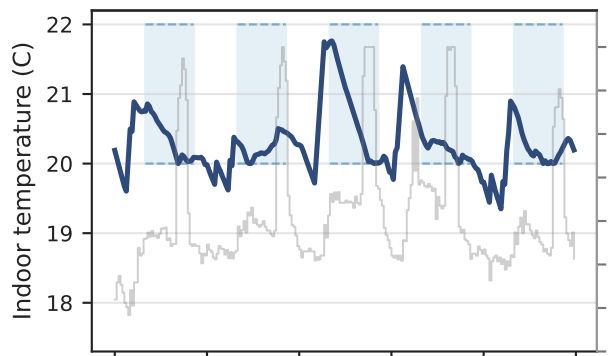

B. Low thermal resistance

Dwelling 93: $R=0.0022$ K/W, $HTC=461.8$ W/K

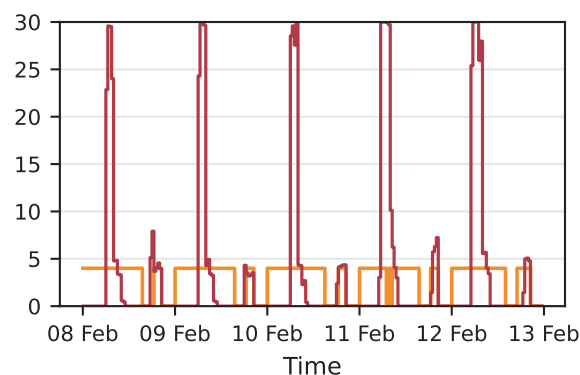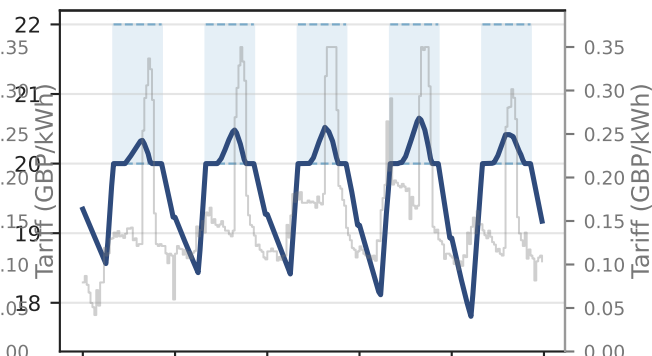

Indoor temperature Comfort band Electricity tariff HP space heat Boiler space heat