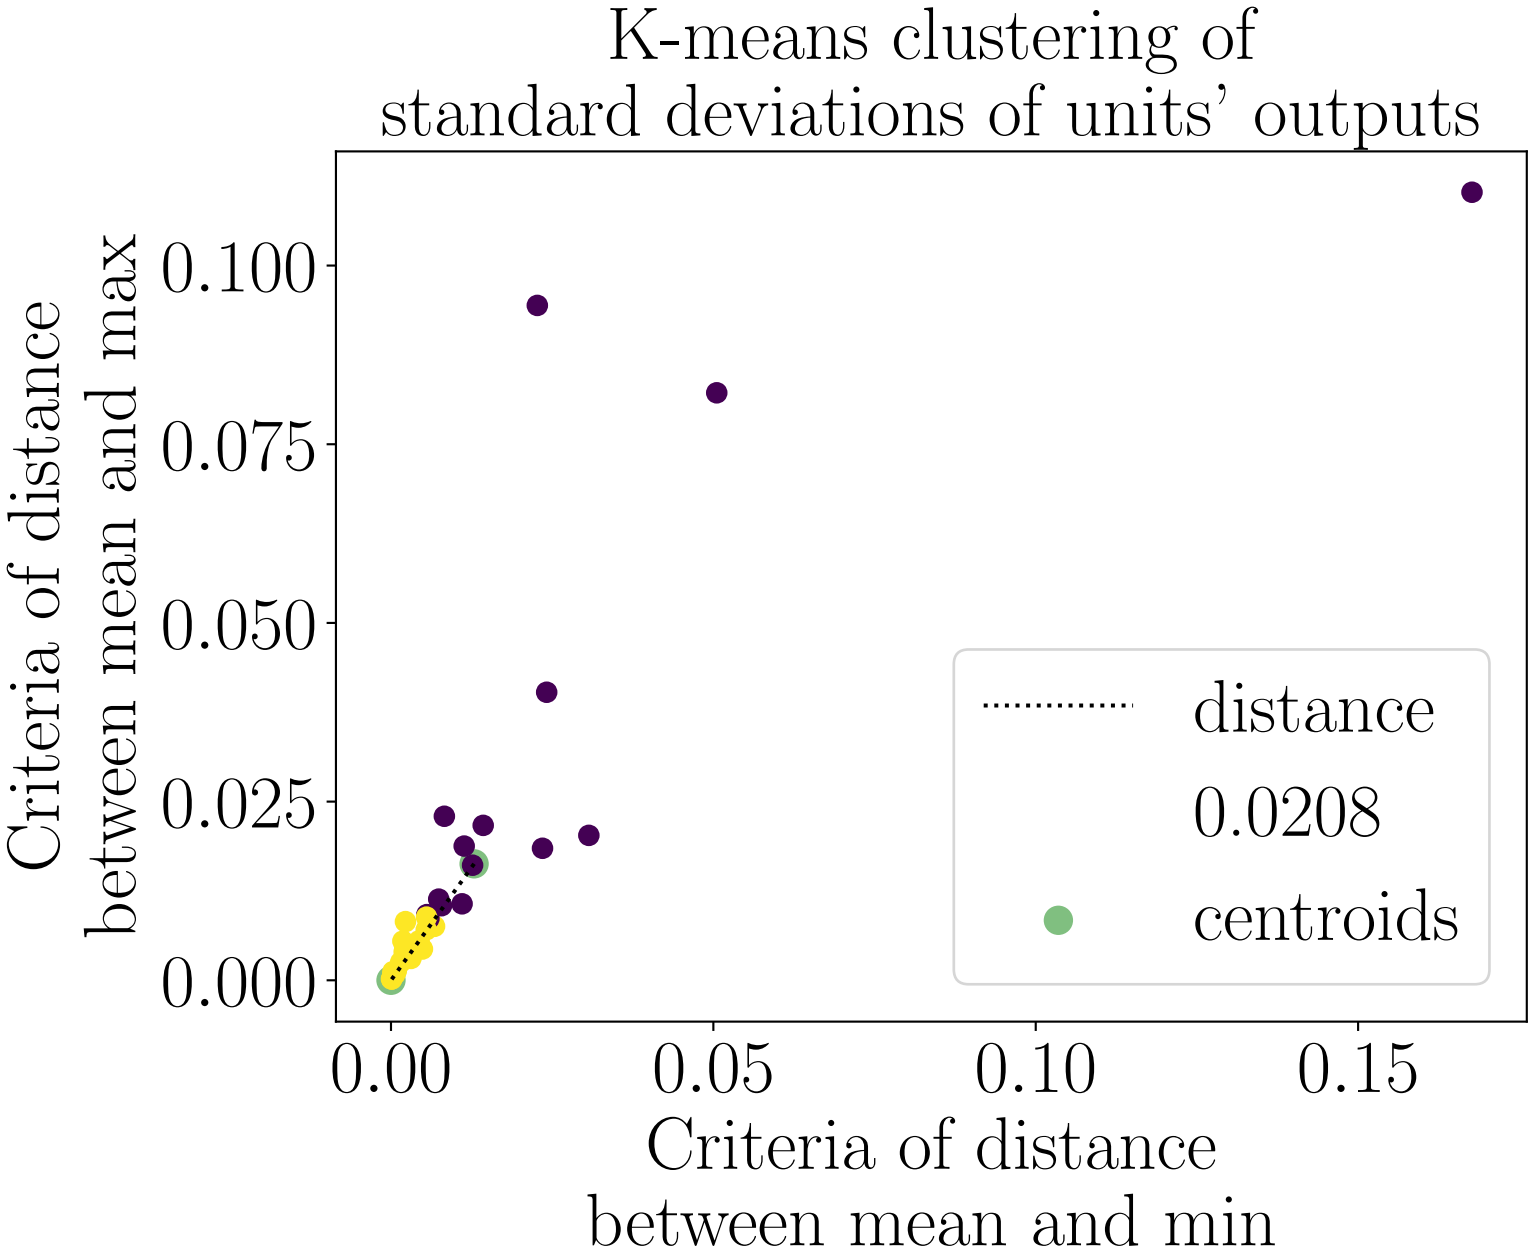
K-means clustering of
standard deviations of units' outputs
Criteria of distance
between mean and max
0.100
0.075
0.050
0.025
0.000
0.00
0.05
0.10
0.15
Criteria of distance
between mean and min
distance
0.0208
centroids