


Kajaani reference system and failure paths

20 MW IT / 25 MW facility | Initial concept | All equipment capacities below are planning targets

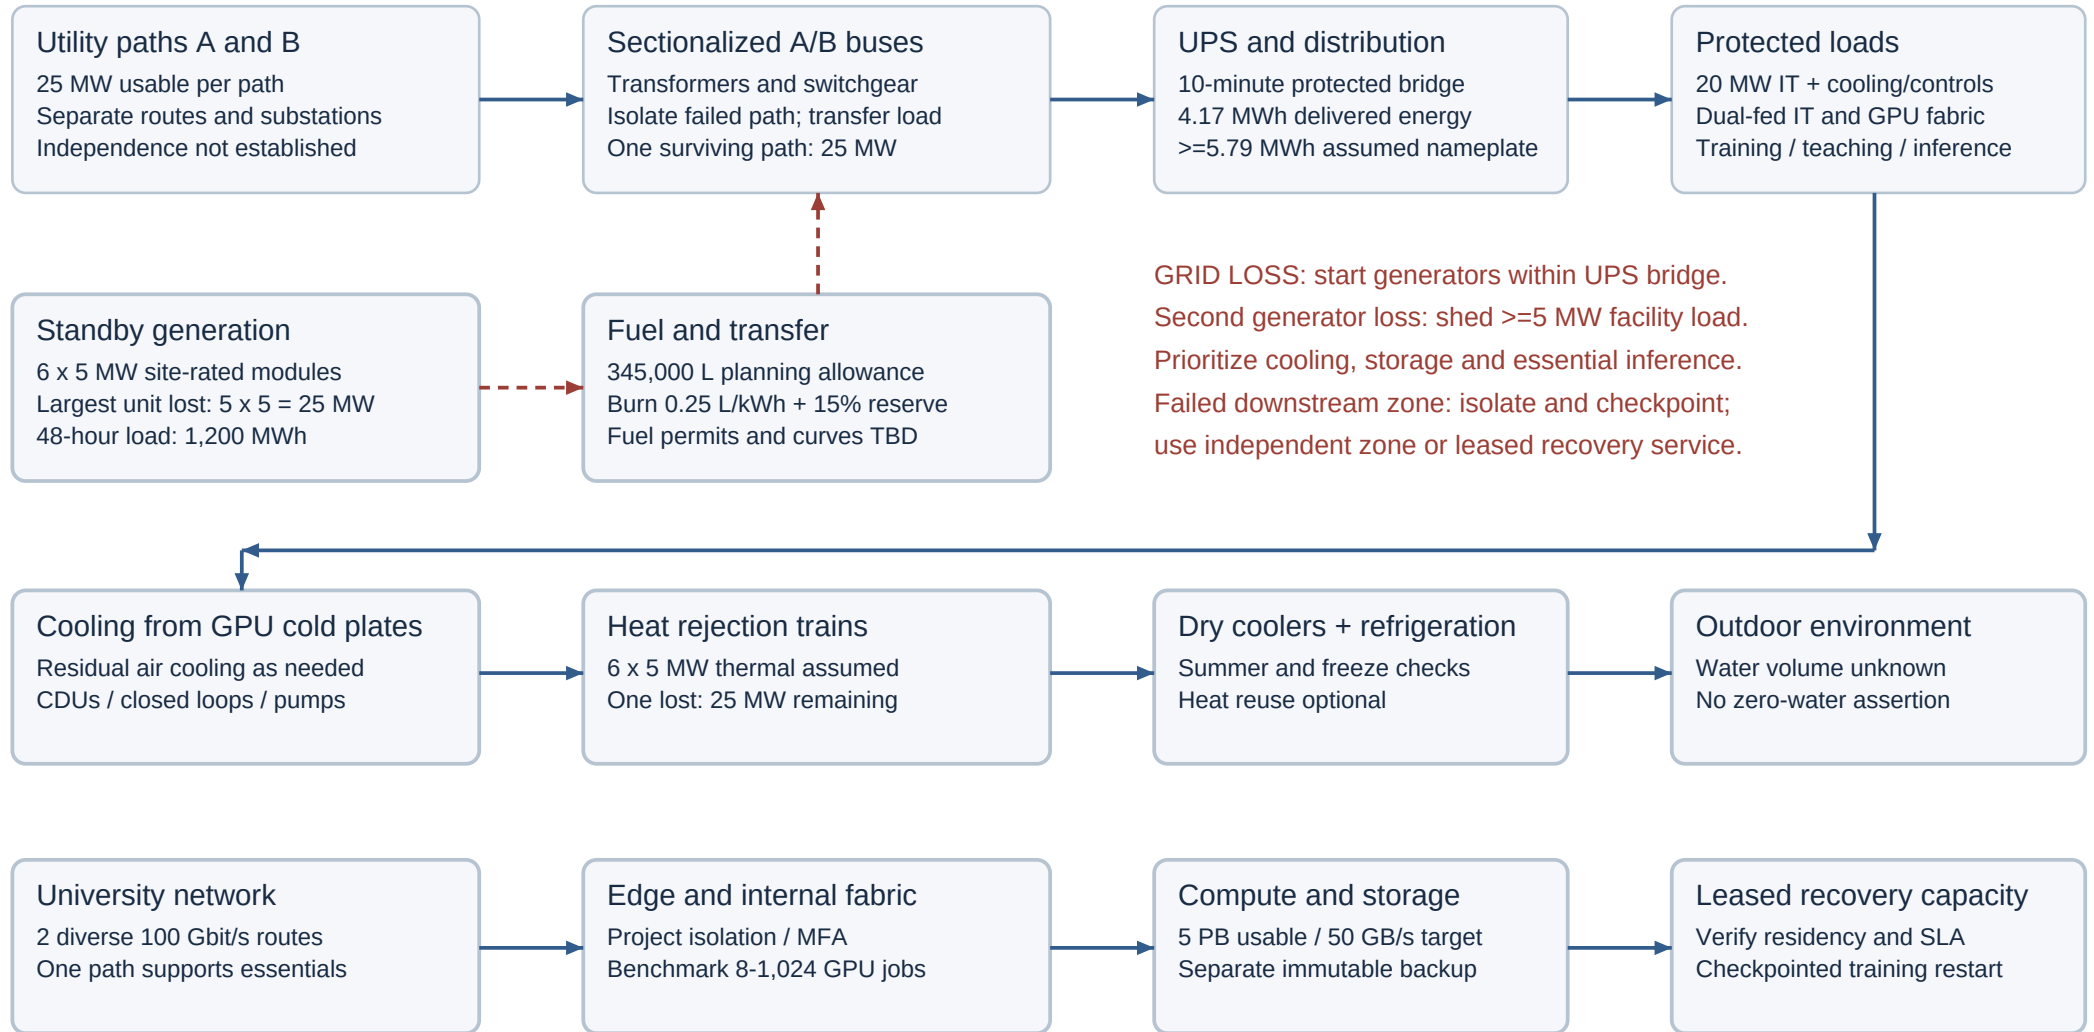

Blue: normal power/heat/data paths. Dashed red: backup/failure response. Hybrid phase must be resized and revalidated.

Uptime is not demonstrated: verify protection, transfer tests, derating, fuel, cooling continuity, shared failures and permits.

Basis: assignment assumptions; DOE/FEMP design guide [S3]; NVIDIA system-power reference [S15]. See Decision dossier.