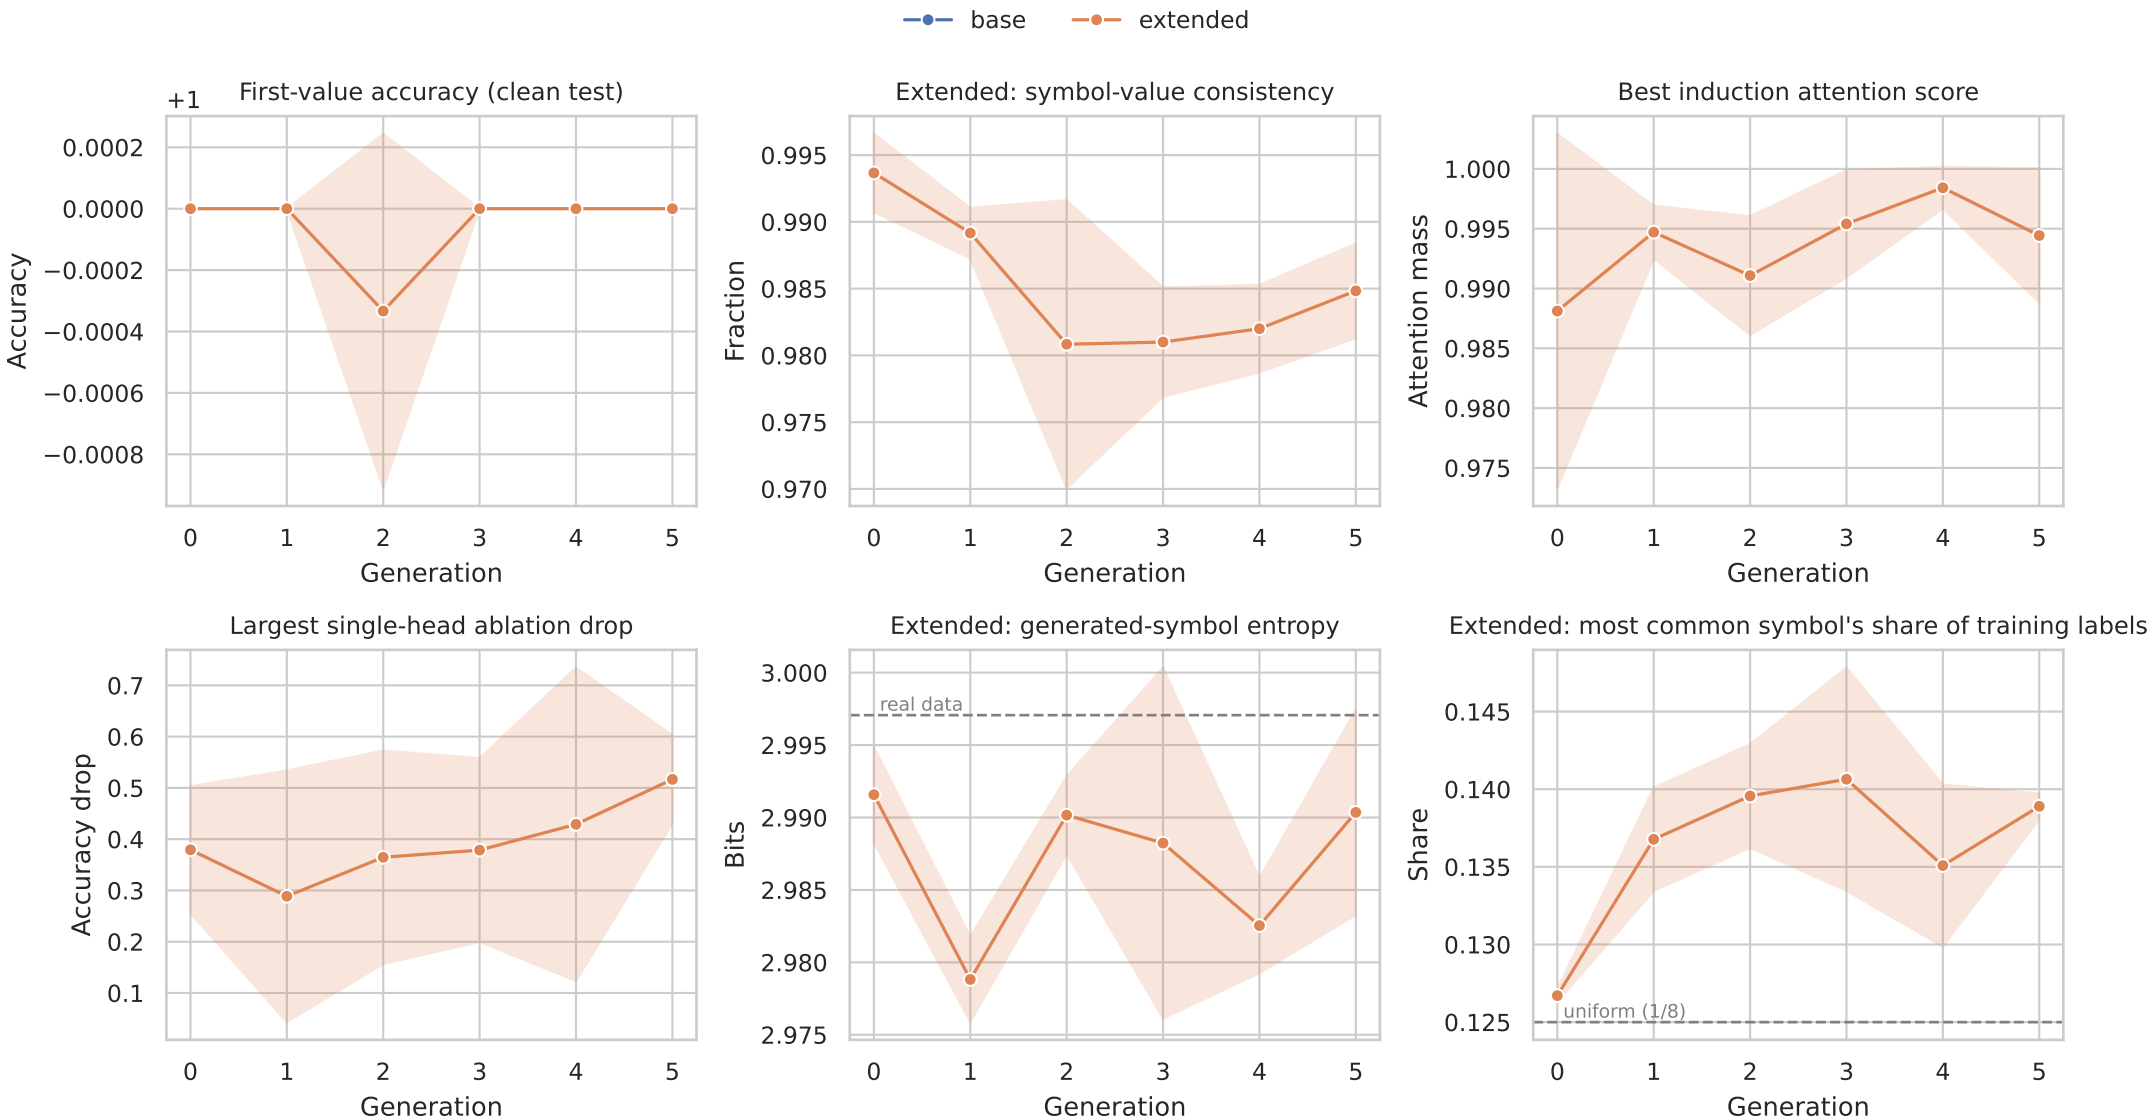
base
extended
First-value accuracy (clean test)
+1
Accuracy
0.0002
0.0000
−0.0002
−0.0004
−0.0006
−0.0008
0
1
2
3
4
5
Generation
Extended: symbol-value consistency
Fraction
0.995
0.990
0.985
0.980
0.975
0.970
Best induction attention score
Attention mass
1.000
0.995
0.990
0.985
0.980
0.975
Largest single-head ablation drop
Accuracy drop
0.7
0.6
0.5
0.4
0.3
0.2
0.1
Extended: generated-symbol entropy
Bits
3.000
2.995
2.990
2.985
2.980
2.975
real data
Extended: most common symbol's share of training labels
Share
0.145
0.140
0.135
0.130
0.125
uniform (1/8)