

**Test Protocol Execution Report
Clinical Library (Part 2)
AOLife Galvani Library**

Confidential, Not for Recirculation

*Document #: XQMS-2718
Rev #: 00*



Date



Date

TABLE OF CONTENTS

1. Environmental Detail 1

2. Test Execution Summary 3

3. Test Case: 1941-Document Revisioning 4

1. Environmental Detail

1.1. Automation Model Version Release Details

Model Name	xLM For AOLife Galvani Library
Model Version	1.0.0

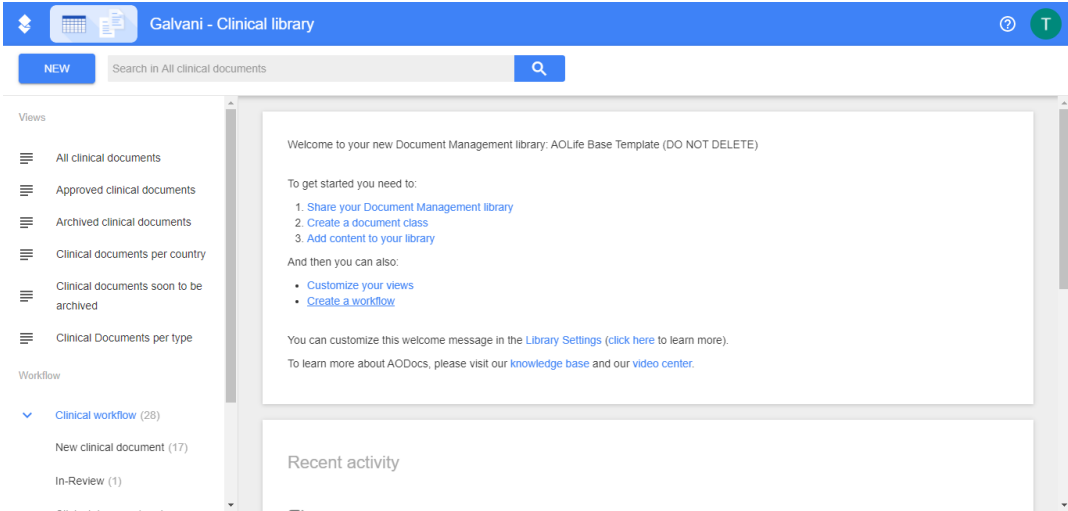
1.2. Test Execution Environment Details

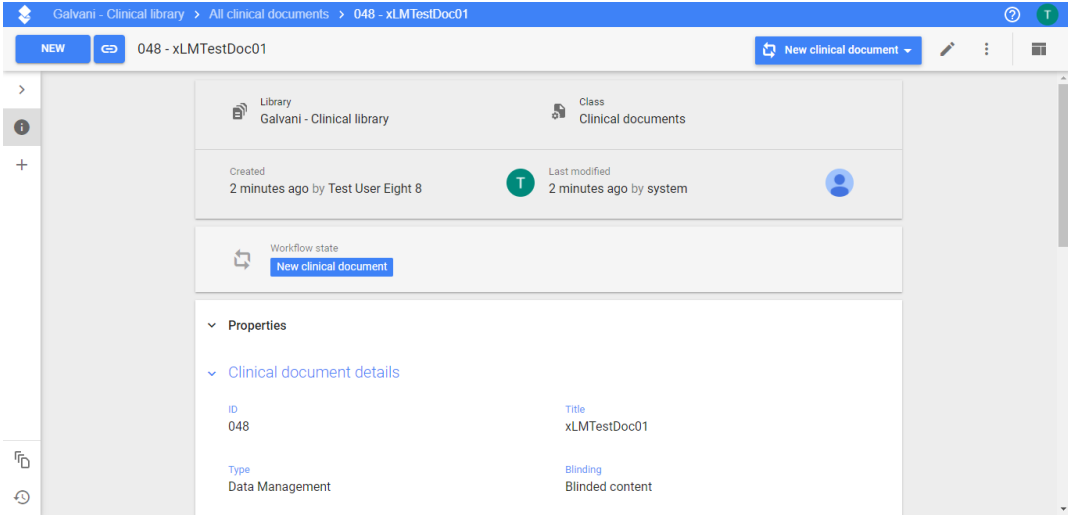
Execution Time Zone	(UTC-08:00) Pacific Time (US & Canada)
Application Name	AODocs
Application URL	https://aodocs.altirnao.com/?locale=en_US&aodocs-domain=xlm.aodocs.net
Application Version	53.10.1
Browser	chrome 86.0.4240.111
OS Version	Microsoft Windows NT 10.0.17763.0
Server IP	NA
Plugins Used	Selenium,xUnit,C#.NET
Login User ID	NA
Execution Start Date/Time	2020-11-04 22:21:15:643
Execution End Date/Time	2020-11-04 22:48:39:795
Execution Duration	0 hours, 27 minutes, 24 seconds, 152 milliseconds

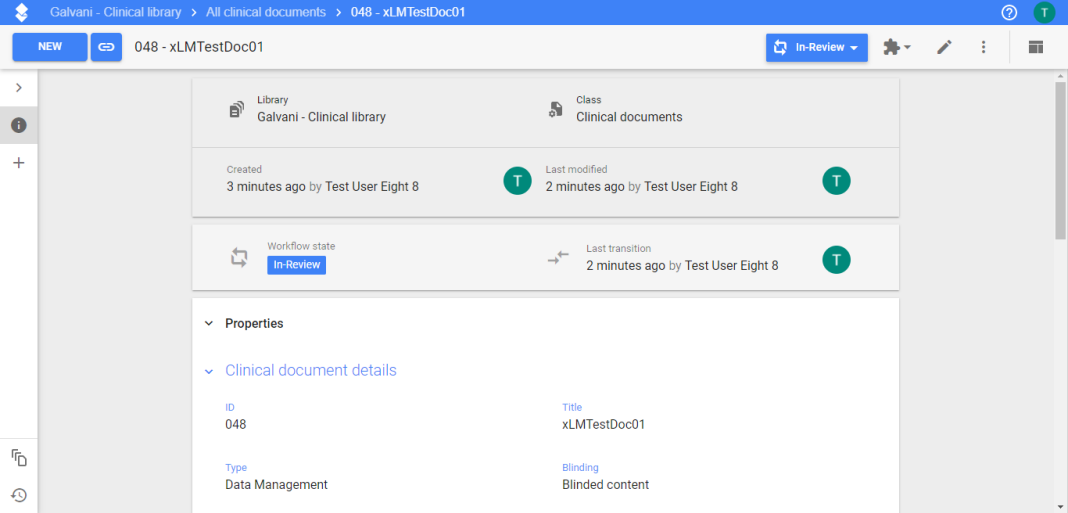
Execution Status	Completed
Number of Tests Passed	1
Number of Tests Failed	0
Number of Total Tests	1

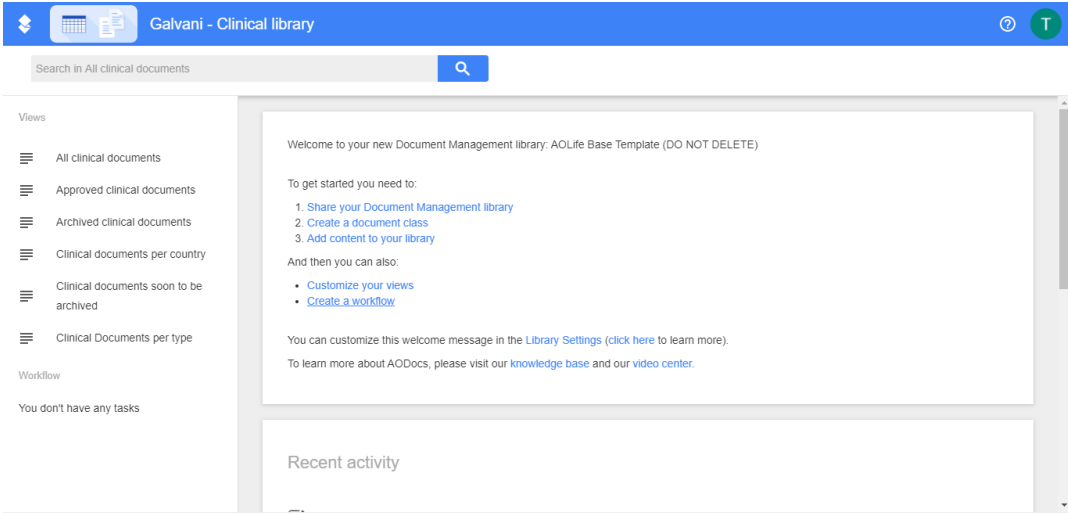
2. Test Execution Summary

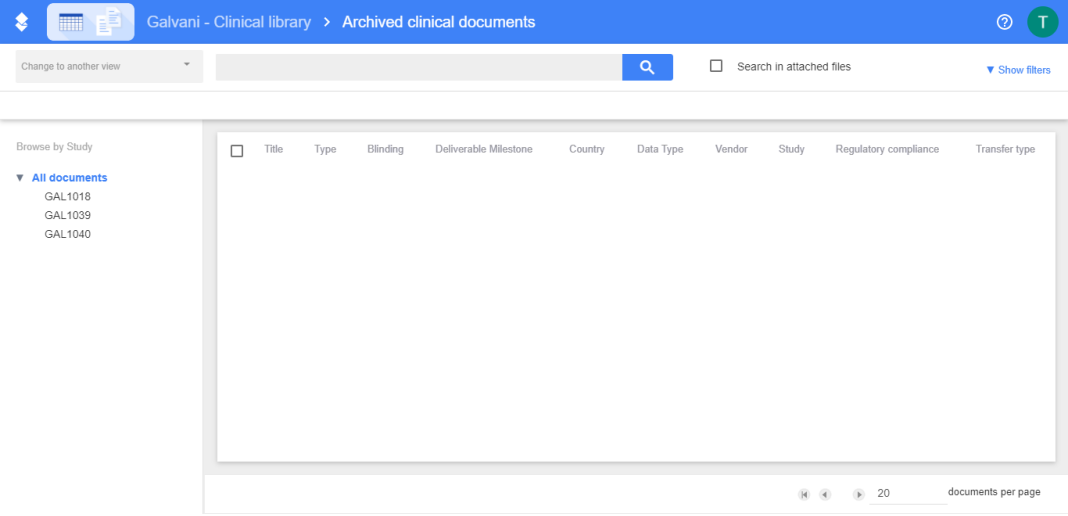
Test Case Title	Test Case Status	Test Case Results
1941-Document Revisioning	Pass	A clinical document can be revised, and a new version of the document is created.

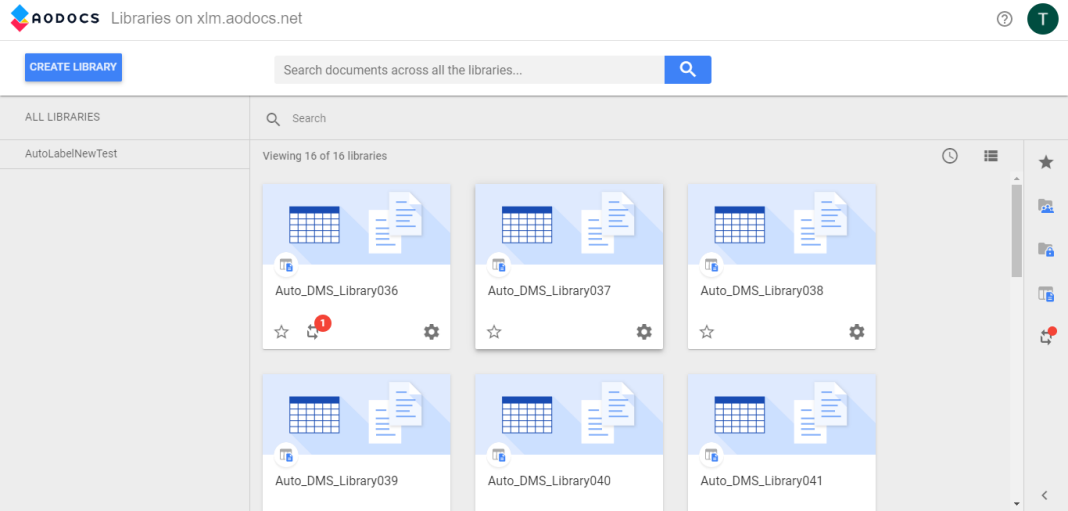
#	Step Description	Expected Result	Actual Result	Status
2	Search for the library 'Galvani - Clinical library' and click on it.	User is navigated to 'Galvani - Clinical library' page.	<div>2020-11-04 22:23:06:772</div> <div>User is navigated to 'Galvani - Clinical library' page.</div> <div>2020-11-04 22:23:06:772</div> <div>Screenshot taken:</div> <div></div>	Pass

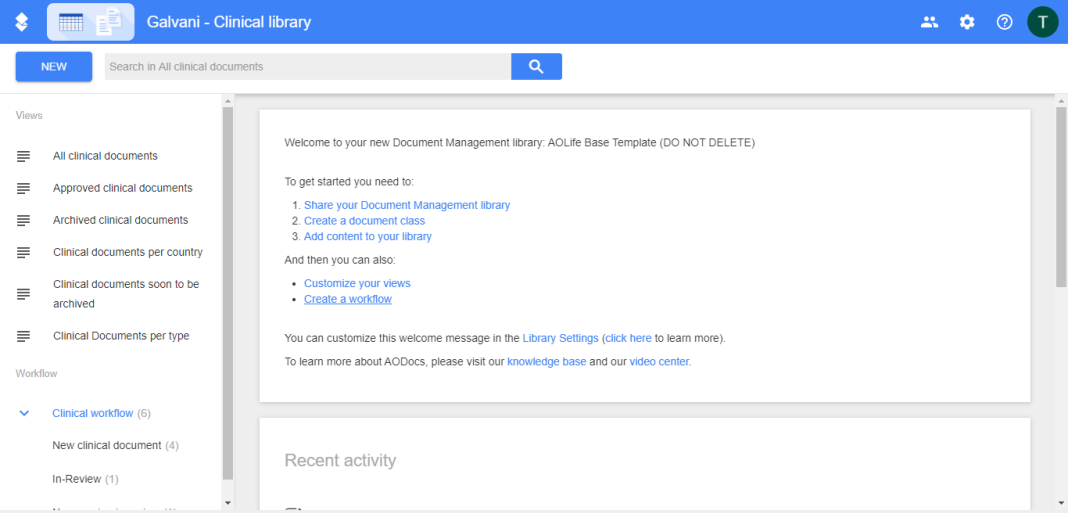
#	Step Description	Expected Result	Actual Result	Status
3	Enter the following field values: Library name = Galvani - Clinical library; Document Class = Clinical documents; Title = xLMTestDoc01; Type = Data Management; Blinding = Blinded content; Study = GAL1040; Deliverable Milestone = End of study; Indication = Rheumatoid Arthritis; Regulatory compliance = Non GxP; Archival Date = Next Year's Date; Clinical Manager = test-user-8@xlm.aodocs.net; Clinical Reviewers1 = test-user-6@xlm.aodocs.net; Clinical Reviewers2 = test-user-8@xlm.aodocs.net; Clinical Uploaders = test-user-5@xlm.aodocs.net;	Document is in 'New clinical document' state.	<div>2020-11-04 22:23:45:959</div> <div>2020-11-04 22:23:45:959</div> <div>Document is in 'New clinical document' state.</div> <div>Screenshot taken:</div> <div></div>	Pass

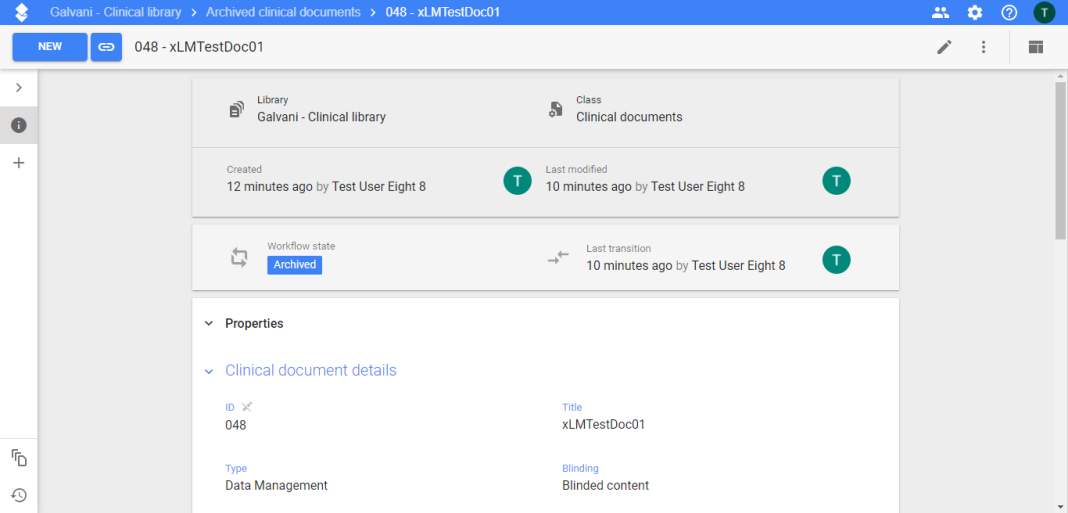
#	Step Description	Expected Result	Actual Result	Status
5	Leave a comment 'Test' and click on submit.	The Clinical document is transitioned to 'In-Review' workflow state.	<div>2020-11-04 22:25:03:421</div> <div>The Clinical document is transitioned to 'In-Review' workflow state.</div> <div>2020-11-04 22:25:03:421</div> <div>Screenshot taken:</div> <div></div>	Pass

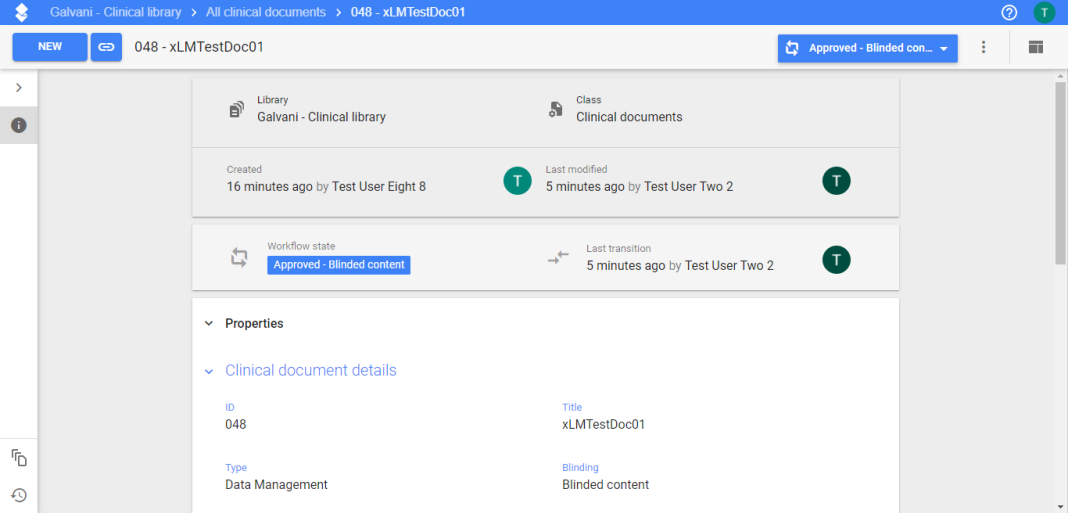
#	Step Description	Expected Result	Actual Result	Status
8	Navigate to the 'Galvani - Clinical library'.	'Galvani - Clinical library' page is displayed.	<div>2020-11-04 22:28:12:716</div> <div>'Galvani - Clinical library' page is displayed.</div> <div>2020-11-04 22:28:12:716</div> <div>Screenshot taken:</div> <div></div>	Pass

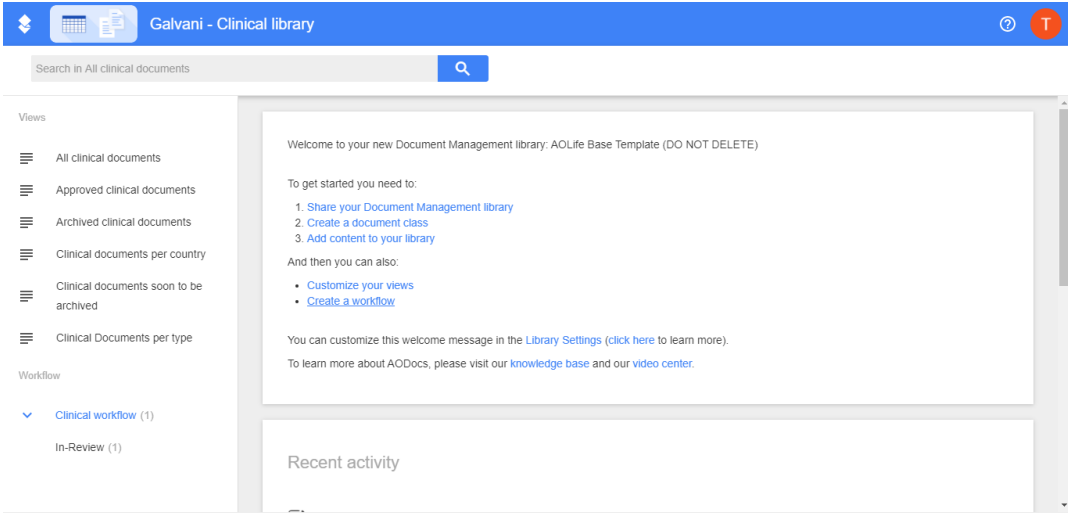
#	Step Description	Expected Result	Actual Result	Status
9	Select 'Archived clinical documents' from the views navigation panel.	No documents are displayed under the 'Archived clinical documents' view.	<div>2020-11-04 22:28:29:018</div> <div>No documents are displayed under the 'Archived clinical documents' view.</div> <div>2020-11-04 22:28:29:018</div> <div>Screenshot taken:</div> <div></div>	Pass

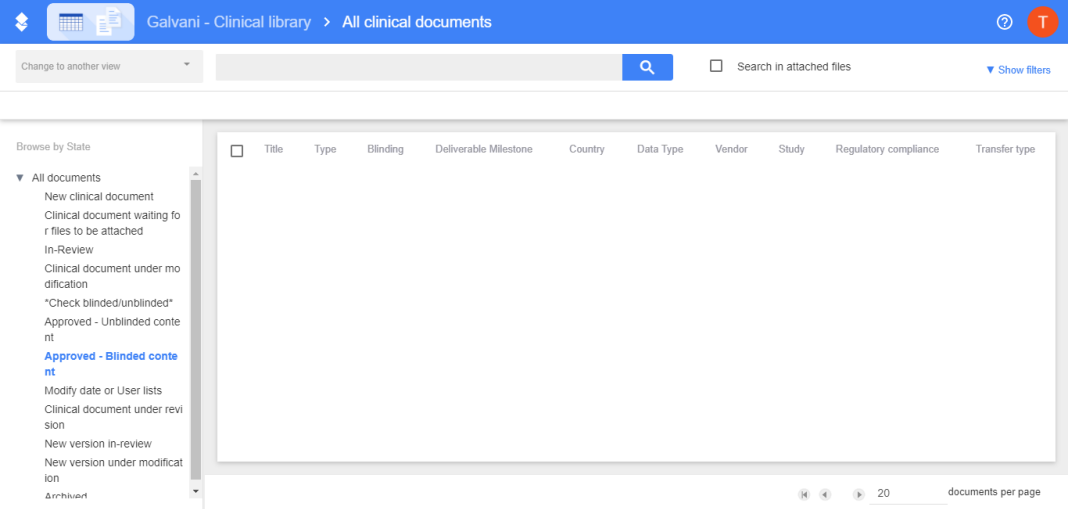
#	Step Description	Expected Result	Actual Result	Status
14	Logout and Login as the 'Test User 2'.	Login is successful for 'Test User 2'.	<div>2020-11-04 22:32:06:847Login is successful for 'Test User 2'.</div> <div>2020-11-04 22:32:06:847Screenshot taken:</div> <div></div>	Pass

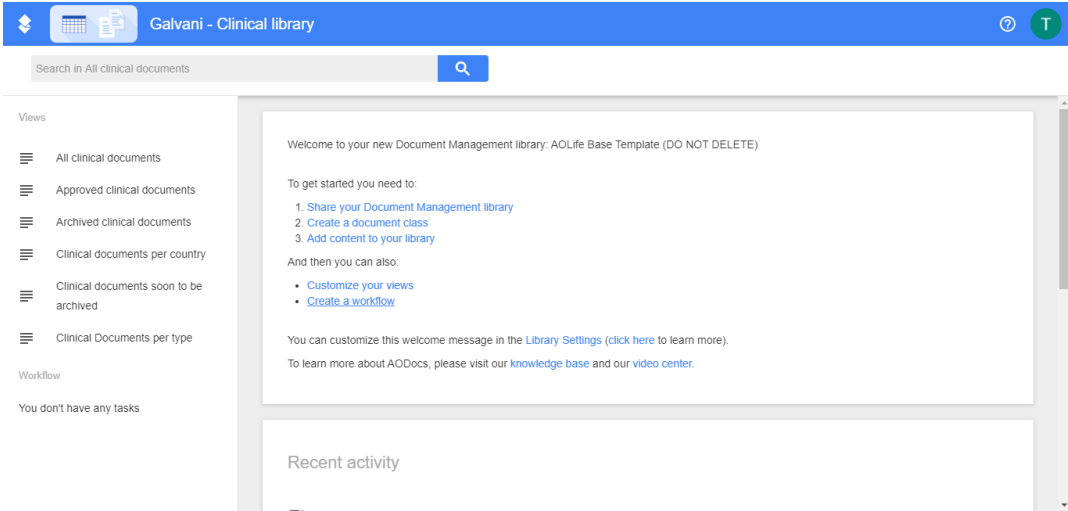
#	Step Description	Expected Result	Actual Result	Status
15	Navigate to the 'Galvani - Clinical library'.	'Galvani - Clinical library' page is displayed.	<div>2020-11-04 22:32:55:443</div> <div>'Galvani - Clinical library' page is displayed.</div> <div>2020-11-04 22:32:55:443</div> <div>Screenshot taken:</div> <div></div>	Pass

#	Step Description	Expected Result	Actual Result	Status
17	Select '048 - xLMTTestDoc01' document.	'048 - xLMTTestDoc01' page is displayed.	<div>2020-11-04 22:33:35:853'048 - xLMTTestDoc01' page is displayed.</div> <div>2020-11-04 22:33:35:853Screenshot taken:</div> <div></div>	Pass

#	Step Description	Expected Result	Actual Result	Status
22	Select '048 - xLMTestDoc01' document.	'048 - xLMTestDoc01' page is displayed.	<div>2020-11-04 22:37:25:322'048 - xLMTestDoc01' page is displayed.</div> <div>2020-11-04 22:37:25:322Screenshot taken:</div> <div></div>	Pass

#	Step Description	Expected Result	Actual Result	Status
31	Navigate to the 'Galvani - Clinical library'.	'Galvani - Clinical library' page is displayed.	<div>2020-11-04 22:46:24:665</div> <div>'Galvani - Clinical library' page is displayed.</div> <div>2020-11-04 22:46:24:665</div> <div>Screenshot taken:</div> <div></div>	Pass

#	Step Description	Expected Result	Actual Result	Status
32	Select 'All Clinical Documents -> Approved – Blinded Content' from the views navigation panel.Verify that the '048 - xLMTTestDoc01' is not displayed.	The document '048 - xLMTTestDoc01' is not displayed.	<div>2020-11-04 22:46:39:337</div> <div>The document '048 - xLMTTestDoc01' is not displayed.</div> <div>2020-11-04 22:46:39:337</div> <div>Screenshot taken:</div> <div></div>	Pass

#	Step Description	Expected Result	Actual Result	Status
34	Navigate to the 'Galvani - Clinical library'.	'Galvani - Clinical library' page is displayed.	<div>2020-11-04 22:48:27:630</div> <div>'Galvani - Clinical library' page is displayed.</div> <div>2020-11-04 22:48:27:630</div> <div>Screenshot taken:</div> <div></div>	Pass

Intentionally left blank