


Calibration Certificate

manufacturer:	BAPI		date:	1/29/2026
model number:	Ba/zpm/hr-nt-nd-bb		time:	4:15 pm
serial number:	PT2A		section:	14
calibration range:	0 - 10 in wc			
output signal:	0 - 10			
accuracy:	Thousandths		technicians:	
calibration station:	Inclined Manometer			
	indicator oil SG:	0.881		
	Hg SG:	13.55		
	pressure port:	1		
ambient temperature:	21.94 ± 0.02 °C			
barometric pressure:	30.51 ± 0.01 inches Hg			

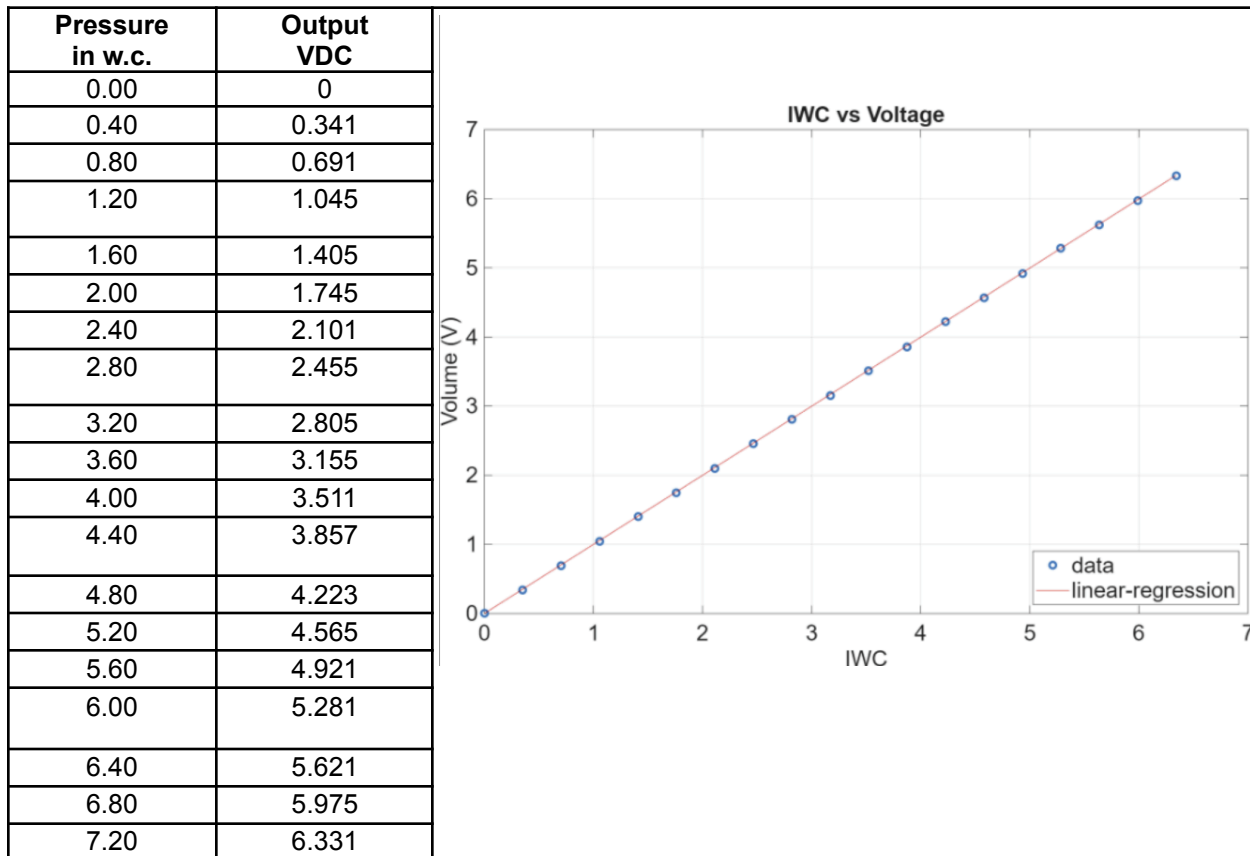

sensitivity, y/x:	0.9992	VDC per in w.c.
bias, y:	-0.0098	VDC
R ² :	1.0000	
sensitivity, x/y:	1.0008	in w.c. per VDC
bias, x:	0.0098	in w.c.