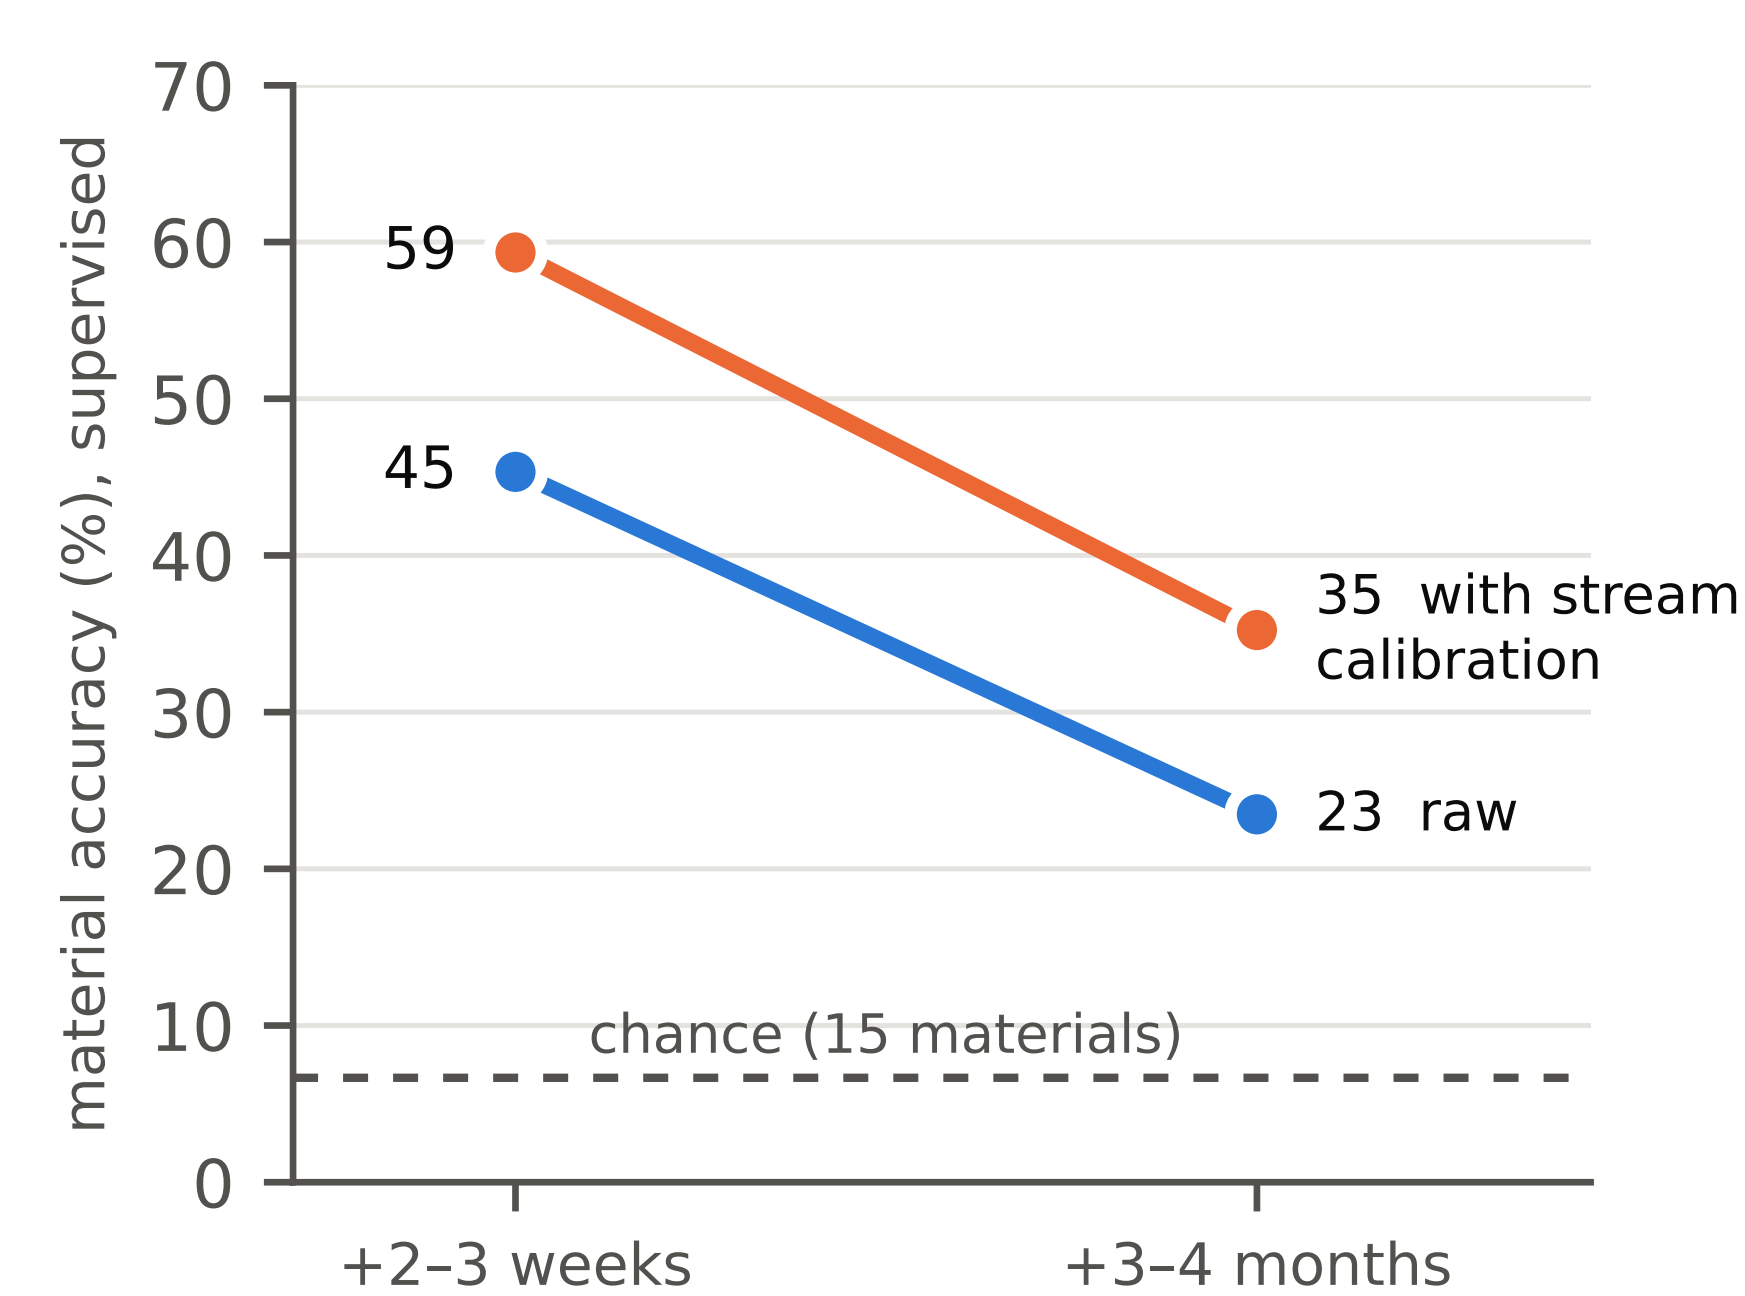
material accuracy (%), supervised
70
60
50
40
30
20
10
0
59
45
35 with stream calibration
23 raw
chance (15 materials)
+2–3 weeks
+3–4 months