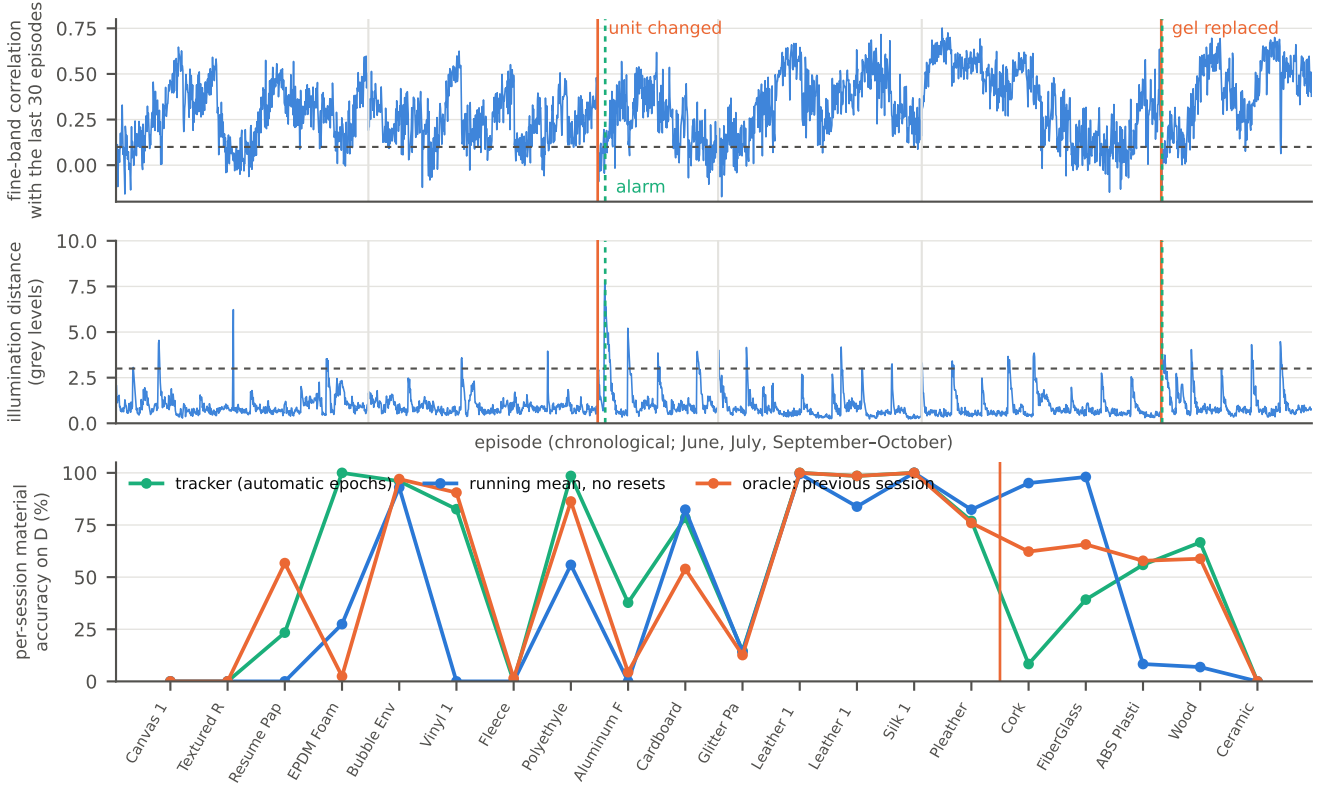

fine-band correlation
with the last 30 episodes
0.75
0.50
0.25
0.00
unit changed
alarm
gel replaced
illumination distance
(grey levels)
10.0
7.5
5.0
2.5
0.0
episode (chronological; June, July, September–October)
per-session material
accuracy on D (%)
100
75
50
25
0
tracker (automatic epochs)
running mean, no resets
oracle: previous session
Canvas 1
Textured R
Resume Pap
EPDM Foam
Bubble Env
Vinyl 1
Fleece
Polyethyle
Aluminum F
Cardboard
Glitter Pa
Leather 1
Leather 1
Silk 1
Pleather
Cork
FiberGlass
ABS Plasti
Wood
Ceramic