






Key


- 


Existing light fitting
- 


Existing light switch
- 


New light switch
- 


Existing Switched fused spur
- 


Proposed Switched fused spur
- 


Existing single or double switched socket - high level
- 


Existing single or double switched socket - low level
- 


New single or double switched socket outlet
- 


Single or double switched socket outlet - high level
- 


Single or double switched socket outlet - low level
- 


240v circuit board
- 


Isolation switch
- 


PIR presence detector
- 


Intruder alarm unit
- 


Existing wall mounted fan heater
- 


Existing electric panel heater
- 


Existing extractor fan
- 


New extractor fan
- 


Existing Fluorescent light fitting
- 


Proposed light fitting
- 


Denotes Emergency version of light fitting
- 


Fire Alarm Panel
- 


Fire alarm break glass
- 


Fire alarm sounder
- 


Existing emergency light fitting
- 


Smoke detector
- 


Heat detector
- 


CO2 Extinguisher
- 


Emergency Illuminated Fire Exit sign
- 


Fire alarm Panel
- 


Incoming water isolation
- 

Cooker switch
- 


Existing telephone outlet
- 

Proposed telephone outlet
- 

Existing IT Double Data Point
- 



Proposed IT Double Data Point
- 

Strip out item

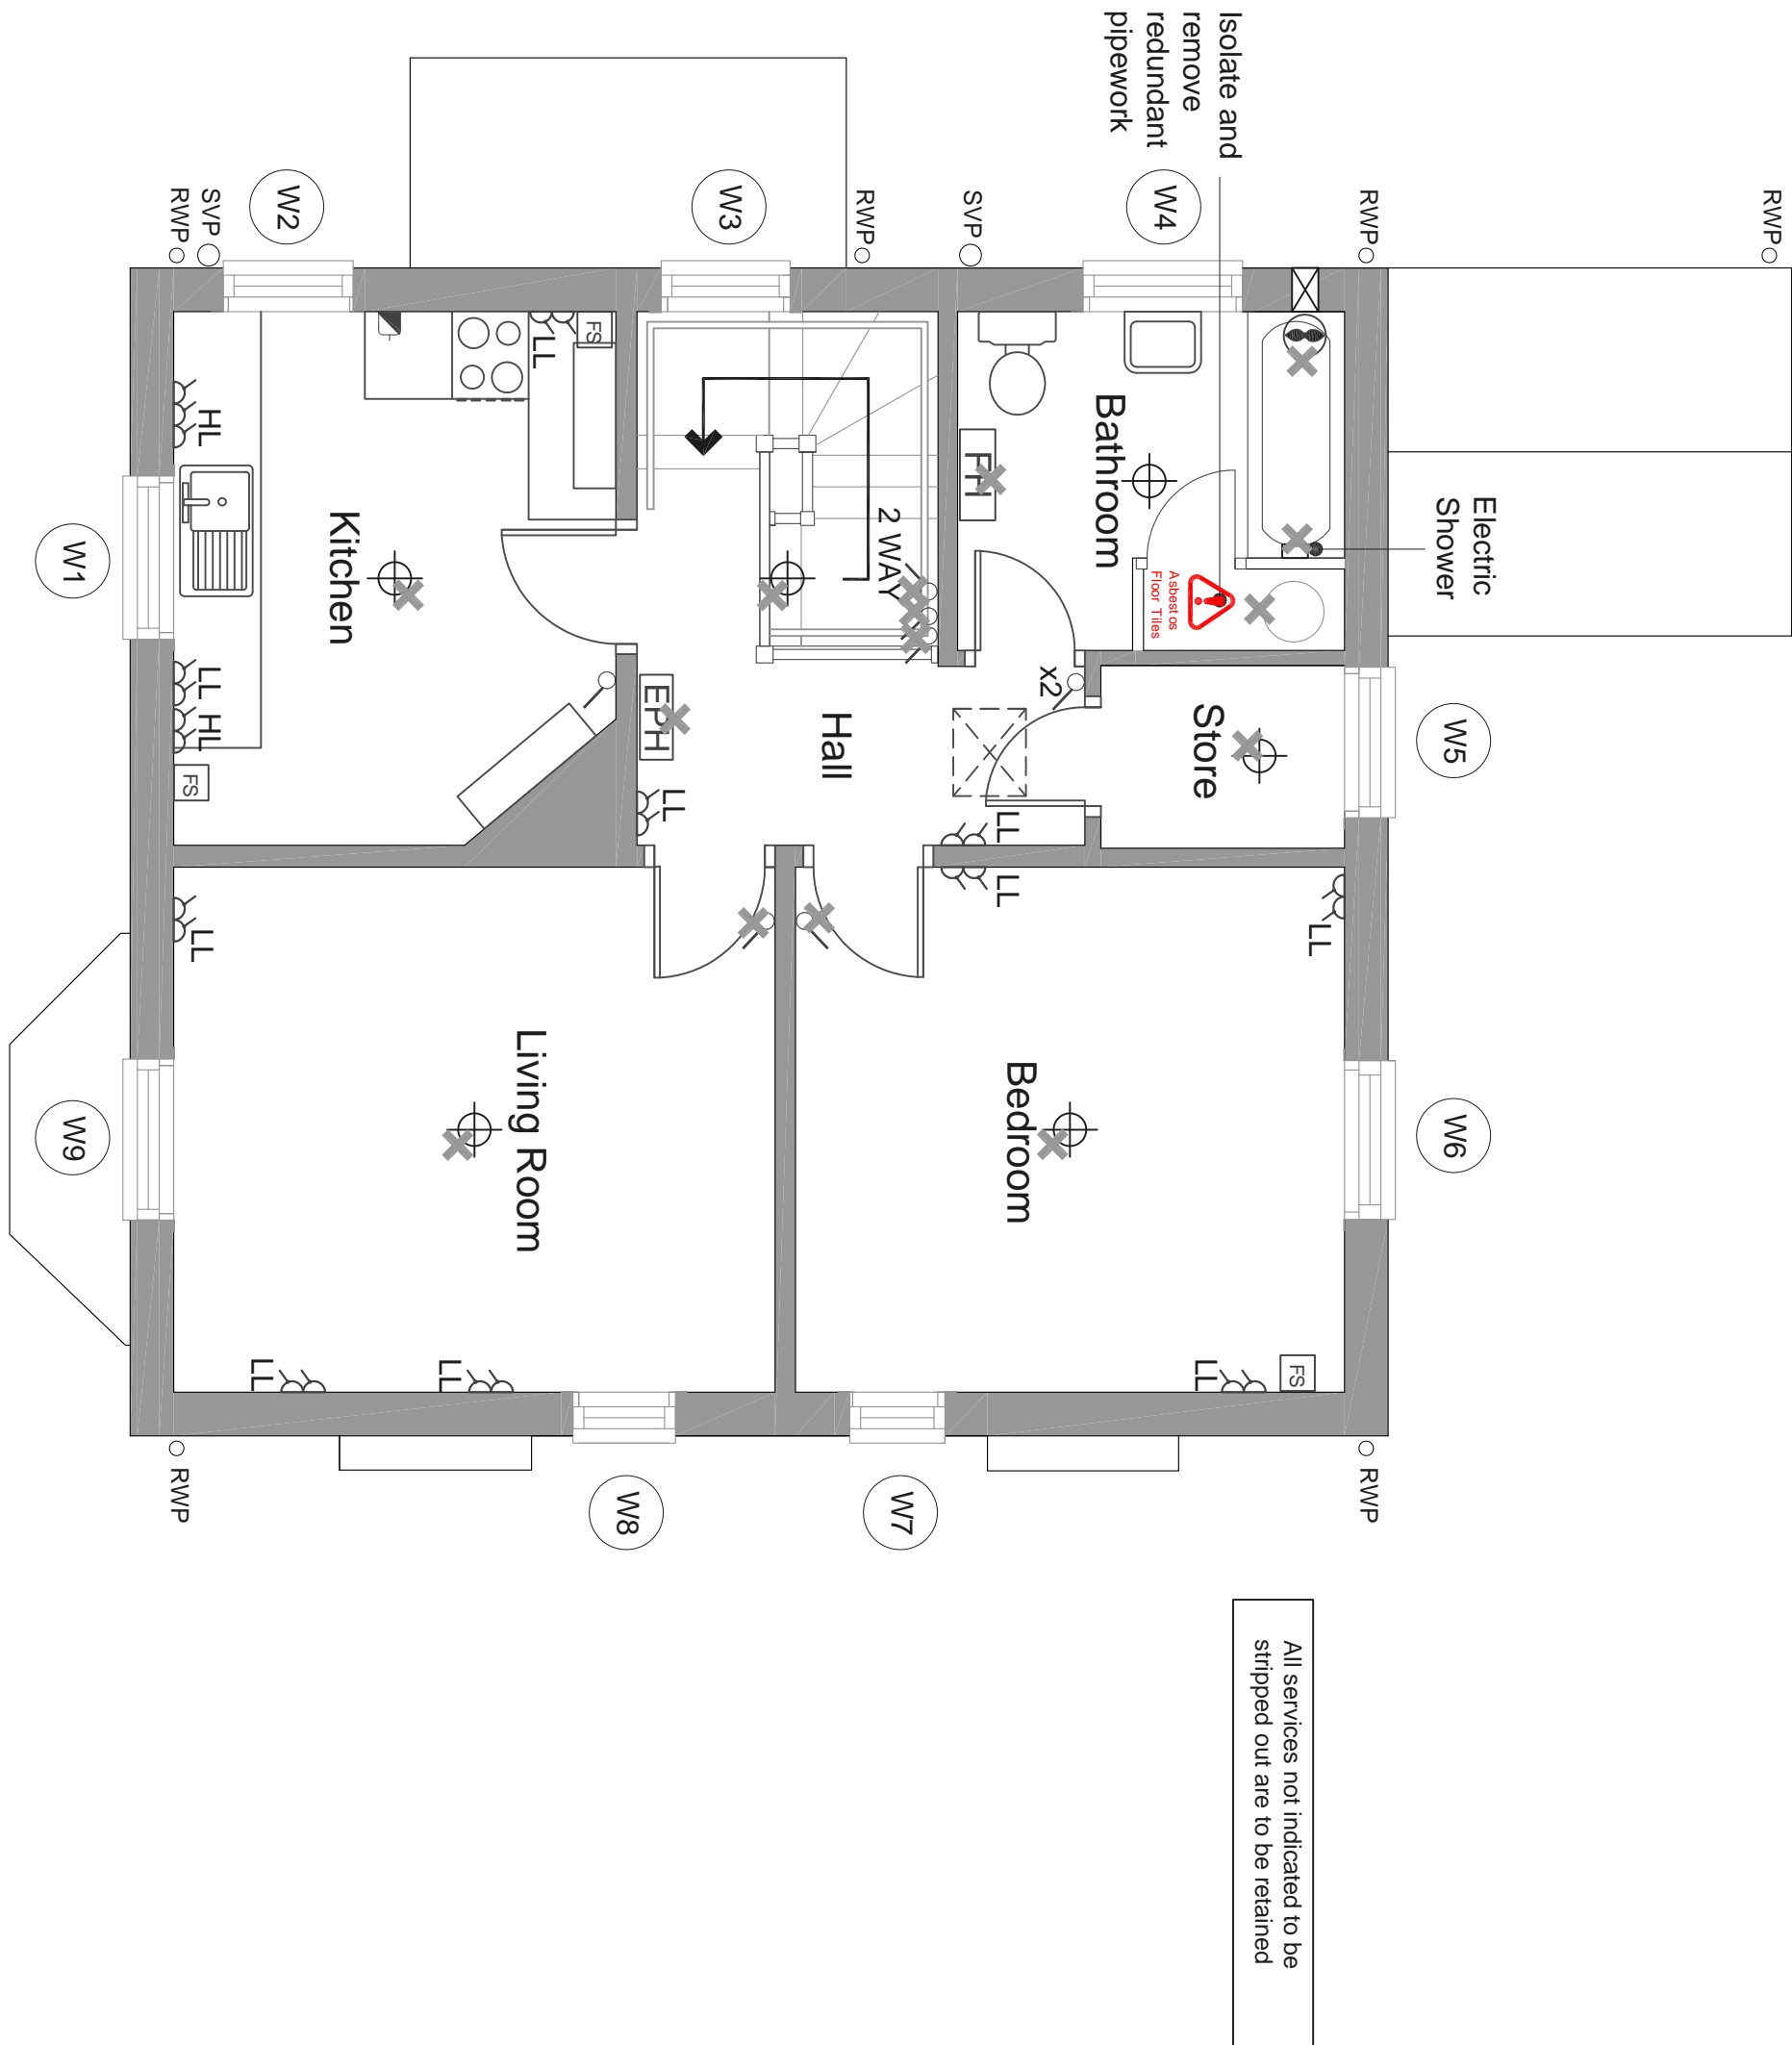

All services not indicated to be stripped out are to be retained

Existing Ground Floor Services

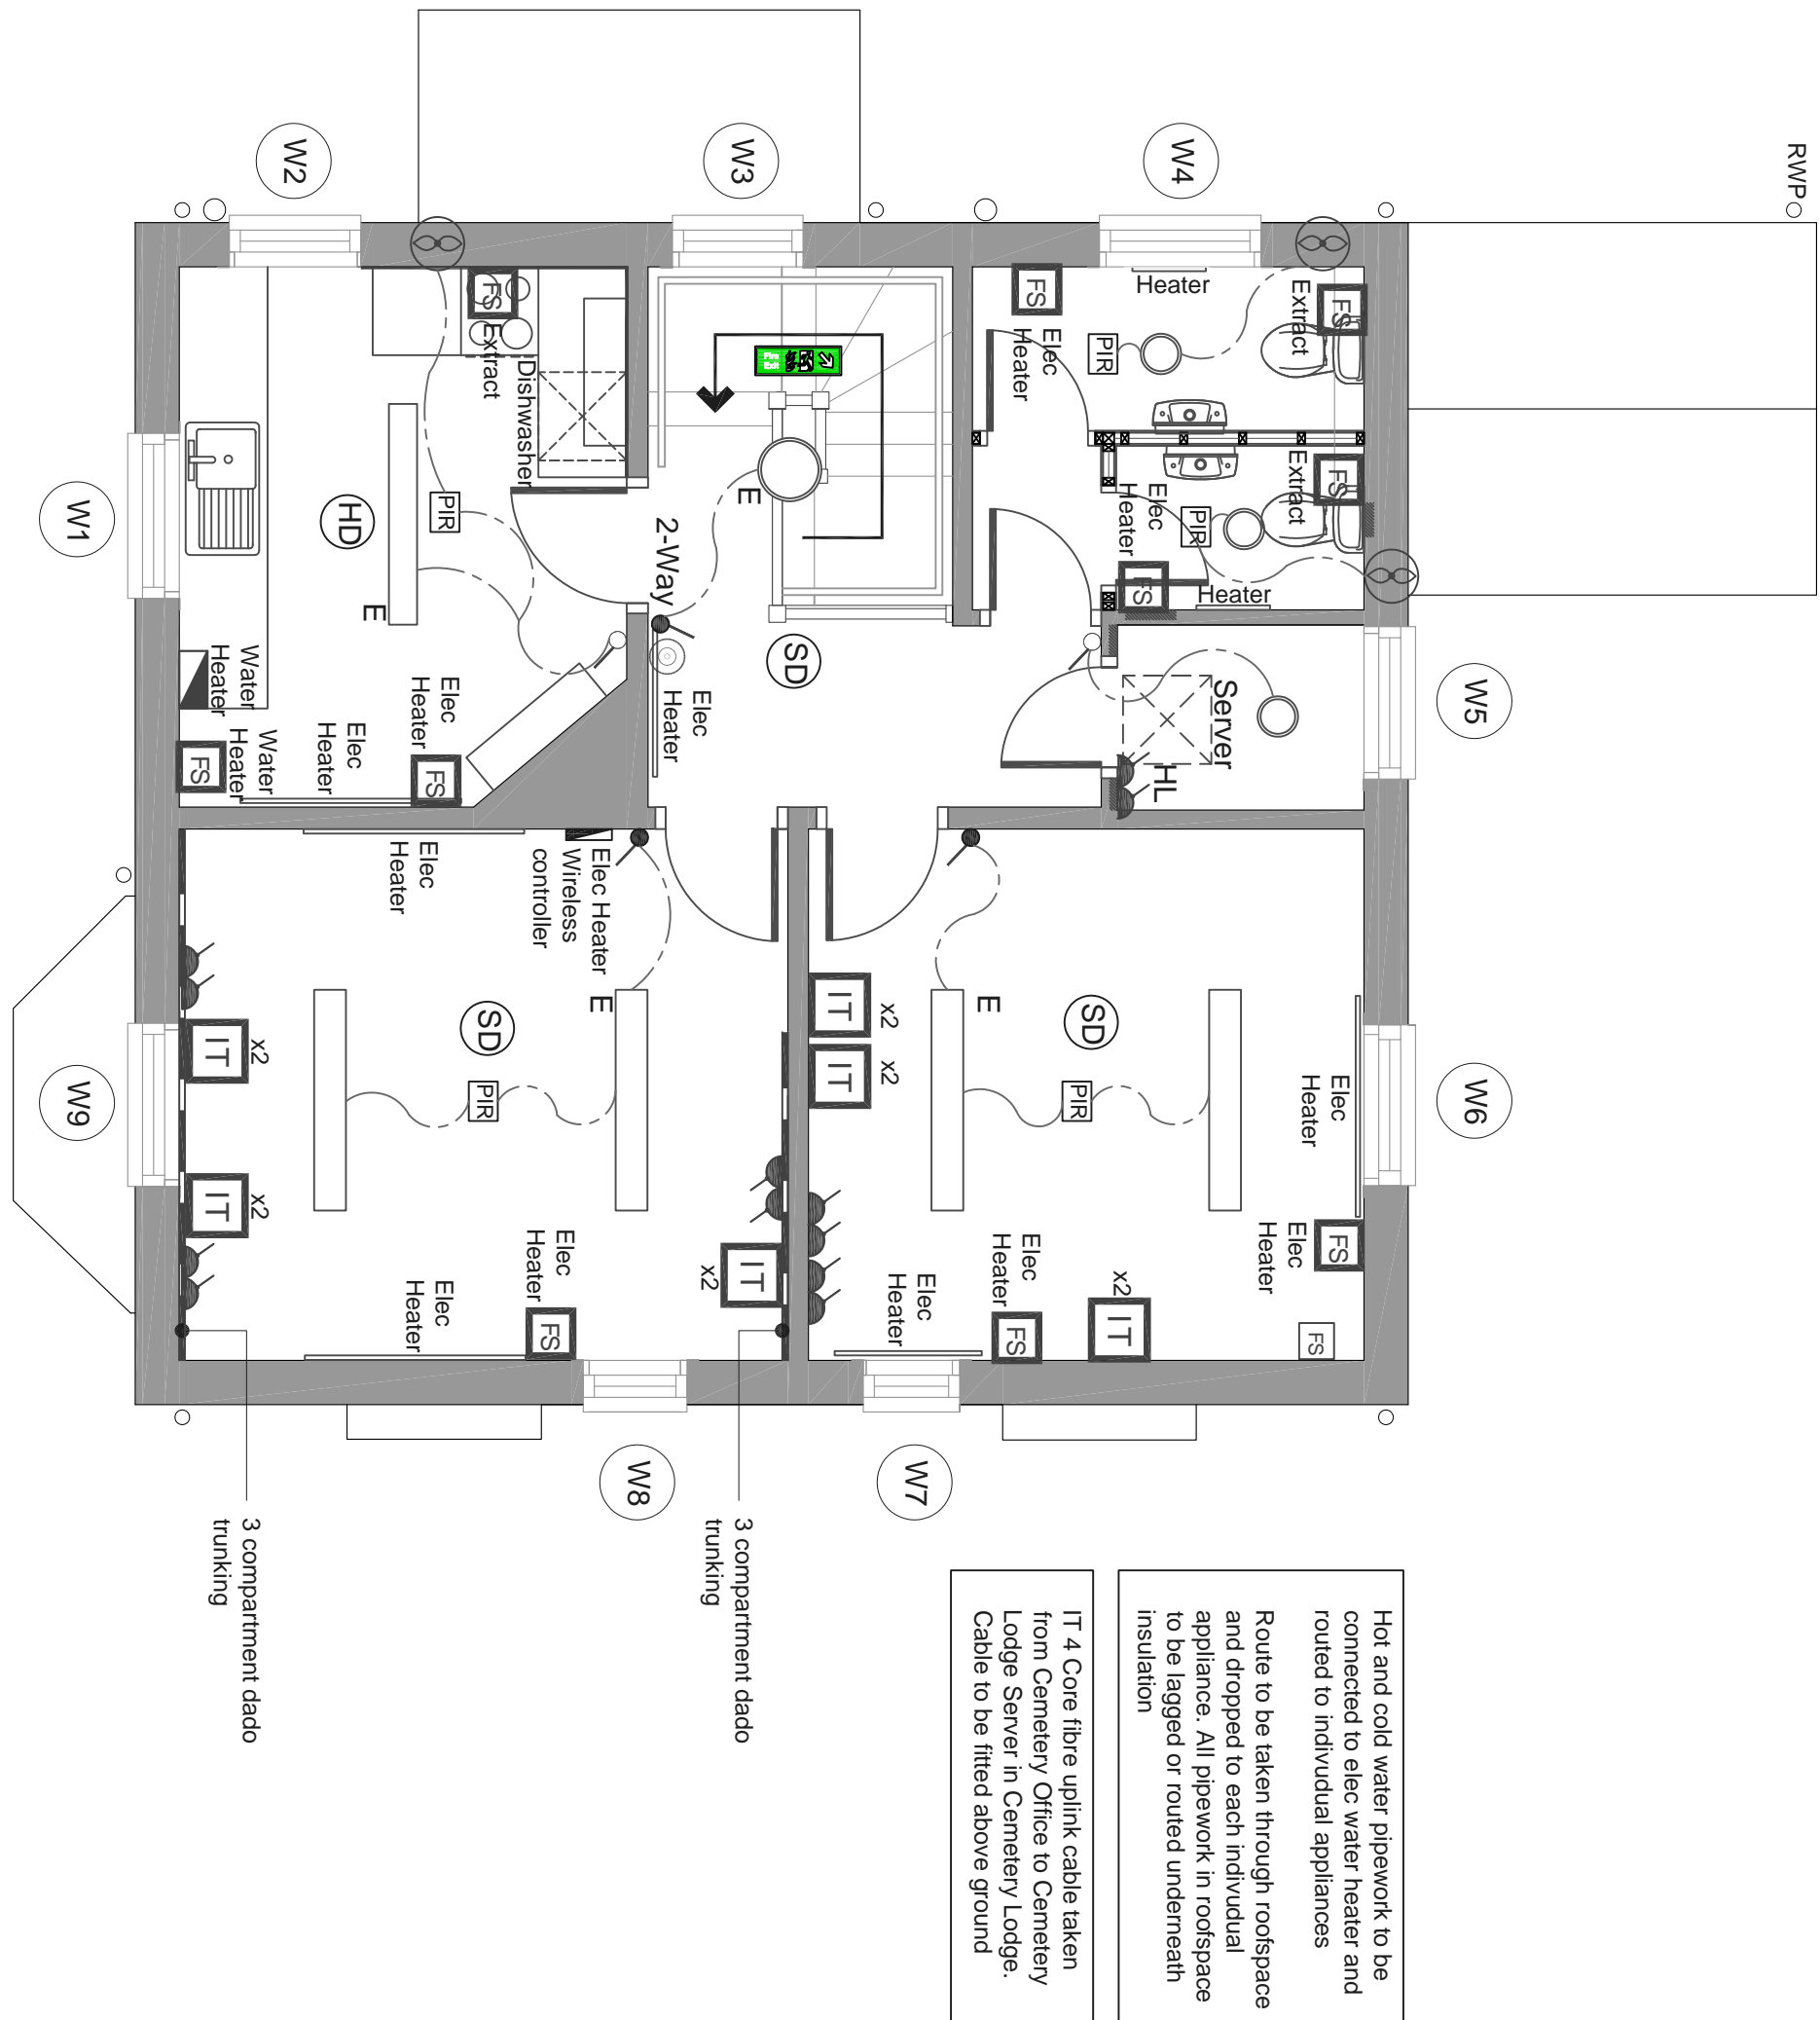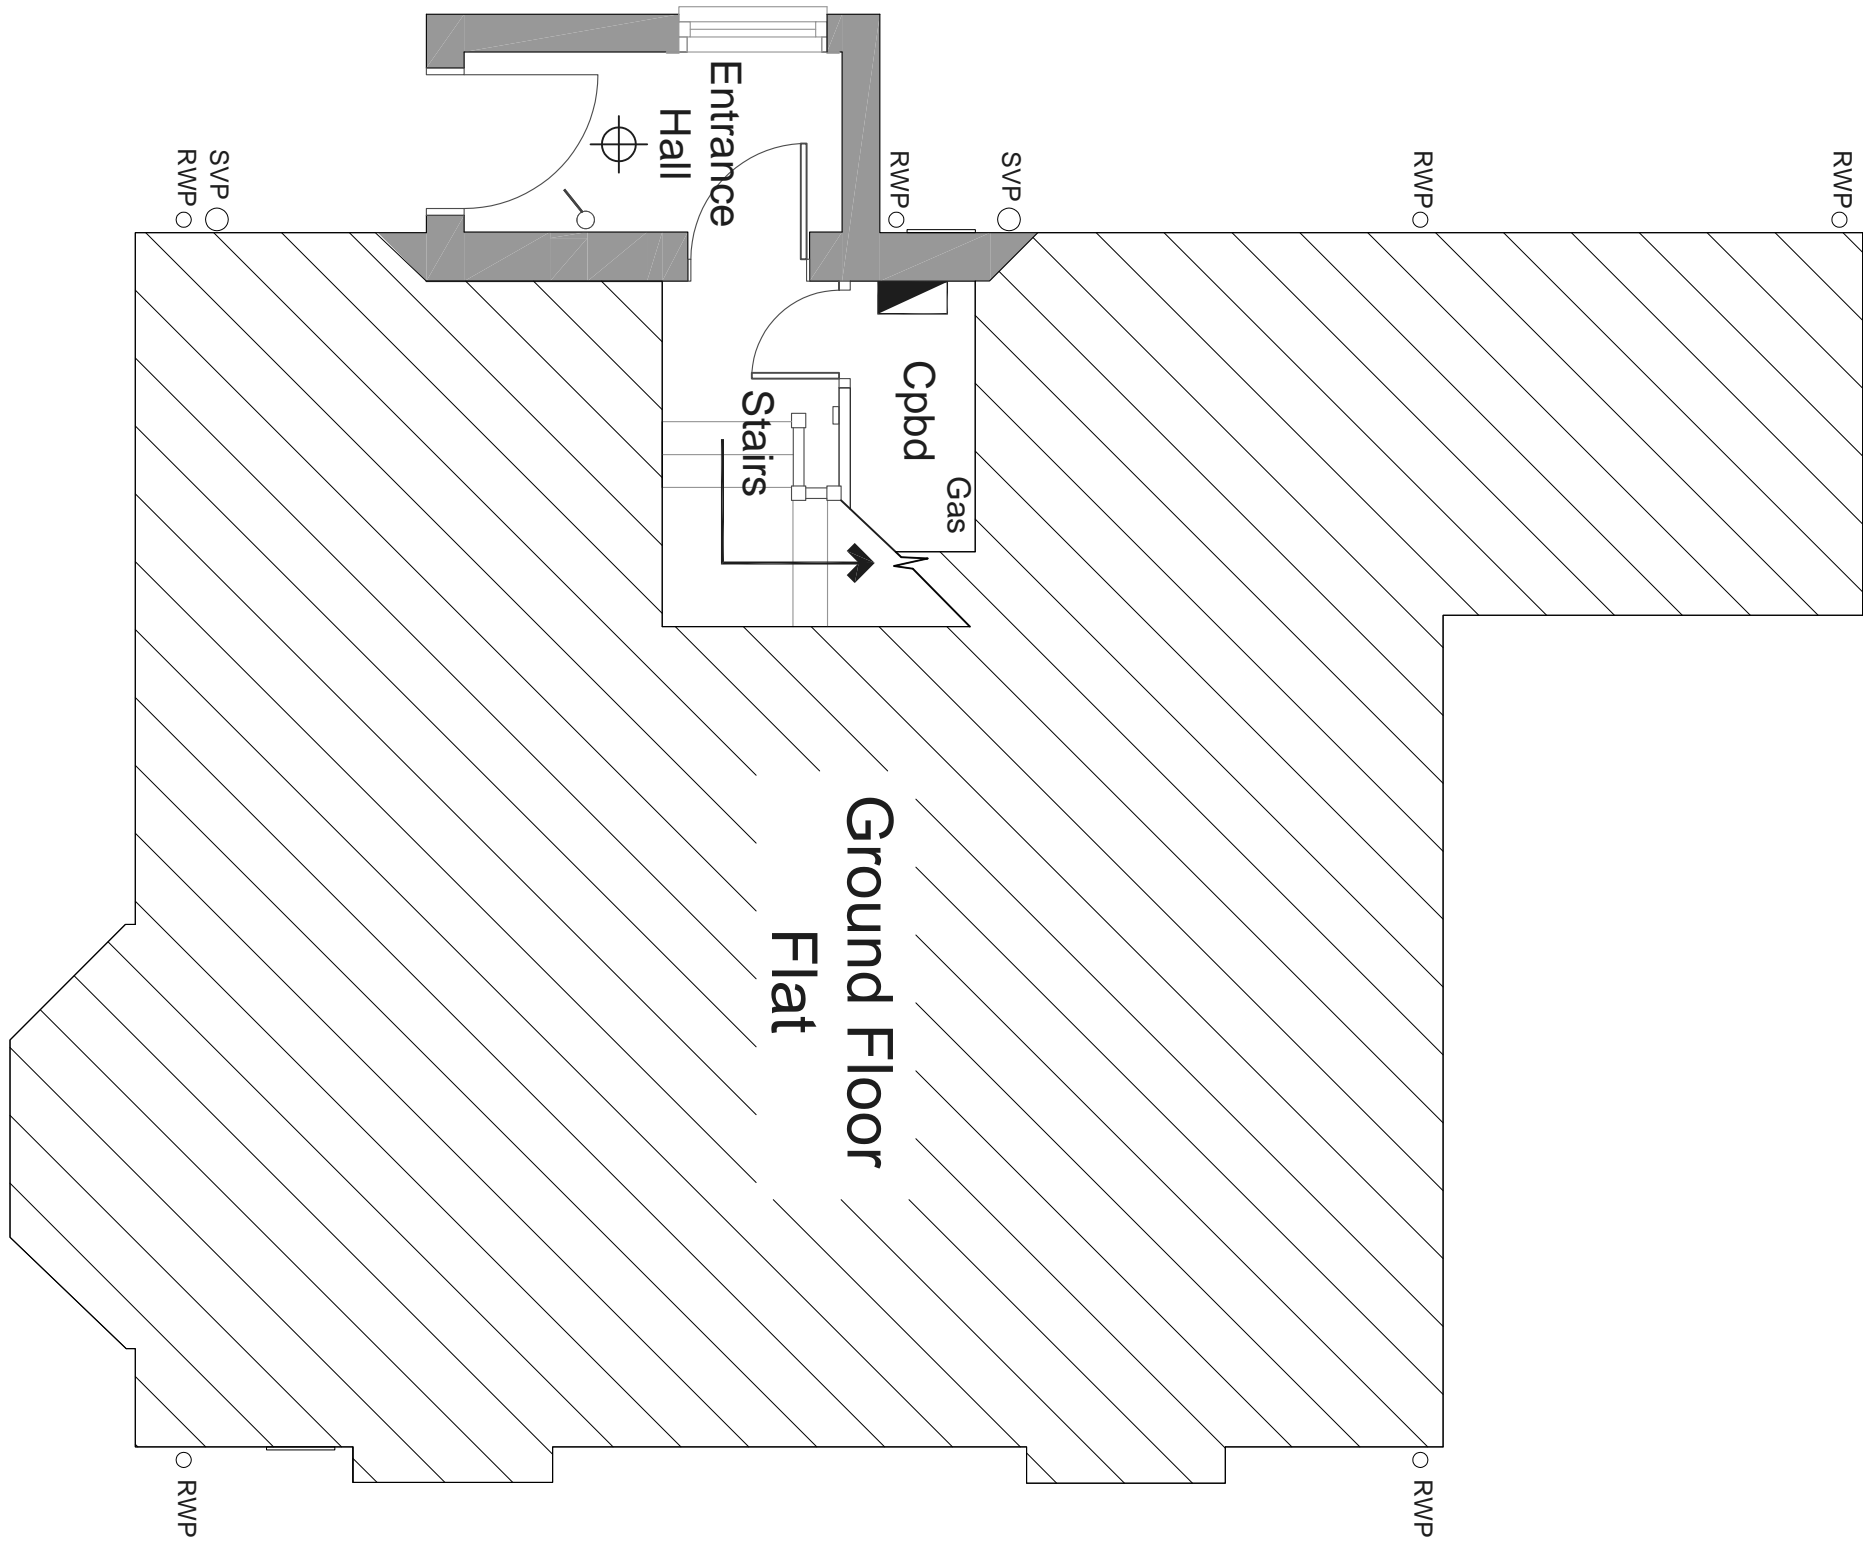

Hot and cold water pipework to be connected to elec water heater and routed to individual appliances

Route to be taken through roofspace and dropped to each individual appliance. All pipework in roofspace to be lagged or routed under stair insulation

IT 4 Core fibre optic cable taken from Cemetery Lodge to Cemetery Lodge Server in Cemetery Lodge. Cable to be fitted above ground

3 compartment dado trunking

3 compartment dado trunking

TENDER

Rev.	Revision description	Date
------	----------------------	------

Project  
**Crewe Cemetery Lodge**  
Crewe Cemetery Lodge, First Floor Flat  
Market Close, Crewe  
Cheshire, CW1 2NA

Title  
**Existing and Proposed Services**

Client  
**Cheshire East Council**

Scale @ A1	Drawn By	Checked By	Date
1:50	MM	DT	09.09.14
Job No.	Sheet No.	Rev.	
Drawing Number	1806	03	

Proposed Ground Floor Services

