

# **SIMULATING ROOM DUCTS USING CELL-DEVS CO2 WITH OCCUPANTS MODEL**

Term Project

SYSC 5104 - Methodologies for Discrete Event Modelling and  
Simulations  
Fall 2020

## **Source Code:**

Term Project:

[https://github.com/malsaeedi/Cell-DEVS\\_CO2\\_with\\_Room\\_Ducts\\_Model](https://github.com/malsaeedi/Cell-DEVS_CO2_with_Room_Ducts_Model)

2D Drawing to Cell-DEVS CO2 Model:

[https://github.com/malsaeedi/2D\\_Drawing\\_to\\_CO2\\_CELL\\_DEVS\\_Model](https://github.com/malsaeedi/2D_Drawing_to_CO2_CELL_DEVS_Model)

Demo:

<https://www.youtube.com/watch?v=iOB9FCErZJ8>

Mohammed Al-Saeedi

101109046

Carleton University

## **SIMULATING ROOM DUCTS USING CELL-DEVS CO<sub>2</sub> WITH OCCUPANTS MODEL**

Mohammed Alsaeedi

Gabriel Wainer

Department of Systems and Computer Engineering  
Carleton University  
1125 Colonel By Drive  
Ottawa, ON. *K1S-5B6 Canada*  
mohammedalsaedi@cmail.carleton.ca

Department of Systems and Computer Engineering  
Carleton University  
1125 Colonel By Drive  
Ottawa, ON. *K1S-5B6 Canada*  
gwainer@sce.carleton.ca

### **ABSTRACT**

Cell-DEVS (Wainer and Giambiasi 2001) is a formalism that enables the simulation of cellular automata models asynchronously with different timing delays. The indoor CO<sub>2</sub> diffusion by breathing occupants has been studied using Cell-DEVS formalism (Khalil et al. 2020), (Khalil and Wainer 2020). The model takes into consideration room dimensions, ventilation, doors, windows, and occupants as a source of producing CO<sub>2</sub>. Developing new Cell-DEVS CO<sub>2</sub> scenarios with a new type of cells is needed and can take some amount of manual work. In this paper, we developed a new implementation to draw a two-dimensional floor plan, add any new type of cell, and create a 2D or 3D model quickly. Furthermore, we added ducts between rooms and show the indoor concentration and diffusion of CO<sub>2</sub> with the presence of these ducts. The results show that implementing ducts between rooms and with the presence of vents can efficiently reduce the concentration of CO<sub>2</sub> inside rooms.

### **1 INTRODUCTION**

The need to use modeling and simulation techniques lies in the difficulty of experimenting with complex artificial systems or very dangerous experiments. One of the most important of these techniques is Cell-DEVS (Wainer and Giambiasi 2001) which is a formalism that enables building very complex cellular automata models asynchronously with different timing delays. The indoor CO<sub>2</sub> diffusion by breathing occupants is one of these experiments that has been studied using Cell-DEVS formalism (Khalil et al. 2020), (Khalil and Wainer 2020). The model takes into consideration room dimensions, ventilation, doors, windows, and occupants as a source of producing CO<sub>2</sub>.

Sensors are used in closed spaces for occupancy detection and controlling the HVAC systems to reduce energy consumption while reducing the amount of CO<sub>2</sub> inside. However, these sensors are limited since it does not give a precise estimate of the number of people occupying the space because they are highly sensitive to the configuration parameters. As such, this model (Khalil et al. 2020) is simulating the different configurations and sensors placed in a close space (Computer Lab as a use case) while the arrival/departure of occupants and shows the increase/decrease in the CO<sub>2</sub> levels. The model uses the Cell-DEVS formalism (Wainer and Giambiasi 2001) to study the relationship between configuration parameters (e.g. room dimensions, window locations, and occupant's mobility) and the ability of CO<sub>2</sub> sensors to detect occupants and how this relationship can be used to determine the best placement of CO<sub>2</sub> sensors.

In this research work, we developed a new implementation to quickly build 2D or 3D scenarios for the Cell-DEVS CO<sub>2</sub> model. Furthermore, we created some scenarios modeling ducts between rooms and measured the indoor concentration and diffusion of CO<sub>2</sub> using the Cell-DEVS CO<sub>2</sub> model (Khalil et al. 2020). Finally, we discuss the results and advantages of adding these indoor ducts between rooms.

## 2 BACKGROUND

DEVS (Wainer 2009) is a mathematical formalism for modeling and simulating discrete event systems. It can represent a system as a hierarchy structure of coupled and atomic components. An atomic model can communicate with other models using input/output ports. Each atomic component has an internal, external transaction to change its state and time advance functions. Cell-DEVS formalism (Wainer and Giambiasi 2001) is an extension to DEVS that allows the implementation of Cellular Automata (CA) with timing delay. Each atomic model in Cell-DEVS is represented by a cell that communicates with its  $N$  neighbor cells to compute its next state. The atomic model in Cell-DEVS is defined as  $\langle X, Y, S, N, \text{delay}, \delta_{\text{int}}, \delta_{\text{ext}}, t, \lambda, D \rangle$  where  $X$  and  $Y$  are the input and output events set respectively.  $S$  is the states set,  $N$  is the neighbors' input values,  $\delta_{\text{int}}$  and  $\delta_{\text{ext}}$  are the internal and external transition functions respectively,  $t$  is the local computing function and  $\lambda$  is the output function. The next state of a cell is calculated by the local computing function  $t$ . The delay associated with each cell can either be transport or inertial.

The authors in (Khalil et al. 2020) studied the relationship between the CO<sub>2</sub> levels and the room configurations and how minor changes may result in significant changes in indoor CO<sub>2</sub> levels. The model takes into consideration the configuration of ventilation, windows, doors, and occupants (CO<sub>2</sub> sources). Ducts between rooms can also play a significant role in changing the indoor CO<sub>2</sub> levels. Therefore, this research work simulates different indoor configuration of ducts between rooms and evaluates the rate of its effect on the concentration and diffusion of CO<sub>2</sub>.

## 3 2D TO CELL-DEVS CO2 MODEL IMPLEMENTATION

This implementation allows the development of different 2d or 3d scenarios for the Cell-DEVS CO<sub>2</sub> models. Here, we will present the structure, configuration, and functionalities of this implementation.

### 3.1 Structure

The implementation uses pre-defined configurations to draw a 2D floor plan grid and convert it to a 2D or 3D Cell-DEVS CO<sub>2</sub> model scenario as shown in Figure 1. The structure of the implementation consists of three main modules as demonstrated in Figure 2.

The DrawGrid module is responsible for drawing a 2D grid using the pre-defined simulation and cell configuration. It has some functionalities like creating a 2D and 3D Cell-DEVS CO<sub>2</sub> models, preview the model in 3D view, and save the model for later use. The ConvertTool module creates the JSON structure of the output model while the GenerateTool module exports the output model.



Figure 1: 2D Drawing to Cell-DEVS CO<sub>2</sub> Model.

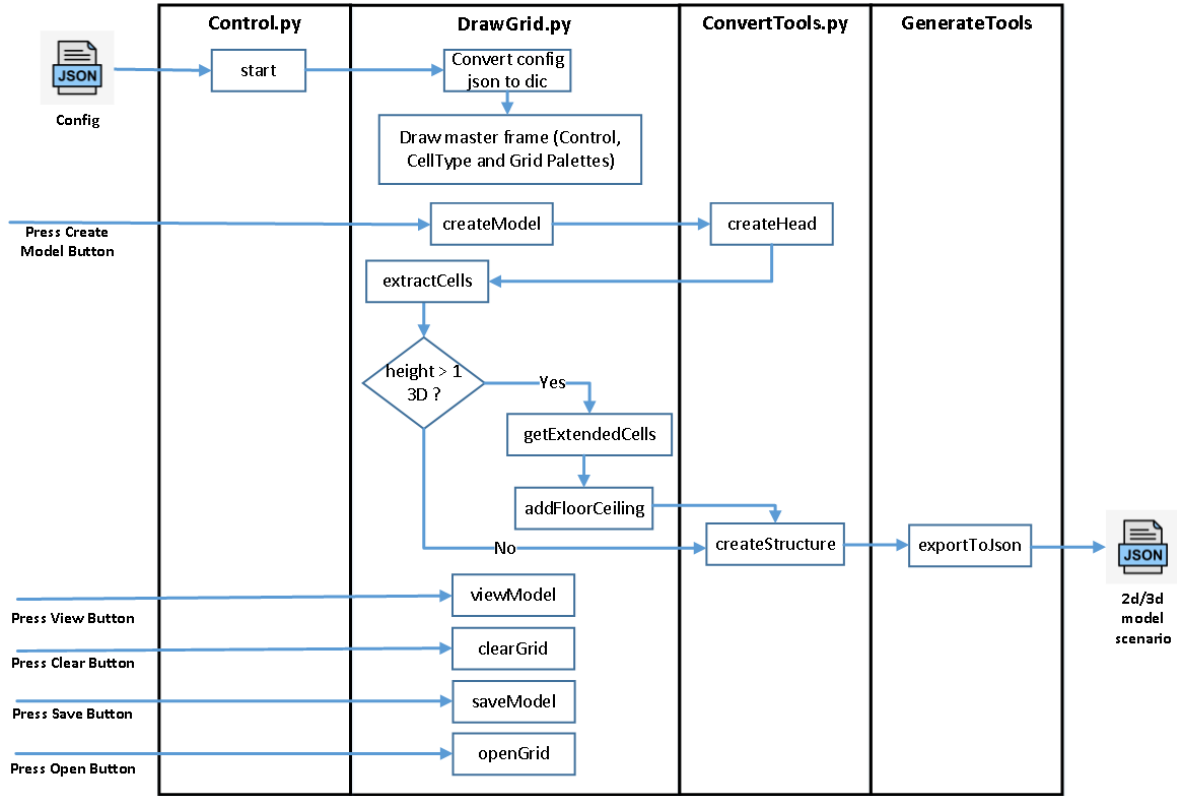


Figure 2: Implementation Structure.

### 3.2 Configuration

The simulation configuration defines the main Cell-DEVS CO<sub>2</sub> model parameters such as the floor plan dimensions, the cell's neighborhood type and the different type of cells. To add new type of cell, the following parameters need to be defined under *colours* key value in the configuration input file:

```

"<color_name>": {
  "name" : "<cell_name>",
  "parent_cell" : "<parent_cell>",
  "alpha" : <transparency_alpha_value>,
  "bottom" : <cell_bottom>,
  "top" : <cell_top>,
  "concentration" : <CO2_concentration>,
  "type" : <cell_type>,
  "counter" : <counter_to_be_CO2_source>},

```

In addition to the current default type of cells, we defined a new cell to simulate ducts between indoor rooms. The different types of cells available in the configuration file are listed in Table 1. Any cell is part of other cells which we call a parent cell. For instance, a window cell is located within walls, so its parent cell is the wall. The parent cell is used to extend the cell's 3d structure beyond its bottom and top. The alpha value is used to define the transparency of the cell for visualization purposes. The size of a cell in the configuration corresponds to 25cm<sup>3</sup> in the real world.

Table 1: Type of Cells in Cell-DEVS CO2 Model.

Color	name	Parent Cell Color	Alpha	Bottom	Top	CO2 Concentration	Type
white	air	white	0	0	12	500	-100
cyan	co2_source	white	100	0	6	0	-200
gray	wall	gray	100	0	12	0	-300
green	door	gray	90	0	8	500	-400
yellow	window	gray	90	4	7	400	-500
blue	vent	white	100	10	11	300	-600
red	workstation	white	100	0	4	500	-700
fuchsia	duct	gray	90	8	10	500	-800

### 3.3 2D and 3D Modeling

The construction of 2D or 3D Cell-DEVS CO2 model scenarios is simply defined by updating the dimensions in the configuration. A 3D model can be defined by setting the height value to greater than one. A value less than or equal to two will be considered as a 2D model. An example of the implementation 2D grid user interface of 25x30 is shown in Figure 3. The colors represent the type of cells in the configuration file.

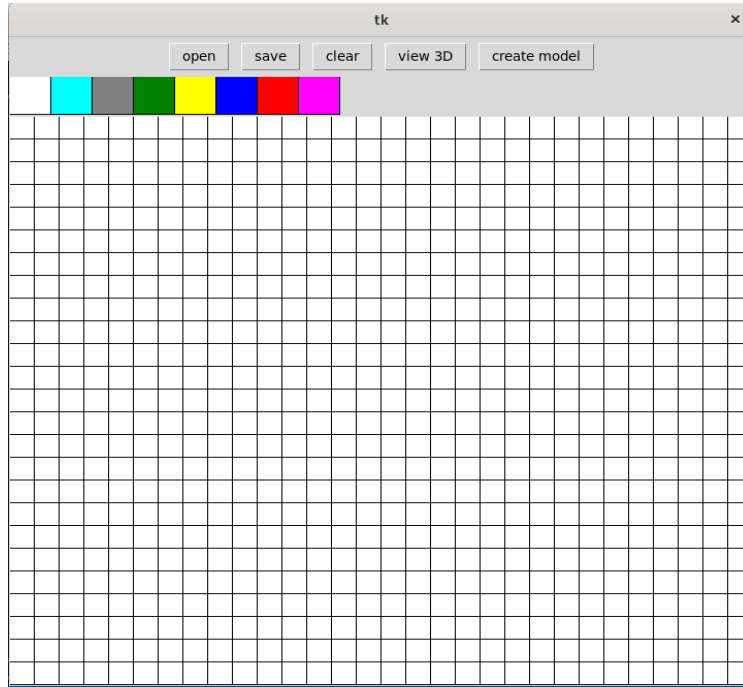


Figure 3: 2D Grid of 25x30 size.

## 4 SIMULATION AND RESULTS

In this section, we simulate and discuss the results of simulating an indoor structure with the presence of a static number of occupants but different setup scenarios of ducts between rooms using the Cell-DEVS CO2 model (Khalil et al. 2020). Table 2 shows the static and variant parameters of the simulation setup. Table 3 shows the type of cells and configuration used in this simulation. The simulation time is 500 units of time. The idea is to change the number and location of ducts while keeping other parameters static and

measure the diffusion and concentration of CO<sub>2</sub> in every room. Six cells (room1 (5,5), room2 (15,5), room3 (21,5), room4 (5,25), room5 (15,25), room6 (21,25)) are selected to measure and compare the concentration of CO<sub>2</sub> in every room with occupants.

The research hypothesis is to prove that the efficient distribution of ducts between rooms can effectively balance the level of CO<sub>2</sub> indoor, which reduces the harmful effect on occupants resulted from exposure to high CO<sub>2</sub> levels.

Table 2: Simulation Setup.

Parameter	Value	Variant	Location Change
Dimensions	25x30x12	No	No
Rooms	7	No	No
Occupants	6	No	Yes
Occupants movement	random	Yes	Yes
Ducts	5	Yes	Yes
Vents	6	No	No
Windows	3	No	No

Table 3: Type of Cells Configuration.

Color	name	Parent Cell Color	Alpha	Bottom	Top	CO <sub>2</sub> Concentration	Type
white	air	white	0	0	12	500	-100
cyan	co2_source	white	100	0	6	0	-200
gray	wall	gray	100	0	12	0	-300
green	door	gray	90	0	8	500	-400
yellow	window	gray	90	4	7	400	-500
blue	vent	white	100	10	11	300	-600
red	workstation	white	100	0	4	500	-700
fuchsia	duct	gray	90	8	10	500	-800

#### 4.1 Simulation Scenario 1

The initial simulation 2D and 3D setup are demonstrated in Figures 4 and 5. In this scenario, three rooms have ducts, while the other three rooms have no ducts. Each room has one occupant and one vent. The living room has no occupants and has two vents. The simulation runs for 500 units of time to show the continuous change in CO<sub>2</sub> level inside these rooms.

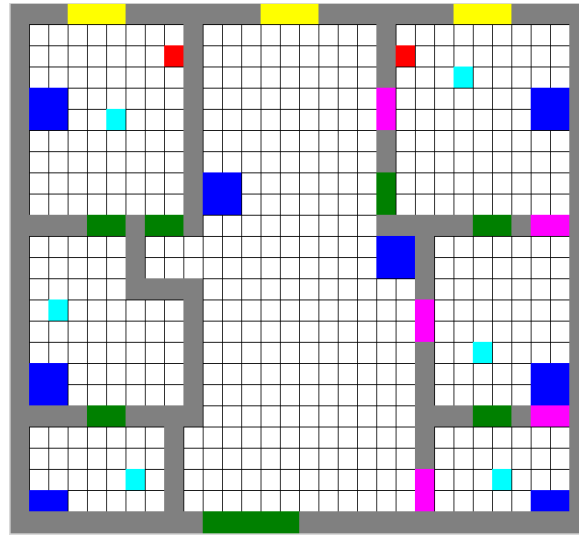


Figure 4: 2D Simulation Setup of Scenario 1.

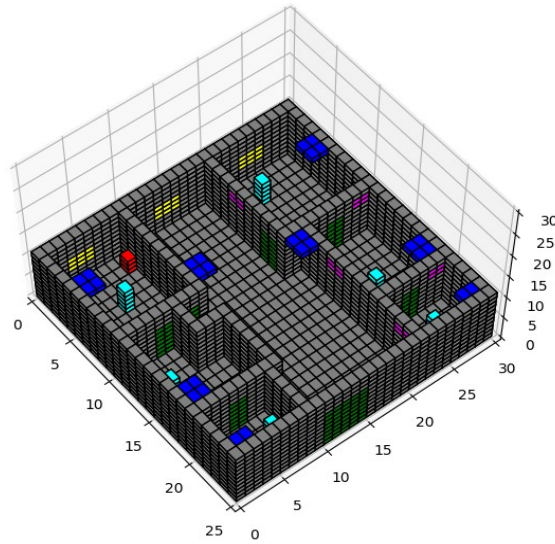


Figure 5: 3D Simulation Setup of Scenario 1.

The results in Figure 6 shows that the CO<sub>2</sub> concentration in rooms with ducts is less than in those rooms without ducts. The presence of ducts between rooms assists the ventilation system in reducing the CO<sub>2</sub> level inside these rooms. The results in Figure 7 and 8 show that cells in room 5 with ducts reaches a maximum CO<sub>2</sub> concentration of nearly 600ppm while in room 2 without ducts reaches a maximum of nearly 1000ppm.

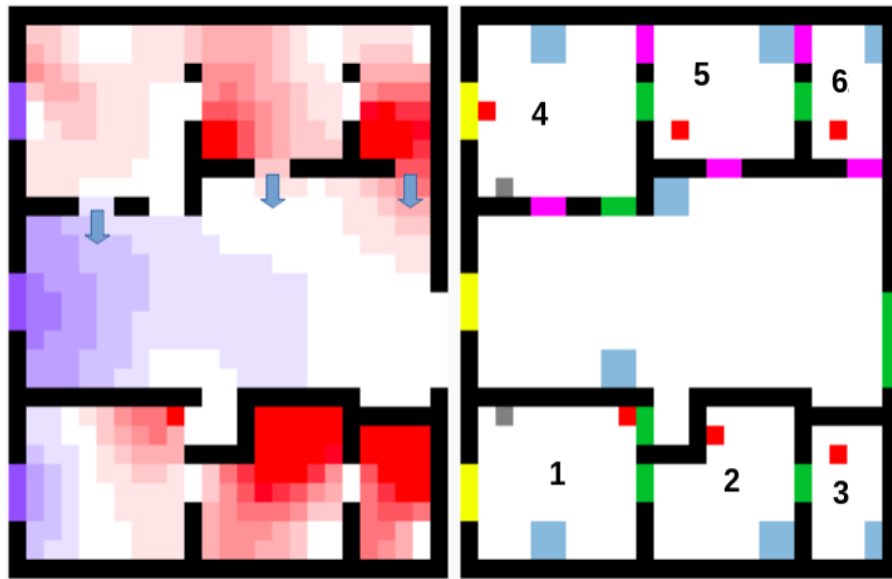


Figure 6: Scenario 1 Results.

CO2 Concentration at Cell (15, 25) vs. Time

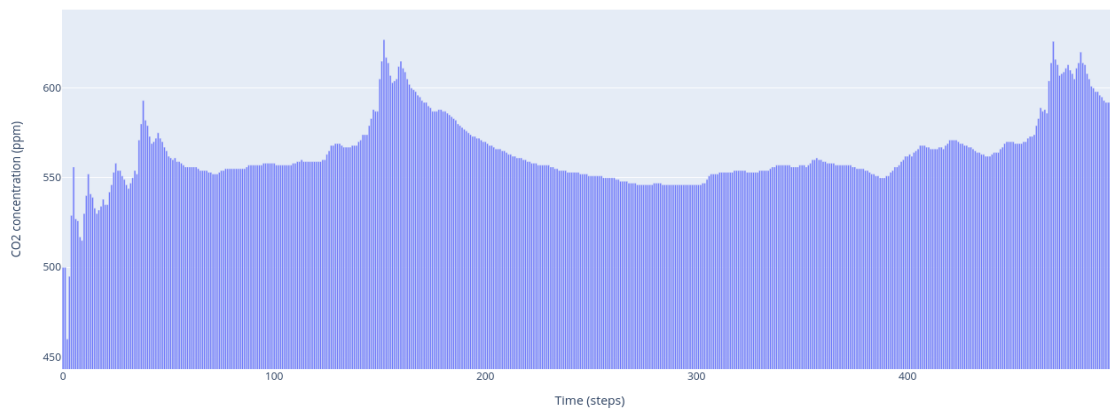


Figure 7: Scenario 1 Room5.

CO2 Concentration at Cell (15, 5) vs. Time

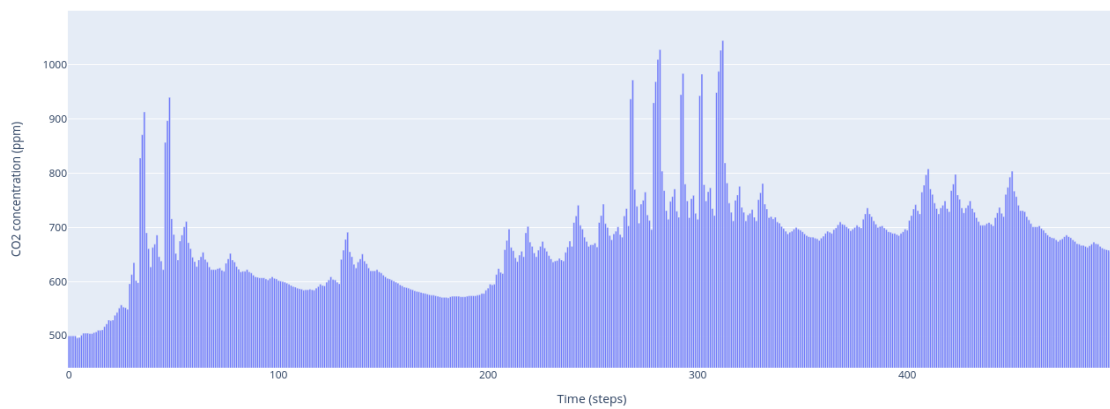


Figure 8: Scenario 1 Room2.



#### 4.2 Simulation Scenario 2

The second simulation 2D and 3D setup are demonstrated in Figures 9 and 10. In this scenario, all six rooms have no ducts. Each room has one occupant and one vent. The living room has no occupants and has two vents. The simulation runs for 500 units of time to show the continuous change in CO<sub>2</sub> level inside these rooms.

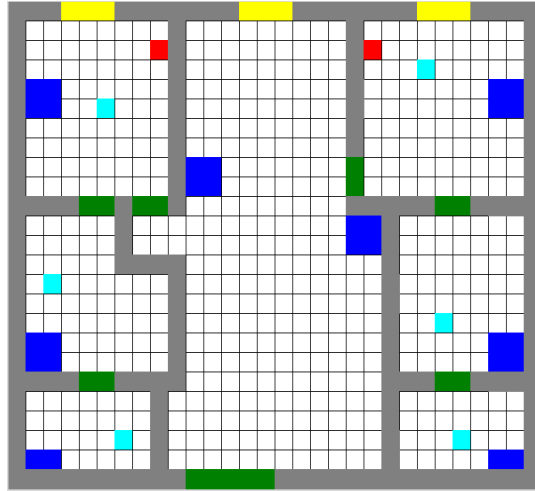


Figure 9: 2D Simulation Setup of Scenario 2.

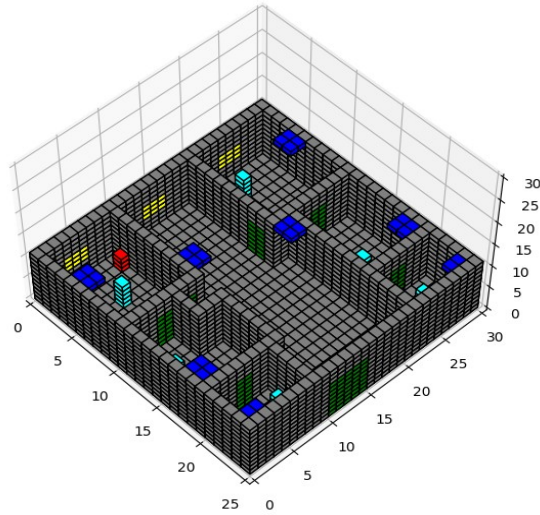


Figure 10: 3D Simulation Setup Scenario 2.

The results in Figure 11 show that the CO<sub>2</sub> level gradually increases in all rooms with occupants. Although the ventilation system is the same as in scenario one, the CO<sub>2</sub> level in this scenario is higher. The absence of ducts between rooms increases the concentration of CO<sub>2</sub> and reduces the efficiency of the ventilation system due to the imbalance distribution of CO<sub>2</sub> in the apartment. The results in Figures 12 and 13 show that cells in both rooms 5 and 2 can reach a maximum CO<sub>2</sub> concentration of nearly 1000ppm.

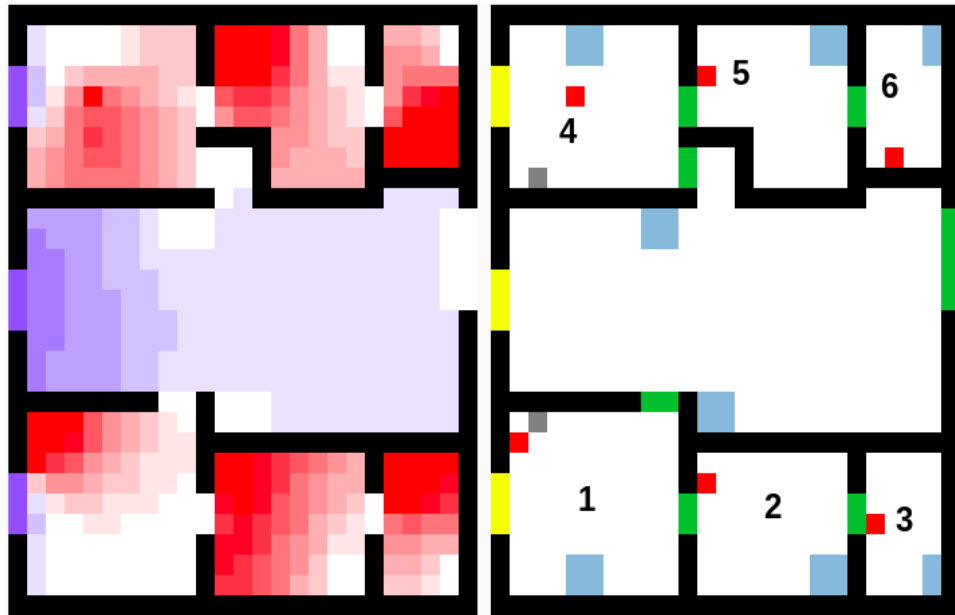


Figure 11: Scenario 2 Results.

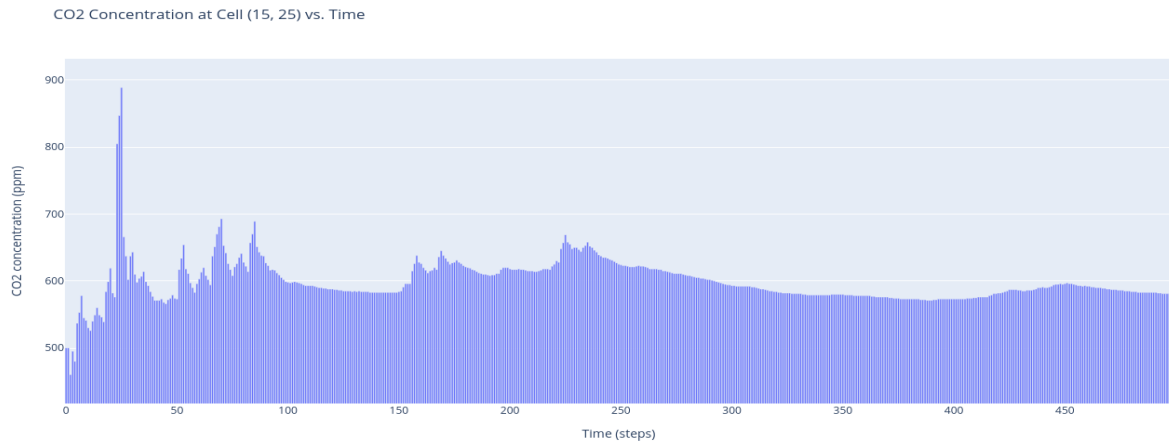


Figure 12: Scenario 2 Room5.

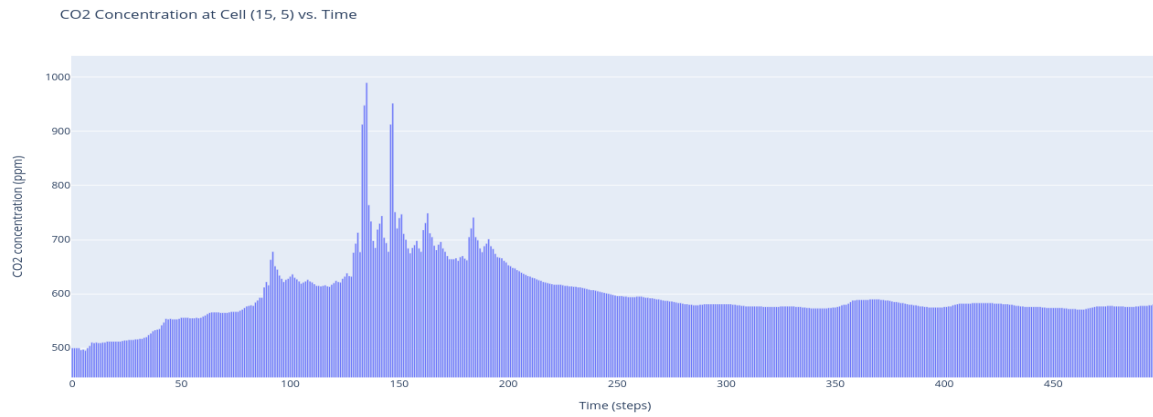


Figure 13: Scenario 2 Room2.

### 4.3 Simulation Scenario 3

The third simulation 2D and 3D setup are demonstrated in Figures 14 and 15. In this scenario, all six rooms have ducts. Each room has one occupant and one vent. The living room has no occupants and has two vents. The simulation runs for 500 units of time to show the continuous change in CO<sub>2</sub> level inside these rooms.

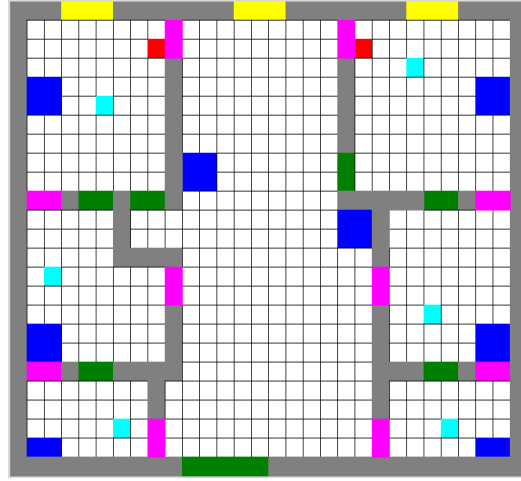


Figure 14: 2D Simulation Setup of Scenario 3.

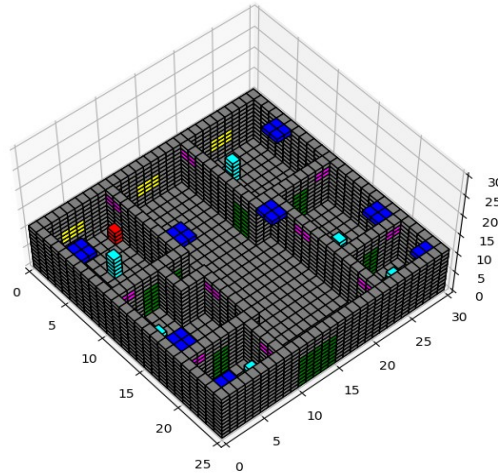


Figure 15: 3D Simulation Setup Scenario 3.

The results in Figure 16 shows that the CO<sub>2</sub> level significantly reduced in all rooms with occupants. The presence of ducts between all rooms reduces the concentration of CO<sub>2</sub> and assists in increasing the efficiency of the ventilation system due to the balanced distribution of CO<sub>2</sub> inside the apartment. The results in Figures 17 and 18 show that cells in both rooms 5 and 2 can reach a maximum CO<sub>2</sub> concentration of nearly 600ppm which is lower than the CO<sub>2</sub> level in scenario 2 with no ducts between rooms.

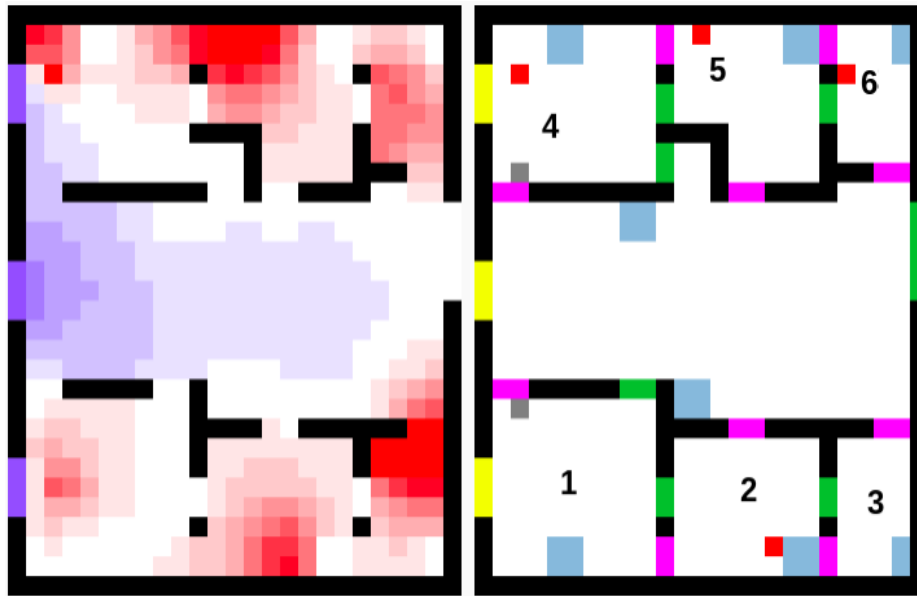


Figure 16: Scenario 3 Results.

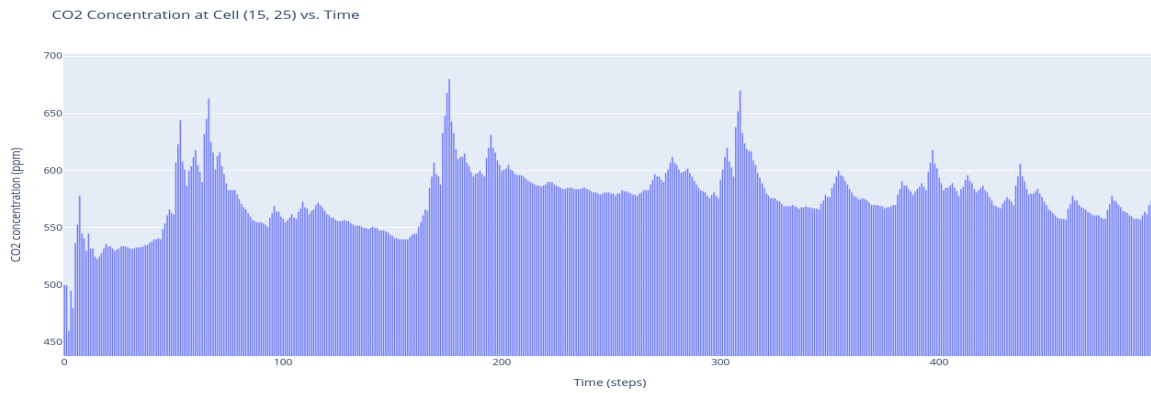


Figure 17: Scenario 3 Room5.

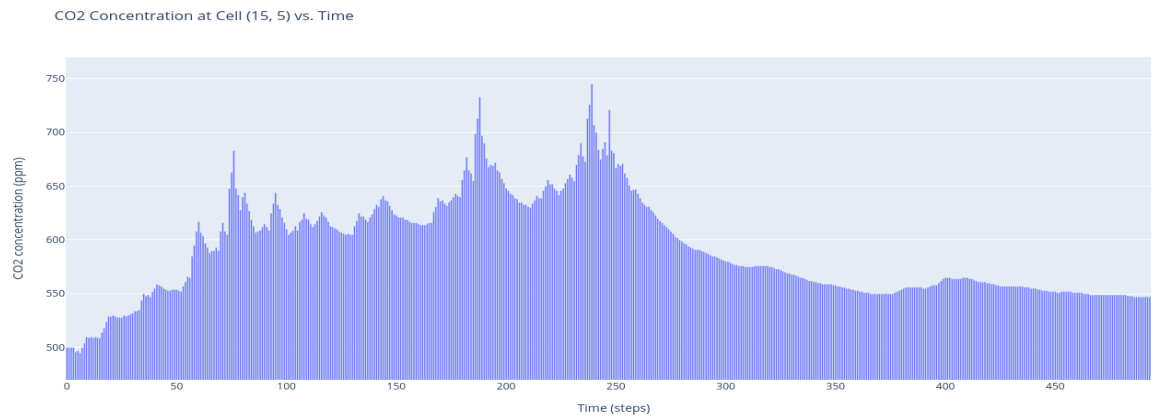


Figure 18: Scenario 3 Room2.

#### 4.4 Simulation Scenario 4

The fourth simulation 2D and 3D setup are demonstrated in Figures 19 and 20. In this scenario, all six rooms have ducts that are also connected to the outside of the apartment. Each room has one occupant and one vent. The living room has no occupants and has two vents. The simulation runs for 500 units of time to show the continuous change in CO<sub>2</sub> level inside these rooms.

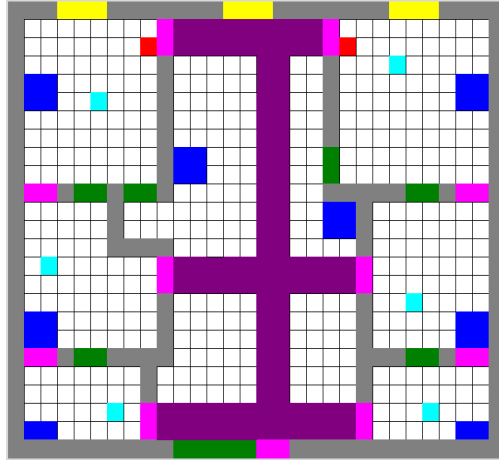


Figure 19: 2D Simulation Setup of Scenario 4.

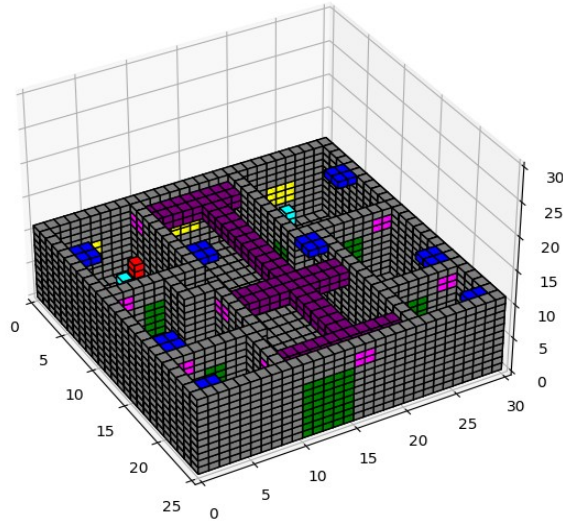


Figure 20: 3D Simulation Setup Scenario 4.

The results in Figure 21 shows that the CO<sub>2</sub> level significantly reduced in all rooms with occupants. Same as in scenario 3, the presence of ducts between all rooms reduces the concentration of CO<sub>2</sub> and assists in increasing the efficiency of the ventilation system due to the balanced distribution of CO<sub>2</sub> inside the apartment. The results in Figures 22 and 23 show that cells in both rooms 5 and 2 can reach a maximum CO<sub>2</sub> concentration of nearly 600-700ppm which is lower than the CO<sub>2</sub> level in scenario 2 with no ducts between rooms.

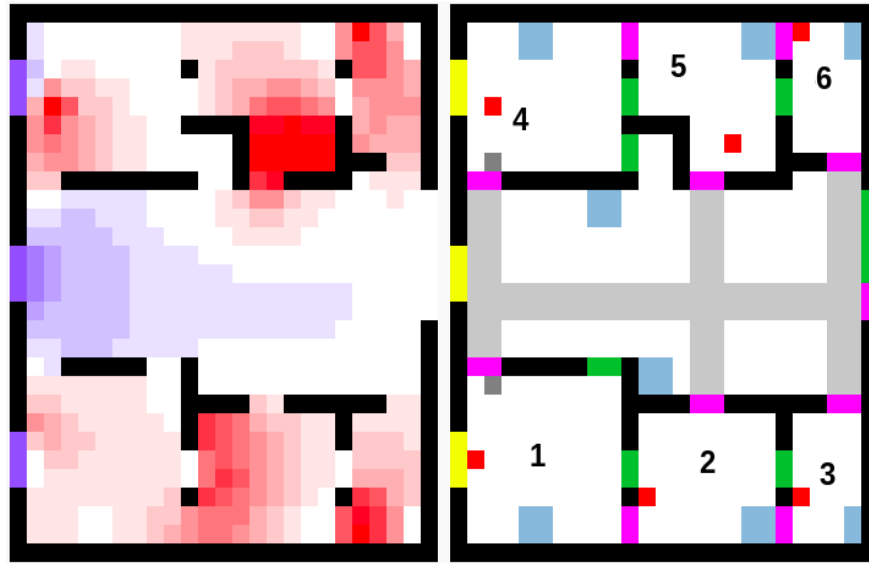


Figure 20: Scenario 4 Results.

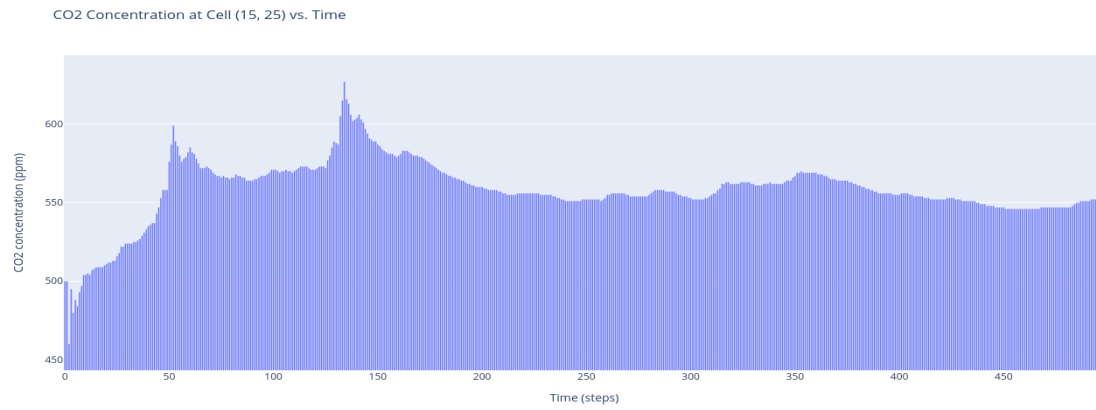


Figure 21: Scenario 4 Room5.

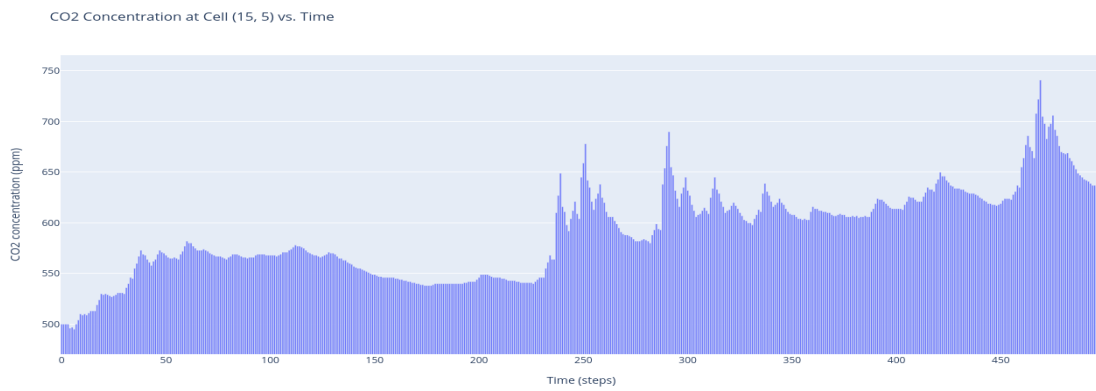


Figure 22: Scenario 4 Room2.

## **5 CONCLUSION**

In conclusion, the example presented in this paper showed that the implementation and configuration of ducts between rooms in a building can result in a significant difference in the concentration of CO<sub>2</sub> inside rooms. The results showed that the ventilation system works efficiently with the presence of ducts. In future work, the optimal setup of ducts between rooms can be measured with respect to the ventilation system setup and the number of rooms.

## **REFERENCES**

- Wainer G., 2009. Discrete-Event Modeling and Simulation: A Practitioner's Approach. 1st ed. CRC Press.
- G. Wainer; N. Giambiasi: "Application of the Cell-DEVS Paradigm for Cell Spaces Modeling and Simulation", Simulation, Vol. 71, No. 1, pp. 22-39, January 2001.
- Hoda khalil, Gabriel A. Wainer, Z Dunnigan "Cell-Devs Models for CO2 Sensors Locations In Closed Spaces", Proceedings of the Winter Simulation Conference 2020, Orlando, Florida, USA – 2020.
- Khalil, H., & Wainer, G. (in press). Modeling carbon dioxide dispersion indoors: a Cell-DEVS experiment. In *Proceedings of the 2020 Cellular Automata for Research and Industry (ACRI)*, December 2-4, 2020, Virtual.