

HIMax[®]

Field Termination Assembly
Manual

SAFETY
NONSTOP



X-FTA 003 02

All HIMA products mentioned in this manual are protected by the HIMA trade-mark. Unless noted otherwise, this also applies to other manufacturers and their respective products referred to herein.

All of the instructions and technical specifications in this manual have been written with great care and effective quality assurance measures have been implemented to ensure their validity. For questions, please contact HIMA directly. HIMA appreciates any suggestion on which information should be included in the manual.

Equipment subject to change without notice. HIMA also reserves the right to modify the written material without prior notice.

For further information, refer to the HIMA DVD and our website at <http://www.hima.de> and <http://www.hima.com>.

© Copyright 2012, HIMA Paul Hildebrandt GmbH

All rights reserved

Contact

HIMA contact details:

HIMA Paul Hildebrandt GmbH

P.O. Box 1261

68777 Brühl, Germany

Phone: +49 6202 709-0

Fax: +49 6202 709-107

E-mail: info@hima.com

Revision index	Revisions	Type of Change	
		technical	editorial
3.02	Added: Numbering of the male connectors (cable plugs) XG1 and XG2	X	X
5.00	Updated edition for SILworX V5 Added: New I/O modules	X	X

Table of Contents

1	Introduction	5
1.1	Structure and Use of the Manual	5
1.2	Target Audience	5
1.3	Formatting Conventions	6
1.3.1	Safety Notes	6
1.3.2	Operating Tips	7
2	Safety	8
2.1	Intended Use	8
2.1.1	Environmental Requirements	8
2.1.2	ESD Protective Measures	8
2.2	Residual Risk	9
2.3	Safety Precautions	9
2.4	Emergency Information	9
3	Product Description	10
3.1	Safety Function	10
3.2	Scope of Delivery	10
3.3	Type Label	10
3.4	Structure	11
3.4.1	Pin Assignment	12
3.4.2	Coding	12
3.5	Product Data	13
3.6	Accessories	13
4	Start-up	14
4.1	Installation/Mounting	15
4.1.1	Connecting the Patched Wires	15
5	Operation	16
5.1	Handling	16
5.2	Diagnosis	16
6	Maintenance	17
6.1	Faults	17
7	Decommissioning	18
8	Transport	19
9	Disposal	20

Appendix	21
Glossary	21
Index of Figures	22
Index of Tables	23
Index	24

1 Introduction

This manual describes the technical characteristics of the field termination assembly (FTA) X-FTA 003 02L and its use.

It provides information on how to install and start up the module.

1.1 Structure and Use of the Manual

The content of this manual is part of the hardware description of the HIMax programmable electronic system.

This manual is organized in the following main chapters:

- Introduction
- Safety
- Product Description
- Start-up
- Operation
- Repairs
- Decommissioning
- Transport
- Disposal

Additionally, the following documents must be taken into account:

Name	Content	Document no.
HIMax System Manual	Hardware description of the HIMax system	HI 801 001 E
HIMax Safety Manual	Safety functions of the HIMax systems	HI 801 003 E
HIMax Communication Manual	Description of communication and protocols	HI 801 101 E
SILworX Online Help (OLH)	Instructions on how to use SILworX	-
First Steps	Introduction to SILworX	HI 801 103 E

Table 1: Additional Valid Manuals

The latest manuals can be downloaded from the HIMA website at www.hima.com. The revision index on the footer can be used to compare the current version of existing manuals with the Internet edition.

1.2 Target Audience

This document addresses system planners, configuration engineers, programmers of automation devices and personnel authorized to implement, operate and maintain the devices and systems. Specialized knowledge of safety-related automation systems is required.

1.3 Formatting Conventions

To ensure improved readability and comprehensibility, the following fonts are used in this document:

Bold:	To highlight important parts Names of buttons, menu functions and tabs that can be clicked and used in SILworX.
<i>Italics:</i>	System parameter and variables
<code>Courier</code>	Literal user inputs
RUN	Operating state are designated by capitals
Chapter 1.2.3	Cross references are hyperlinks even though they are not particularly marked. When the cursor hovers over a hyperlink, it changes its shape. Click the hyperlink to jump to the corresponding position.

Safety notes and operating tips are particularly marked.

1.3.1 Safety Notes

The safety notes are represented as described below.

These notes must absolutely be observed to reduce the risk to a minimum. The content is structured as follows:

- Signal word: danger, warning, caution, notice
- Type and source of danger
- Consequences arising from the danger
- Danger prevention

SIGNAL WORD



Type and source of danger!

Consequences arising from the danger

Danger prevention

The signal words have the following meanings:

- Danger indicates hazardous situation which, if not avoided, will result in death or serious injury.
- Warning indicates hazardous situation which, if not avoided, could result in death or serious injury.
- Caution indicates hazardous situation which, if not avoided, could result in minor or modest injury.
- Notice indicates a hazardous situation which, if not avoided, could result in property damage.

NOTICE



Type and source of damage!

Damage prevention

1.3.2 Operating Tips

Additional information is structured as presented in the following example:

i

The text corresponding to the additional information is located here.

Useful tips and tricks appear as follows:

TIP

The tip text is located here.

2 Safety

All safety information, notes and instructions specified in this manual must be strictly observed. The product may only be used if all guidelines and safety instructions are adhered to.

This product is operated in accordance with SELV or PELV. No imminent danger results from the module itself. The use in Ex-Zone is permitted if additional measures are taken.

2.1 Intended Use

HIMax components are designed for assembling safety-related controller systems.

When using the components in the HIMax system, comply with the following general requirements

2.1.1 Environmental Requirements

Requirement type	Range of values
Protection class	Protection class III in accordance with IEC/EN 61131-2
Ambient temperature	0...+60 °C
Storage temperature	-40...+85 °C
Pollution	Pollution degree II in accordance with IEC/EN 61131-2
Altitude	< 2000 m
Housing	Standard: IP20
Supply voltage	24 VDC

Table 2: Environmental Requirements

Exposing the HIMax system to environmental conditions other than those specified in this manual can cause the HIMax system to malfunction.

2.1.2 ESD Protective Measures

Only personnel with knowledge of ESD protective measures may modify or extend the system or replace modules.

NOTE



Device damage due to electrostatic discharge!

- When performing the work, make sure that the working area is free of static and wear an ESD wrist strap.
- If not used, ensure that the device is protected from electrostatic discharge, e.g., by storing it in its packaging.

2.2 Residual Risk

No imminent danger results from a HIMax module itself.

Residual risk may result from:

- Faults in the engineering
- Faults in the wiring

2.3 Safety Precautions

Observe all local safety requirements and use the protective equipment required on site.

2.4 Emergency Information

A HIMax controller is a part of the safety equipment of a system. If the controller fails, the system adopts the safe state.

In case of emergency, no action that may prevent the HIMax systems from operating safely is permitted.

3 Product Description

The FTAs are mounted on the DIN rails of the control or marshalling cabinets and are used to connect the individual actuators or sensors of the field zone to the corresponding I/O modules. The FTA is connected to the connector board of the I/O module via system cables, see Figure 4.

The FTA is suitable for operating I/O modules redundantly or as single modules. The use of the FTA to set the redundancy allows I/O modules that are not located in the base plate adjacently to be connected redundantly.

The X-FTA 003 02L/02R can be connected via system cable with the connector boards of the following I/O modules:

Modules	Connector Boards	System cable
X-DI 64 01	X-CB 006 03/04	X-CA 003
X-DI 64 51	X-CB 006 53/54	X-CA 003

Table 3: Appropriate I/O Modules for the X-FTA 003 02L/02R

The FTA is encoded to ensure its connection to the proper system cable, see Chapter 3.4.2.

3.1 Safety Function

No safety function is performed by the FTA.

3.2 Scope of Delivery

The FTA is delivered without additional components.

3.3 Type Label

The type label specifies the following important details:


- Product name
- Mark of conformity
- Bar code (1D or 2D code)
- Part number (Part-No.)
- Hardware revision index (HW Rev.)
- Ex specifications (if applicable)
- Production year (Prod-Year:)



Figure 1: Sample Type Label

3.4 Structure

The FTA is manufactured in a left variant X-FTA 003 02L and a right variant X-FTA 003 02R. The X-FTA 003 02L is connected on the left side with a system cable, the X-FTA 003 02R on the right side.

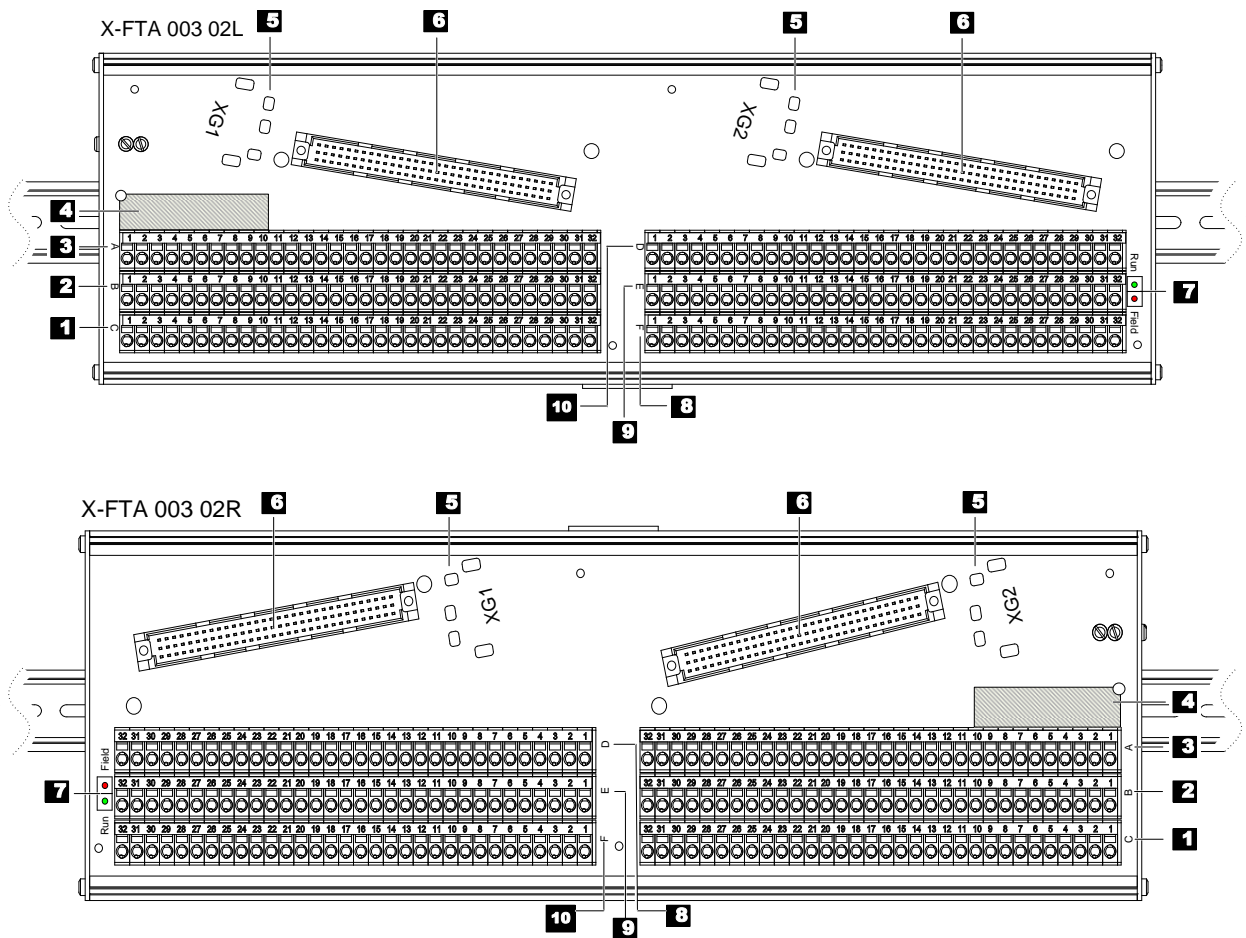

- | | |
|-----------------------------|---|
| 1 Row of Terminals C | 6 Male Connector (Cable Plugs) XG1 and XG2 |
| 2 Row of Terminals B | 7 Status Indicators |
| 3 Row of Terminals A | 8 Row of Terminals F |
| 4 Label Field | 9 Row of Terminals E |
| 5 Coding | 10 Row of Terminals D |

Figure 2: X-FTA 003 02L and X-FTA 003 02R

i

Only use a felt marker or a sticker to mark the label field **4** since traces are placed underneath it.

3.4.1 Pin Assignment

The field termination assemblies are equipped with six rows of terminals (A, B, C, D, E and F) containing 32 terminals each, whereby in rows A, C, D and F the same voltage is always present on each set of eight terminals.

Patched wires are connected as follows:

Row of Terminals	Terminal	Signal
A	1...8, 9...16, 17...24, 25...32	DI-, DI-, DI-, DI-
B	1...32	DI1+...DI32+
C	1...8, 9...16, 17...24, 25...32	S1+, S2+, S3+, S4+
D	1...8, 9...16, 17...24, 25...32	DI-, DI-, DI-, DI-
A	1...32	DI33+...DI64+
F	1...8, 9...16, 17...24, 25...32	S5+, S6+, S7+, S8+

Table 4: Pin Assignment of Patched Wires

3.4.2 Coding

The FTA is provided with a fixed coding scheme, see Figure 2. This prevents the wrong type of system cable plug from being inserted into the FTA.

3.5 Product Data

General	
Permissible voltage	SELV or PELV
Current load rating per channel	0.75 A per terminal
Terminal cross-section	0.2...2.5 mm ² flexible
Operating temperature	0...+60 °C
Storage temperature	-40...+85 °C
Humidity	max. 95 % relative humidity, non-condensing
Type of protection	IP20
Dimensions (H x W x D)	359 x 111 x 42 mm 359 x 111 x 85 mm (with cable plug)
Mounting	On DIN rail 35 mm
Weight	approx. 1 kg
Mounting position	Horizontal or vertical

Table 5: Product Data

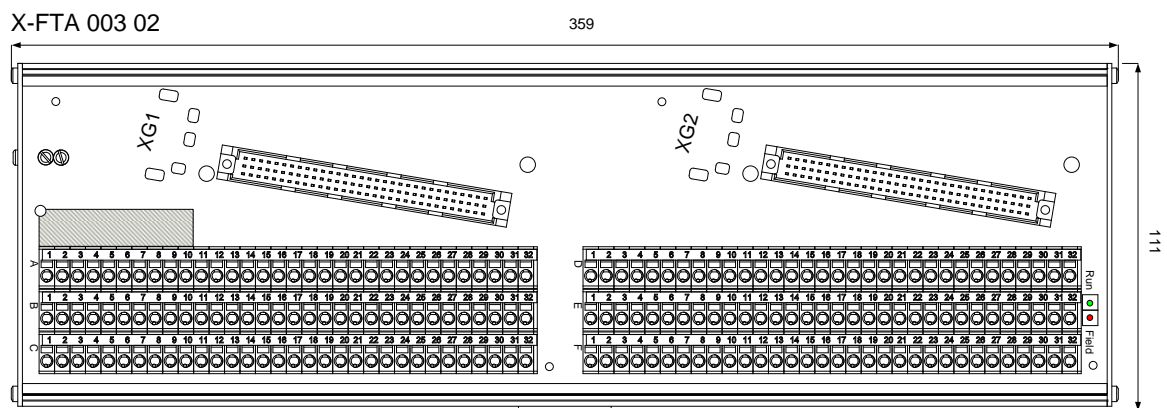



Figure 3: Dimension Drawing

3.6 Accessories

No accessories are provided with the X-FTA 003 02.

4 Start-up

The I/O modules are connected to the FTA via pre-assembled cables. One cable plug of the system cable is plugged in to the connector board of the corresponding I/O module and the other cable plug to the FTA. The patched wires are applied to the rows of terminals on the FTA. The patched wires connect the field cables attached to the spring terminals with the FTA.

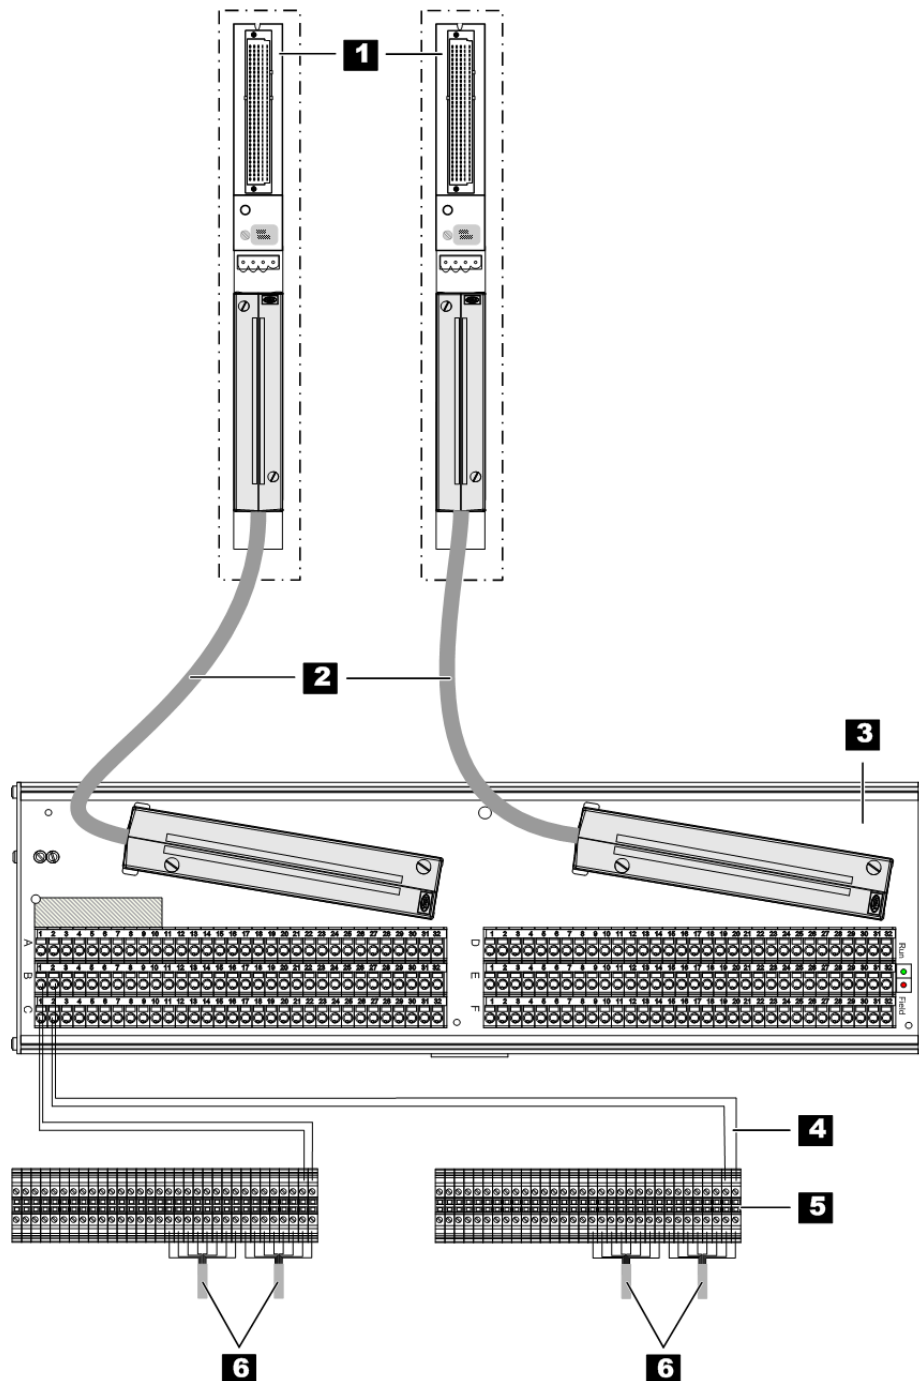

- | | |
|---|---|
| 1 Connector Boards in the Base Plate | 4 Patched Wires |
| 2 System Cable X-CA 003 01 | 5 Field Terminals in the Marshalling Cabinet |
| 3 X-FTA 003 02L | 6 Field Lines (Actuators/Sensors) |

Figure 4: Connection of the Field Lines to I/O Modules via FTA

4.1 Installation/Mounting

This chapter describes how to connect the patched wires. Refer to the corresponding module manual for details on proper wiring of I/O modules via FTAs.

4.1.1 Connecting the Patched Wires

Tools and utilities:

- Screwdriver, slotted 0.6 x 3.5 mm
- Wire stripper

1. Strip the insulation from the ends of the connector cables to a length of 8 mm.
2. Hold the stripped end in the round openings intended for the wires. Insert the screwdriver into the rectangular opening of the spring terminal to reduce its tension.
3. Insert the wire as far as it can go and remove the screwdriver.
Wires with wire end ferrules can be inserted directly.
4. Check that the connector cable is holding securely.
5. Reduce the tension on the spring terminal to release the patched wires. To do so, insert the screwdriver into the rectangular opening of the spring terminal.

i

After the system cable plugs were plugged in to the connector board and FTA, use the captive screws located on the plugs to secured them.

5 Operation

The field termination assembly is operated within a control or a marshalling cabinet and does not require any specific monitoring.

5.1 Handling

Direct handling of the FTA is not foreseen.

5.2 Diagnosis

The green LED *Run* and the red LED *Field* are used to indicate the following states:

LED	State
Run	The I/O module is supplied with voltage and connected to the FTA via system cables.
Field	Mono operation: The I/O module has detected field faults (e.g., in the I/O loop or in the connection between I/O module and FTA) Redundant operation: Both modules detect field faults

Table 6: LED Indicators

i

The LED indicators are not refreshed when the module is in STOP mode. For this reason, the LEDs still indicate field faults, even if they were removed. The LED indicators are refreshed as soon as the module is in RUN mode again.

6 Maintenance

The FTA is maintenance free. All system components are designed for continuous operation.

6.1 Faults

If faults occur, the defective system components must be replaced with components of the same type or with approved replacement models. Send defective system components back to HIMA.

Only personnel with knowledge of ESD protective measures may modify or extend the HIMax system.

WARNING



Electrostatic discharge can damage the electronic components within the systems.

7 Decommissioning

Remove the system cable to decommission the FTA.

8 Transport

To avoid mechanical damage, HIMax components must be transported in packaging.

Always store HIMax components in their original product packaging. This packaging also provides protection against electrostatic discharge. Note that the product packaging alone is not suitable for transport.

9 Disposal

Industrial customers are responsible for correctly disposing of decommissioned HIMax hardware. Upon request, a disposal agreement can be arranged with HIMA.

All materials must be disposed of in an ecologically sound manner.



Appendix

Glossary

Term	Description
ARP	Address Resolution Protocol: Network protocol for assigning the network addresses to hardware addresses
AI	Analog Input
Connector Board	Connector board for the HIMax module
COM	Communication module
CRC	Cyclic Redundancy Check
DI	Digital Input
DO	Digital Output
EMC	Electromagnetic Compatibility
EN	European Norm
ESD	ElectroStatic Discharge
FB	Fieldbus
FBD	Function Block Diagram
FTT	Fault Tolerance Time
ICMP	Internet Control Message Protocol: Network protocol for status or error messages
IEC	International Electrotechnical Commission
MAC address	Hardware address of one network connection (Media Access Control)
PADT	Programming And Debugging Tool (in accordance with IEC 61131-3), PC with SILworX
PE	Protective Earth
PELV	Protective Extra Low Voltage
PES	Programmable Electronic System
PFD	Probability of Failure on Demand, probability of failure on demand of a safety function
PFH	Probability of Failure per Hour, probability of a dangerous failure per hour
R	Read
r_p	Peak value of a total AC component
Rack ID	Base plate identification (number)
Interference-free	Supposing that two input circuits are connected to the same source (e.g., a transmitter). An input circuit is termed "non-reactive" if it does not distort the signals of the other input circuit.
R/W	Read/Write
SB	System Bus (Module)
SELV	Safety Extra Low Voltage
SFF	Safe Failure Fraction, portion of safely manageable faults
SIL	Safety Integrity Level (in accordance with IEC 61508)
SILworX	Programming tool for HIMax
SNTP	Simple Network Time Protocol (RFC 1769)
SRS	System.Rack.Slot addressing of a module
SW	Software
TMO	TiMeOut
W	Write
Watchdog (WD)	Time monitoring for modules or programs. If the watchdog time is exceeded, the module or program enters the ERROR STOP state.
WDT	WatchDog Time

Index of Figures

Figure 1:	Sample Type Label	10
Figure 2:	X-FTA 003 02L and X-FTA 003 02R	11
Figure 3:	Dimension Drawing	13
Figure 4:	Connection of the Field Lines to I/O Modules via FTA	14

Index of Tables

Table 1:	Additional Valid Manuals	5
Table 2:	Environmental Requirements	8
Table 3:	Appropriate I/O Modules for the X-FTA 003 02L/02R	10
Table 4:	Pin Assignment of Patched Wires	12
Table 5:	Product Data	13
Table 6:	LED Indicators	16

Index

FTA.....	5	specifications	13
LED.....	16		

HI 801 121 E

© 2012 HIMA Paul Hildebrandt GmbH

HIMax and SILworX are registered trademark of:
HIMA Paul Hildebrandt GmbH

Albert-Bassermann-Str. 28

68782 Brühl, Germany

Tel. +49 6202 709-0

Fax: +49 6202 709-107

HIMax-info@hima.com

www.hima.com



SAFETY
NONSTOP