# **HIMatrix**

# **Safety-Related Controller**

# **F3 DIO 8/8 01 Manual**





HIMA Paul Hildebrandt GmbH Industrial Automation

Rev. 2.00 HI 800 179 E

All HIMA products mentioned in this manual are protected by the HIMA trade-mark. Unless noted otherwise, this also applies to other manufacturers and their respective products referred to herein.

HIMax<sup>®</sup>, HIMatrix<sup>®</sup>, SILworX<sup>®</sup>, XMR<sup>®</sup> and FlexSILon<sup>®</sup> are registered trademarks of HIMA Paul Hildebrandt GmbH.

All of the instructions and technical specifications in this manual have been written with great care and effective quality assurance measures have been implemented to ensure their validity. For questions, please contact HIMA directly. HIMA appreciates any suggestion on which information should be included in the manual.

Equipment subject to change without notice. HIMA also reserves the right to modify the written material without prior notice.

For further information, refer to the HIMA DVD and our website at http://www.hima.de and http://www.hima.com.

© Copyright 2013, HIMA Paul Hildebrandt GmbH All rights reserved

#### Contact

HIMA contact details:

HIMA Paul Hildebrandt GmbH

P.O. Box 1261

68777 Brühl, Germany Phone: +49 6202 709-0

Fax: +49 6202 709-107 E-mail: info@hima.com

Revision	Revisions	Type of change		
index		technical	editorial	
1.00	Added: Configuration with SILworX	Х	X	
1.01	Deleted: Chapter <i>Monitoring the Temperature State</i> integrated in the system manual		Х	
2.00	Revised: Chapters 3.4.1 and 3.4.2.1 Added: F3 DIO 8/8 014, SIL 4 certified according to EN 50126, EN 50128 and EN 50129, Chapter 4.1.4	Х	Х	

F3 DIO 8/8 01 Table of Contents

# **Table of Contents**

1	Introduction	5
1.1	Structure and Use of this Manual	5
1.2	Target Audience	6
1.3	Formatting Conventions	7
1.3.1 1.3.2	Safety Notes Operating Tips	7 8
2	Safety	9
2.1	Intended Use	9
2.1.1 2.1.2	Environmental Requirements ESD Protective Measures	9
2.2	Residual Risk	10
2.3	Safety Precautions	10
2.4	Emergency Information	10
3	Product Description	11
3.1	Safety Function	11
3.1.1	Safety-Related Digital Inputs	11
3.1.1.1 3.1.1.2	Reaction in the Event of a Fault Line Control	12 12
3.1.2	Safety-Related Digital Outputs	13
3.1.2.1	Line Diagnosis	14
3.1.2.2	Reaction in the Event of a Fault	15
3.1.3	Pulsed Outputs	15
3.2	Equipment, Scope of Delivery	16
3.2.1	IP Address and System ID (SRS)	16
3.3	Type Label	17
<b>3.4</b> 3.4.1	Assembly	18
3.4.1.1	LED Indicators Operating Voltage LED	19 19
3.4.1.2 3.4.1.3	System LEDs Communication LEDs	19 20
3.4.1.4	I/O LEDs	20
3.4.2	Communication	21
3.4.2.1 3.4.2.2	Connections for Ethernet Communication Network Ports Used for Ethernet Communication	21 21
3.4.3	Reset Key	22
3.5	Product Data	23
3.5.1	Product Data F3 DIO 8/8 014	25
3.6	Certified HIMatrix F3 DIO 8/8 01	25
4	Start-up	26
4.1	Installation and Mounting	26
4.1.1	Connecting the Digital Inputs	26
4.1.1.1	Surges on Digital Inputs	26
4.1.2	Connecting the Digital Outputs	27

HI 800 179 E Rev. 2.00 Page 3 of 52

Table of Contents F3 DIO 8/8 01

4.1.3	Connecting Pulsed Outputs	27
4.1.4	Cable Plugs	28
4.1.5	Mounting the F3 DIO 8/8 01 in Zone 2	29
4.2	Configuration	30
4.3	Configuration with SILworX	30
4.3.1 4.3.2	Parameters and Error Codes for the Inputs and Outputs Digital Inputs of F3 DIO 8/8 01	30 31
4.3.2.1	Tab: <b>Module</b> Tab: <b>DO 8 LC: Channels</b>	31
4.3.2.2 4.3.3	Digital Outputs of F3 DIO 8/8 01: DO 2 02	32 33
4.3.3.1	Tab: <b>Module</b>	33
4.3.3.1 4.3.3.2	Tab: <b>DO 2 02: DO1 Channels</b>	34
4.3.3.3	Tab: <b>DO 2 02: DO2 Channels</b>	34
4.3.4	Digital Outputs of F3 DIO 8/8 01: DO 2 01	35
4.3.4.1	Tab: Module	35
4.3.4.2	Tab: DO 2 01: DO1 Channels	36
4.4	Configuration with ELOP II Factory	37
4.4.1	Configuring the Inputs and Outputs	37
4.4.2 4.4.3	Signals and Error Codes for the Inputs and Outputs Digital Inputs of F3 DIO 8/8 01	37 38
4.4.3 4.4.4	Digital Outputs of F3 DIO 8/8 01, DO+ (DO1), DO- (DO2)	39
4.4.5	Pulsed Outputs for F3 DIO 8/8 01	40
5	Operation	41
5.1	Handling	41
5.2	Diagnosis	41
6	Maintenance	42
6.1	Faults	42
6.2	Maintenance Measures	42
6.2.1	Loading the Operating System	42
6.2.2	Proof Test	42
7	Decommissioning	43
8	Transport	44
9	Disposal	45
	Appendix	47
	Glossary	47
	Index of Figures	48
	Index of Tables	49
	Index	50

Page 4 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 1 Introduction

#### 1 Introduction

This manual describes the technical characteristics of the device and its use. It provides information on how to install, start up and configure the module.

#### 1.1 Structure and Use of this Manual

The content of this manual is part of the hardware description of the HIMatrix programmable electronic system.

This manual is organized in the following main chapters:

- Introduction
- Safety
- Product Description
- Start-up
- Operation
- Maintenance
- Decommissioning
- Transport
- Disposal

HIMatrix remote I/Os are available for the programming tools SILworX and ELOP II Factory. Which programming tool can be used, depends on the processor operating system of the HIMatrix remote I/O, refer to the following table:

	Programming tool	Processor operating system
	SILworX	CPU OS V7 and higher
ſ	ELOP II Factory	CPU OS up to V6.x

Table 1: Programming Tools for HIMatrix Remote I/Os

In the manual, the differences are specified by using:

- Separated chapters
- Tables differentiating among the versions

i	Projects created with ELOP II Factory cannot be edited with SILworX, and vice versa!
i	Compact controllers and remote I/Os are referred to as devices.

HI 800 179 E Rev. 2.00 Page 5 of 52

1 Introduction F3 DIO 8/8 01

Additionally, the following documents must be taken into account:

Name	Content	Document number
HIMatrix System Manual Compact Systems	Hardware description of the HIMatrix compact systems	HI 800 141 E
HIMatrix System Manual Modular System F60	Hardware description of the HIMatrix modular system	HI 800 191 E
HIMatrix Safety Manual	Safety functions of the HIMatrix system	HI 800 023 E
HIMatrix Safety Manual for Railway Applications	Safety functions of the HIMatrix system using the HIMatrix in railway applications	HI 800 437 E
SILworX Online Help	Instructions on how to use SILworX	-
ELOP II Factory Online Help	Instructions on how to use ELOP II Factory, Ethernet IP protocol	-
SILworX First Steps	Introduction to SILworX using the HIMax system as an example	HI 801 103 E
ELOP II Factory First Steps	Introduction to ELOP II Factory	HI 800 006 E

Table 2: Additional Relevant Documents

The latest manuals can be downloaded from the HIMA website at www.hima.com. The revision index on the footer can be used to compare the current version of existing manuals with the Internet edition.

# 1.2 Target Audience

This document addresses system planners, configuration engineers, programmers of automation devices and personnel authorized to implement, operate and maintain the modules and systems. Specialized knowledge of safety-related automation systems is required.

Page 6 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 1 Introduction

# 1.3 Formatting Conventions

To ensure improved readability and comprehensibility, the following fonts are used in this document:

**Bold** To highlight important parts.

Names of buttons, menu functions and tabs that can be clicked and used

in the programming tool.

Italics For parameters and system variables

Courier Literal user inputs

RUN Operating state are designated by capitals

Chapter 1.2.3 Cross references are hyperlinks even though they are not particularly

marked. When the cursor hovers over a hyperlink, it changes its shape.

Click the hyperlink to jump to the corresponding position.

Safety notes and operating tips are particularly marked.

#### 1.3.1 Safety Notes

The safety notes are represented as described below.

These notes must absolutely be observed to reduce the risk to a minimum. The content is structured as follows:

- Signal word: warning, caution, notice
- Type and source of risk
- Consequences arising from non-observance
- Risk prevention

# **A** SIGNAL WORD



Type and source of risk!

Consequences arising from non-observance

Risk prevention

The signal words have the following meanings:

- Warning indicates hazardous situation which, if not avoided, could result in death or serious injury.
- Caution indicates hazardous situation which, if not avoided, could result in minor or modest injury.
- Notice indicates a hazardous situation which, if not avoided, could result in property damage.

#### **NOTE**



Type and source of damage!

Damage prevention

HI 800 179 E Rev. 2.00 Page 7 of 52

1 Introduction F3 DIO 8/8 01

# 1.3.2 Operating Tips Additional information is structured as presented in the following example: The text corresponding to the additional information is located here. Useful tips and tricks appear as follows:

TIP

The tip text is located here.

Page 8 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 2 Safety

# 2 Safety

All safety information, notes and instructions specified in this document must be strictly observed. The product may only be used if all guidelines and safety instructions are adhered to.

This product is operated with SELV or PELV. No imminent risk results from the product itself. The use in Ex-zone is permitted if additional measures are taken.

#### 2.1 Intended Use

HIMatrix components are designed for assembling safety-related controller systems.

When using the components in the HIMatrix system, comply with the following general requirements.

# 2.1.1 Environmental Requirements

Requirement type	Range of values 1)		
Protection class	Protection class III in accordance with IEC/EN 61131-2		
Ambient temperature	0+60 °C		
Storage temperature	-40+85 °C		
Pollution	Pollution degree II in accordance with IEC/EN 61131-2		
Altitude	< 2000 m		
Housing	Standard: IP20		
Supply voltage	24 VDC		
1) The values ensified in the technical data apply and are decisive for devices with extended			

The values specified in the technical data apply and are decisive for devices with extended environmental requirements.

Table 3: Environmental Requirements

Exposing the HIMatrix system to environmental conditions other than those specified in this manual can cause the HIMatrix system to malfunction.

# 2.1.2 ESD Protective Measures

Only personnel with knowledge of ESD protective measures may modify or extend the system or replace devices.

#### NOTE



Device damage due to electrostatic discharge!

- When performing the work, make sure that the workspace is free of static, and wear an ESD wrist strap.
- If not used, ensure that the device is protected from electrostatic discharge, e.g., by storing it in its packaging.

HI 800 179 E Rev. 2.00 Page 9 of 52

2 Safety F3 DIO 8/8 01

## 2.2 Residual Risk

No imminent risk results from a HIMatrix system itself.

Residual risk may result from:

- Faults related to engineering
- Faults related to the user program
- Faults related to the wiring

# 2.3 Safety Precautions

Observe all local safety requirements and use the protective equipment required on site.

## 2.4 Emergency Information

A HIMatrix system is a part of the safety equipment of a site. If a device or a module fails, the system enters the safe state.

In case of emergency, no action that may prevent the HIMatrix systems from operating safely is permitted.

Page 10 of 52 HI 800 179 E Rev. 2.00

# 3 Product Description

The safety-related **F3 DIO 8/8 01** remote I/O is a compact system in a metal housing with 8 digital inputs, 8 digital DO+ outputs (L- ground), 2 digital DO- outputs (S+ ground) and 2 pulsed outputs. The digital outputs DO4+, DO8+, DO4- and DO8- can also be connected as 2-pole connections.

The remote I/O is available in various model variants for SILworX and ELOP II Factory, see Table 4.

Remote I/Os are connected to individual HIMax or HIMatrix controllers via safe**ethernet**. They are used to extend the I/O level, but are not able to run any user program by themselves.

The remote I/O is suitable for mounting in Ex-zone 2, see Chapter 4.1.5.

The device is TÜV-certified for safety-related applications up to SIL 3 (IEC 61508, IEC 61511 and IEC 62061), Cat. 4 and PL e (EN ISO 13849-1) and SIL 4 (EN 50126, EN 50128 and EN 50129).

Further safety standards, application standards and test standards are specified in the certificates available on the HIMA website.

#### 3.1 Safety Function


The remote I/O is equipped with safety-related digital inputs and outputs. The input values on the inputs are safely transmitted to the connected controller via safe**ethernet**. The outputs are safely assigned their values by the connected controller via safe**ethernet**.

#### 3.1.1 Safety-Related Digital Inputs

The remote I/O is equipped with 8 digital inputs. The state (HIGH, LOW) of each input is signaled by an individual LED.

Mechanical contacts without own power supply or signal power source can be connected to the inputs. Potential-free mechanical contacts without own power supply are fed via an internal short-circuit-proof 24 V power source (LS+). Each of them supply a group of 4 mechanical contacts. Figure 1 shows how the connection is performed.

With signal voltage sources, the corresponding ground must be connected to the input (L-), see Figure 1.

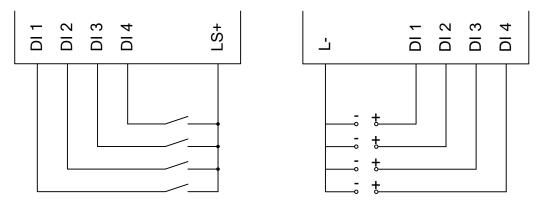

Connection of potential-free mechanical contacts

Connection of signal power sources

Figure 1: Connections to Safety-Related Digital Inputs

For the external wiring and the connection of sensors, apply the de-energized-to-trip principle. Thus, if a fault occurs, the input signals adopt a de-energized, safe state (low level).

If an external wire is not monitored, an open-circuit is considered as safe low level.

HI 800 179 E Rev. 2.00 Page 11 of 52

#### 3.1.1.1 Reaction in the Event of a Fault

If the device detects a fault on a digital input, the user program processes a low level in accordance with the de-energized to trip principle.

The device activates the FAULT LED.

In addition to the channel signal value, the user program must also consider the corresponding error code.

The error code allows the user to configure additional fault reactions in the user program.

#### 3.1.1.2 Line Control

Line control is used to detect short-circuits or open-circuits and can be configured for the remote I/O, e.g., on EMERGENCY STOP inputs complying with Cat. 4 and PL e in accordance with EN ISO 13849-1.

To this end, connect the digital outputs TO 1 through TO 2 of the system to the digital inputs DI of the same system as follows:

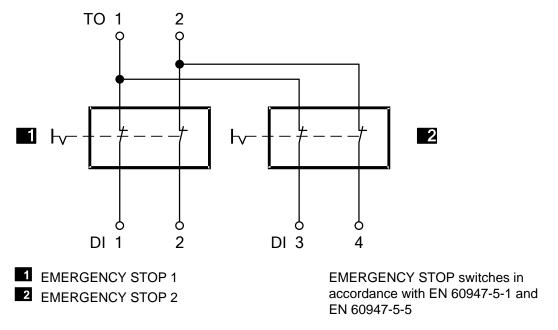


Figure 2: Line Control

The remote I/O pulses the pulsed outputs to detect short-circuits and open-circuits on the lines connected to the digital inputs. To do so, configure the *Value* [BOOL] -> system variable in SILworX or the *DO[01].Value* system signal in ELOP II Factory. The variables for the pulsed outputs must begin with channel 1 and reside in direct sequence, one after the other.

If the following faults occur, the *FAULT* LED located on the front plate of the device blinks, the inputs are set to low level and an (evaluable) error code is created:

- Cross-circuit between two parallel wires.
- Invalid connections of two lines (e.g., TO 2 to DI 3),
- Earth fault on one wire (with earthed ground only).
- Open-circuit or open contacts, i.e., including when one of the two EMERGENCY STOP switches mentioned above has been engaged, the FAULT LED blinks and the error code is created.

Page 12 of 52 HI 800 179 E Rev. 2.00

# 3.1.2 Safety-Related Digital Outputs

The remote I/O is equipped with 8 digital outputs DO+ (ground L-) and 2 digital outputs DO- (ground S+). The state (HIGH, LOW) of each output is signaled by an individual LED (HIGH, LOW).

At the maximum ambient temperature, the DO+ outputs 1...3 and 5...7 can be loaded with 0.5 A each, and DO+ outputs 4 and 8 can be loaded with 1 A or with 2 A at an ambient temperature of up to 40 °C.

At the maximum ambient temperature, the DO- outputs 4- and 8- can be loaded with 1 A each or with 2 A at an ambient temperature of up to 40 °C.

Within a temperature range of 60...70 °C, all outputs of the F3 DIO 8/8 014 can be loaded with 0.5 A, see Table 15.

The digital outputs DO4+, DO8+, DO4- and DO8- can be connected as one-pole or 2-pole switching connections. The remaining outputs are only set up for one-pole switching connections.

With 1-pole switching outputs, ensure that the system's L- ground from the corresponding channel group is used for the DO+ outputs and the system's S+ ground is used for the DO-outputs, see Table 18. The S+ ground is limited by the system to a maximum current of 8 A and obtained from the 24 V voltage connection.

The external wire of an output is not monitored, however, a detected short-circuit is signaled.

With 2-pole switching outputs, the L+ switching output DO4+ must be connected to the L-switching output DO4- and the L+ switching output DO8+ to the L- switching output DO8-. This type of connection must be set via the DO2[xx].2-pole system parameter.

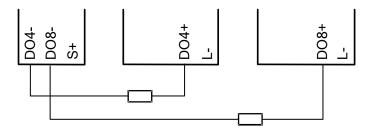


Figure 3: Connection to the 2-Pole Switching Outputs (DO-, DO+)

HI 800 179 E Rev. 2.00 Page 13 of 52

# 3.1.2.1 Line Diagnosis

During 2-pole operation, a line diagnosis is performed to detect potential external short-circuits to L+ and L-. Time on delay is required to detect external short-circuits with an inductive or capacitive load or a lamp load. This delay can be configured using the *Time on delay* system parameter. In the range of 0...30 ms, the value can be set in steps of 1 ms.

Initial values must be set for all relevant system parameters of the line diagnosis (DO2[xx].2-Pole, Time on delay).

Therefore, first set all required system parameters in the programming tool, then compile the user program, and finally, transfer the program to the controller.

The settings for the system parameters configured for line diagnosis cannot be changed during operation!

An external open-circuit will not be detected.

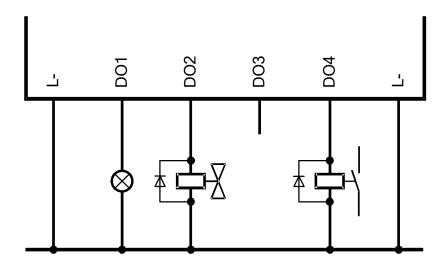


Figure 4: Connection of Actuators to Outputs

The redundant connection of two outputs must be decoupled with diodes. Only 1-pole switching outputs may be connected redundantly.

# **A** CAUTION



For connecting a load to a one-pole switching output, use the corresponding L- ground of the respective channel group (2-pole connection) to ensure that the internal protective circuit can function.

Page 14 of 52 HI 800 179 E Rev. 2.00

#### 3.1.2.2 Reaction in the Event of a Fault

If the device detects a faulty signal on a digital output, the affected module output is set to the safe (de-energized) state using the safety switches.

If a device fault occurs, all digital outputs are switched off.

In both cases, the devices activates the FAULT LED.

The error code allows the user to configure additional fault reactions in the user program.

# 3.1.3 Pulsed Outputs

The 2 digital pulsed outputs can be used to detect short-circuits and open-circuits on digital inputs, e.g., on EMERGENCY STOP button complying with Cat. 4 and PL e in accordance with EN ISO 13849-1.

Pulsed outputs must not be used as safety-related outputs (e.g., for activating safety-related actuators)!

HI 800 179 E Rev. 2.00 Page 15 of 52

# 3.2 Equipment, Scope of Delivery

The following table specifies the available remote I/O variants:

Designation	Description
F3 DIO 8/8 01	Remote I/O (8 digital inputs, 8 digital outputs, 2 pulsed outputs), Operating temperature: 0+60 °C, for ELOP II Factory programming tool
F3 DIO 8/8 014	Remote I/O (8 digital inputs, 8 digital outputs, 2 pulsed outputs), Operating temperature: -25+70 °C (temperature class T1), Vibration and shock tested according to EN 50125-3 and EN 50155, class 1B according to IEC 61373, for ELOP II Factory programming tool
F3 DIO 8/8 01 SILworX	Remote I/O (8 digital inputs, 8 digital outputs, 2 pulsed outputs), Operating temperature: 0+60 °C, for SILworX programming tool
F3 DIO 8/8 014 SILworX	Remote I/O (8 digital inputs, 8 digital outputs, 2 pulsed outputs), Operating temperature: -25+70 °C (temperature class T1), Vibration and shock tested according to EN 50125-3 and EN 50155, class 1B according to IEC 61373, for SILworX programming tool

Table 4: Available Variants

# 3.2.1 IP Address and System ID (SRS)

A transparent label is delivered with the device to allow one to note the IP address and the system ID (SRS for system rack slot) after a change.

חו			CDC	
IΡ	-		SRS	

Default value for IP address: 192.168.0.99

Default value for SRS: 60 000.200.0 (SILworX)

60 000.0.0 (ELOP II Factory)

The label must be affixed such that the ventilation slots in the housing are not obstructed.

Refer to the First Steps manual of the programming tool for more information on how to modify the IP address and the system ID.

Page 16 of 52 HI 800 179 E Rev. 2.00

# 3.3 Type Label

The type plate contains the following details:

- Product name
- Bar code (1D or 2D code)
- Part no.
- Production year
- Hardware revision index (HW Rev.)
- Firmware revision index (FW Rev.)
- Operating voltage
- Mark of conformity



Figure 5: Sample Type Label

HI 800 179 E Rev. 2.00 Page 17 of 52

# 3.4 Assembly

This chapter describes the layout and function of the remote I/Os, and their communication via safe**ethernet**.

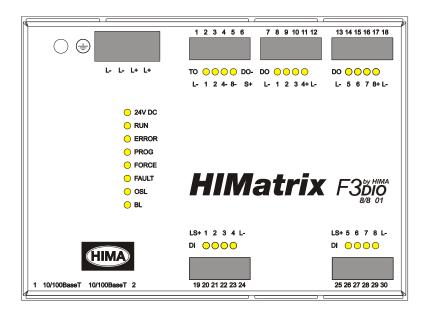


Figure 6: Front View

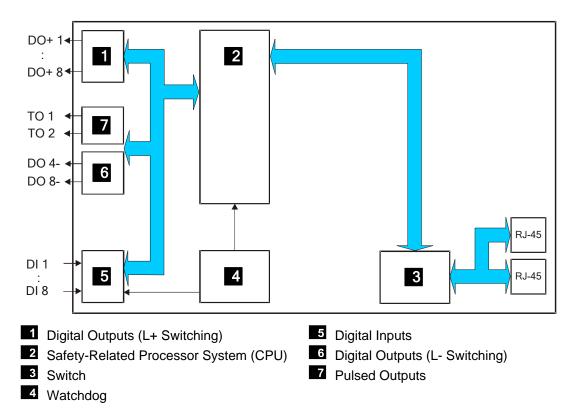


Figure 7: Block Diagram

Page 18 of 52 HI 800 179 E Rev. 2.00

## 3.4.1 LED Indicators

The light-emitting diodes (LEDs) indicate the operating state of the remote I/O. The LEDs are classified as follows:

- Operating voltage LED
- System LEDs
- Communication LEDs
- I/O LEDs

## 3.4.1.1 Operating Voltage LED

LED	Color	Status	Description
24 VDC	Green	On	24 VDC operating voltage present
		Off	No operating voltage

Table 5: Operating Voltage LED

# 3.4.1.2 System LEDs

While the system is being booted, all LEDs are lit simultaneously.

LED	Color	Status	Description		
RUN	Green	On	Device in RUN, normal operation		
		Blinking	Device in STOP		
			A new operating system is being loaded.		
		Off	The device is not in the RUN state.		
ERROR	Red	On	The device is in the ERROR STOP state.		
			Internal fault detected by self-tests, e.g., hardware faults or cycle time overrun.		
			The processor system can only be restarted with a command from the PADT (reboot).		
		Blinking	If ERROR blinks and all others LEDs are lit simultaneously, the boot loader has detected an operating system fault in the flash memory and waits for a new operating system to be loaded.		
		Off	No faults detected.		
PROG	Yellow	On	A new configuration is being loaded into the device.		
		Blinking	The device switches from INIT to STOP		
			A new operating system is being loaded into the flash ROM.		
		Off	No configuration or operating system is being loaded.		
FORCE	Yellow	Off	The FORCE LED of a remote I/O is not functioning. The FORCE LED of the associated controller serves to signal the forcing of a remote I/O.		
FAULT	Yellow	On	The loaded configuration is not valid.		
			The new operating system is corrupted (after OS download).		
		Blinking	Fault while loading a new operating system		
			One or multiple I/O faults occurred.		
		Off	None of the described faults occurred.		
OSL	Yellow	Blinking	Operating system emergency loader active.		
		Off	Operating system emergency loader inactive.		
BL	Yellow	Blinking	OS and OSL binary defective or hardware fault, INIT_FAIL.		
		Off	None of the described faults occurred.		

Table 6: System LEDs

HI 800 179 E Rev. 2.00 Page 19 of 52

# 3.4.1.3 Communication LEDs

All RJ-45 connectors are provided with a small green and a yellow LEDs. The LEDs signal the following states:

LED	Status	Description				
Green	On	Full duplex operation				
	Blinking	Collision				
	Off	Half duplex operation, no collision				
<b>Yellow</b>	On	Connection available				
	Blinking	Interface activity				
	Off	No connection available				

Table 7: Ethernet Indicators

# 3.4.1.4 I/O LEDs

LED	Color	Status	Description	
DI 18	<b>Yellow</b>	On	The related input is active (energized).	
		Off	The related input is inactive (de-energized).	
TO 1,	<b>Yellow</b>	On	Pulsed output activated.	
TO 2		Off	Pulsed output deactivated.	
DO 18	Yellow	On	The related output is active (energized).	
		Off	The related output is inactive (de-energized).	
DO 4-, DO	<b>Yellow</b>	On	The related output is active (energized).	
8-		Off	The related output is inactive (de-energized).	

Table 8: I/O LEDs

Page 20 of 52 HI 800 179 E Rev. 2.00

#### 3.4.2 Communication

The remote I/O communicates with the associated controller via safeethernet.

#### 3.4.2.1 Connections for Ethernet Communication

Property	Description	
Port	2 x RJ-45	
Transfer standard	10BASE-T/100BASE-Tx, half and full duplex	
Auto negotiation	Yes	
Auto crossover	Yes	
IP address	Freely configurable <sup>1)</sup>	
Subnet mask	Freely configurable <sup>1)</sup>	
Supported protocols  Safety-related: safeethernet Standard protocols: Programming and debugging tool (PADT), SNTP		
1) The general rules for assigning IP address and subnet masks must be adhered to.		

Table 9: Ethernet Interfaces Properties

The two RJ-45 connectors with integrated LEDs are located on the bottom left-hand side of the housing. Refer to Chapter 3.4.1.3 for a description of the LEDs' function.

The connection parameters are read based on the MAC address (media access control address) defined during manufacturing.

The MAC address for the remote I/O is specified on a label located above the two RJ-45 connectors (1 and 2).

MAC 00:E0:A1:00:06:C0

Figure 8: Sample MAC Address Label

The remote I/O is equipped with an integrated switch for Ethernet communication. For further information on the integrated switch and safe**ethernet**, refer to Chapter *Communication* of the system manual for compact systems (HI 800 141 E).

#### 3.4.2.2 Network Ports Used for Ethernet Communication

UDP ports	Use
8000	Programming and operation with the programing tool
8001	Configuration of the remote I/O using the PES (ELOP II Factory)
8004	Configuration of the remote I/O using the PES (SILworX)
6010	safeethernet
123	SNTP (time synchronization between PES and remote I/O, PES and external devices)

Table 10: Network Ports in Use

HI 800 179 E Rev. 2.00 Page 21 of 52

#### 3.4.3 Reset Key

The remote I/O is equipped with a reset key. The key is only required if the user name or password for administrator access is not known. If only the IP address set for the remote I/O does not match the PADT (PC), the connection can be established with a Route add entry on the PC.

i

Only the model variants without protective lacquer are equipped with a reset key.

The key can be accessed through a small round hole located approximately 5 cm from the upper left-hand side of the housing. The key is engaged using a suitable pin made of insulating material to avoid short-circuits within the remote I/O.

The reset is only effective if the remote I/O is rebooted (switched off and on) while the key is simultaneously engaged for at least 20 s. Engaging the key during operation has no effect.

Properties and behavior of the remote I/IO after a reboot with engaged reset key:

- Connection parameters (IP address and system ID) are set to the default values.
- All accounts are deactivated except for the administrator default account with empty password.

After a new reboot without the reset key engaged, the connection parameters (IP address and system ID) and accounts become effective.

- Those configured by the user.
- Those valid prior to rebooting with the reset key engaged, if no changes were performed.

Page 22 of 52 HI 800 179 E Rev. 2.00

# 3.5 Product Data

General	
Response time	≥ 10 ms
Ethernet interfaces	2 x RJ-45, 10BASE-T/100BASE-Tx with integrated switch
Operating voltage	24 VDC, -15+20 %, r <sub>PP</sub> ≤ 15 %, from a power supply unit with safe insulation in accordance with IEC 61131-2
Current input	max. 8 A (with maximum load) Idle: approx. 0.4 A at 24 V
Fuse (external)	10 A time-lag (T)
Back-up battery	None
Operating temperature	0+60 °C
Storage temperature	-40+85 °C
Type of protection	IP20
Max. dimensions (without plug)	Width: 152 mm (with housing screws) Height: 114 mm (with fixing bolt) Depth: 66 mm (with earthing screw)
Weight	approx. 1 kg

Table 11: Product Data

Digital inputs			
Number of inputs		8 (non-galvanically separated)	
High level: Voltage		1530 VDC	
	Current input	≥ 2 mA at 15 V	
Low level:	Voltage	max. 5 VDC	
	Current input	max. 1.5 mA (1 mA at 5 V)	
Switching point		typ. 7.5 V	
Supply		2 x 20 V / 100 mA (at 24 V), short-circuit-proof	

Table 12: Specifications for Digital Inputs

HI 800 179 E Rev. 2.00 Page 23 of 52

Digital outputs (DO+ and DO-)				
Number of outputs DO+	8 (non-galvanically separated)			
L+ switching	Common ground L-	, , , ,		
Number of outputs DO-	2 (non-galvanically separated)			
L- switching	Common ground S+			
Output voltage	≥ L+ minus 2 V			
Output current DO+	Channels 13 and 57: 0.5 A	up to 60 °C		
	The output current of the chann	els 4 and 8 depends on the		
	ambient temperature.			
	Ambient temperature	Output current		
	< 40 °C	2 A		
	4060 °C	1 A		
Output current DO-	The output current of the chann	els 4 and 8 depends on the		
	ambient temperature.	Outrant summent		
	Ambient temperature	Output current		
	< 40 °C	2 A		
	4060 °C	1 A		
Lamp load, max.:				
DO+ channel 13 and 57	10 W			
DO+ channel 4 and 8	25 W			
DO- channel 4 and 8	25 W			
Inductive load, max.:				
DO+ channel 13 and 57	500 mH			
DO+ channel 4 and 8	500 mH			
DO- channel 4 and 8	500 mH			
Minimum load	2 mA for each channel			
Internal voltage drop	max. 2 V at 2 A			
Behavior upon overload	The affected output is switched off and cyclically switched again			
Total output current	max. 7 A, upon overload, all outputs are s switched on again	witched off and cyclically		

Table 13: Specifications for the Digital Outputs

Pulsed outputs		
Number of outputs	2 (non-galvanically separated)	
Output voltage	≥ L+ minus 4 V	
Output current	approx. 60 mA	
Minimum load	none	
Switching time	≤ 100 µs	
Behavior upon overload	2 x ≥ 19.2 V, short-circuit current 60 mA at 24 V	

Table 14: Specifications for the Pulsed Outputs

Page 24 of 52 HI 800 179 E Rev. 2.00

## 3.5.1 Product Data F3 DIO 8/8 014

The F3 DIO 8/8 014 model variant is intended for use in railway applications. The electronic components are coated with a protective lacquer.

F3 DIO 8/8 014		
Operating temperature	-25+70 °C (temperature class	s T1)
Output current DO+	Channels 13 and 57: 0.5 A at ≤ 70 °C  The output current of the channels 4 and 8 depends on the ambient temperature.	
	Ambient temperature	Output current
	< 40 °C	2 A
	4060 °C	1 A
	> 60 °C	0.5 A
Output current DO-	The output current of the channels 4 and 8 depends on the ambient temperature.	
	Ambient temperature	Output current
	< 40 °C	2 A
	4060 °C	1 A
	> 60 °C	0.5 A
Weight	approx. 1 kg	

Table 15: Product Data of F3 DIO 8/8 014

The remote I/O F3 DIO 8/8 014 meets the conditions for vibrations and shock test according to IEC 61373, category 1, class B.

#### 3.6 Certified HIMatrix F3 DIO 8/8 01

HIMatrix F3 DIO 8/8 01		
CE	EMC, ATEX Zone 2	
TÜV	IEC 61508 1-7:2000 up to SIL 3	
	IEC 61511:2004	
	EN ISO 13849-1:2008 up to Cat. 4 und PL e	
UL Underwriters	ANSI/UL 508, NFPA 70 – Industrial Control Equipment	
Laboratories Inc.	CSA C22.2 No.142	
	UL 1998 Software Programmable Components	
	NFPA 79 Electrical Standard for Industrial Machinery	
	IEC 61508	
FM Approvals	Class I, DIV 2, Groups A, B, C and D	
	Class 3600, 1998	
	Class 3611, 1999	
	Class 3810, 1989	
	Including Supplement #1, 1995	
	CSA C22.2 No. 142	
	CSA C22.2 No. 213	
TÜV CENELEC	Railway application	
	EN 50126: 1999 up to SIL 4	
	EN 50128: 2001 up to SIL 4	
	EN 50129: 2003 up to SIL 4	

Table 16: Certificates

HI 800 179 E Rev. 2.00 Page 25 of 52

4 Start-up F3 DIO 8/8 01

# 4 Start-up

To start up the remote I/O, it must be mounted, connected and configured in the programming tool.

# 4.1 Installation and Mounting

The remote I/O is mounted on a 35 mm DIN rail such as described in the HIMatrix system manual for compact systems.

When laying cables (long cables, in particular), take appropriate measures to avoid interference, e.g., by separating the signal lines from the power lines.

When dimensioning the cables, ensure that their electrical properties have no negative impact on the measuring circuit.

#### 4.1.1 Connecting the Digital Inputs

Use the following terminals to connect the digital inputs:

Terminal	Designation	Function (inputs)
19	LS+	Sensor supply of the inputs 14
20	1	Digital input 1
21	2	Digital input 2
22	3	Digital input 3
23	4	Digital input 4
24	L-	Ground
Terminal	Designation	Function (inputs)
Terminal 25	Designation LS+	Function (inputs) Sensor supply of the inputs 58
25	LS+	Sensor supply of the inputs 58
25 26	LS+ 5	Sensor supply of the inputs 58  Digital input 5
25 26 27	LS+ 5 6	Sensor supply of the inputs 58  Digital input 5  Digital input 6

Table 17: Terminal Assignment for the Digital Inputs

#### 4.1.1.1 Surges on Digital Inputs

Due to the short cycle time of the HIMatrix systems, a surge pulse as described in EN 61000-4-5 can be read in to the digital inputs as a short-term high level.

The following measures ensure proper operation in environments where surges may occur:

- 1. Install shielded input wires
- 2. Program noise blanking in the user program. A signal must be present for at least two cycles before it is evaluated. The fault reaction is triggered with a corresponding delay.
- $\overset{\bullet}{1} \qquad \text{The measures specified above are not necessary if the plant design precludes surges from occurring within the system.}$

In particular, the design must include protective measures with respect to overvoltage, lightning, earth grounding and plant wiring in accordance with the relevant standards and the instructions specified in the system manual (HI 800 141 E or HI 800 191 E).

Page 26 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 4 Start-up

# 4.1.2 Connecting the Digital Outputs

Use the following terminals to connect the digital outputs:

Terminal	Designation	Function (outputs, DO)
4	4-	Digital output 4- (for increased load)
5	8-	Digital output 8- (for increased load)
6	S+	Ground channel group
Terminal	Designation	Function (outputs, DO+)
7	L-	Ground channel group
8	1	Digital output 1
9	2	Digital output 2
10	3	Digital output 3
11	4+	Digital output 4+ (for increased load)
12	L-	Ground channel group
Terminal	Designation	Function (outputs, DO+)
13	L-	Ground channel group
14	5	Digital output 5
15	6	Digital output 6
16	7	Digital output 7
17	8+	Digital output 8+ (for increased load)
18	L-	Ground channel group

Table 18: Terminal Assignment for the Digital Outputs

# 4.1.3 Connecting Pulsed Outputs

Terminal	Designation	Function (non-safe pulsed outputs TO)
1	L-	Ground
2	1	Pulsed output 1
3	2	Pulsed output 2

Table 19: Terminal Assignment for the Pulsed Outputs

HI 800 179 E Rev. 2.00 Page 27 of 52

4 Start-up F3 DIO 8/8 01

# 4.1.4 Cable Plugs

Cable plugs attached to the pin headers of the devices are used to connect to the power supply and to the field zone. The cable plugs are included within the scope of delivery of the HIMatrix devices and modules.

The devices power supply connections feature the following properties:

Connection to the power supply				
Cable plugs	four poles, screw terminals			
Wire cross-section	0.22.5 mm <sup>2</sup> (single-wire)			
	0.22.5 mm <sup>2</sup> (finely stranded)			
	0.22.5 mm <sup>2</sup> (with wire end ferrule)			
Stripping length	10 mm			
Screwdriver	Slotted 0.6 x 3.5 mm			
Tightening torque	0.40.5 Nm			

Table 20: Power Supply Cable Plug Properties

Connection to the field zone	
Number of cable plugs	5 pieces, six poles, screw terminals
Wire cross-section	0.21.5 mm <sup>2</sup> (single-wire) 0.21.5 mm <sup>2</sup> (finely stranded) 0.21.5 mm <sup>2</sup> (with wire end ferrule)
Stripping length	6 mm
Screwdriver	Slotted 0.4 x 2.5 mm
Tightening torque	0.20.25 Nm

Table 21: Input and Output Cable Plug Properties

Page 28 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 4 Start-up

## 4.1.5 Mounting the F3 DIO 8/8 01 in Zone 2

(EC Directive 94/9/EC, ATEX)

The remote I/O is suitable for mounting in zone 2. Refer to the corresponding declaration of conformity available on the HIMA website.

When mounting the device, observe the special conditions specified in the following section.

#### Specific Conditions X

1. Mount the remote I/O in an enclosure that meets the EN 60079-15 requirements and achieves a type of protection of at least IP54, in accordance with EN 60529. Provide the enclosure with the following label:

#### Work is only permitted in the de-energized state

#### Exception:

If a potentially explosive atmosphere has been precluded, work can also performed when the controller is under voltage.

- The enclosure in use must be able to safely dissipate the generated heat. Depending on the output load and supply voltage, the HIMatrix F3 DIO 8/8 01 has a power dissipation ranging between 9 W and 27 W.
- Protect the HIMatrix F3 DIO 8/8 01 with a 10 A time-lag fuse.
   The 24 VDC power must come from a power supply unit with safe isolation. Use power supply units of type PELV or SELV only.
- 4. Applicable standards:

VDE 0170/0171 Part 16, DIN EN 60079-15: 2004-5 VDE 0165 Part 1, DIN EN 60079-14: 1998-08

Pay particular attention to the following sections:

DIN EN 60079-15:

Chapter 5 Design

Chapter 6 Terminals and cabling
Chapter 7 Air and creeping distances

Chapter 14 Connectors

DIN EN 60079-14:

Chapter 5.2.3 Equipment for use in zone 2
Chapter 9.3 Cabling for zones 1 and 2
Chapter 12.2 Equipment for zones 1 and 2

The remote I/O is additionally equipped with the label represented below:

HIMA

Paul Hildebrandt GmbH

A -Bassermann-Straße 2

A.-Bassermann-Straße 28, D-68782 Brühl

HIMatrix (Ex) II 3 G Ex nA II T4 X

F3 DIO 8/8 01  $0^{\circ}C \le Ta \le 60^{\circ}C$ 

Besondere Bedingungen X beachten!

Figure 9: Label for Ex Conditions

HI 800 179 E Rev. 2.00 Page 29 of 52

4 Start-up F3 DIO 8/8 01

# 4.2 Configuration

The remote I/O can be configured using a programming tool, SILworX or ELOP II Factory. Which programming tool should be used, depends on the revision status of the operating system (firmware):

- SILworX is required for CPU OS V7 and higher.
- ELOP II Factory is required for CPU OS up to V6.x.

How to switch between operating systems is described in Chapter *Loading Operating Systems* of the system manual for compact systems (HI 800 141 E).

## 4.3 Configuration with SILworX

In the Hardware Editor, the remote I/Os are represented like a base plate equipped with the following modules:

- Processor module (CPU)
- Input module (DI 8 LC) with Line Control
- Output module (DO 2 02)
- Output module (DO 2 01)

Double-click the module to open the Detail View with the corresponding tabs. The tabs are used to assign the global variables configured in the user program to the system variables of the corresponding module.

# 4.3.1 Parameters and Error Codes for the Inputs and Outputs

The following tables specify the system parameters that can be read and set for the inputs and outputs, including the corresponding error codes.

In the user program, the error codes can be read using the variables assigned within the logic.

The error codes can also be displayed in SILworX.

Page 30 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 4 Start-up

# 4.3.2 Digital Inputs of F3 DIO 8/8 01

The following tables present the statuses and parameters for the input module (DI 8 LC) in the same order as given in the Hardware Editor.

## 4.3.2.1 Tab **Module**

The **Module** tab contains the following system parameters:

System parameter	Data type	R/W	Description		
DI Number of	USINT	W	Number of pulsed outputs (supply outputs)		
Pulsed Channels			Coding Description		
			0 No pulsed output planned for SC/OC <sup>1)</sup> detection		
			1 Pulsed output 1 planned for SC/OC <sup>1)</sup> detection		
			Pulsed output 1 and 2 planned for SC/OC <sup>1)</sup> detection		
			Pulsed outputs must not be used as safety-related outputs!		
DI Pulse Slot	UDINT	W	Pulse module slot (SC/OC <sup>1)</sup> detection), set the value to 3		
DI Pulse Delay [μs]	UINT	W	Waiting time for line control (detection of short-circuits or cross-circuits)		
DI.Error Code	WORD	R	Error codes for all digital inputs		
			Coding Description		
			0x0001 Fault within the digital inputs		
			0x0002 FTT test of test pattern faulty		
Module Error Code	WORD	R Module error code			
			Coding Description		
			0x0000 I/O processing, if required with errors		
			see other error codes		
			0x0001 No I/O processing (CPU not in RUN)		
			0x0002 No I/O processing during the booting test		
			0x0004 Manufacturer interface operating		
			0x0010 No I/O processing: invalid configuration		
			0x0020 No I/O processing: fault rate exceeded		
			0x0040/ No I/O processing: configured module not plugged in		
Module SRS	[UDINT]	R	Slot number (System Rack Slot)		
Module Type	[UINT]	R	Type of module, target value: 0x00A5 [165 <sub>dec</sub> ]		
1) SC/OC (SC = short-	-circuit, OC =	= open-	circuit)		

Table 22: SILworX - System Parameters for Digital Inputs, **Module** Tab

HI 800 179 E Rev. 2.00 Page 31 of 52

4 Start-up F3 DIO 8/8 01

# 4.3.2.2 Tab **DO 8 LC: Channels**

The DI 8 LC: Channels tab contains the following system parameters.

System parameter	Data type	R/W	Description	
Channel no.		R	Channel number, defined by default	
-> Error Code	BYTE	R	Error codes for the digital input channels	
[BYTE]			Coding	Description
			0x01	Fault in the digital input module
			0x10	Short-circuit of the channel
			0x80	Intermittence between pulsed output TO and digital input DI, e.g.,  • Open-circuit
				Open switch
				■ L+ undervoltage
-> Value [BOOL]	BOOL	R	Input values for the digital input channels	
			0 = input de-energized	
			1 = input energized	
Pulsed Output	USINT	W	Source channel for pulsed supply	
[USINT] ->			Coding	Description
			0	Input channel
			1	Pulse of the 1st TO channel
			2	Pulse of the 2nd TO channel

Table 23: SILworX - System Parameters for Digital Inputs, DI 8 LC: Channels Tab

Page 32 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 4 Start-up

# 4.3.3 Digital Outputs of F3 DIO 8/8 01: DO 2 02

The following tables present the statuses and parameters for the output module (DO 2 02) in the same order as given in the Hardware Editor.

#### 4.3.3.1 Tab **Module**

The **Module** tab contains the following system parameters:

System parameter	Data type	R/W	Description	
DO1.Error Code	WORD	R	Error codes for all digital outputs	
			Coding	Description
			0x0001	Fault within the digital outputs
			0x0002	Test of safety shutdown returns a fault
			0x0004	Test of auxiliary voltage returns a fault
			0x0008	FTT test of test pattern faulty
			0x0010	Output switch test pattern faulty
			0x0020	Output switch test pattern (shutdown test of the outputs) faulty
			0x0040	Active shutdown via WD faulty
			0x0200	All outputs are switched off, total current exceeded
			0x0400	FTT test: 1st temperature threshold exceeded
			0x0800	FTT test: 2nd temperature threshold exceeded
			0x1000	FTT test: Monitoring of auxiliary voltage 1: Undervoltage
DO2.Error Code	WORD	R	see DO1.Error Code	
Time on delay	UINT	W		for 2-pole tests due to line capacities, inductive load, range 030 ms, 1 ms steps
Module Error Code	WORD	R	Module error code	
			Coding	Description
			0x0000	I/O processing, if required with errors, see other error codes
			0x0001	No I/O processing (CPU not in RUN)
			0x0002	No I/O processing during the booting test
			0x0004	Manufacturer interface operating
			0x0010	No I/O processing: invalid configuration
			0x0020	No I/O processing: fault rate exceeded
			0x0040/ 0x0080	No I/O processing: configured module not plugged in
Module SRS	UDINT	R	Slot number (System Rack Slot)	
Module Type	UINT	R	Type of module, target value: 0x00B4 [180 <sub>dec</sub> ]	

Table 24: SILworX - System Parameters for Digital Outputs DO 2 02, Module Tab

HI 800 179 E Rev. 2.00 Page 33 of 52

4 Start-up F3 DIO 8/8 01

# 4.3.3.2 Tab **DO 2 02: DO1 Channels**

The DO 2 02: DO1 Channels tab contains the following system parameters.

System parameter	Data type	R/W	Description		
Channel no.		R	Channel number, defined by default		
-> Error Code	BYTE	R	Error codes for the digital output channels		
[BYTE]			Coding	Description	
			0x01	Fault in the digital output module	
			0x02	Channel shutdown due to overload	
			0x04	Error while reading back the digital outputs	
			0x08	Error while reading back the status of the digital outputs	
			0x40	External short-circuit or short-circuit of the EMC protection returns an error	
			0x80	Channel is switched off due to fault on the corresponding channel	
Value [BOOL] ->	BOOL	W	Output value for DO channels:		
			1 = output energized		
			0 = output de-energized		

Table 25: SILworX - System Parameters for Digital Outputs, DO 2 02: DO1 Channels Tab

## 4.3.3.3 Tab **DO 2 02: DO2 Channels**

The DO 2 02: DO2 Channels tab contains the following system parameters.

System parameter	Data type	R/W	Description		
Channel no.		R	Channel number, defined by default		
-> Error Code	BYTE	R	Error codes for the digital output channels		
[BYTE]			Coding	Description	
			0x01	Fault in the digital output module	
			0x02	Channel shutdown due to overload	
			0x04	Error while reading back the digital outputs	
			0x08	Error while reading back the status of the digital outputs	
			0x40	External short-circuit or short-circuit of the EMC protection returns an error	
			0x80	Channel is switched off due to fault on the corresponding channel	
Value [BOOL] ->	BOOL	W	Output value for DO channels:		
			1 = output energized		
			0 = output de-energized		
2-pole [BOOL] ->	UINT	W	Configuration for a 2-Pole channel  1 = DO2[01] and DO1[04] are used as a 2-pole channel or DO2[02] and DO1[08] are used as a 2-pole channel  0 = DO2[xx] is not used as a 2-pole channel.		

Table 26: SILworX - System Parameters for Digital Outputs, **DO 2 02: DO2 Channels** Tab

Page 34 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 4 Start-up

# 4.3.4 Digital Outputs of F3 DIO 8/8 01: DO 2 01

The following tables present the statuses and parameters for the output module (DO 2 01) in the same order as given in the Hardware Editor.

#### 4.3.4.1 Tab **Module**

The **Module** tab contains the following system parameters:

System parameter	Data type	R/W	Description		
DO.Error Code	WORD	R	Error codes for all digital outputs		
			Coding	Description	
			0x0001	Fault within the digital outputs	
			0x0002	Test of safety shutdown returns a fault	
			0x0004	Test of auxiliary voltage returns a fault	
			0x0008	FTT test of test pattern faulty	
			0x0010	Output switch test pattern faulty	
			0x0020	Output switch test pattern (shutdown test of the outputs) faulty	
			0x0040	Active shutdown via WD faulty	
			0x0200	All outputs are switched off, total current exceeded	
			0x0400	FTT test: 1st temperature threshold exceeded	
			0x0800	FTT test: 2nd temperature threshold exceeded	
			0x1000	FTT test: Monitoring of auxiliary voltage 1: Undervoltage	
Module Error Code	WORD	R	Module error o	code	
			Coding	Description	
			0x0000	I/O processing, if required with errors, see other error codes	
			0x0001	No I/O processing (CPU not in RUN)	
			0x0002	No I/O processing during the booting test	
			0x0004	Manufacturer interface operating	
			0x0010	No I/O processing: invalid configuration	
			0x0020	No I/O processing: fault rate exceeded	
			0x0040/ 0x0080	No I/O processing: configured module not plugged in	
Module SRS	UDINT	R	Slot number (System Rack Slot)		
Module Type	UINT	R	Type of module, target value: 0x00B4 [180 <sub>dec</sub> ]		

Table 27: SILworX - System Parameters for Digital Outputs DO 2 01, Module Tab

HI 800 179 E Rev. 2.00 Page 35 of 52

4 Start-up F3 DIO 8/8 01

# 4.3.4.2 Tab **DO 2 01: DO1 Channels**

The **DO 2 01: DO1 Channels** tab contains the following system parameters:

System parameter	Data type	R/W	Description		
Channel no.		R	Channel number, defined by default		
-> Error Code	BYTE	R	Error codes for the digital output channels		
[BYTE]			Coding	Description	
			0x01	Fault in the digital output module	
			0x02	Channel shutdown due to overload	
			0x04	Error while reading back the digital outputs	
			0x08	Error while reading back the status of the digital outputs	
			0x40	External short-circuit or short-circuit of the EMC protection returns an error	
			0x80	Channel is switched off due to fault on the corresponding channel	
Value [BOOL] ->	BOOL	W	Output value for DO channels:		
			1 = output energized		
			0 = output de-energized		

Table 28: SILworX - System Parameters for Digital Outputs, **DO 2 01: DO1 Channels** Tab

Page 36 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 4 Start-up

### 4.4 Configuration with ELOP II Factory

### 4.4.1 Configuring the Inputs and Outputs

The signals previously defined in the Signal Editor (Hardware Management) are assigned to the individual channels (inputs and outputs) using ELOP II Factory. Refer to the system manual for compact systems or the online help for more details.

The following chapter describes the system signals used for assigning signals in the remote I/O.

### 4.4.2 Signals and Error Codes for the Inputs and Outputs

The following tables specify the signals that can be read and set for the inputs and outputs, including the corresponding error codes.

In the user program, the error codes can be read using the signals assigned within the logic.

The error codes can also be displayed in ELOP II Factory.

HI 800 179 E Rev. 2.00 Page 37 of 52

4 Start-up F3 DIO 8/8 01

## 4.4.3 Digital Inputs of F3 DIO 8/8 01

System Signal	R/W	Description		
Mod.SRS [UDINT]	R		System Rack Slot)	
Mod. Type [UINT]	R	Type of module, target value: 0x00A5 [165 <sub>dec</sub> ]		
Mod. Error Code	R	Module error code		
[WORD]		Coding	Description	
		0x0000	I/O processing, if required with errors	
			see other error codes	
		0x0001	No I/O processing (CPU not in RUN)	
		0x0002	No I/O processing during the booting test	
		0x0004	Manufacturer interface operating	
		0x0010	No I/O processing: invalid configuration	
		0x0020	No I/O processing: fault rate exceeded	
		0x0040/ 0x0080	No I/O processing: configured module not plugged in	
DI.Error Code	R	<del>                                     </del>	· all digital inputs	
[WORD]	``	Coding	Description	
		0x0001	Fault within the digital inputs	
		0x0002	FTT test of test pattern faulty	
DI[xx].Error Code	R		the digital input channels	
[BYTE]	' \	Coding	Description	
		0x01	Fault in the analog input module	
		0x10	Short-circuit of the channel	
		0x80	Intermittence between pulsed output TO and digital input	
			DI, e.g.,	
			Open-circuit	
			Open switch	
D/ 1)/ / / / / / / / / / / / / / / / / /	L+ undervoltage			
			for the digital input channels	
		0 = input de-er	<del>-</del>	
DI Number of	W	1 = input energized  Number of pulsed outputs (supply outputs)		
Pulsed Channels	VV	Coding	Description	
[USINT]		0	No pulsed output planned for SC/OC <sup>1)</sup> detection	
		1	Pulsed output 1 planned for SC/OC¹ detection	
		2	Pulsed output 1 and 2 planned for SC/OC <sup>1)</sup> detection	
			ts must not be used as safety-related outputs!	
DI Pulse Slot	W	•	slot (SC/OC <sup>1)</sup> detection), set the value to 3	
[UDINT]	V V	1 dioc iniodule	Sist (35/55 dolosilon), set the value to 5	
DI[xx].Pulsed Output W Source channel for pulsed supply		el for pulsed supply		
[USINT]		Coding	Description	
		0	Input channel	
		1	Pulse of the 1st TO channel	
		2	Pulse of the 2nd TO channel	
DI Pulse Delay [10E-6 s] [UINT]	W	Waiting time for line control (detection of short-circuits or cross-circuits)		
1) SC/OC (SC = short	t-circuit,	OC = open-circu	it)	
· · · · · · · · · · · · · · · · · · ·	<u> </u>	·	•	

Table 29: ELOP II Factory - Digital Input System Signals

Page 38 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 4 Start-up

# 4.4.4 Digital Outputs of F3 DIO 8/8 01, DO+ (DO1), DO- (DO2)

System Signal	R/W	Description			
Mod.SRS [UDINT]	R	Slot number (System Rack Slot)			
Mod. Type [UINT]	R	Type of module, target value: 0x005B [91 <sub>dec</sub> ]			
Mod. Error Code	R	Module error code			
[WORD]		Coding	Description		
		0x0000	I/O processing, if required with errors, see other error codes		
		0x0001	No I/O processing (CPU not in RUN)		
		0x0002	No I/O processing during the booting test		
		0x0004	Manufacturer interface operating		
		0x0010	No I/O processing: invalid configuration		
		0x0020	No I/O processing: fault rate exceeded		
		0x0040/ 0x0080	No I/O processing: configured module not plugged in		
DOy.Error Code	R	ļ L	or all digital outputs		
[WORD]		Coding	Description		
y = 1 or 2		0x0001	Fault within the digital outputs		
		0x0002	Test of safety shutdown returns a fault		
		0x0004	Test of auxiliary voltage returns a fault		
		0x0008	FTT test of test pattern faulty		
		0x0010	Output switch test pattern faulty		
		0x0020	Output switch test pattern (shutdown test of the outputs) faulty		
		0x0040	Active shutdown via WD faulty		
		0x0200	All outputs are switched off, total current exceeded		
		0x0400	FTT test: 1st temperature threshold exceeded		
		0x0800	FTT test: 2nd temperature threshold exceeded		
		0x1000	FTT test: Monitoring of auxiliary voltage 1: Undervoltage		
DOy[xx].Error Code	R	Error codes for the digital output channels			
[BYTE]		Coding	Description		
y = 1 or 2		0x01	Fault in the digital output module		
		0x02	Channel shutdown due to overload		
		0x04	Error while reading back the digital outputs		
		0x08	Error while reading back the status of the digital outputs		
		0x40	External short-circuit or short-circuit of the EMC protection returns an error		
		0x80	Channel is switched off due to fault on the corresponding channel		
DOy[xx].Value	W	Output value for DO channels:			
[BOOL]		1 = output energized			
y = 1 or 2		0 = output de-energized			
DO2[xx].2-Pole	W	_	for a 2-Pole channel		
[BOOL]		1 = DO2[01] and DO1[04] are used as a 2-pole channel			
		0f D02[02] and D04[02] are used as a 2 pale channel			
		DO2[02] and DO1[08] are used as a 2-pole channel			
		0 = DO2[xx] is not used as a 2-pole channel.			

HI 800 179 E Rev. 2.00 Page 39 of 52

4 Start-up F3 DIO 8/8 01

System Signal	R/W	Description
Time on delay [UINT]	W	Time on delay for 2-pole tests due to line capacities, inductive and capacitive load, range 030 ms,  1 ms steps

Table 30: ELOP II Factory - Digital Output System Signals

## 4.4.5 Pulsed Outputs for F3 DIO 8/8 01

System signal	R/W	Description			
Mod.SRS [UDINT]	R	Slot number (System Rack Slot)			
Mod. Type [UINT]	R	Type of module, target value: 0x005B [91 <sub>dec</sub> ]			
Mod. Error Code	R	Module error code			
[WORD]		Coding Description			
		0x0000 I/O processing, if required with errors, see other error codes			
		0x0001 No I/O processing (CPU not in RUN)			
		0x0002 No I/O processing during the booting test			
		0x0004 Manufacturer interface operating			
		0x0010 No I/O processing: invalid configuration			
		0x0020 No I/O processing: fault rate exceeded			
		0x0040/ No I/O processing: configured module not plugged in 0x0080			
DO.Error Code	R	Error code of the TO unit as a whole			
[WORD]		Coding Description			
		0x0001 Error of the TO unit as a whole:			
DO[xx].Error Code	R	Error code of the individual digital pulsed output channels:			
[BYTE]		Coding Description			
		0x01 Fault in the digital output module			
DO[xx].Value [BOOL]	W	Output value for TO channels:			
		1 = output energized			
		0 = output de-energized			
		Pulsed outputs must not be used as safety-related outputs!			

Table 31: ELOP II Factory - System Signals for the Pulsed Outputs

Page 40 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 5 Operation

## 5 Operation

The remote I/O can only operated together with a controller. No specific monitoring is required for remote I/Os.

## 5.1 Handling

Handling of the remote I/O during operation is not required.

## 5.2 Diagnosis

A first diagnosis results from evaluating the LEDs, see Chapter 3.4.1.

The device diagnostic history can also be read using the programming tool.

HI 800 179 E Rev. 2.00 Page 41 of 52

6 Maintenance F3 DIO 8/8 01

#### 6 Maintenance

No maintenance measures are required during normal operation.

If a failure occurs, the defective module or device must be replaced with a module or device of the same type or with a replacement model approved by HIMA.

Only the manufacturer is authorized to repair the device/module.

#### 6.1 Faults

Refer to Chapter 3.1.1.1, for more information on the fault reaction of digital inputs.

Refer to Chapter 3.1.2.2, for more information on the fault reaction of digital outputs.

If the test harnesses detect safety-critical faults, the module enters the STOP\_INVALID state and will remain in this state. This means that the input signals are no longer processed by the device and the outputs switch to the de-energized, safe state. The evaluation of diagnostics provides information on the fault cause.

#### 6.2 Maintenance Measures

The following measures are required for the device:

- Loading the operating system, if a new version is required
- Executing the proof test

### 6.2.1 Loading the Operating System

HIMA is continuously improving the operating system of the devices. HIMA recommends to use system downtimes to load a current version of the operating system into the devices.

Refer to the release list to check the consequences of the new operation system version on the system!

The operating system is loaded using the programming tool.

Prior to loading the operating system, the device must be in STOP (displayed in the programming tool). Otherwise, stop the device.

For more information, refer to the programming tool documentation.

#### 6.2.2 Proof Test

HIMatrix devices and modules must be subjected to a proof test in intervals of 10 years. For more information, refer to the safety manual (HI 800 023 E).

Page 42 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 7 Decommissioning

# 7 Decommissioning

Remove the supply voltage to decommission the device. Afterwards pull out the pluggable screw terminal connector blocks for inputs and outputs and the Ethernet cables.

HI 800 179 E Rev. 2.00 Page 43 of 52

8 Transport F3 DIO 8/8 01

## 8 Transport

To avoid mechanical damage, HIMatrix components must be transported in packaging.

Always store HIMatrix components in their original product packaging. This packaging also provides protection against electrostatic discharge. Note that the product packaging alone is not suitable for transport.

Page 44 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 9 Disposal

## 9 Disposal

Industrial customers are responsible for correctly disposing of decommissioned HIMatrix hardware. Upon request, a disposal agreement can be arranged with HIMA.

All materials must be disposed of in an ecologically sound manner.





HI 800 179 E Rev. 2.00 Page 45 of 52

9 Disposal F3 DIO 8/8 01

Page 46 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 Appendix

# **Appendix**

## Glossary

Term	Description
ARP	Address resolution protocol: Network protocol for assigning the network addresses to
	hardware addresses
Al	Analog input
AO	Analog output
COM	Communication module
CRC	Cyclic redundancy check
DI	Digital input
DO	Digital output
ELOP II Factory	Programming tool for HIMatrix systems
EMC	Electromagnetic compatibility
EN	European norm
ESD	Electrostatic discharge
FB	Fieldbus
FBD	Function block diagrams
FTT	Fault tolerance time
ICMP	Internet control message protocol: Network protocol for status or error messages
IEC	International electrotechnical commission
MAC address	Media access control address: Hardware address of one network connection
PADT	Programming and debugging tool (in accordance with IEC 61131-3), PC with SILworX or ELOP II Factory
PE	Protective earth
PELV	Protective extra low voltage
PES	Programmable electronic system
R	Read: The system variable or signal provides value, e.g., to the user program
Rack ID	Base plate identification (number)
Interference-free	Supposing that two input circuits are connected to the same source (e.g., a transmitter). An input circuit is termed <i>interference-free</i> if it does not distort the signals of the other input circuit.
R/W	Read/Write (column title for system variable/signal type)
SELV	Safety extra low voltage
SFF	Safe failure fraction, portion of faults that can be safely controlled
SIL	Safety integrity level (in accordance with IEC 61508)
SILworX	Programming tool for HIMatrix systems
SNTP	Simple network time protocol (RFC 1769)
SRS	System.rack.slot addressing of a module
SW	Software
TMO	Timeout
W	Write: System variable/signal is provided with value, e.g., from the user program
r <sub>PP</sub>	Peak-to-peak value of a total AC component
Watchdog (WD)	Time monitoring for modules or programs. If the watchdog time is exceeded, the module or program enters the ERROR STOP state.
WDT	Watchdog time

HI 800 179 E Rev. 2.00 Page 47 of 52

Appendix F3 DIO 8/8 01

Index of	Figures	
Figure 1:	Connections to Safety-Related Digital Inputs	11
Figure 2:	Line Control	12
Figure 3:	Connection to the 2-Pole Switching Outputs (DO-, DO+)	13
Figure 4:	Connection of Actuators to Outputs	14
Figure 5:	Sample Type Label	17
Figure 6:	Front View	18
Figure 7:	Block Diagram	18
Figure 8:	Sample MAC Address Label	21
Figure 9:	Label for Ex Conditions	29

Page 48 of 52 HI 800 179 E Rev. 2.00

F3 DIO 8/8 01 Appendix

Index of	Tables	
Table 1:	Programming Tools for HIMatrix Remote I/Os	5
Table 2:	Additional Relevant Documents	6
Table 3:	Environmental Requirements	9
Table 4:	Available Variants	16
Table 5:	Operating Voltage LED	19
Table 6:	System LEDs	19
Table 7:	Ethernet Indicators	20
Table 8:	I/O LEDs	20
Table 9:	Ethernet Interfaces Properties	21
Table 10:	Network Ports in Use	21
Table 11:	Product Data	23
Table 12:	Specifications for Digital Inputs	23
Table 13:	Specifications for the Digital Outputs	24
Table 14:	Specifications for the Pulsed Outputs	24
Table 15:	Product Data of F3 DIO 8/8 014	25
Table 16:	Certificates	25
Table 17:	Terminal Assignment for the Digital Inputs	26
Table 18:	Terminal Assignment for the Digital Outputs	27
Table 19:	Terminal Assignment for the Pulsed Outputs	27
Table 20:	Power Supply Cable Plug Properties	28
Table 21:	Input and Output Cable Plug Properties	28
Table 22:	SILworX - System Parameters for Digital Inputs, Module Tab	31
Table 23:	SILworX - System Parameters for Digital Inputs, DI 8 LC: Channels Tab	32
Table 24:	SILworX - System Parameters for Digital Outputs DO 2 02, Module Tab	33
Table 25:	SILworX - System Parameters for Digital Outputs, DO 2 02: DO1 Channels Tab	34
Table 26:	SILworX - System Parameters for Digital Outputs, DO 2 02: DO2 Channels Tab	34
Table 27:	SILworX - System Parameters for Digital Outputs DO 2 01, Module Tab	35
Table 28:	SILworX - System Parameters for Digital Outputs, DO 2 01: DO1 Channels Tab	36
Table 29:	ELOP II Factory - Digital Input System Signals	38
Table 30:	ELOP II Factory - Digital Output System Signals	40
Table 31:	ELOP II Factory - System Signals for the Pulsed Outputs	40

HI 800 179 E Rev. 2.00 Page 49 of 52

Appendix F3 DIO 8/8 01

## Index

block diagram18	B pulsed outputs	15
diagnosis41		
fault reaction	safe <b>ethernet</b>	
digital inputs12	safety function	11
digital outputs15	•	
front view18		
	) SIITAA	26



HIMA Paul Hildebrandt GmbH P.O. Box 1261 68777 Brühl, Germany Phone: +49 6202 709-0

Fax: +49 6202 709-107