


Calibration (reliability diagram)

Predicted vs observed positive rate, binned by predicted prob

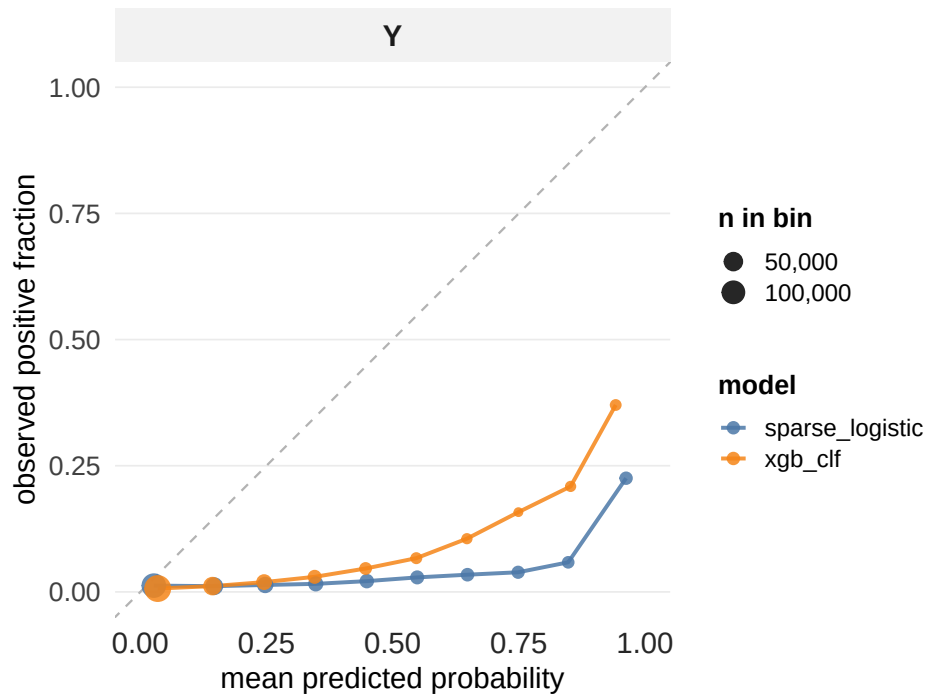

run = 20260605_005709_nogit | bins = deciles of predicted prob