




Title		
Size	Number	Revision
A4		
Date:	23/07/2018	Sheet of
File:	C:\PROY ALTIUM\...\PFM connectors.sch	Drawn By:

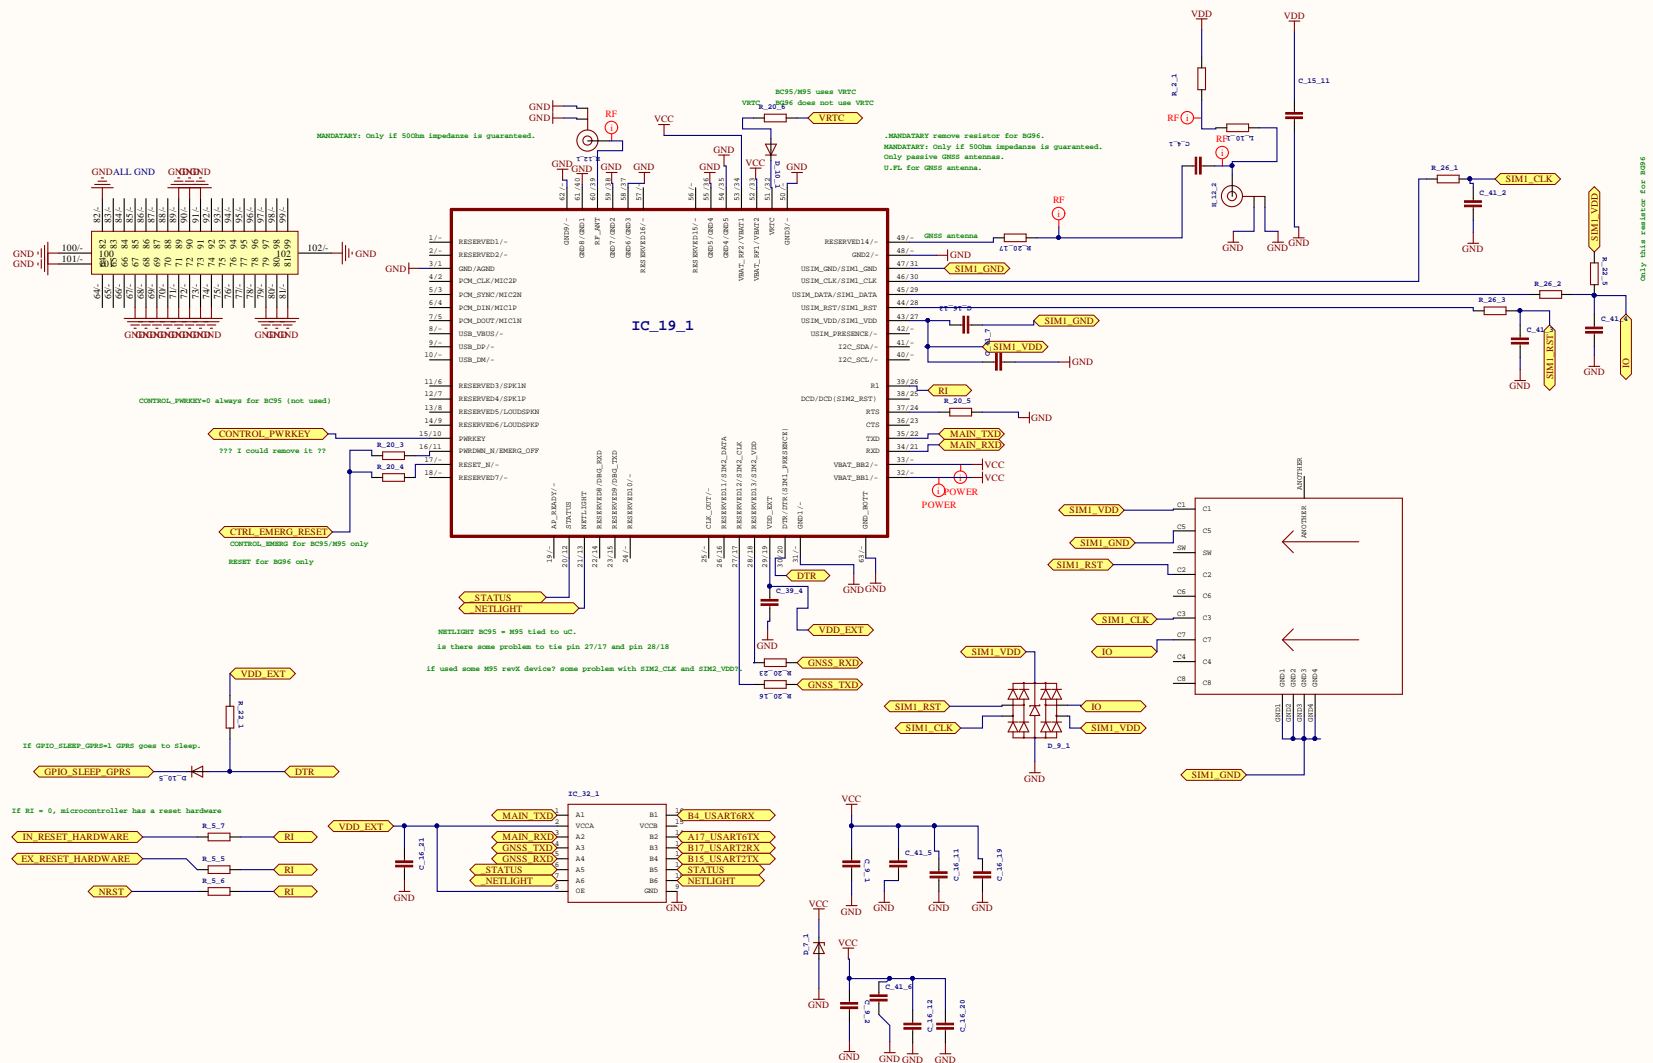

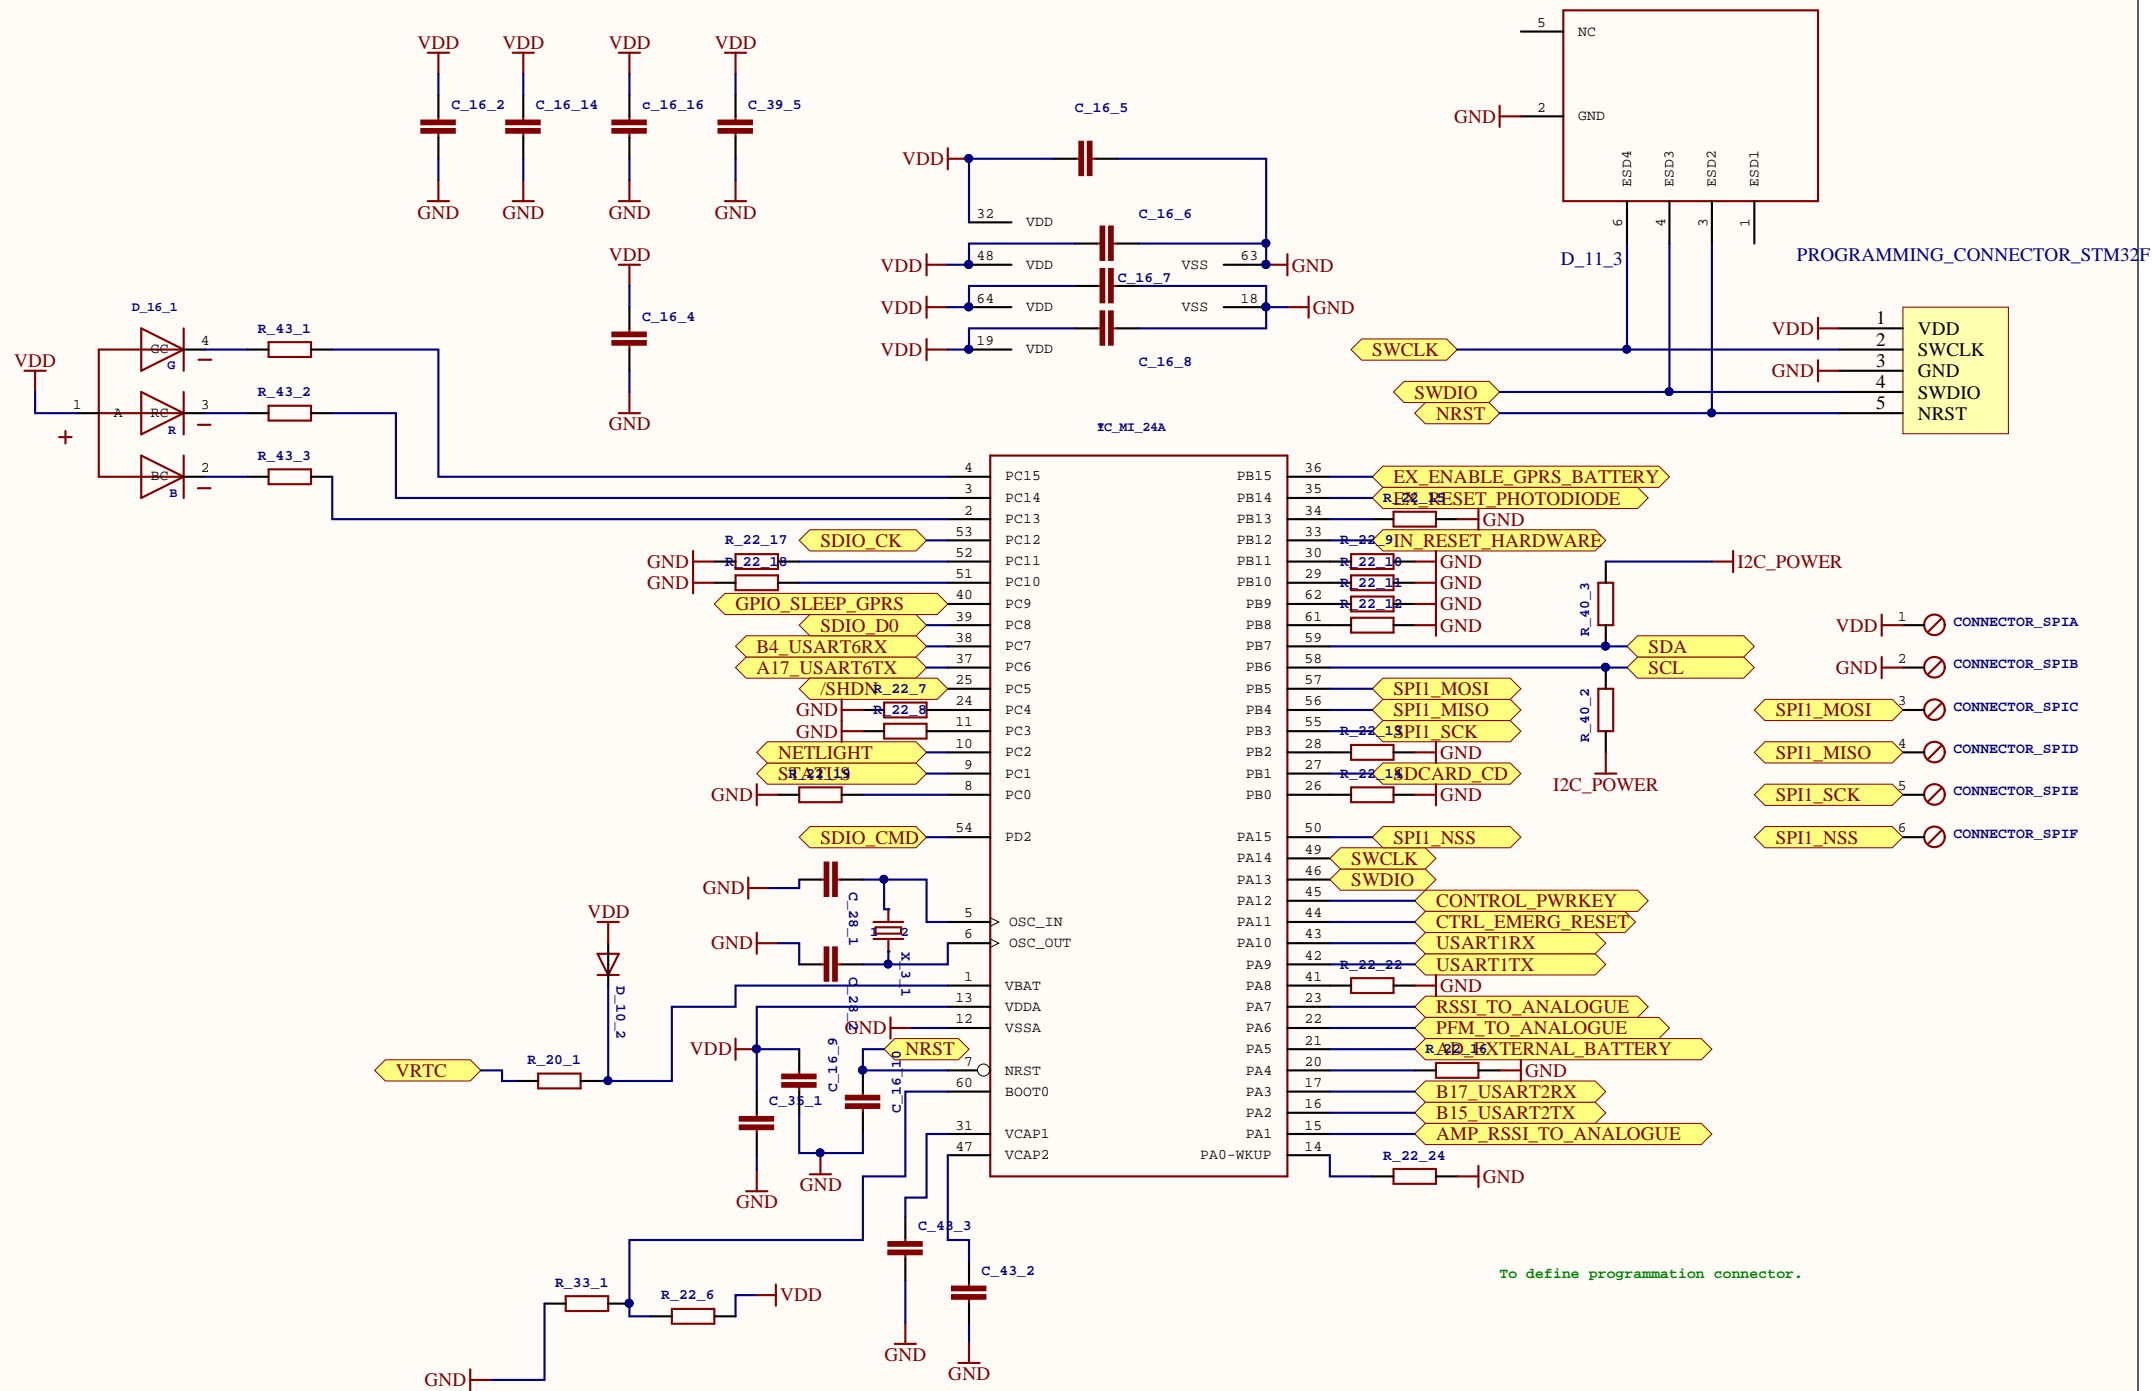


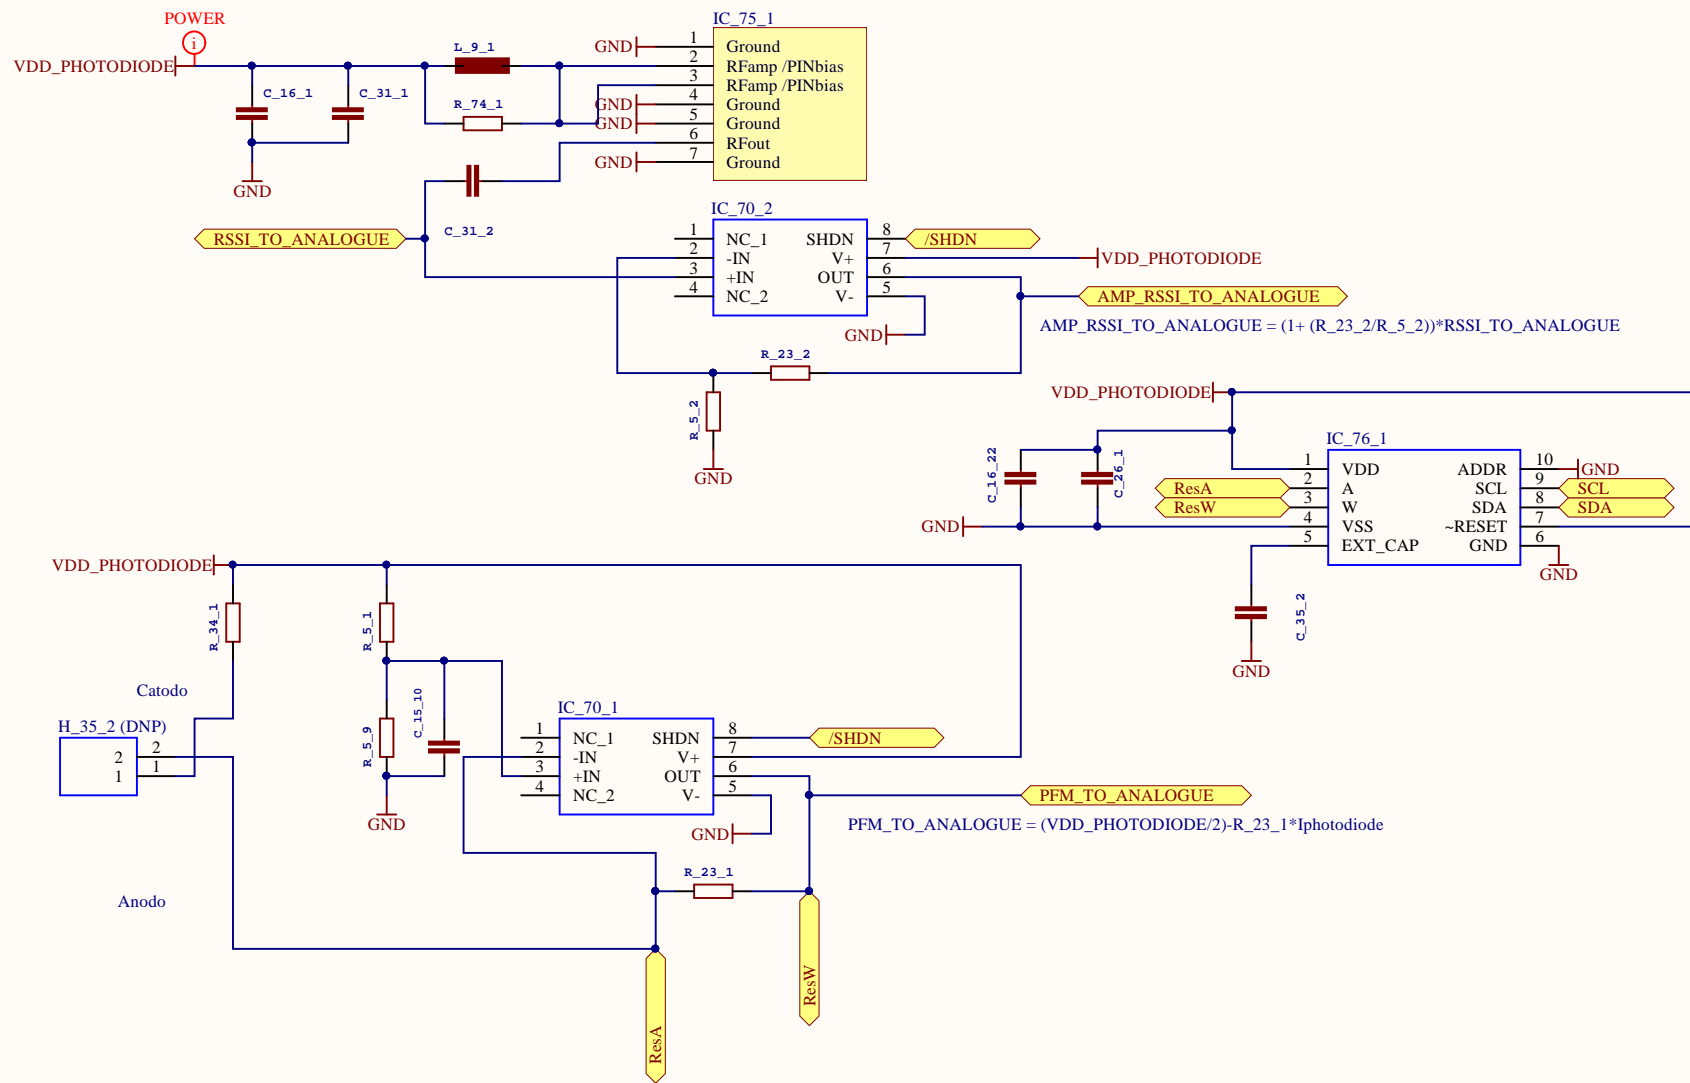

Title		
Size	Number	Revision
A4		
Date:	23/07/2018	Sheet of
File:	C:\PROY ALTUM\...\PFM_photodiode_SchDoc	Drawn By:

A

A

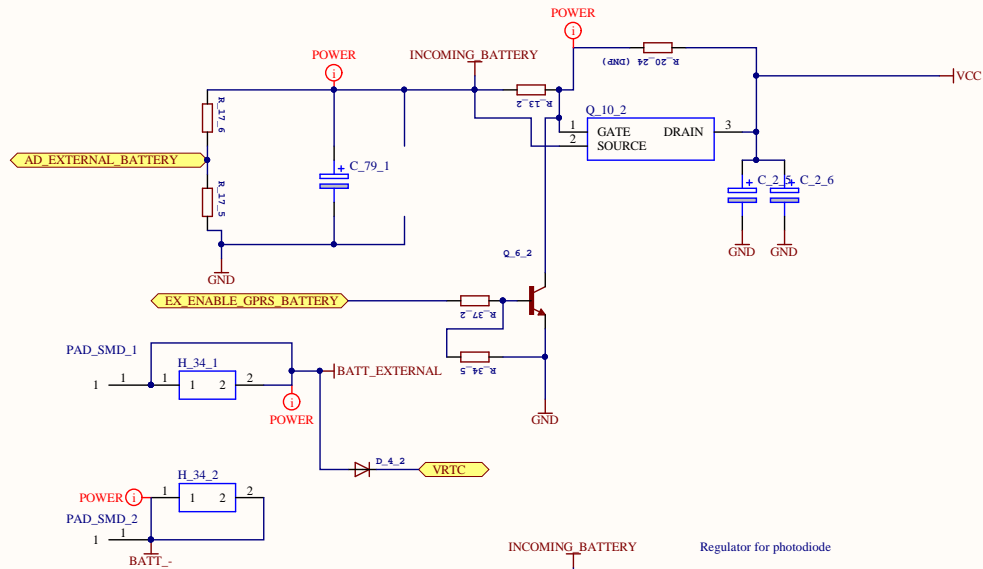


<-- Power management for GPRS device
with internal battery

<-- Reference DC-DC Design with one high capacity battery

<-- Power management for GPRS device with external battery

B

B

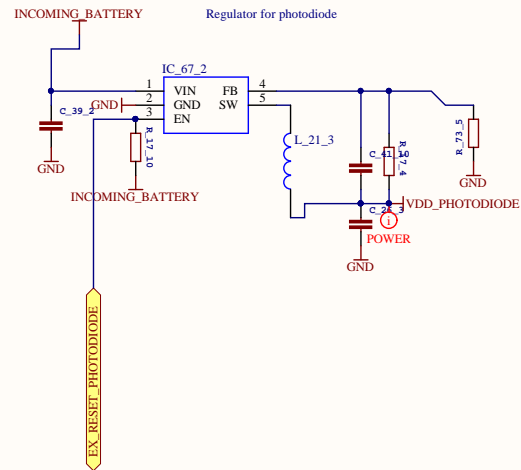


Take care, this must be 5V for HFBR-2524Z

<-- Power management for photodiode
with external battery

C

C

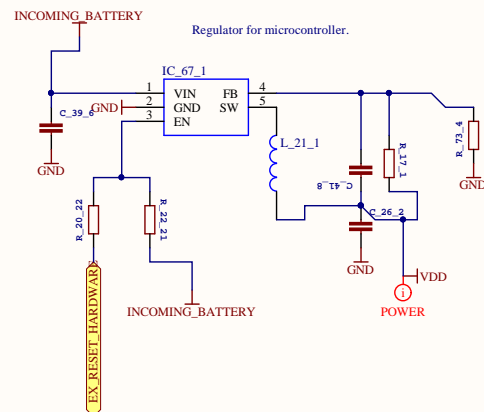

<-- Power management for microcontroller
with external battery

D

D

Title		
Size	Number	Revision
A3		
Date:	23/07/2018	Sheet of
File:	C:\PROY ALTIUM\...\PFM_powerManagement\InternalBattery.SchDoc	

