
	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

1. Enter the username, password, Select Module and click on login button

SSNo : PSS-LIMS-SS-001

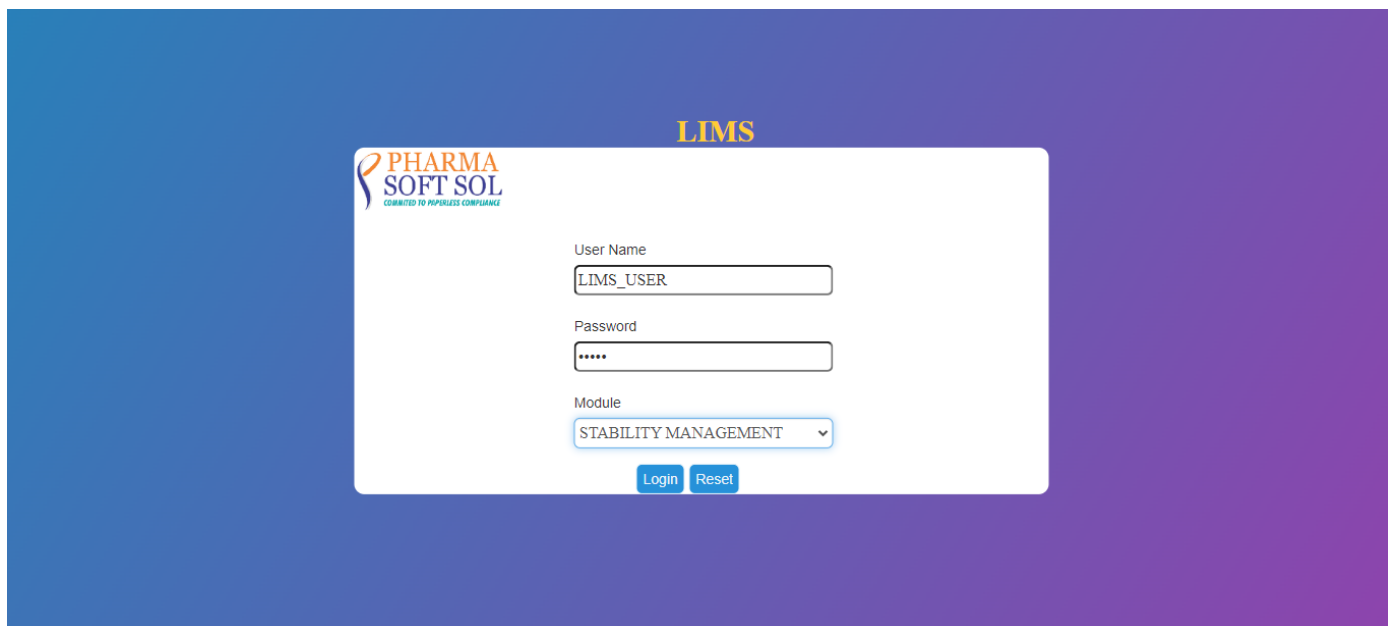


The screenshot shows the LIMS login interface. At the top center, the word "LIMS" is displayed in yellow. Below it is the PharmaSoftSol logo. The login form contains the following fields:

- User Name:** A text input field containing "LIMS\_USER".
- Password:** A password input field with masked characters "\*\*\*\*\*".
- Module:** A dropdown menu currently showing "STABILITY MANAGEMENT".
- Login/Reset Buttons:** Two blue buttons labeled "Login" and "Reset" are positioned at the bottom of the form.

2. Click on Schedule Test

SSNo : PSS-LIMS-SS-002

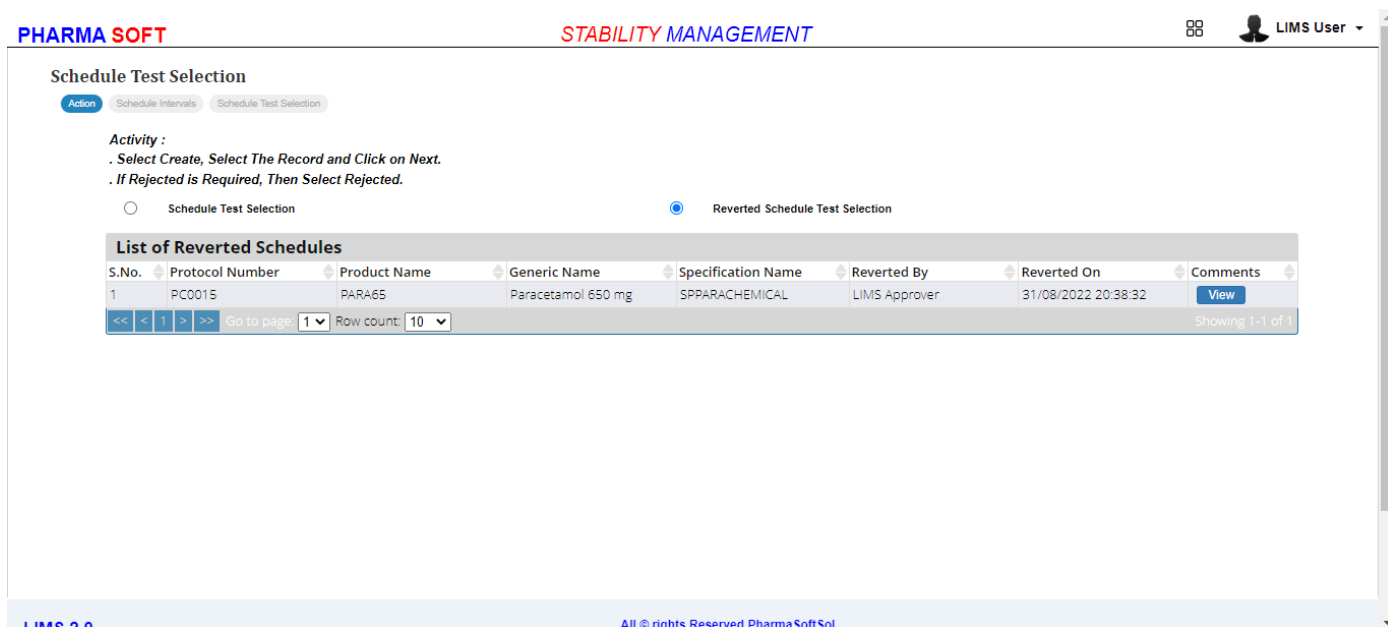

The screenshot displays the "Schedule Test Selection" screen within the LIMS application. The header includes the PharmaSoftSol logo, the text "STABILITY MANAGEMENT", and a user profile icon labeled "LIMS User".

**Schedule Test Selection**

**Activity :**

- . Select Create, Select The Record and Click on Next.
- . If Rejected is Required, Then Select Rejected.

There are two radio buttons for selection:


- ☐ Schedule Test Selection
- ☒ Reverted Schedule Test Selection

**List of Reverted Schedules**

S.No.	Protocol Number	Product Name	Generic Name	Specification Name	Reverted By	Reverted On	Comments
1	PC0015	PARA65	Paracetamol 650 mg	SPPARACHEMICAL	LIMS Approver	31/08/2022 20:38:32	<a href="#">View</a>

Navigation controls at the bottom of the table include: "<<" "<" "1" ">" ">>" "Go to page: 1" "Row count: 10" and "Showing 1-1 of 1".

Footer: LIMS 2.0 | All © rights Reserved PharmaSoftSol

 <b>PHARMA SOFT SOL</b> <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

### 3.Select a Record

SSNo : PSS-LIMS-SS-003

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS User

#### Schedule Test Selection

Action
Schedule Intervals
Schedule Test Selection

Activity :

- . Select Create, Select The Record and Click on Next.
- . If Rejected is Required, Then Select Rejected.

☐ Schedule Test Selection
 ☒ Reverted Schedule Test Selection

##### List of Reverted Schedules

S.No.	Protocol Number	Product Name	Generic Name	Specification Name	Reverted By	Reverted On	Comments
1	PC0015	PARA65	Paracetamol 650 mg	SPPARACHEMICAL	LIMS Approver	31/08/2022 20:38:32	<a href="#">View</a>

Go to page: 1
Row count: 10

Showing 1-1 of 1

IMS 2.0
All © rights Reserved PharmaSoftSol

### 4.Click on Next

SSNo : PSS-LIMS-SS-004

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS User

#### Schedule Test Selection

Action
Schedule Intervals
Schedule Test Selection

☒ Reverted Schedule Test Selection

Generic Name	Specification Name	Reverted By	Reverted On	Comments
Paracetamol 650 mg	SPPARACHEMICAL	LIMS Approver	31/08/2022 20:38:32	<a href="#">View</a>

Showing 1-1 of 1


. Select The Record and Click On Next.

. Select The Record and Click On Next.

##### Schedule Storage Conditions

<input type="checkbox"/>	S.No	Packing Type	Batch Number	Batch
<input type="checkbox"/>	1		44	100

IMS 2.0
All © rights Reserved PharmaSoftSol

	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

## 5.Select a Record

SSNo : PSS-LIMS-SS-005

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS User

### Schedule Test Selection

Action
Schedule Intervals
Schedule Test Selection

. Select The Record and Click On Next.  
. Select The Record and Click On Next.

Schedule Storage Conditions									
<input type="checkbox"/>	S.No	Packing Type	Batch Number	Batch Size	Mfg.Date	Exp.Date	Storage Conditions	Stability Conditions	Schedule Interval Type
<input checked="" type="checkbox"/>	1	Blister	44	100	08/31/2022	08/31/2028	40°C ± 2°C / 75%	ACCELERATED	MONTH

IMS 2.0
All © rights Reserved PharmaSoftSol

## 6.Click on Next

SSNo : PSS-LIMS-SS-006

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS User

### Schedule Test Selection

Action
Schedule Intervals
Schedule Test Selection

. Select The Test, Select Approval Life Cycle and Click On Finish.  
. Enter E-Signature Password and Click On Submit.  
. Modify The Required Fields and Click On Finish.  
. Enter E-Signature Password and Click On Submit.

Set1

Packing Type: Blister
Product Batch No: 44


Storage Conditions: 40°C ± 2°C / 75%RH ± 5%RH
Schedule Interval Type: MONTH

Stability Condition: ACCELERATED
Orientation: UP RIGHT

Interval and Test Details


S.No	Test Name
1	

IMS 2.0
All © rights Reserved PharmaSoftSol

	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass


7.Click on Finish

SSNo : PSS-LIMS-SS-007

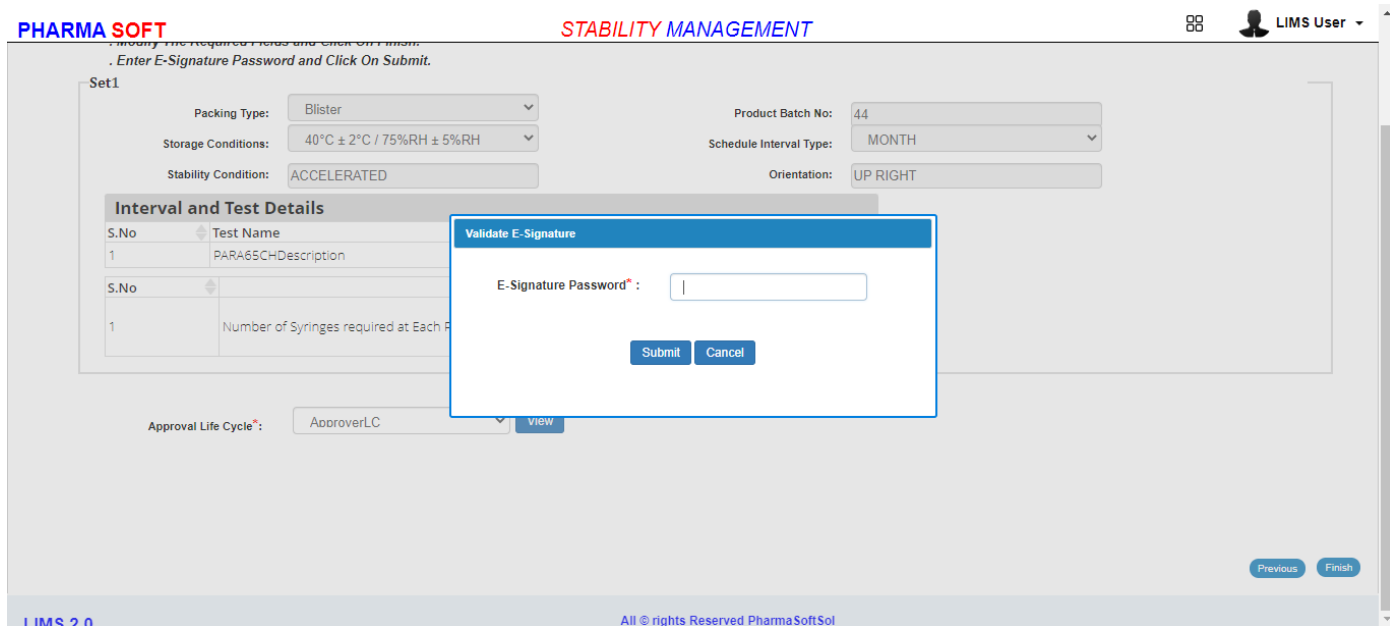


8.Enter E-Signature Password

SSNo : PSS-LIMS-SS-008

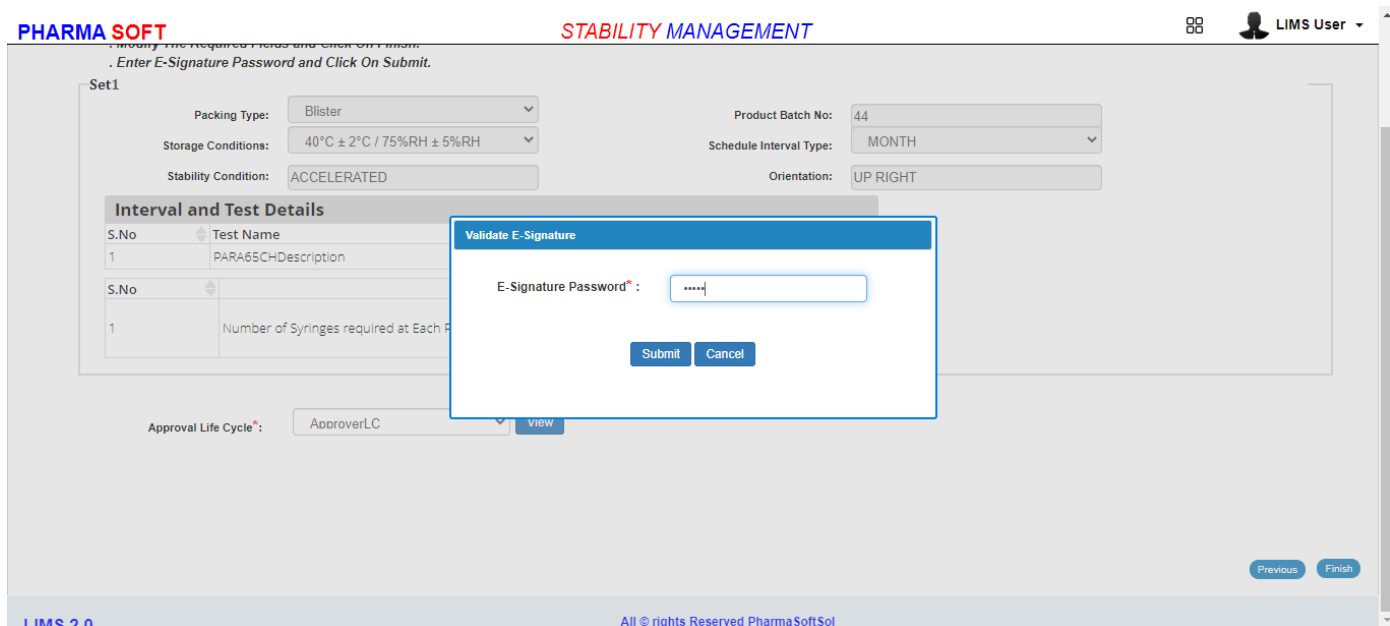



 <b>PHARMA SOFT SOL</b> <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

9. Click on OK button

SSNo : PSS-LIMS-SS-009

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS User

### Schedule Test Selection

[Action](#)
[Schedule Intervals](#)
[Schedule Test Selection](#)

*. Select The Test, Select Approval Life Cycle and Click On Finish.*  
*. Enter E-Signature Password and Click On Submit.*  
*. Modify The Required Fields and Click On Finish.*  
*. Enter E-Signature Password and Click On Submit.*

Set1

Packing Type: Blister  
Storage Conditions: 40°C ± 2°C / 75%RH ± 5%RH  
Stability Condition: ACCELERATED

#### Interval and Test Details

S.No	Test Name
1	PARA65CHDescription

S.No	Number of Syringes required at Each Point
1	50

Approval Life Cycle\*: ApoverLC [View](#)

Success

Submitted successfully.

OK

LIMS 2.0
All © rights Reserved PharmaSoftSol

10. Click on User Name

SSNo : PSS-LIMS-SS-010

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS User

### Schedule Test Selection

[Action](#)
[Schedule Intervals](#)
[Schedule Test Selection](#)


**Activity :**  
*. Select Create, Select The Record and Click on Next.*  
*. If Rejected is Required, Then Select Rejected.*

☐ Schedule Test Selection
☒ Reverted Schedule Test Selection

#### List of Reverted Schedules


S.No.	Protocol Number	Product Name	Generic Name	Specification Name	Reverted By	Reverted On	Comments
No data available!							

Row count: 10



Logout

LIMS 2.0
All © rights Reserved PharmaSoftSol

	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

11.Click on Logout

SSNo : PSS-LIMS-SS-011

