
	Test Case Name	Create Loading
	Test Case Number	LIMS-SM-011
	Actual Result	Pass

1. Enter the username, password, Select Module and click on login button


SSNo : PSS-LIMS-SS-001

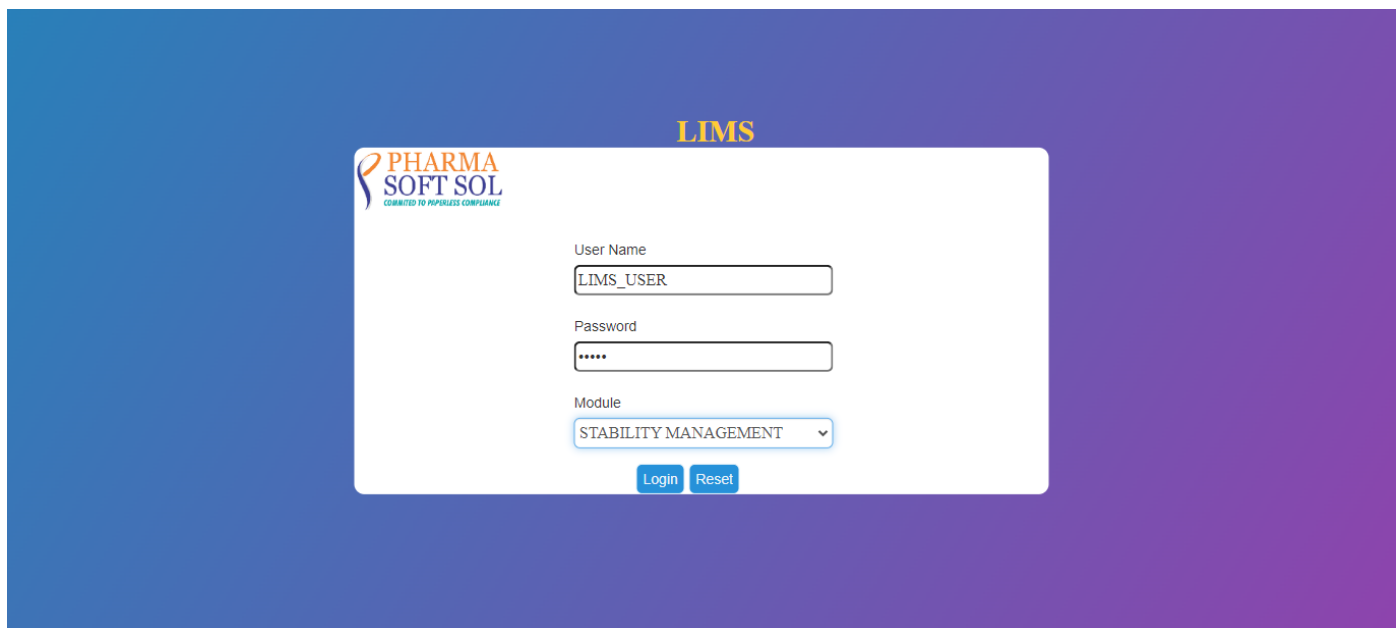

The screenshot shows the LIMS login interface. At the top center, the word "LIMS" is displayed in yellow. Below it is the PharmaSoftSol logo. The login form contains three input fields: "User Name" with the value "LIMS_USER", "Password" with masked characters "*****", and "Module" with a dropdown menu set to "STABILITY MANAGEMENT". At the bottom of the form are two buttons: "Login" and "Reset".

1. Click on Loading

SSNo : PSS-LIMS-SS-001

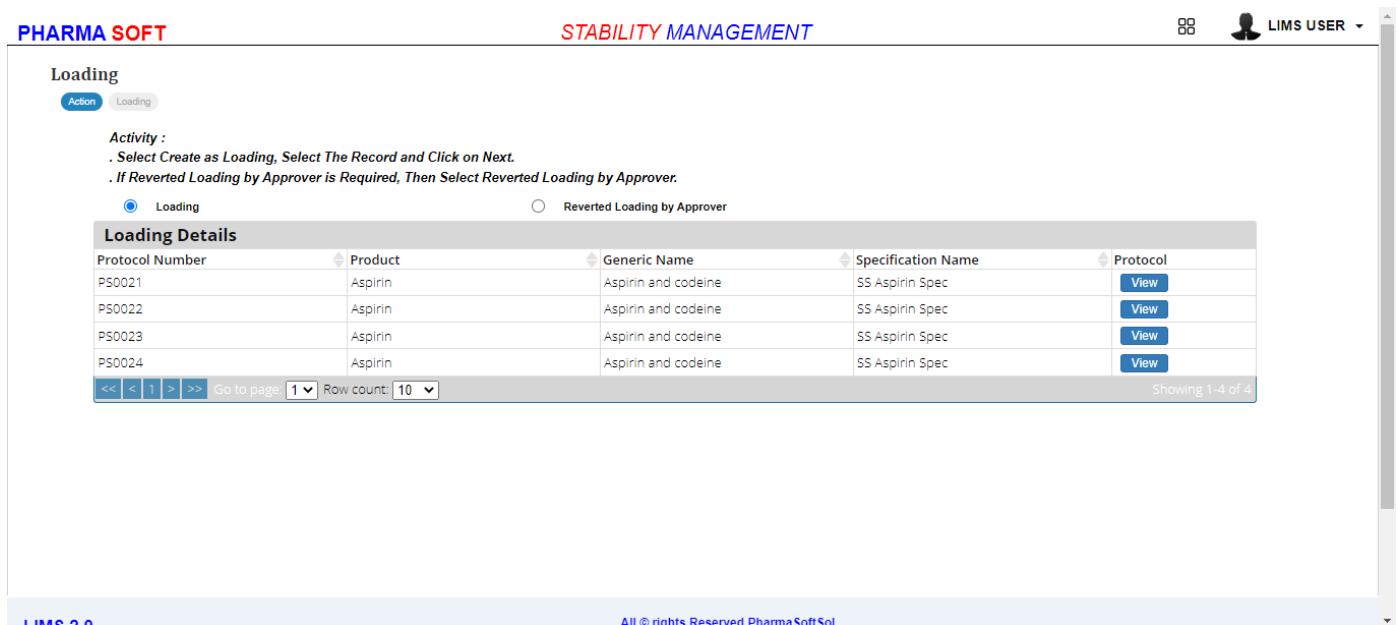

The screenshot shows the "Loading" section of the LIMS application. The header includes the PharmaSoftSol logo, the text "STABILITY MANAGEMENT", and a user profile icon labeled "LIMS USER". The "Loading" section has a tabbed interface with "Action" and "Loading" tabs. Below the tabs, there is a section titled "Activity :" with instructions: ". Select Create as Loading, Select The Record and Click on Next." and ". If Reverted Loading by Approver is Required, Then Select Reverted Loading by Approver." There are two radio buttons: "Loading" (selected) and "Reverted Loading by Approver". Below this is a table titled "Loading Details" with columns: Protocol Number, Product, Generic Name, Specification Name, and Protocol. The table contains four rows of data for Aspirin. Each row has a "View" button in the Protocol column. At the bottom of the table, there is a pagination bar with navigation arrows, "Go to page: 1", "Row count: 10", and "Showing 1-4 of 4".

Protocol Number	Product	Generic Name	Specification Name	Protocol
PS0021	Aspirin	Aspirin and codeine	SS Aspirin Spec	View
PS0022	Aspirin	Aspirin and codeine	SS Aspirin Spec	View
PS0023	Aspirin	Aspirin and codeine	SS Aspirin Spec	View
PS0024	Aspirin	Aspirin and codeine	SS Aspirin Spec	View

2. Select a Record

SSNo : PSS-LIMS-SS-002



Test Case Name	Create Loading
Test Case Number	LIMS-SM-011
Actual Result	Pass

Loading

Action Loading

Activity :
. Select Create as Loading, Select The Record and Click on Next.
. If Reverted Loading by Approver is Required, Then Select Reverted Loading by Approver.


☒ Loading ☐ Reverted Loading by Approver

Loading Details				
Protocol Number	Product	Generic Name	Specification Name	Protocol
PS0021	Aspirin	Aspirin and codeine	SS Aspirin Spec	View
PS0022	Aspirin	Aspirin and codeine	SS Aspirin Spec	View
PS0023	Aspirin	Aspirin and codeine	SS Aspirin Spec	View
PS0024	Aspirin	Aspirin and codeine	SS Aspirin Spec	View

<< < 1 > >>

Go to page: Row count:

Showing 1-4 of 4

 PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	Test Case Name	Create Loading
	Test Case Number	LIMS-SM-011
	Actual Result	Pass

3. Click on Next

SSNo : PSS-LIMS-SS-003

PHARMA SOFT
STABILITY MANAGEMENT
LIMS USER

Loading

Action Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

Loading Details														
Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	2		Sele			Sel	Evaluate		Select

Approval From*: Select

IMS 2.0
All © rights Reserved PharmaSoftSol

4. Enter Analysis Quantity

SSNo : PSS-LIMS-SS-004

PHARMA SOFT
STABILITY MANAGEMENT
LIMS USER

Loading


Action Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	2		Sele			Sel	Evaluate		Select

Approval From*: Select

IMS 2.0
All © rights Reserved PharmaSoftSol

 PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	Test Case Name	Create Loading
	Test Case Number	LIMS-SM-011
	Actual Result	Pass

5. Enter Reference Quantity

SSNo : PSS-LIMS-SS-005

PHARMA SOFT
STABILITY MANAGEMENT
LIMS USER

Loading

Action
Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
. Select Approval User From Click On Select and Click On Finish.
. Enter E-Signature Password and Click On Submit.

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	2	3	Sele			Sel	Evaluate		Select

Approval From*:
Select

IMS 2.0
All © rights Reserved PharmaSoftSol

6. Select UOM

SSNo : PSS-LIMS-SS-006

PHARMA SOFT
STABILITY MANAGEMENT
LIMS USER

Loading


Action
Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
. Select Approval User From Click On Select and Click On Finish.
. Enter E-Signature Password and Click On Submit.

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	2	3	Gm			Sel	Evaluate		Select

Approval From*:
Select

IMS 2.0
All © rights Reserved PharmaSoftSol

 PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	Test Case Name	Create Loading
	Test Case Number	LIMS-SM-011
	Actual Result	Pass

7. Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-007

PHARMA SOFT
STABILITY MANAGEMENT
LIMS USER

Loading

Action
Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
. Select Approval User From Click On Select and Click On Finish.
. Enter E-Signature Password and Click On Submit.

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	2	3	Gm	3		Sel	Evaluate		Select

Approval From*:

Select

IMS 2.0
All © rights Reserved PharmaSoftSol

8. Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-008

PHARMA SOFT
STABILITY MANAGEMENT
LIMS USER

Loading

Action
Loading


. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
. Select Approval User From Click On Select and Click On Finish.
. Enter E-Signature Password and Click On Submit.

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	2	3	Gm	3	2	Sel	Evaluate		Select

Approval From*:

Select

IMS 2.0
All © rights Reserved PharmaSoftSol

 PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	Test Case Name	Create Loading
	Test Case Number	LIMS-SM-011
	Actual Result	Pass

9. Select UOM

SSNo : PSS-LIMS-SS-009

PHARMA SOFT
STABILITY MANAGEMENT
LIMS USER

Loading

Action
Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
. Select Approval User From Click On Select and Click On Finish.
. Enter E-Signature Password and Click On Submit.

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	<input type="text" value="2"/>	<input type="text" value="3"/>	Gm	<input type="text" value="3"/>	<input type="text" value="2"/>	Gm	<input type="button" value="Evaluate"/>	<input type="text"/>	<input type="button" value="Select"/>

Approval From*:

IMS 2.0
All © rights Reserved PharmaSoftSol

10. Click on Start Date

SSNo : PSS-LIMS-SS-010

PHARMA SOFT
STABILITY MANAGEMENT
LIMS USER

Loading


Action
Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
. Select Approval User From Click On Select and Click On Finish.
. Enter E-Signature Password and Click On Submit.

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	<input type="text" value="2"/>	<input type="text" value="3"/>	Gm	<input type="text" value="3"/>	<input type="text" value="2"/>	Gm	<input type="button" value="Evaluate"/>	<input type="text" value="5-07-2022"/>	<input type="button" value="Select"/>


Approval From*:

IMS 2.0
All © rights Reserved PharmaSoftSol

	Test Case Name	Create Loading
	Test Case Number	LIMS-SM-011
	Actual Result	Pass

11. Click on Select

SSNo : PSS-LIMS-SS-011

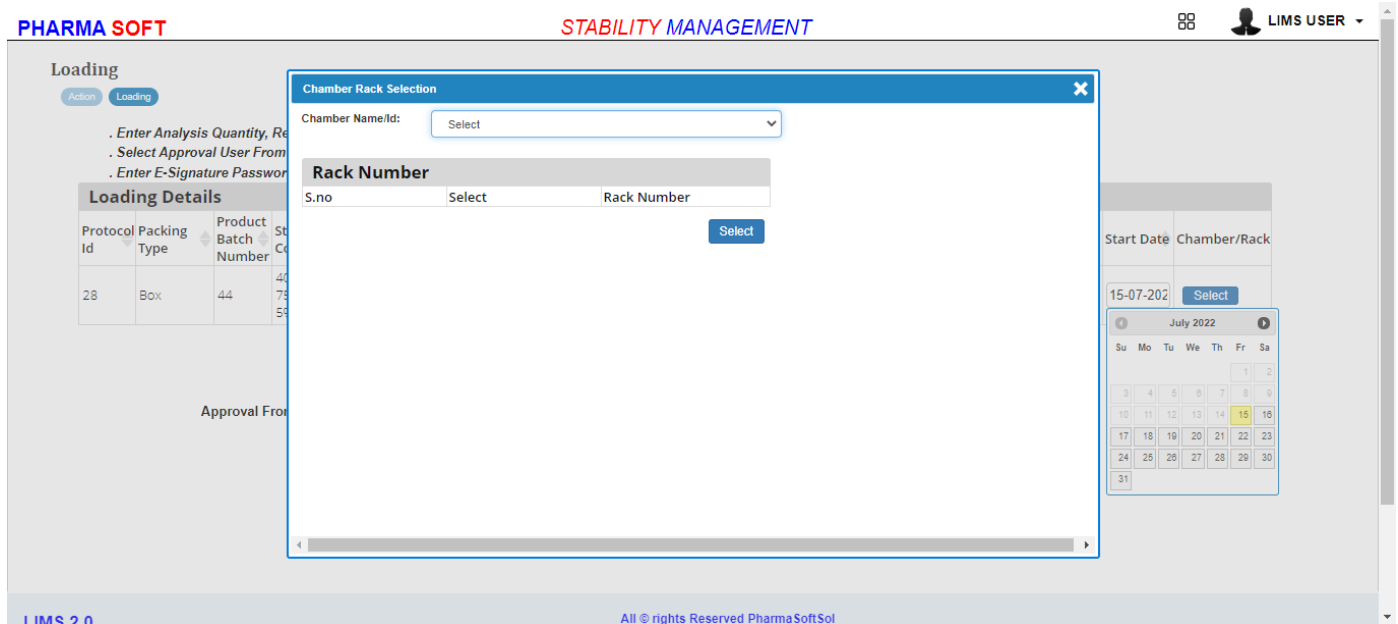

PHARMA SOFT **STABILITY MANAGEMENT** LIMS USER

Loading

Action Loading

. Enter Analysis Quantity, Re
. Select Approval User From
. Enter E-Signature Passwor

Loading Details

Protocol Id	Packing Type	Product Batch Number	St Co
28	Box	44	40 79 53

Approval Fro

Chamber Rack Selection

Chamber Name/Id: Select

Rack Number

S.no Select Rack Number

Select

Start Date Chamber/Rack

15-07-202 Select


July 2022

Su	Mo	Tu	We	Th	Fr	Sa
						1
3	4	5	6	7	8	9
10	11	12	13	14	15	16
17	18	19	20	21	22	23
24	25	26	27	28	29	30
31						

LIMS 2.0 All © rights Reserved PharmaSoftSol

12. Select Chamber

SSNo : PSS-LIMS-SS-012

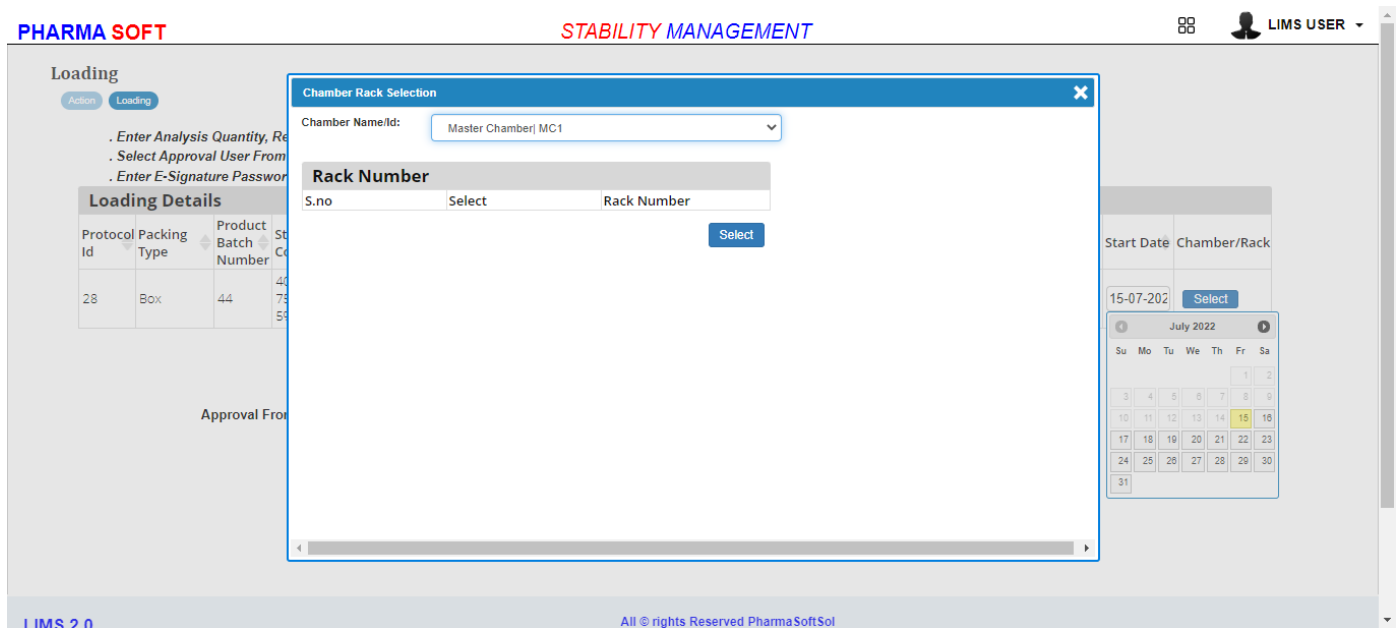

PHARMA SOFT **STABILITY MANAGEMENT** LIMS USER

Loading

Action Loading

. Enter Analysis Quantity, Re
. Select Approval User From
. Enter E-Signature Passwor

Loading Details

Protocol Id	Packing Type	Product Batch Number	St Co
28	Box	44	40 79 53

Approval Fro

Chamber Rack Selection

Chamber Name/Id: Master Chamber| MC1

Rack Number

S.no Select Rack Number

Select


Start Date Chamber/Rack

15-07-202 Select

July 2022

Su	Mo	Tu	We	Th	Fr	Sa
						1
3	4	5	6	7	8	9
10	11	12	13	14	15	16
17	18	19	20	21	22	23
24	25	26	27	28	29	30
31						

LIMS 2.0 All © rights Reserved PharmaSoftSol

 PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	Test Case Name	Create Loading
	Test Case Number	LIMS-SM-011
	Actual Result	Pass

13. Select Check Box

PHARMA SOFT

STABILITY MANAGEMENT

88

LIMS USER

Loading

Action Loading

Enter Analysis Quantity, Re
Select Approval User From
Enter E-Signature Passwor

Loading Details			
Protocol Id	Packing Type	Product Batch Number	St C
28	Box	44	47 73 53

Approval Fro

Chamber Rack Selection
✕

Chamber Name/Id: Master Chamber| MC1

Rack Number		
S.no	Select	Rack Number
1	<input checked="" type="checkbox"/>	134

Select

Start Date	Chamber/Rack
15-07-202	Select

July 2022
➡

Su	Mo	Tu	We	Th	Fr	Sa
						1 2
3	4	5	6	7	8	9
10	11	12	13	14	15	16
17	18	19	20	21	22	23
24	25	26	27	28	29	30
31						

LIMS 2.0

All © rights Reserved PharmaSoftSol

STABILITY MANAGEMENT

LIMS USER

Loading

Action Loading

. Enter Analysis Quantity, Re

. Select Approval User From

. Enter E-Signature Password

Loading Details

Protocol Id	Packing Type	Product Batch Number	Stock Code
28	Box	44	407959

Approval From

Chamber Rack Selection

Chamber Name/Id: Master Chamber| MC1

Rack Number		
S.no	Select	Rack Number
1	<input checked="" type="checkbox"/>	134

Select

Chamber Name/Id:

Rack Number

S.no	Select	Rack Number
1	<input checked="" type="checkbox"/>	134

Select

Start Date	Chamber/Rack
------------	--------------

15-07-202 Select

July 2022						
Su	Mo	Tu	We	Th	Fr	Sa
					1	2
3	4	5	6	7	8	9
10	11	12	13	14	15	16
17	18	19	20	21	22	23
24	25	26	27	28	29	30
31						

IMS 20

All © rights Reserved PharmaSoftSol

14. Click on Select

PHARMA SOFT

STABILITY MANAGEMENT

LIMS USER

Loading

Action

Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.

. Select Approval User From Click On Select and Click On Finish.

. Enter E-Signature Password and Click On Submit.

Loading Details

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	<input type="text" value="2"/>	<input type="text" value="3"/>	<div></div>	<input type="text" value="3"/>	<input type="text" value="2"/>	<div></div>	<div>Evaluate</div>	15-07-202	<div>Select</div>

Approval From*:

Select

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

31

LIMS 2.0

All © rights Reserved PharmaSoft Sol

STABILITY MANAGEMENT

 LIMS USER

Loading

Action Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.

. Select Approval User From Click On Select and Click On Finish.


. Enter E-Signature Password and Click On Submit.

Loading Details

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	<input type="text" value="2"/>	<input type="text" value="3"/>	<input type="text" value=""/>	<input type="text" value="3"/>	<input type="text" value="2"/>	<input type="text" value=""/>	<input type="button" value="Evaluate"/>	<input type="text" value="15-07-202"/>	<input type="button" value="Select"/>

Approval From^{*}:


Select



A screenshot of a calendar for July 2022. The date 15 is highlighted in yellow.

IMS 20

All © rights Reserved PharmaSoftSol

 PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	Test Case Name	Create Loading
	Test Case Number	LIMS-SM-011
	Actual Result	Pass

17. Select a Record

SSNo : PSS-LIMS-SS-017

PHARMA SOFT **STABILITY MANAGEMENT** LIMS USER

Loading

Action Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.

. Select Approval User From Click On Select and Click On Finish.

. Enter E-Signature Password and Click On Submit.

Loading Details

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	2	3	Gm	3	2	Gm	Evaluate	15-07-202	Select

Approval From*: LIMS APPROVER Select

Locations

organization

Plant-1

QA

QC

PF

First Name: Last Name:

Search Clear

Users

First Name	Last Name
LIMS	USER
LIMS	REVIEWER
LIMS	APPROVER

<< < 1 > >> Go to page: 1 Row count: 5 Showing 1-3 of 3

Select Cancel

IIMS 2.0 All © rights Reserved PharmaSoftSol

18. Click on Select

SSNo : PSS-LIMS-SS-018

PHARMA SOFT **STABILITY MANAGEMENT** LIMS USER

Loading

Action Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.

. Select Approval User From Click On Select and Click On Finish.

. Enter E-Signature Password and Click On Submit.

Loading Details

Protocol Id	Packing Type	Product Batch Number	Storage Conditions	Stability Conditions	Schedule Interval Type	Analysis Quantity	Reference Quantity	UOM (Quantity)	Analysis Qty Count	Ref. Quantity Count	UOM (Qty Count)	Total Count	Start Date	Chamber/Rack
28	Box	44	40°C ± 2°C / 75%RH ± 5%RH	ACCELERATED	MONTH	2	3	Gm	3	2	Gm	Evaluate	15-07-202	Select

Approval From*: LIMS APPROVER Select

IIMS 2.0 All © rights Reserved PharmaSoftSol

