


| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

1.Enter the username, password, Select Module and click on login button

SSNo : PSS-LIMS-SS-001

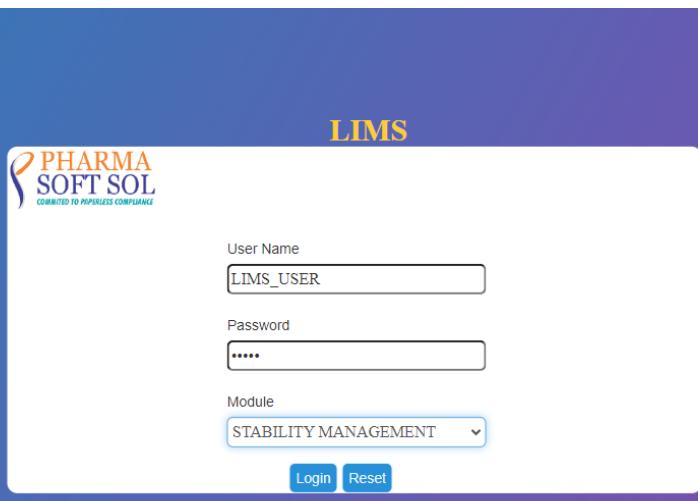

The screenshot shows the LIMS login interface. At the top center, it says "LIMS". Below that is the "PHARMA SOFT SOL" logo. The form fields include "User Name" with "LIMS_USER" entered, "Password" with "*****" entered, and a "Module" dropdown set to "STABILITY MANAGEMENT". At the bottom are "Login" and "Reset" buttons.

1.Click on Loading

SSNo : PSS-LIMS-SS-001



The screenshot shows the "STABILITY MANAGEMENT" module's "Loading" screen. At the top, there are tabs for "Action" (selected) and "Loading". Below that is a note: ". Select Create as Loading, Select The Record and Click on Next. . If Reverted Loading by Approver is Required, Then Select Reverted Loading by Approver." There are two radio buttons: "Loading" (selected) and "Reverted Loading by Approver". The main area is titled "Loading Details" and contains a table with columns: Protocol Number, Product, Generic Name, Specification Name, and Protocol. The table data is as follows:

| Protocol Number | Product | Generic Name | Specification Name | Protocol |
|-----------------|-------------|--------------------|------------------------------|----------------------|
| PC0001 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0002 | Epinephrine | GN 001 | SS Epinephrine Specification | View |
| PC0003 | Epinephrine | GN 001 | SS Epinephrine Specification | View |
| PC0004 | Epinephrine | GN 001 | SS Epinephrine Specification | View |
| PC0005 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0006 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0008 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0007 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0018 | PARA65 | Paracetamol 650 mg | SPPARACHEMICAL | View |

At the bottom, there are navigation links: <<, <, >, >>, Go to page: 1, Row count: 10, and a note: Showing 1-9 of 9.

2.Select a Record

SSNo : PSS-LIMS-SS-002

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

Activity :
 . Select Create as Loading, Select The Record and Click on Next.
 . If Reverted Loading by Approver is Required, Then Select Reverted Loading by Approver.

Loading Reverted Loading by Approver

| Loading Details | | | | | |
|-----------------|-------------|--------------------|------------------------------|---|--|
| Protocol Number | Product | Generic Name | Specification Name | Protocol | |
| PC0001 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 |  | |
| PC0002 | Epinephrine | GN 001 | SS Epinephrine Specification |  | |
| PC0003 | Epinephrine | GN 001 | SS Epinephrine Specification |  | |
| PC0004 | Epinephrine | GN 001 | SS Epinephrine Specification |  | |
| PC0005 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 |  | |
| PC0006 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 |  | |
| PC0008 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 |  | |
| PC0007 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 |  | |
| PC0018 | PARA65 | Paracetamol 650 mg | SPPARACHEMICAL |  | |

<< < 1 > >> Go to page: Row count:

Showing 1-9 of 9

LIMS 2.0

All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

3.Click on Next

SSNo : PSS-LIMS-SS-003

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

4.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-004

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

5.Enter Reference Quantity

SSNo : PSS-LIMS-SS-005

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | Select | | Select | Evaluate | | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | | Select | | Select | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | | Select | | Select | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | | Select | | Select | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | | Select | | Select | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | | Select | | Select | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

6.Select UOM

SSNo : PSS-LIMS-SS-006

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | Select | | Select | Evaluate | | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | | Select | | Select | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | | Select | | Select | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | | Select | | Select | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | | Select | | Select | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | | Select | | Select | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

7.Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-007

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | | | | Evaluate | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | | | Evaluate | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | | | Evaluate | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec | | | | | Evaluate | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | | | Evaluate | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | | | Evaluate | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

8.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-008

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.


| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | | | Evaluate | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | | | Evaluate | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | | | Evaluate | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec | | | | | Evaluate | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | | | Evaluate | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | | | Evaluate | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

9.Select UOM

SSNo : PSS-LIMS-SS-009

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  


. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|----------------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | <input type="text"/> | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

10.Click on Start Date

SSNo : PSS-LIMS-SS-010

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.


| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|---|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Sele | Evaluate |  | |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Sele | Evaluate | <input type="text"/> | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

11.Click on Select


SSNo : PSS-LIMS-SS-011

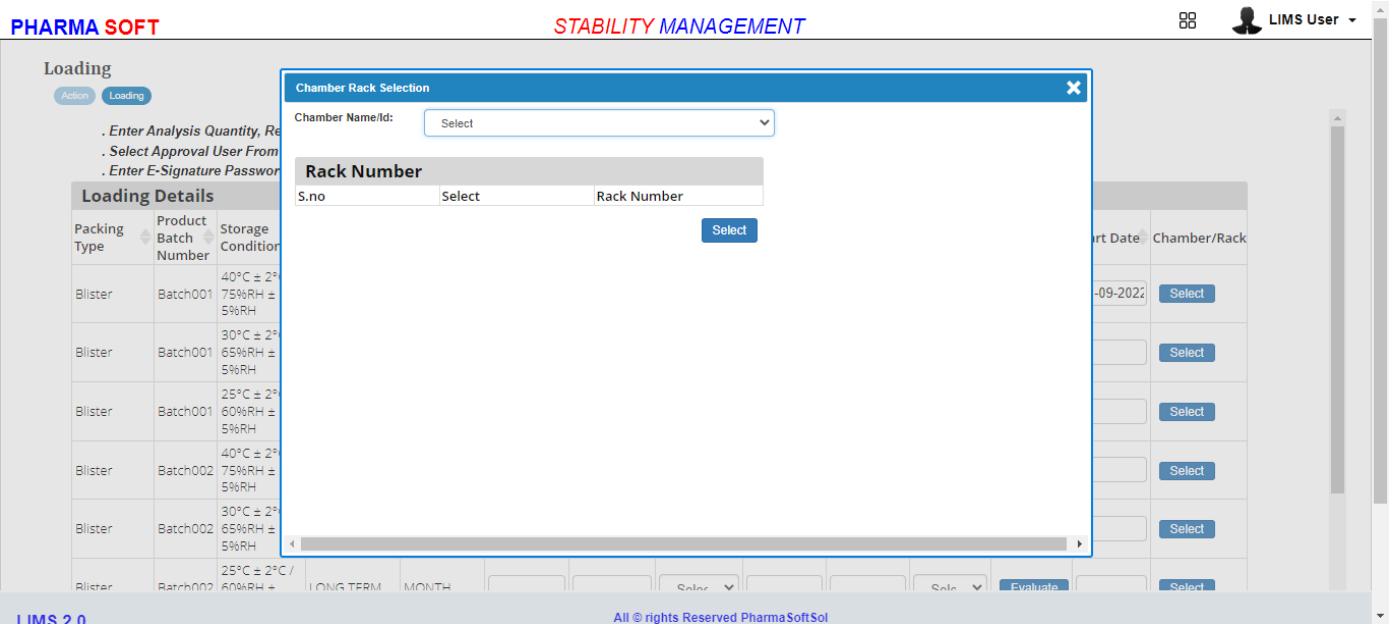

The screenshot shows the 'STABILITY MANAGEMENT' module. On the left, there's a 'Loading' section with a table of 'Loading Details'. The table has columns for 'Packing Type', 'Product Batch Number', and 'Storage Condition'. Several rows are listed, each with a different batch number and specific temperature and humidity ranges. On the right, a 'Chamber Rack Selection' modal is open, asking for a chamber name and a rack number. The background shows a list of stability test results with columns for 'Start Date' and 'Chamber/Rack'.

12.Select Chamber

SSNo : PSS-LIMS-SS-012

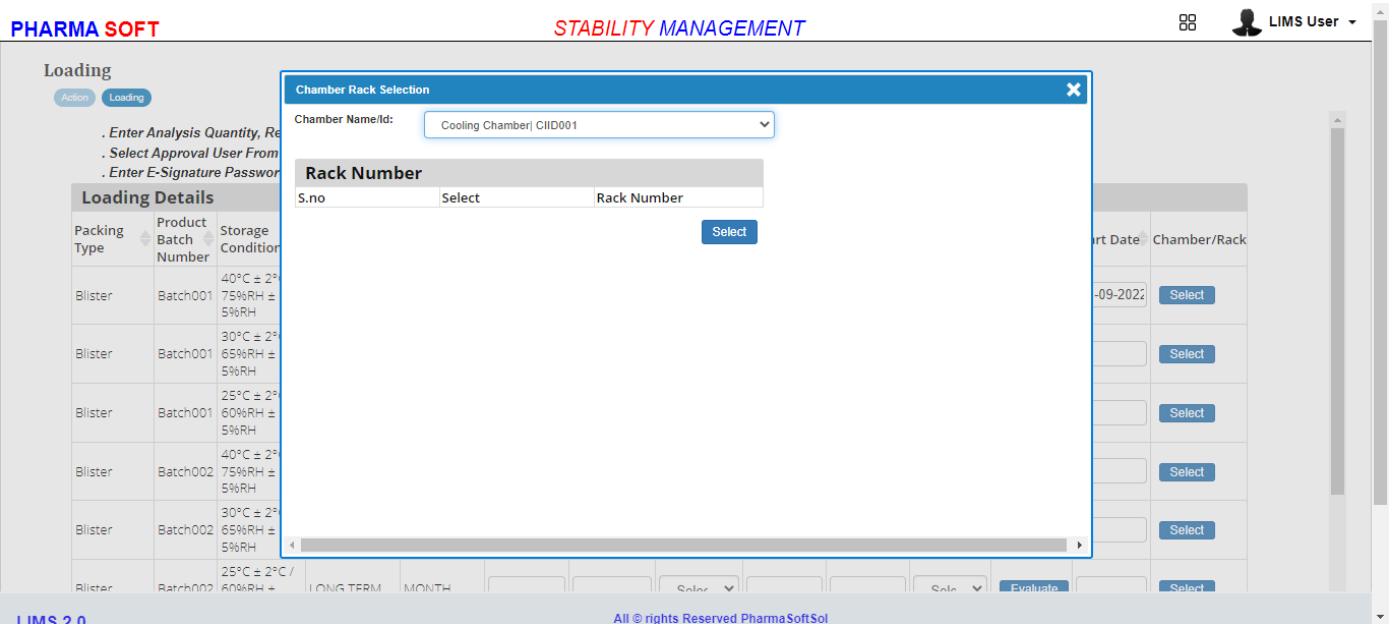


This screenshot is similar to the previous one, showing the 'STABILITY MANAGEMENT' module. The 'Loading' section and the 'Chamber Rack Selection' modal are present. However, the 'Chamber Name/Id' dropdown in the modal is now populated with 'Cooling Chamber CIID001'. The rest of the interface, including the main table and the background list of test results, remains the same.

| | |
|--|--------------------------------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name Create Loading |
| | Test Case Number LIMS-SM-011 |
| | Actual Result Pass |

13. Select Check Box

SSNo : PSS-LIMS-SS-013

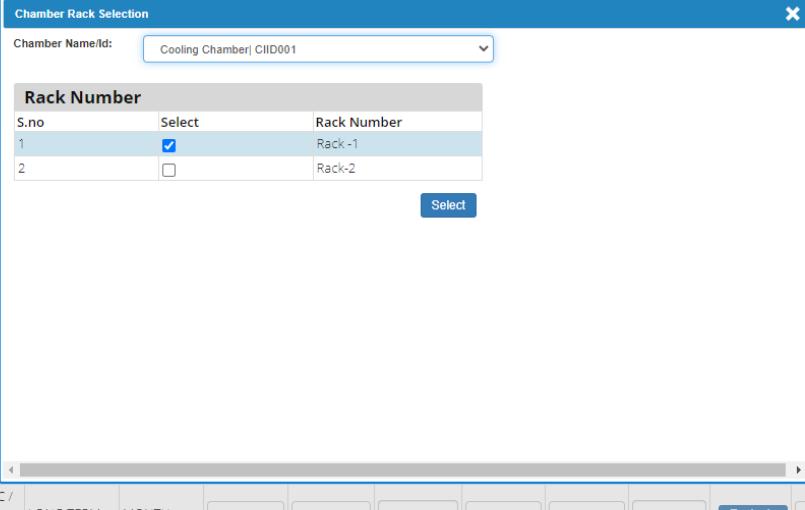


The screenshot shows the 'Stability Management' module. A modal window titled 'Chamber Rack Selection' is open, prompting for a 'Chamber Name/Id' (Cooling Chamber CID001). Below it is a table titled 'Rack Number' with two entries:

| S.no | Select | Rack Number |
|------|-------------------------------------|-------------|
| 1 | <input checked="" type="checkbox"/> | Rack-1 |
| 2 | <input type="checkbox"/> | Rack-2 |

At the bottom of the modal are 'Select' and 'Evaluate' buttons.

14. Click on Select

SSNo : PSS-LIMS-SS-014

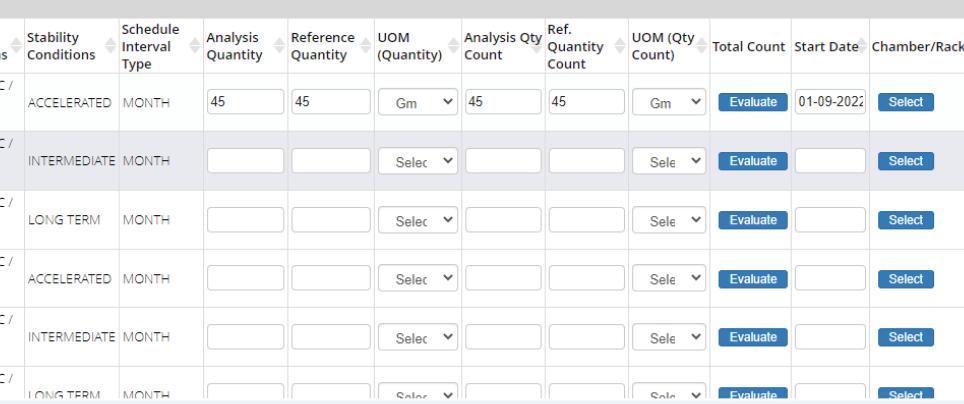

The screenshot shows the 'Stability Management' module. A table titled 'Loading Details' is displayed with the following columns:

| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
|--------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Sele | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Sele | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec | | | Sele | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Sele | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele | | | Sele | Evaluate | | Select |

At the bottom of the table are 'Evaluate' and 'Select' buttons.

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

15.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-015

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

16.Enter Reference Quantity

SSNo : PSS-LIMS-SS-016

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

17. Select UOM

SSNo : PSS-LIMS-SS-017

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

18. Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-018

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Sele ▼ | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

19.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-019

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

20.Select UOM

SSNo : PSS-LIMS-SS-020

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.


| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

21.Click on Start Date

SSNo : PSS-LIMS-SS-021

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  


. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
|--------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Selec | Evaluate | | |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec | | | Selec | Evaluate | | |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Selec | Evaluate | | |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Selec | Evaluate | | Select |

All © rights Reserved PharmaSoftSol

22.Click on Select

SSNo : PSS-LIMS-SS-022

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber/Rack.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Packing Type | Product Batch Number | Storage Condition | Chamber/Rack |
|--------------|----------------------|---------------------------|-------------------|
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | 01-09-2022 Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | 01-09-2022 Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | 01-09-2022 Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | 01-09-2022 Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | 01-09-2022 Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | 01-09-2022 Select |

Chamber Rack Selection

Chamber Name/Id:


| Rack Number | | |
|-------------|--------|-------------|
| S.no | Select | Rack Number |
| | Select | |

All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

23. Select Chamber

SSNo : PSS-LIMS-SS-023

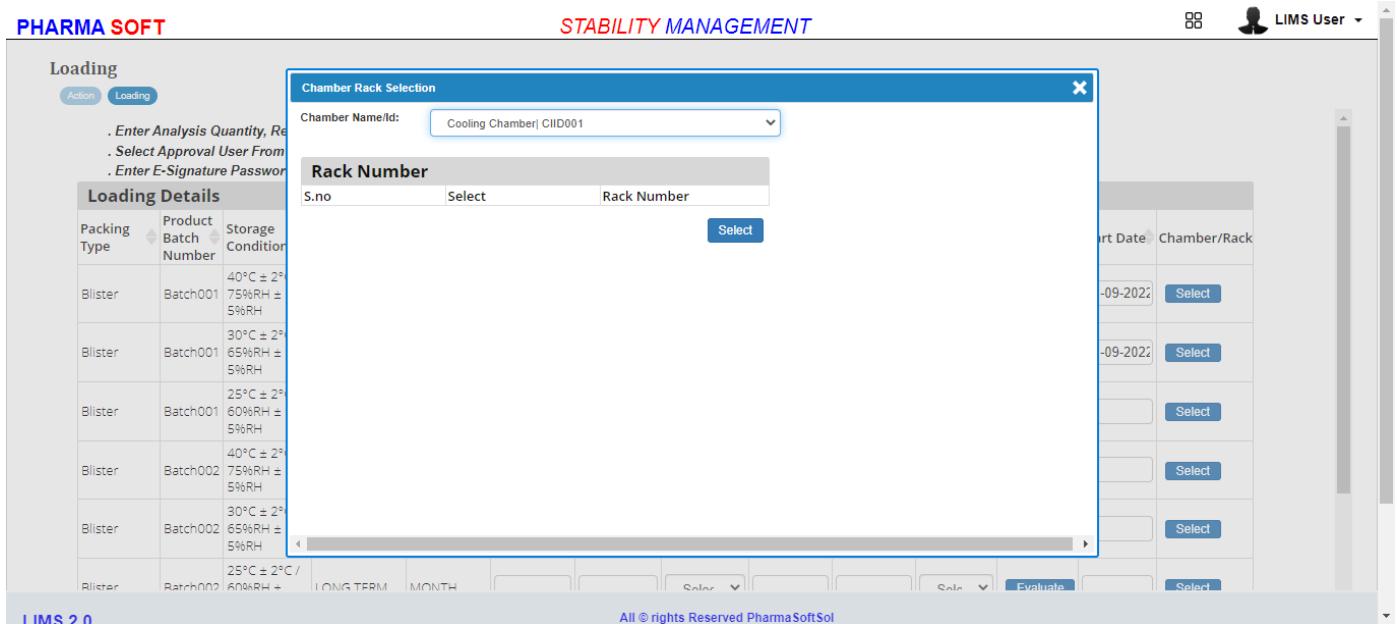


The screenshot shows the 'Stability MANAGEMENT' module. On the left, there's a 'Loading' section with a table of 'Loading Details'. On the right, a 'Chamber Rack Selection' dialog box is open, prompting for a chamber name and listing rack numbers.

| Chamber Rack Selection | | |
|------------------------|-------------------------------------|-------------|
| Chamber Name/Id: | Cooling Chamber CII001 | |
| Rack Number | | |
| S.no | Select | Rack Number |
| 1 | <input checked="" type="checkbox"/> | Rack -1 |
| 2 | <input type="checkbox"/> | Rack-2 |

24. Select Check Box

SSNo : PSS-LIMS-SS-024

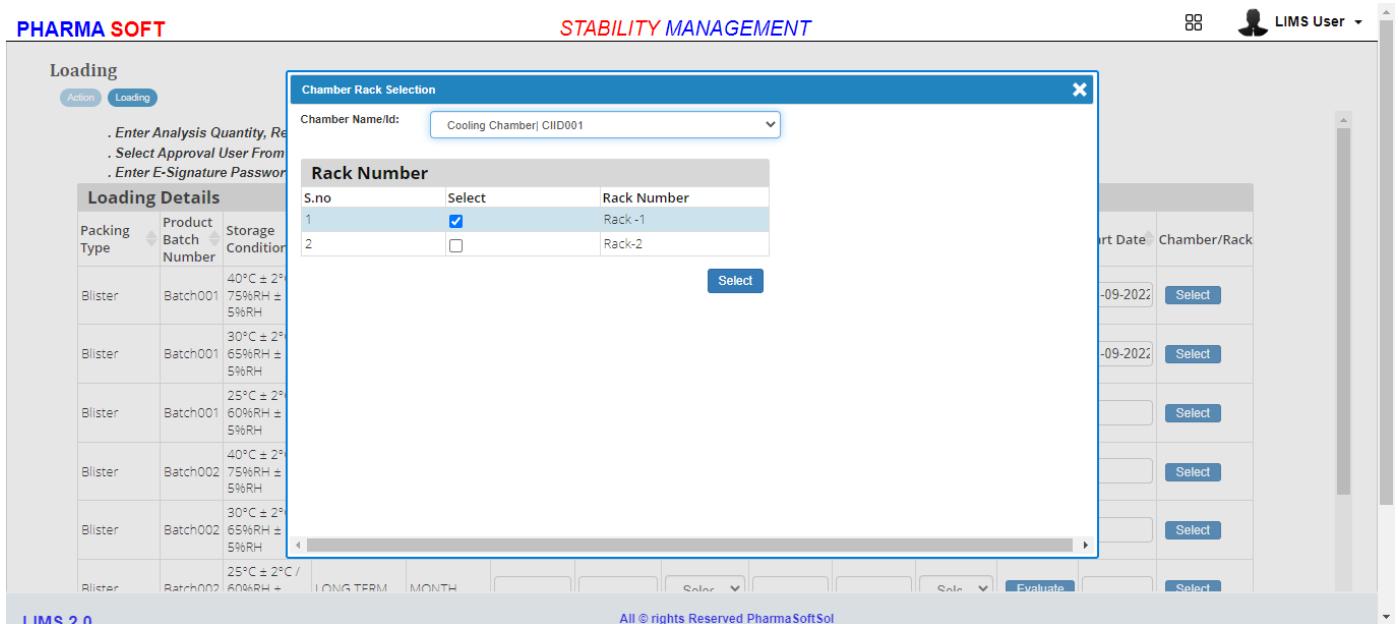

This screenshot is nearly identical to the previous one, showing the 'Chamber Rack Selection' dialog with the 'Select' checkbox checked for the first row. The rest of the interface, including the loading details table and the overall layout, remains the same.

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

25.Click on Select

SSNo : PSS-LIMS-SS-025

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | | 60 | 60 | | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

26.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-026

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

27.Enter Reference Quantity

SSNo : PSS-LIMS-SS-027

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

28.Select UOM

SSNo : PSS-LIMS-SS-028

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Selec ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

29.Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-029

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

30.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-030

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.


| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

31.Select UOM

SSNo : PSS-LIMS-SS-031

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec | | | Sele | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Sele | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele | | | Sele | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

32.Click on Start Date


SSNo : PSS-LIMS-SS-032

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | Selec | | | Sele | Evaluate | | |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec | | | Sele | Evaluate | | |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele | | | Sele | Evaluate | | |


 September 2022
Su Mo Tu We Th Fr Sa
1 2 3
4 5 6 7 8 9 10
11 12 13 14 Selected 15 16 17
18 19 20 21 22 23 24
25 26 27 28 29 30 31

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

33.Click on Select


SSNo : PSS-LIMS-SS-033

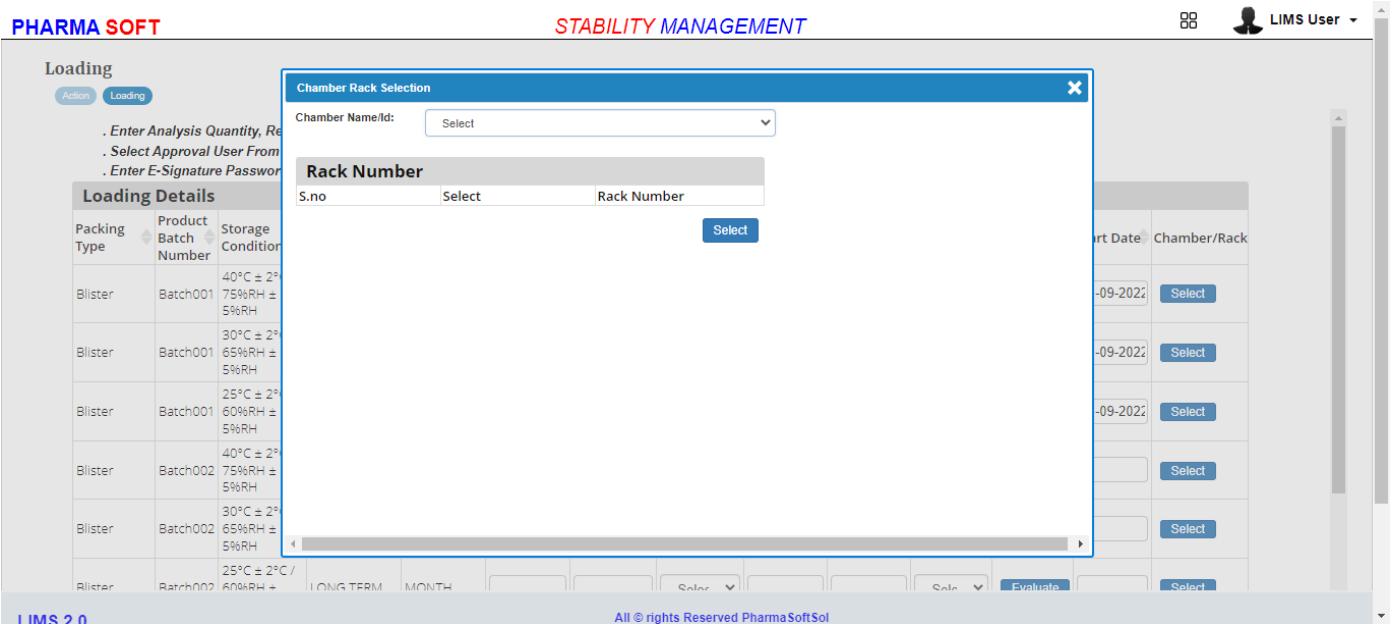

The screenshot shows the 'STABILITY MANAGEMENT' module. On the left, there's a table titled 'Loading Details' with columns for 'Packing Type', 'Product Batch Number', and 'Storage Condition'. The table contains several rows of data for different batches (Batch001 to Batch002) under various temperature and humidity conditions. On the right, a large grid displays stability data points for different dates and chamber/rack combinations, each with a 'Select' button.

34.Select Chamber

SSNo : PSS-LIMS-SS-034

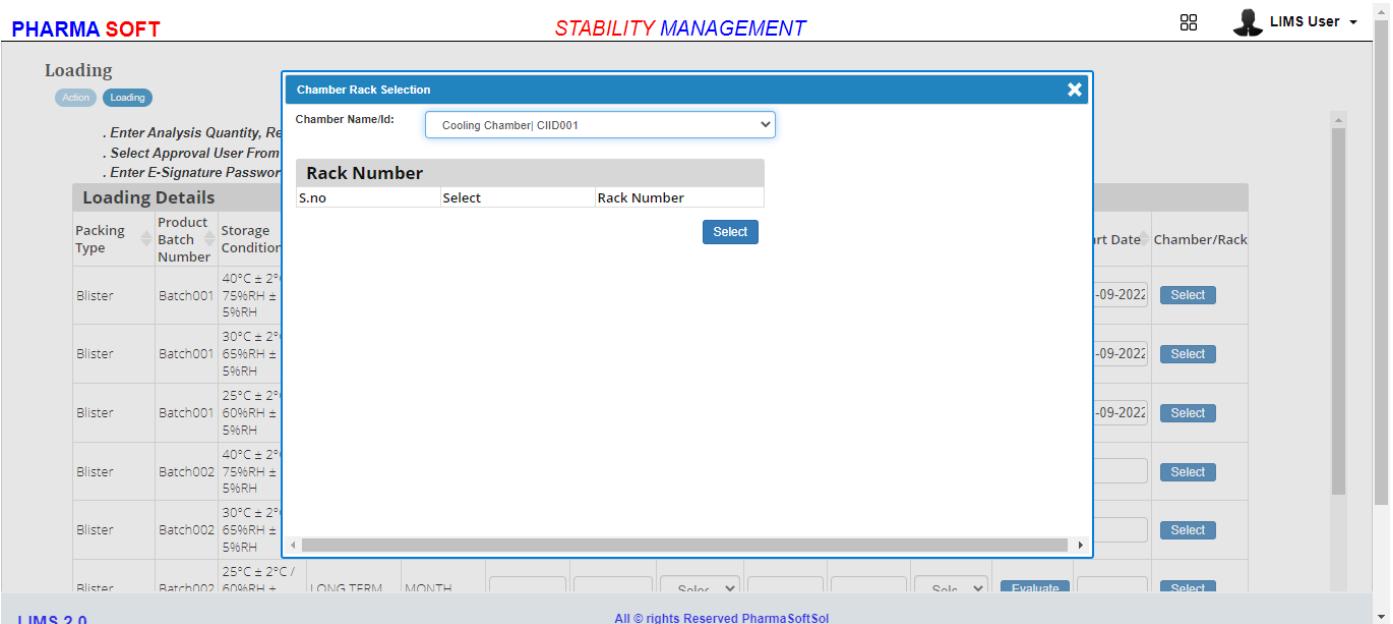


This screenshot is nearly identical to the previous one, showing the 'STABILITY MANAGEMENT' module. The 'Chamber Rack Selection' modal now shows 'Cooling Chamber CIID001' selected in the dropdown. The main table and the data grid on the right remain the same, displaying loading details and stability data points respectively.

| | |
|--|--------------------------------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name Create Loading |
| | Test Case Number LIMS-SM-011 |
| | Actual Result Pass |

35. Select Check Box

SSNo : PSS-LIMS-SS-035

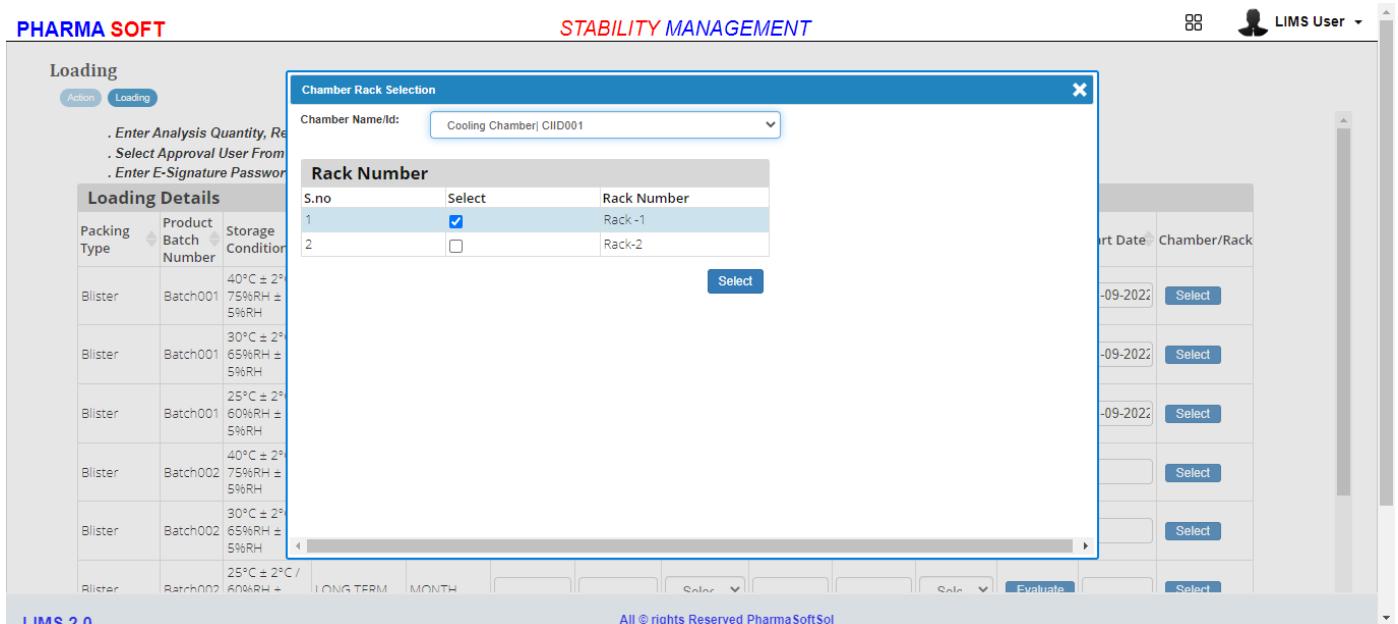

The screenshot shows the 'STABILITY MANAGEMENT' module. A 'Chamber Rack Selection' dialog box is open, prompting for a 'Chamber Name/Id' (Cooling Chamber CID001). Inside the dialog, there's a table titled 'Rack Number' with two rows: S.no 1 (Select checked, Rack Number Rack-1) and S.no 2 (Select unchecked, Rack Number Rack-2). A 'Select' button is at the bottom right of the dialog. The background shows a grid of stability test entries with columns for Start Date, Chamber/Rack, and various status buttons like 'Select' and 'Evaluate'.

36. Click on Select

SSNo : PSS-LIMS-SS-036



The screenshot shows the 'STABILITY MANAGEMENT' module. The 'Loading Details' table has several rows for different batches and conditions. The first row (Batch001, ACCELERATED, MONTH) has its 'Select' button highlighted. The table includes columns for Packing Type, Product Batch Number, Storage Conditions, Stability Conditions, Schedule Interval Type, Analysis Quantity, Reference Quantity, UOM (Quantity), Analysis Qty Count, Ref. Quantity Count, UOM (Qty Count), Total Count, Start Date, and Chamber/Rack.

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

37.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-037

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

38.Enter Reference Quantity

SSNo : PSS-LIMS-SS-038

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

39.Select UOM

SSNo : PSS-LIMS-SS-039

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

40.Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-040

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|---|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

41.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-041

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

42.Select UOM

SSNo : PSS-LIMS-SS-042

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

43.Click on Start Date

SSNo : PSS-LIMS-SS-043

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
|--------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sel ▼ | | | Sel ▼ | Evaluate | | Select |

All © rights Reserved PharmaSoftSol

44.Click on Select

SSNo : PSS-LIMS-SS-044

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber/Rack.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
|--------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sel ▼ | | | Sel ▼ | Evaluate | | Select |

Chamber Rack Selection

Chamber Name/Id:


| S.no | Select | Rack Number |
|------|---------------------------------------|-------------|
| | <input type="button" value="Select"/> | |

All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

45.Select Chamber


SSNo : PSS-LIMS-SS-045

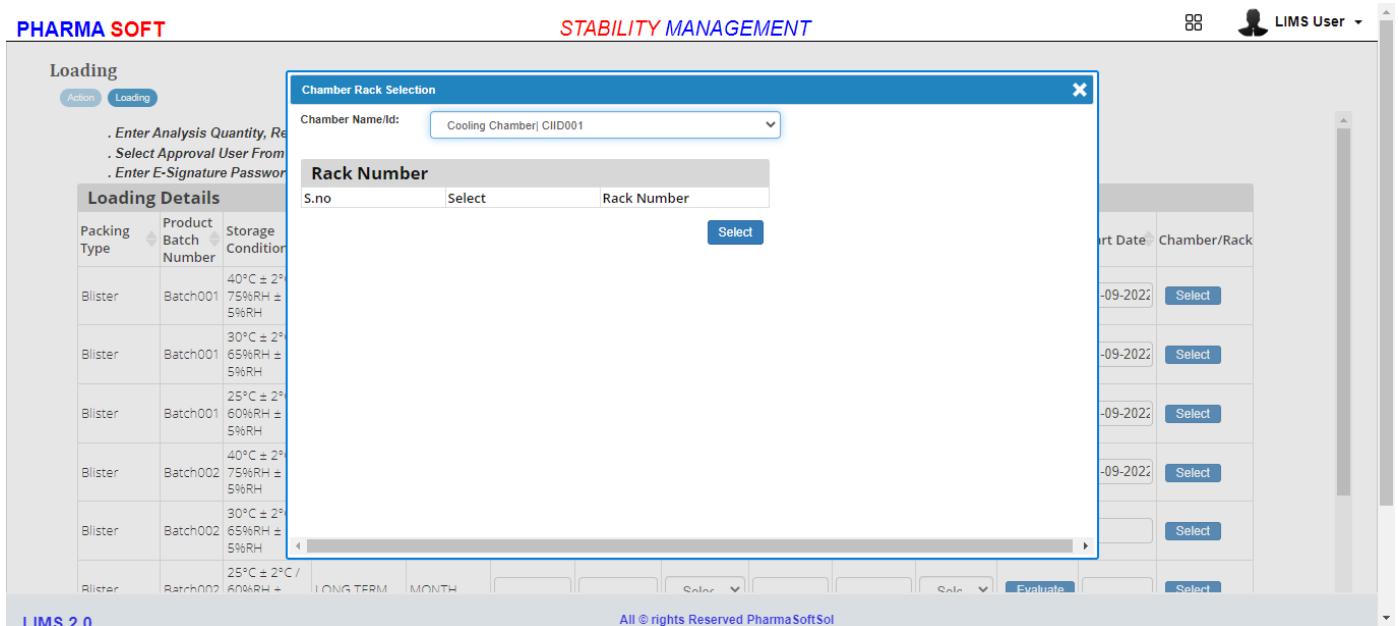

The screenshot shows the 'Stability MANAGEMENT' module. On the left, there's a table titled 'Loading Details' with columns for 'Packing Type', 'Product Batch Number', and 'Storage Condition'. The table lists several entries for Blister packaging with various batch numbers and storage conditions. On the right, there's a large table for 'Chamber/Rack' with columns for 'Start Date' and 'Chamber/Rack'. Below these tables is a 'Chamber Rack Selection' dialog box. Inside the dialog, there's a dropdown for 'Chamber Name/Id' set to 'Cooling Chamber| CII001'. Below it is a 'Rack Number' table with two rows. The first row has 'S.no' 1, 'Select' checked (with a blue checkmark), and 'Rack Number' 'Rack -1'. The second row has 'S.no' 2, 'Select' unchecked (with an empty box), and 'Rack Number' 'Rack-2'. At the bottom of the dialog is a 'Select' button.

46.Select Check Box

SSNo : PSS-LIMS-SS-046

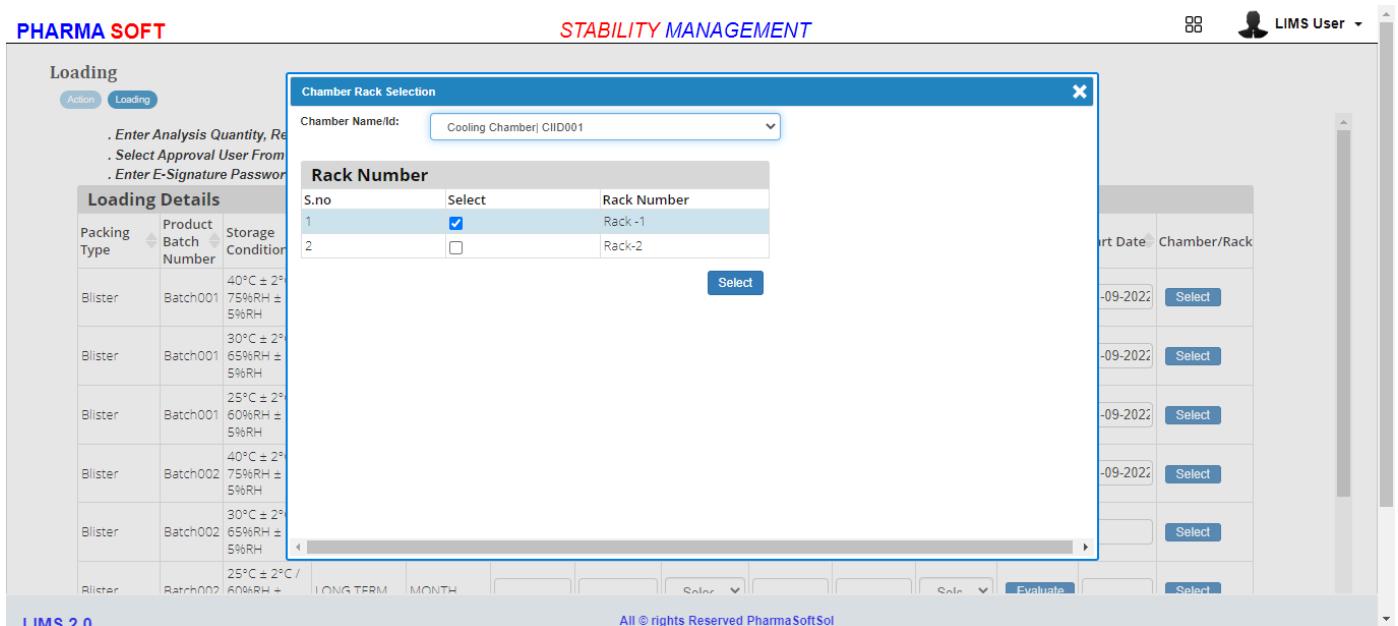

This screenshot is nearly identical to the previous one, showing the 'Stability MANAGEMENT' module. The 'Loading Details' table and the large 'Chamber/Rack' table are the same. The 'Chamber Rack Selection' dialog box is also present, with the 'Chamber Name/Id' set to 'Cooling Chamber| CII001'. The 'Rack Number' table has two rows. The first row now has 'Select' checked (blue checkmark) and 'Rack Number' 'Rack -1'. The second row has 'Select' unchecked (empty box) and 'Rack Number' 'Rack-2'. The 'Select' button at the bottom of the dialog is visible.

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

47.Click on Select

SSNo : PSS-LIMS-SS-047

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sale ▼ | | | Sale ▼ | Evaluate | | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

48.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-048

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sale ▼ | | | Sale ▼ | Evaluate | | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

49.Enter Reference Quantity

SSNo : PSS-LIMS-SS-049

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sale ▼ | | | Sale ▼ | Evaluate | | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

50.Select UOM

SSNo : PSS-LIMS-SS-050

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sale ▼ | | | Sale ▼ | Evaluate | | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

51.Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-051

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sale ▼ | | | Sale ▼ | Evaluate | | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

52.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-052

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.


| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Sele ▼ | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sale ▼ | | | Sale ▼ | Evaluate | | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

53.Select UOM

SSNo : PSS-LIMS-SS-053

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  


. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sales | | | Sales | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

54.Click on Start Date

SSNo : PSS-LIMS-SS-054

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | | |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | | |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | | |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sales | | | Sales | Evaluate | | Select |


 01-09-2022  September 2022

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |


55.Click on Select

SSNo : PSS-LIMS-SS-055

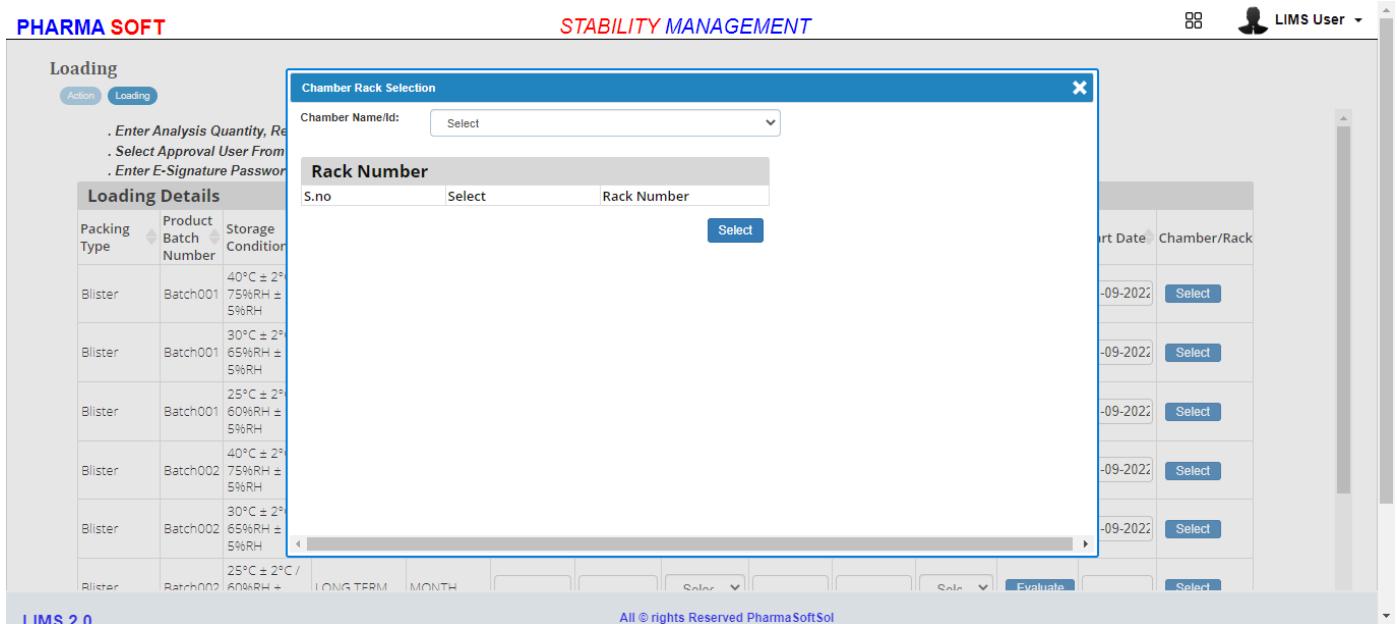

56.Select Chamber


SSNo : PSS-LIMS-SS-056

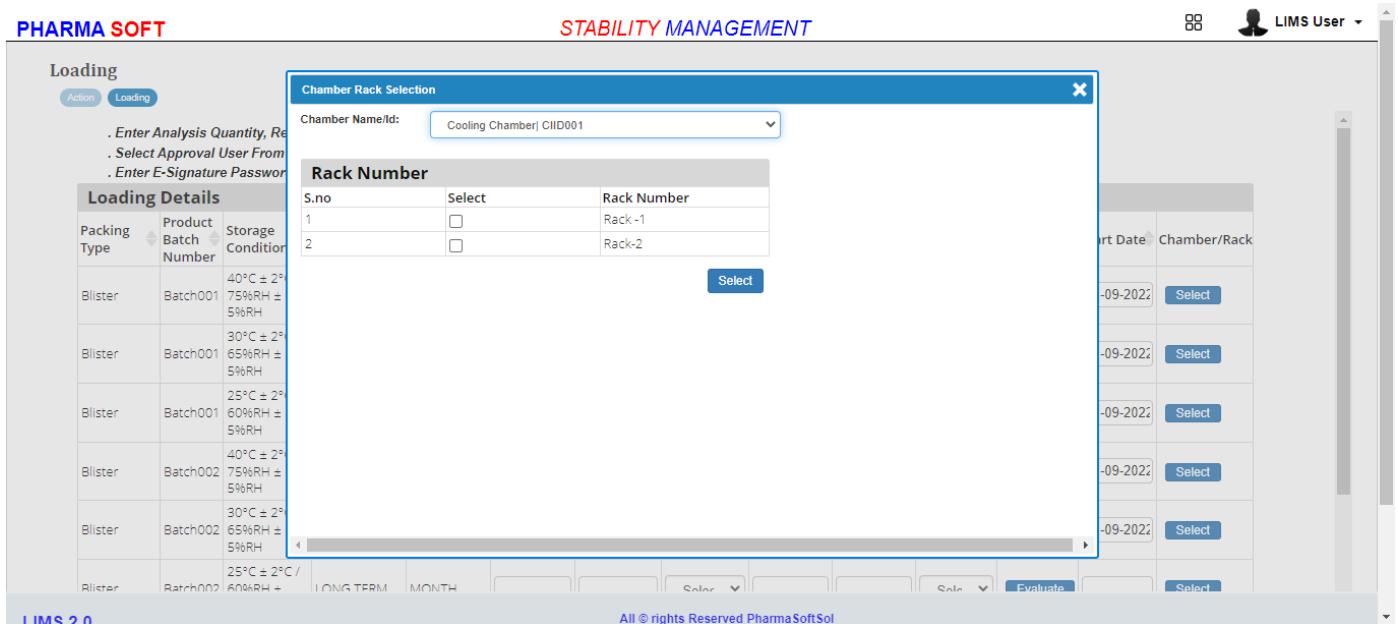

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

57. Select Check Box


SSNo : PSS-LIMS-SS-057

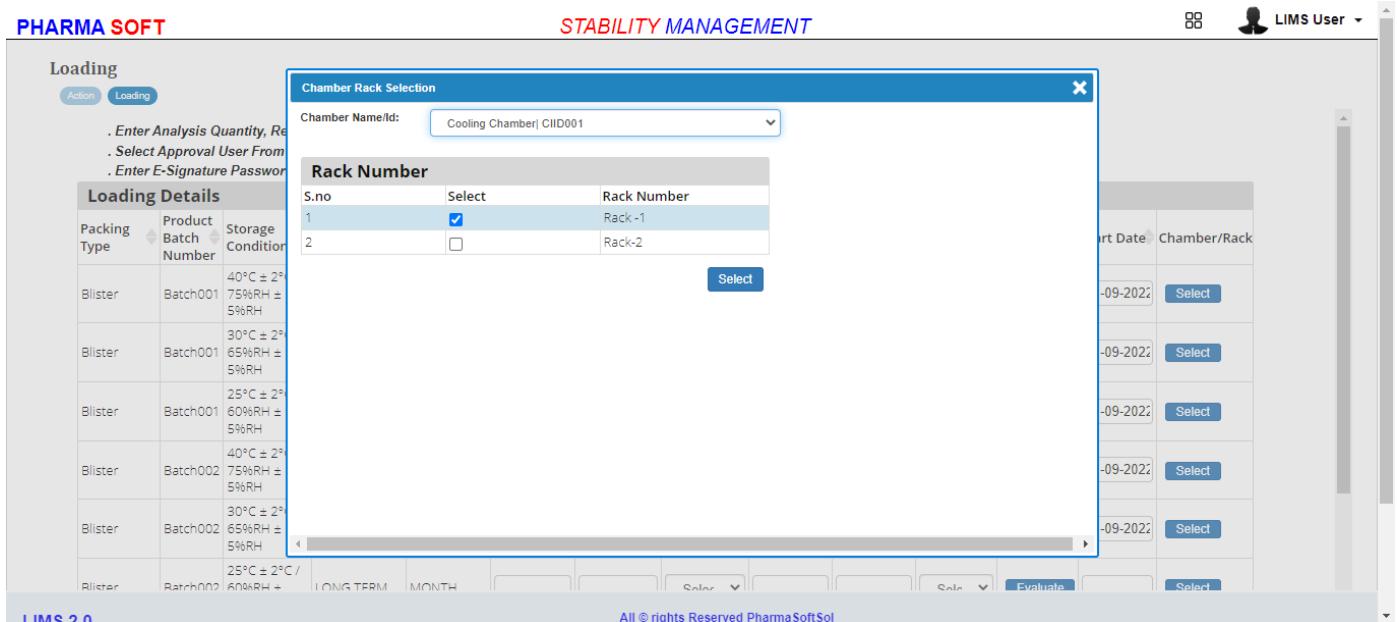

The screenshot shows the 'Stability Management' module. A 'Chamber Rack Selection' dialog box is open, prompting for a 'Chamber Name/Id' (Cooling Chamber CID001). Inside the dialog, there's a table titled 'Rack Number' with two rows: S.no 1 (Select checked, Rack Number Rack-1) and S.no 2 (Select unchecked, Rack Number Rack-2). A 'Select' button is at the bottom right of the dialog. The background shows a grid of stability test results with columns for Start Date, Chamber/Rack, and various status buttons like 'Select'.

58. Click on Select

SSNo : PSS-LIMS-SS-058

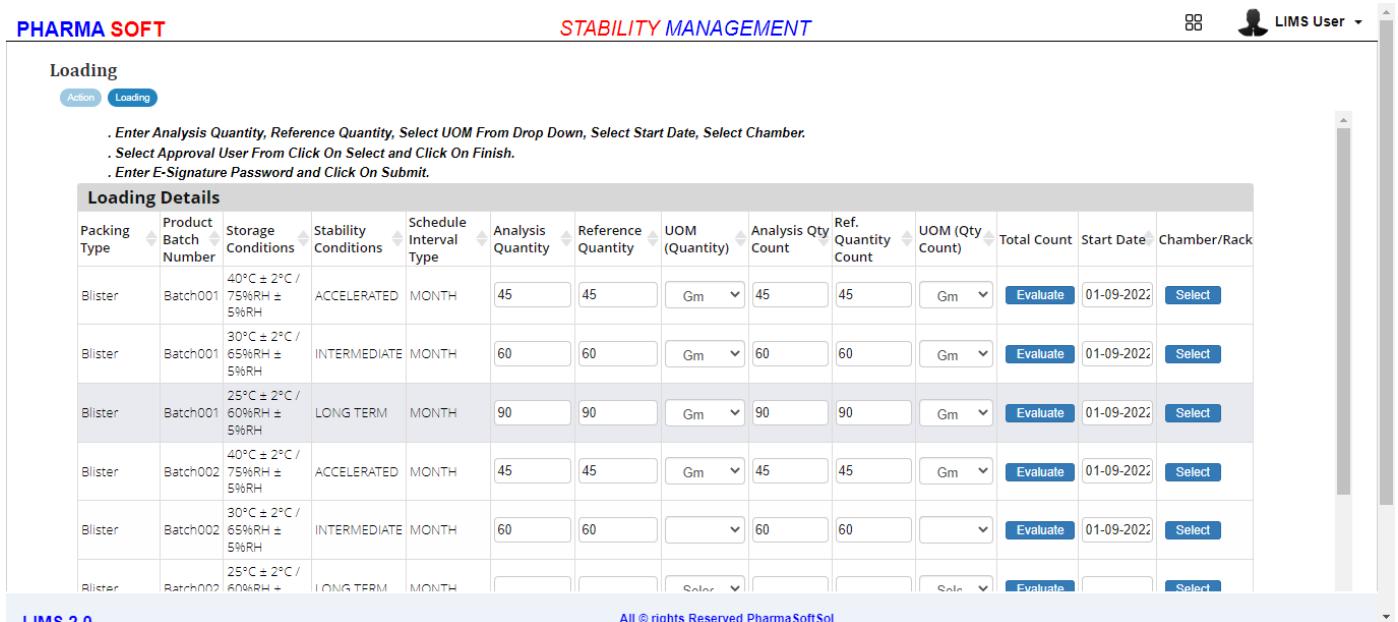

The screenshot shows the 'Stability Management' module with a focus on the 'Loading Details' table. The table has columns for Product Batch Number, Storage Conditions, Stability Conditions, Schedule Interval Type, Analysis Quantity, Reference Quantity, UOM (Quantity), Analysis Qty Count, Ref. Quantity Count, UOM (Qty Count), Total Count, Start Date, and Chamber/Rack. The first row (Batch001) has its 'Select' button highlighted in blue. The background shows a grid of stability test results with columns for Start Date, Chamber/Rack, and various status buttons like 'Evaluate' and 'Select'.

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

59.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-059

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Sales ▼ | | | Sales ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

60.Enter Reference Quantity

SSNo : PSS-LIMS-SS-060

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Sales ▼ | | | Sales ▼ | Evaluate | | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

61.Select UOM

SSNo : PSS-LIMS-SS-061

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

62.Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-062

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.


| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

63.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-063

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  


. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

64.Select UOM

SSNo : PSS-LIMS-SS-064

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.


| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL COMMITTED TO PAPERLESS COMPLIANCE | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

65.Click on Start Date

SSNo : PSS-LIMS-SS-065

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  


. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
|--------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

66.Click on Select

SSNo : PSS-LIMS-SS-066

PHARMA SOFT **STABILITY MANAGEMENT** 

Loading  

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
|--------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |

Chamber Rack Selection

Chamber Name/Id:


| S.no | Select | Rack Number |
|------|---------------------------------------|-------------|
| 1 | <input type="button" value="Select"/> | |

IIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

67.Select Chamber


SSNo : PSS-LIMS-SS-067

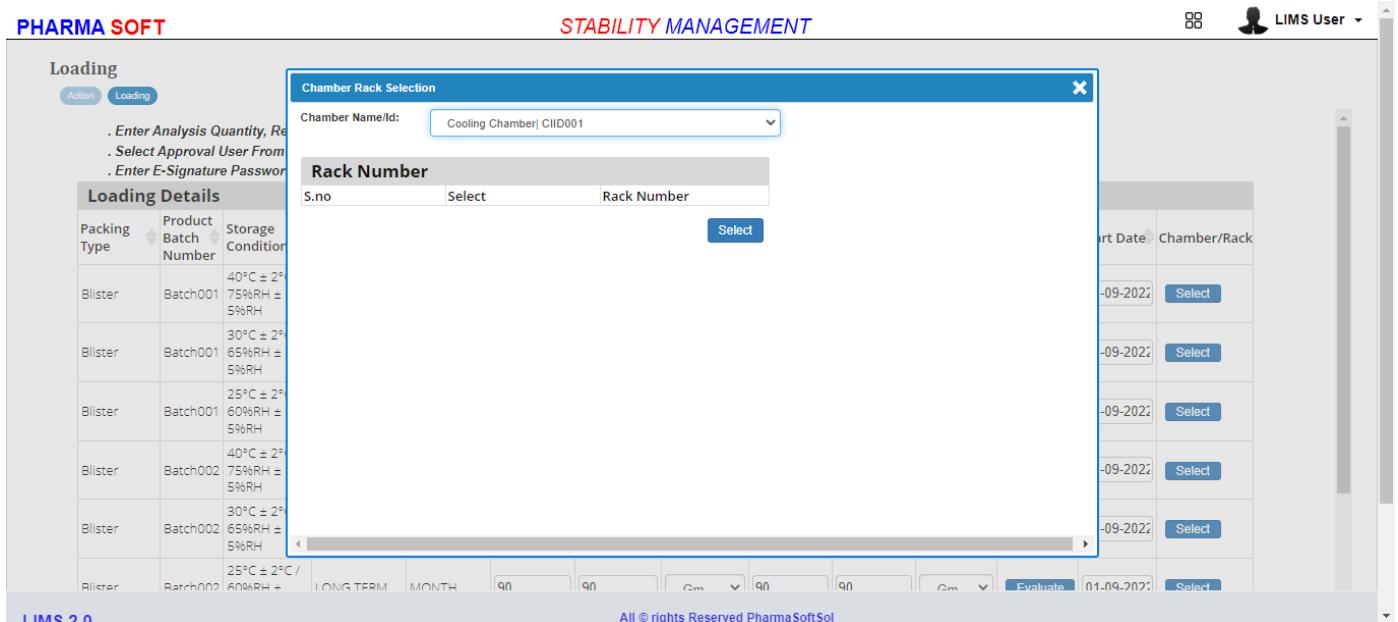

| S.no | Select | Rack Number |
|------|-------------------------------------|-------------|
| 1 | <input checked="" type="checkbox"/> | Rack -1 |
| 2 | <input type="checkbox"/> | Rack-2 |

68.Select Check Box

SSNo : PSS-LIMS-SS-068

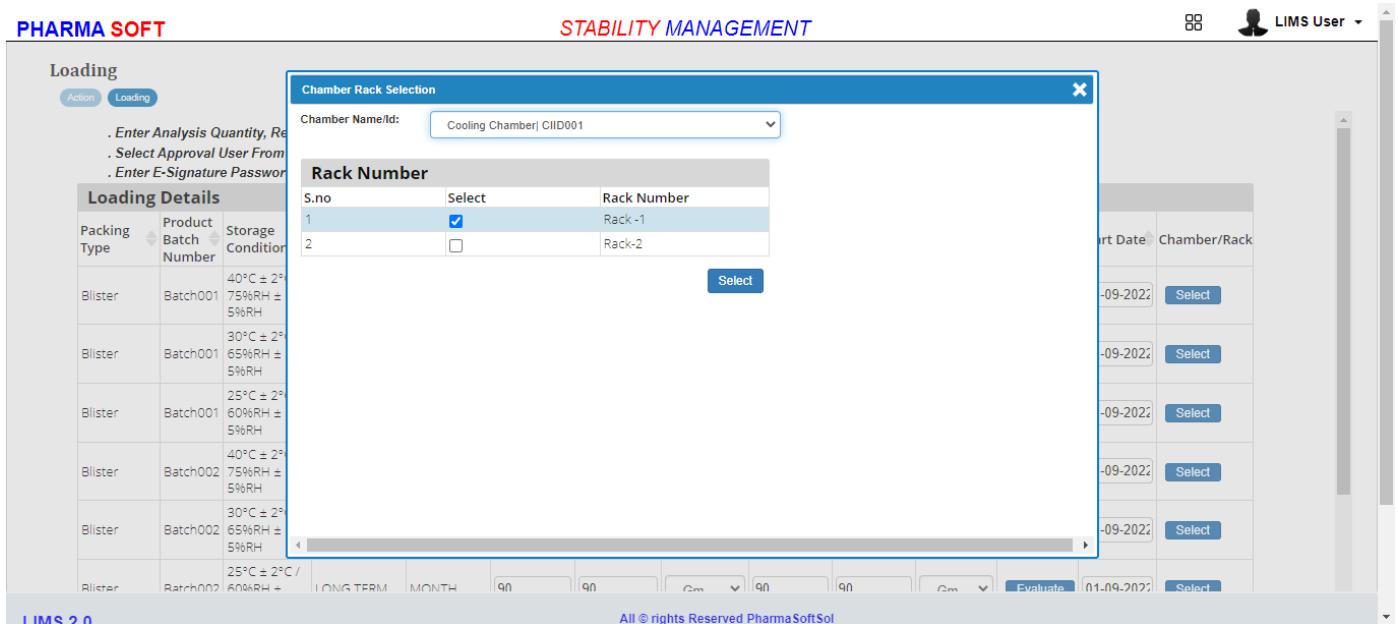

| S.no | Select | Rack Number |
|------|-------------------------------------|-------------|
| 1 | <input checked="" type="checkbox"/> | Rack -1 |
| 2 | <input type="checkbox"/> | Rack-2 |

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

69.Click on Select

SSNo : PSS-LIMS-SS-069

PHARMA SOFT STABILITY MANAGEMENT LIMS User ▾

Loading Action Loading

. Enter Analysis Quantity, Reference Quantity, Select UOM From Drop Down, Select Start Date, Select Chamber.
 . Select Approval User From Click On Select and Click On Finish.
 . Enter E-Signature Password and Click On Submit.

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | ▼ | 90 | 90 | ▼ | Evaluate | 01-09-2022 | Select |

IIMS 2.0 All © rights Reserved PharmaSoftSol

70.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-070

PHARMA SOFT STABILITY MANAGEMENT LIMS User ▾

Loading Details

| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
|--------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | Selec ▼ | ▼ | Selec ▼ | Selec ▼ | Selec ▼ | Evaluate | ▼ | Select |

Previous Finish

IIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

71.Enter Reference Quantity

SSNo : PSS-LIMS-SS-071

PHARMA SOFT **STABILITY MANAGEMENT**

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Sele | | | Sele | Evaluate | | Select |

Previous Finish

LIMS 2.0

All © rights Reserved PharmaSoftSol

72.Select UOM

SSNo : PSS-LIMS-SS-072

PHARMA SOFT **STABILITY MANAGEMENT**

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | | | Sele | Evaluate | | Select |

Previous Finish

LIMS 2.0

All © rights Reserved PharmaSoftSol

| | | |
|---|-------------------------|----------------|
|  COMMITTED TO PAPERLESS COMPLIANCE | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

73.Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-073

PHARMA SOFT STABILITY MANAGEMENT LIMS User

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |

Previous Finish

LIMS 2.0

All © rights Reserved PharmaSoftSol

74.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-074

PHARMA SOFT STABILITY MANAGEMENT LIMS User

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |

Previous Finish

LIMS 2.0

All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

75. Select UOM

SSNo : PSS-LIMS-SS-075

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |

Previous  Finish 

LIMS 2.0

All © rights Reserved PharmaSoftSol

76. Click on Start Date

SSNo : PSS-LIMS-SS-076

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

| Loading Details | | | | | | | | | | | | | |
|-----------------|----------------------|---------------------------|----------------------|------------------------|-------------------|--------------------|----------------|--------------------|---------------------|-----------------|-------------|------------|--------------|
| Packing Type | Product Batch Number | Storage Conditions | Stability Conditions | Schedule Interval Type | Analysis Quantity | Reference Quantity | UOM (Quantity) | Analysis Qty Count | Ref. Quantity Count | UOM (Qty Count) | Total Count | Start Date | Chamber/Rack |
| Blister | Batch001 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch001 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |

Select

01-09-2022
September 2022

| | | | | | | |
|----|----|----|----|----|----|----|
| Su | Mo | Tu | We | Th | Fr | Sa |
| 01 | 02 | 03 | 04 | 05 | 06 | 07 |
| 08 | 09 | 10 | 11 | 12 | 13 | 14 |
| 15 | 16 | 17 | 18 | 19 | 20 | 21 |
| 22 | 23 | 24 | 25 | 26 | 27 | 28 |
| 29 | 30 | | | | | |

Previous  Finish 


LIMS 2.0

All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

77.Click on Select


SSNo : PSS-LIMS-SS-077

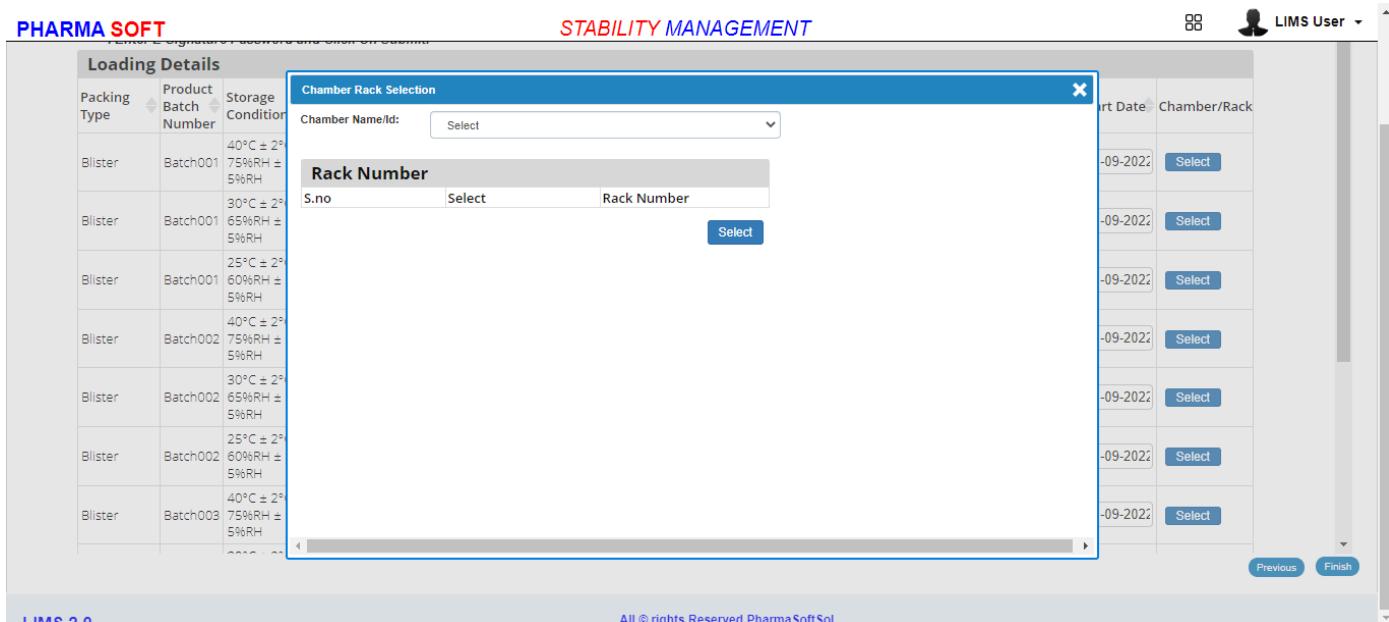

The screenshot shows the 'STABILITY MANAGEMENT' module. A 'Chamber Rack Selection' dialog box is open, prompting for a chamber name/id (set to 'Select') and a rack number. The main area displays 'Loading Details' for multiple batches across different storage conditions. To the right, a list of entries with start dates and chamber/rack assignments is provided, each with a 'Select' button.

78.Select Chamber

SSNo : PSS-LIMS-SS-078

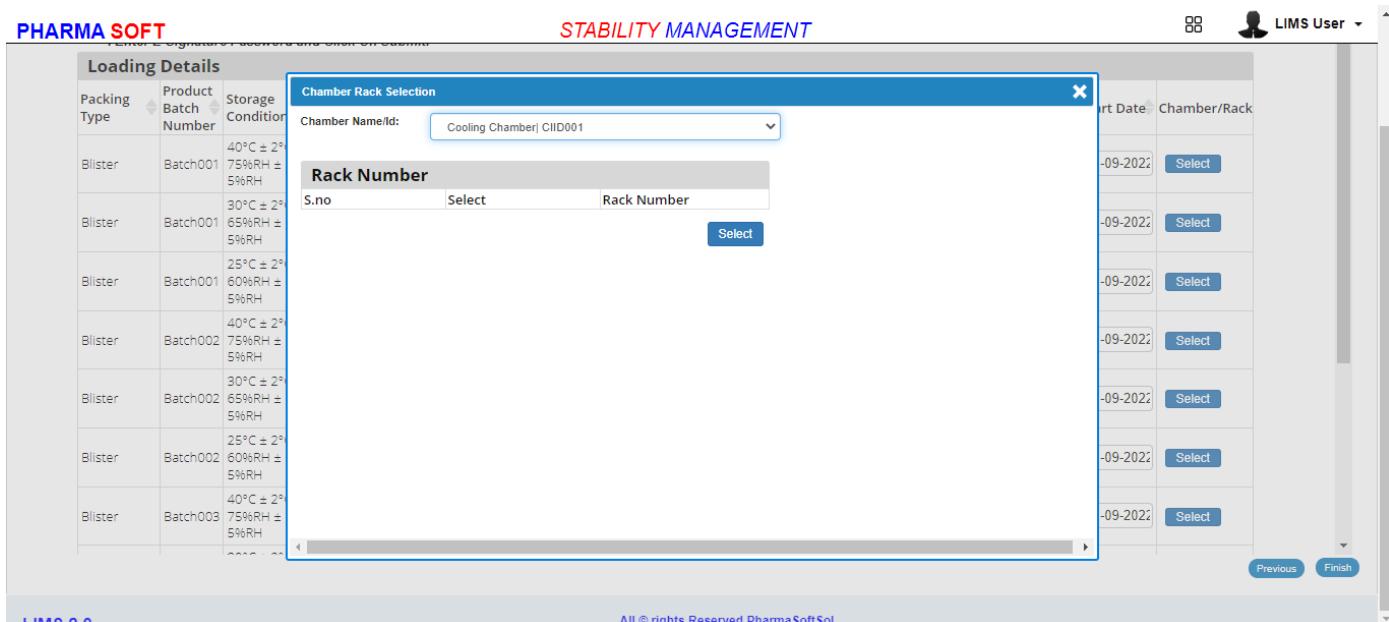


This screenshot is nearly identical to the previous one, showing the 'Chamber Rack Selection' dialog with 'Cooling Chamber CIID001' selected. The main area and the list on the right remain the same, indicating the selection of a specific chamber for the stability test.

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

79. Select Check Box


SSNo : PSS-LIMS-SS-079

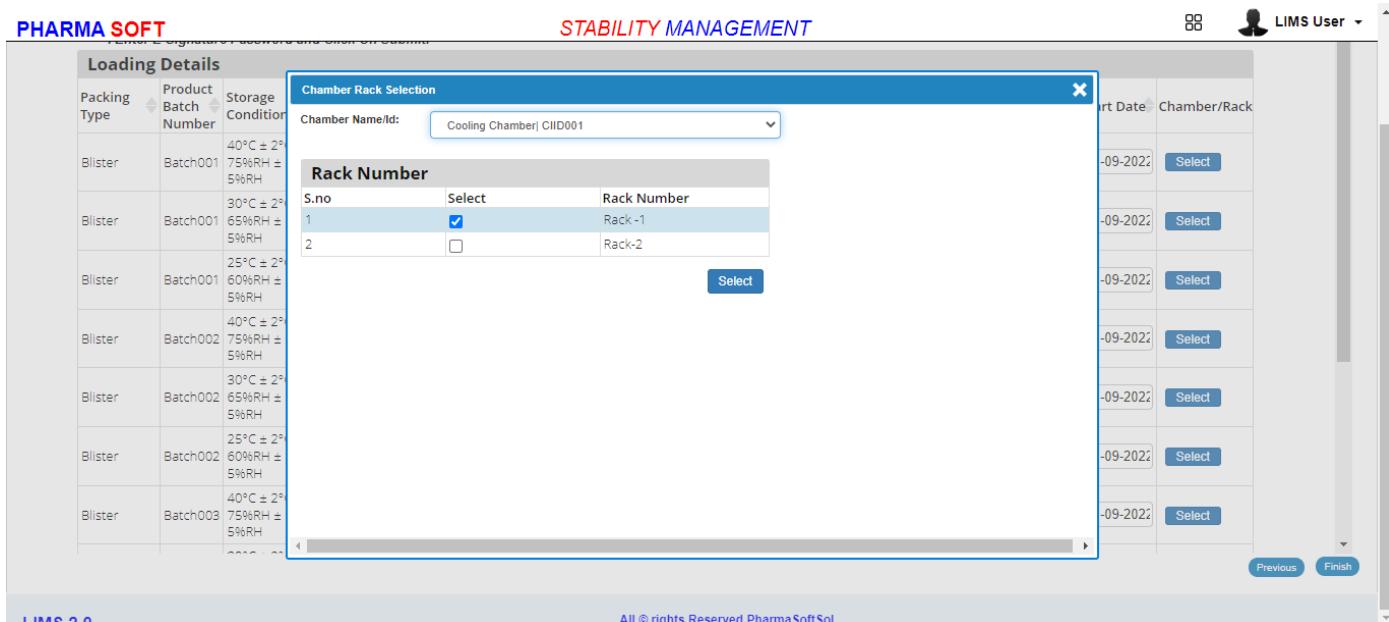

The screenshot shows the 'Stability MANAGEMENT' module. On the left, there's a table titled 'Loading Details' listing various batches with their storage conditions. A specific row for 'Batch001' is highlighted. A modal window titled 'Chamber Rack Selection' is open over the main table. Inside this modal, another smaller table titled 'Rack Number' lists two options: 'Rack -1' and 'Rack -2'. The checkbox next to 'Rack -1' is checked, indicating it has been selected. A 'Select' button is located at the bottom right of this inner table.

80. Click on Select

SSNo : PSS-LIMS-SS-080

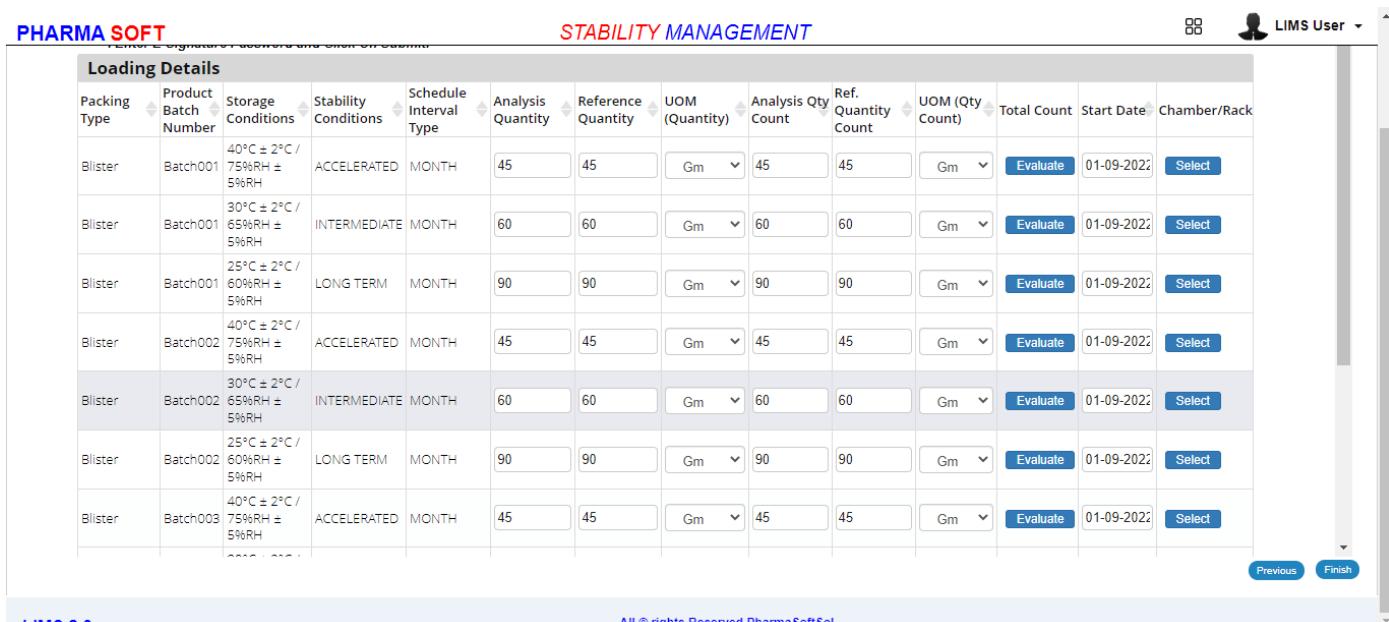

The screenshot shows the 'Stability MANAGEMENT' module with a larger table titled 'Loading Details'. This table contains many rows of data for different batches. Each row includes fields for packing type, product batch number, storage conditions, stability conditions, schedule interval type, analysis quantity, reference quantity, UOM, analysis quantity count, ref. quantity count, UOM quantity count, total count, start date, and chamber/rack. At the end of each row is a blue 'Evaluate' button and a blue 'Select' button. The rows represent different experimental runs or stability studies for the same product batch.

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

81.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-081

PHARMA SOFT **STABILITY MANAGEMENT** LIMS User ▾

| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
|---------|----------|---------------------------|--------------|-------|----|----|---------|----|----|--------|----------|------------|--------|
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |

Approval From*: Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

82.Enter Reference Quantity

SSNo : PSS-LIMS-SS-082

PHARMA SOFT **STABILITY MANAGEMENT** LIMS User ▾

| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
|---------|----------|---------------------------|--------------|-------|----|----|---------|----|----|--------|----------|------------|--------|
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Selec ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec ▼ | | | Sele ▼ | Evaluate | | Select |

Approval From*: Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|---|-------------------------|----------------|
|  COMMITTED TO PAPERLESS COMPLIANCE | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

83.Select UOM

SSNo : PSS-LIMS-SS-083

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

| | | | | | | | | | | | | |
|---------|--|--------------|-------|----|----|--------|----|----|--------|----------|------------|--------|
| Blister | Batch002 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | | | Sele ▼ | Evaluate | | Select |
| Blister | Batch003 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

Approval From*:

[Previous](#) [Finish](#)

LIMS 2.0 All © rights Reserved PharmaSoftSol

84.Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-084

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

| | | | | | | | | | | | | |
|---------|--|--------------|-------|----|----|--------|----|----|--------|----------|------------|--------|
| Blister | Batch002 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Sele ▼ | Evaluate | | Select |
| Blister | Batch003 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

Approval From*:

[Previous](#) [Finish](#)

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

85.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-085

PHARMA SOFT
STABILITY MANAGEMENT
LIMS User

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|--------------|-------|----|----|------|----|----|------|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Sele | Evaluate | | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele | | | Sele | Evaluate | | Select |

Approval From*: Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

86.Select UOM

SSNo : PSS-LIMS-SS-086

PHARMA SOFT
STABILITY MANAGEMENT
LIMS User

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|--------------|-------|----|----|------|----|----|------|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele | | | Sele | Evaluate | | Select |

Approval From*: Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

87.Click on Start Date

SSNo : PSS-LIMS-SS-087

PHARMA SOFT STABILITY MANAGEMENT

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|--------------|-------|----|----|-------|----|----|------|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Sele | Evaluate | | |

Approval From*:

September 2022
Su Mo Tu We Th Fr Sa
1 2 3
4 5 6 7 8 9 10
11 12 13 14 15 16 17
18 19 20 21 22 23 24
25 26 27 28 29 30

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

88.Click on Select

SSNo : PSS-LIMS-SS-088

PHARMA SOFT STABILITY MANAGEMENT

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|--------------|-------|----|----|-------|----|----|------|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Selec | | | Sele | Evaluate | | |

Approval From:

Chamber Rack Selection

Chamber Name/Id:

Rack Number

| S.no | Select | Rack Number | Select |
|------|--------|-------------|--------|
| | | | |

09-2022 Select
09-2022 Select
09-2022 Select
09-2022 Select
09-2022 Select
09-2022 Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

89. Select Chamber

SSNo : PSS-LIMS-SS-089

PHARMA SOFT STABILITY MANAGEMENT

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|-------------|-------|----|----|----|----|----|----|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2° / 65%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch002 | 25°C ± 2° / 60%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 40°C ± 2° / 75%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 30°C ± 2° / 65%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 25°C ± 2° / 60%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |

Chamber Rack Selection

Chamber Name/Id: Cooling Chamber| CII001

Rack Number

| S.no | Select | Rack Number |
|------|-------------------------------------|-------------|
| 1 | <input checked="" type="checkbox"/> | Rack -1 |
| 2 | <input type="checkbox"/> | Rack-2 |

Approval From

IMS 2.0 All © rights Reserved PharmaSoftSol

90. Select Check Box

SSNo : PSS-LIMS-SS-090

PHARMA SOFT STABILITY MANAGEMENT

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|-------------|-------|----|----|----|----|----|----|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2° / 65%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch002 | 25°C ± 2° / 60%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 40°C ± 2° / 75%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 30°C ± 2° / 65%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 25°C ± 2° / 60%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |

Chamber Rack Selection

Chamber Name/Id: Cooling Chamber| CII001

Rack Number

| S.no | Select | Rack Number |
|------|-------------------------------------|-------------|
| 1 | <input checked="" type="checkbox"/> | Rack -1 |
| 2 | <input type="checkbox"/> | Rack-2 |

Approval From

IMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|---|-------------------------|----------------|
|  COMMITTED TO PAPERLESS COMPLIANCE | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

91.Click on Select

SSNo : PSS-LIMS-SS-091

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

| | | | | | | | | | | | | |
|---------|---------------------------------------|--------------|-------|----|----|--------|----|----|--------|----------|------------|--------|
| Blister | Batch002 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

Approval From*: **Select**

Previous **Finish**

LIMS 2.0 All © rights Reserved PharmaSoftSol

92.Enter Analysis Quantity

SSNo : PSS-LIMS-SS-092

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

| | | | | | | | | | | | | |
|---------|---------------------------------------|--------------|-------|----|--------|--------|----|----|--------|----------|------------|--------|
| Blister | Batch002 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | Sele ▼ | Sele ▼ | | | Sele ▼ | Evaluate | | Select |

Approval From*: **Select**

Previous **Finish**

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|---|-------------------------|----------------|
|  COMMITTED TO PAPERLESS COMPLIANCE | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

93.Enter Reference Quantity

SSNo : PSS-LIMS-SS-093

PHARMA SOFT
STABILITY MANAGEMENT
LIMS User

| | | | | | | | | | | | | |
|---------|--|--------------|-------|----|----|-------|----|----|------|----------|------------|--------|
| Blister | Batch002 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Selec | | | Sele | Evaluate | | Select |

Approval From*: Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

94.Select UOM

SSNo : PSS-LIMS-SS-094

PHARMA SOFT
STABILITY MANAGEMENT
LIMS User

| | | | | | | | | | | | | |
|---------|--|--------------|-------|----|----|----|----|----|------|----------|------------|--------|
| Blister | Batch002 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | | | Sele | Evaluate | | Select |

Approval From*: Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|---|-------------------------|----------------|
|  COMMITTED TO PAPERLESS COMPLIANCE | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

95.Enter Analysis Quantity Count

SSNo : PSS-LIMS-SS-095

PHARMA SOFT
STABILITY MANAGEMENT
LIMS User

| | | | | | | | | | | | | |
|---------|--|--------------|-------|----|----|----|----|----|------|----------|------------|--------|
| Blister | Batch002 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Sele | Evaluate | | Select |

Approval From*: Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

96.Enter Reference Quantity Count

SSNo : PSS-LIMS-SS-096

PHARMA SOFT
STABILITY MANAGEMENT
LIMS User

| | | | | | | | | | | | | |
|---------|--|--------------|-------|----|----|----|----|----|------|----------|------------|--------|
| Blister | Batch002 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $40^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $30^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 $25^{\circ}\text{C} \pm 2^{\circ}\text{C}$ / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Sele | Evaluate | | Select |

Approval From*: Select

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

97.Select UOM

SSNo : PSS-LIMS-SS-097

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
|---------|----------|---------------------------|--------------|-------|----|----|------|----|----|------|----------|------------|--------|
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | | Select |

Approval From*:

[Previous](#) [Finish](#)

LIMS 2.0 All © rights Reserved PharmaSoftSol

98.Click on Start Date

SSNo : PSS-LIMS-SS-098

PHARMA SOFT **STABILITY MANAGEMENT**  LIMS User ▾

| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
|---------|----------|---------------------------|--------------|-------|----|----|------|----|----|------|----------|------------|--------|
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm ▼ | 45 | 45 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm ▼ | 60 | 60 | Gm ▼ | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm ▼ | 90 | 90 | Gm ▼ | Evaluate | 01-09-2022 | Select |

Approval From*:

September 2022 [Previous](#) [Finish](#)


Su Mo Tu We Th Fr Sa
 1 2 3
 4 5 6 7 8 9 10
 11 12 13 14 15 16 17
 18 19 20 21 22 23 24
 25 26 27 28 29 30

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

99.Click on Select

SSNo : PSS-LIMS-SS-099

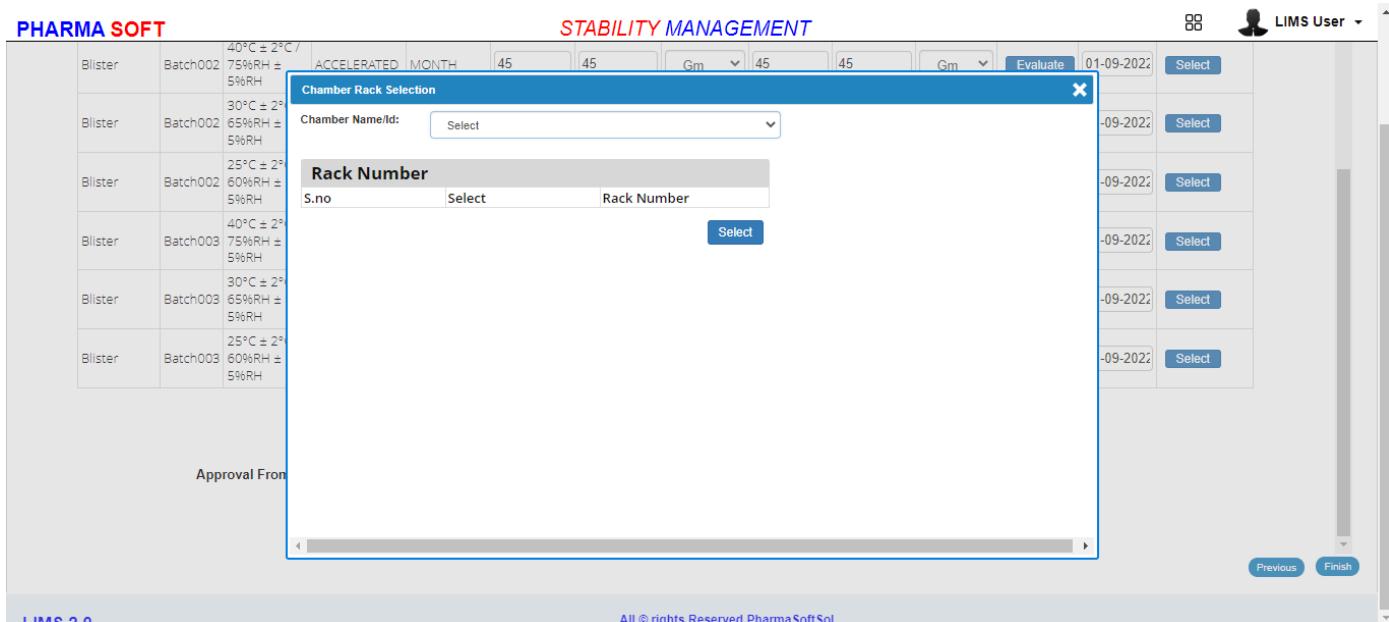

PHARMA SOFT STABILITY MANAGEMENT

Blister Batch002 40°C ± 2°C / 75%RH ± 5%RH ACCELERATED MONTH 45 45 Gm Evaluate 01-09-2022 Select

Blister Batch002 30°C ± 2°C / 65%RH ± 5%RH

Blister Batch002 25°C ± 2°C / 60%RH ± 5%RH

Blister Batch003 40°C ± 2°C / 75%RH ± 5%RH

Blister Batch003 30°C ± 2°C / 65%RH ± 5%RH

Blister Batch003 25°C ± 2°C / 60%RH ± 5%RH

Approval From:

Chamber Rack Selection

Chamber Name/Id: Select

Rack Number

| S.no | Select | Rack Number |
|------|--------|-------------|
|------|--------|-------------|


Select

Previous Finish

All © rights Reserved PharmaSoftSol

100.Select Chamber

SSNo : PSS-LIMS-SS-100

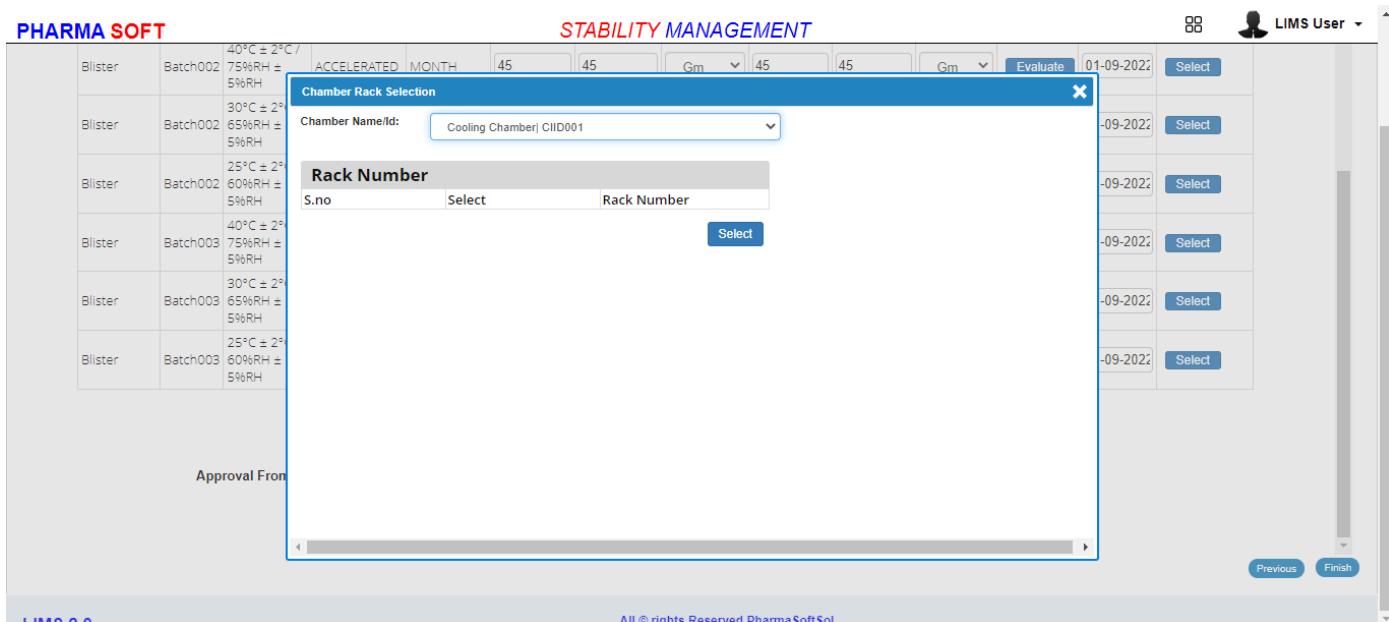

PHARMA SOFT STABILITY MANAGEMENT

Blister Batch002 40°C ± 2°C / 75%RH ± 5%RH ACCELERATED MONTH 45 45 Gm Evaluate 01-09-2022 Select

Blister Batch002 30°C ± 2°C / 65%RH ± 5%RH

Blister Batch002 25°C ± 2°C / 60%RH ± 5%RH

Blister Batch003 40°C ± 2°C / 75%RH ± 5%RH

Blister Batch003 30°C ± 2°C / 65%RH ± 5%RH

Blister Batch003 25°C ± 2°C / 60%RH ± 5%RH

Approval From:

Chamber Rack Selection

Chamber Name/Id: Cooling Chamber CIID001

Rack Number

| S.no | Select | Rack Number |
|------|--------|-------------|
|------|--------|-------------|

Select

Previous Finish

All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

101.Select Check Box

SSNo : PSS-LIMS-SS-101

PHARMA SOFT **STABILITY MANAGEMENT** LIMS User

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|-------------|-------|----|----|----|----|----|----|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | | | | | | | | | | -09-2022 | Select |

Chamber Rack Selection

Chamber Name/Id: Cooling Chamber C10001

Rack Number

| S.no | Select | Rack Number |
|------|-------------------------------------|-------------|
| 1 | <input checked="" type="checkbox"/> | Rack -1 |
| 2 | <input type="checkbox"/> | Rack-2 |

Approval From: Select

Previous Finish

All © rights Reserved PharmaSoftSol

102.Click on Select

SSNo : PSS-LIMS-SS-102

PHARMA SOFT **STABILITY MANAGEMENT** LIMS User

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|--------------|-------|----|----|----|----|----|----|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | | 90 | 90 | | Evaluate | 01-09-2022 | Select |

Approval From*: Select


Previous Finish

All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

103.Click on Select


SSNo : PSS-LIMS-SS-103

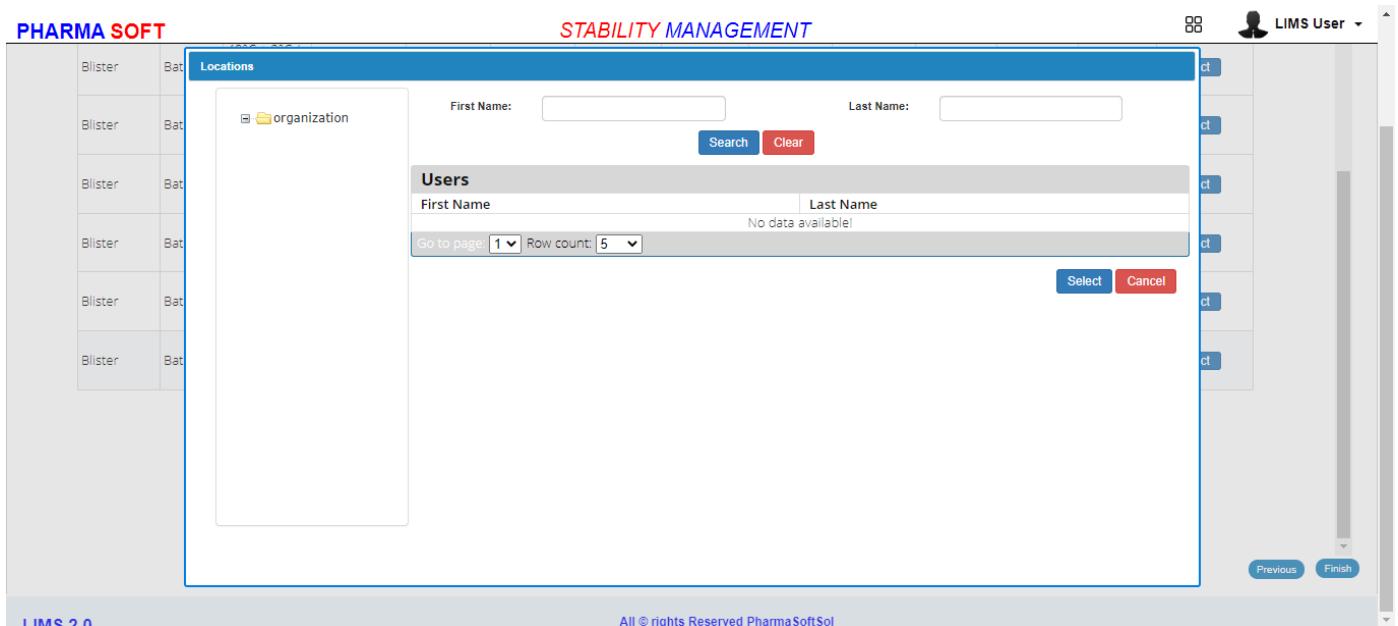

The screenshot shows the 'STABILITY MANAGEMENT' application. A modal dialog box titled 'Locations' is open. On the left, there's a tree view showing a hierarchy under 'organization': 'Plant-1' is expanded, revealing 'QA', 'QC', and 'EN'. To the right of the tree view are search fields for 'First Name' and 'Last Name', and buttons for 'Search' and 'Clear'. Below the search area is a table header for 'Users' with columns for 'First Name' and 'Last Name'. A message 'No data available!' is displayed. At the bottom of the dialog are buttons for 'Select' and 'Cancel'. The background of the main application window shows a grid of 'Blister' and 'Batch' entries.

104.Click on Location

SSNo : PSS-LIMS-SS-104

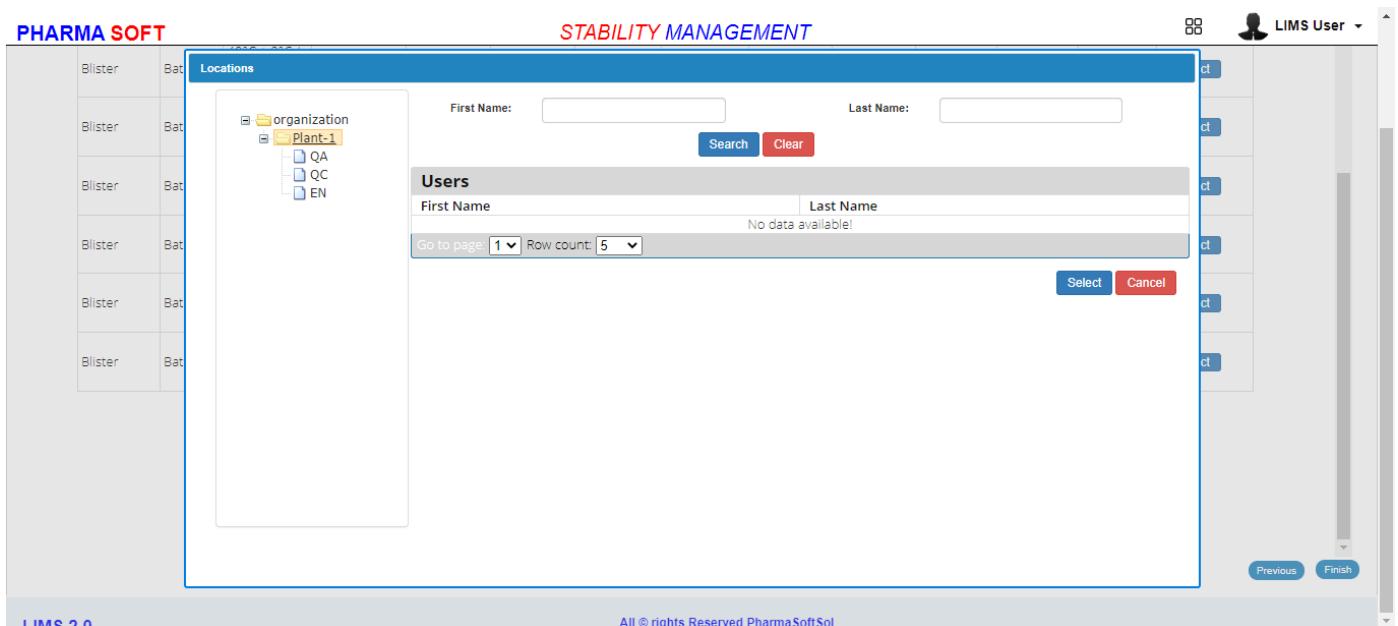


This screenshot is nearly identical to the previous one, showing the 'STABILITY MANAGEMENT' application with the 'Locations' search dialog open. The tree view on the left shows the 'organization' folder expanded, with 'Plant-1' containing 'QA', 'QC', and 'EN'. The search fields and user table are the same, with the message 'No data available!' still present. The background grid of 'Blister' and 'Batch' entries is visible.

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

105.Select a Record

SSNo : PSS-LIMS-SS-105

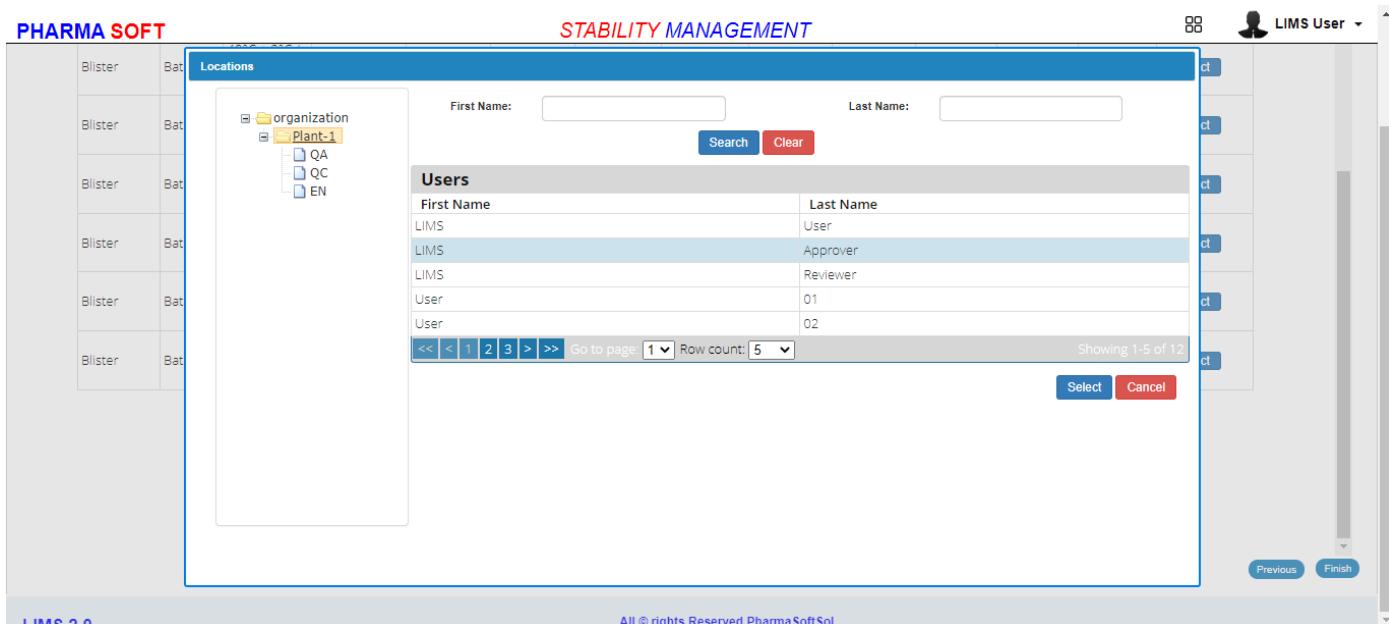

The screenshot shows a 'Locations' tree on the left with 'organization' expanded, showing 'Plant-1' which further expands into 'QA', 'QC', and 'EN'. On the right, there is a 'Users' search interface with fields for 'First Name' and 'Last Name', a 'Search' button, and a 'Clear' button. Below these are two tables of users:

| First Name | Last Name |
|------------|-----------|
| LIMS | User |
| LIMS | Approver |
| LIMS | Reviewer |
| User | 01 |
| User | 02 |


Below the tables are navigation buttons: '<<', '<|', '|>', '>>', 'Go to page [1]', 'Row count: 5', and 'Showing 1-5 of 12'. At the bottom right of the dialog are 'Select' and 'Cancel' buttons.

LIMS 2.0

All © rights Reserved PharmaSoftSol

106.Click on Select

SSNo : PSS-LIMS-SS-106

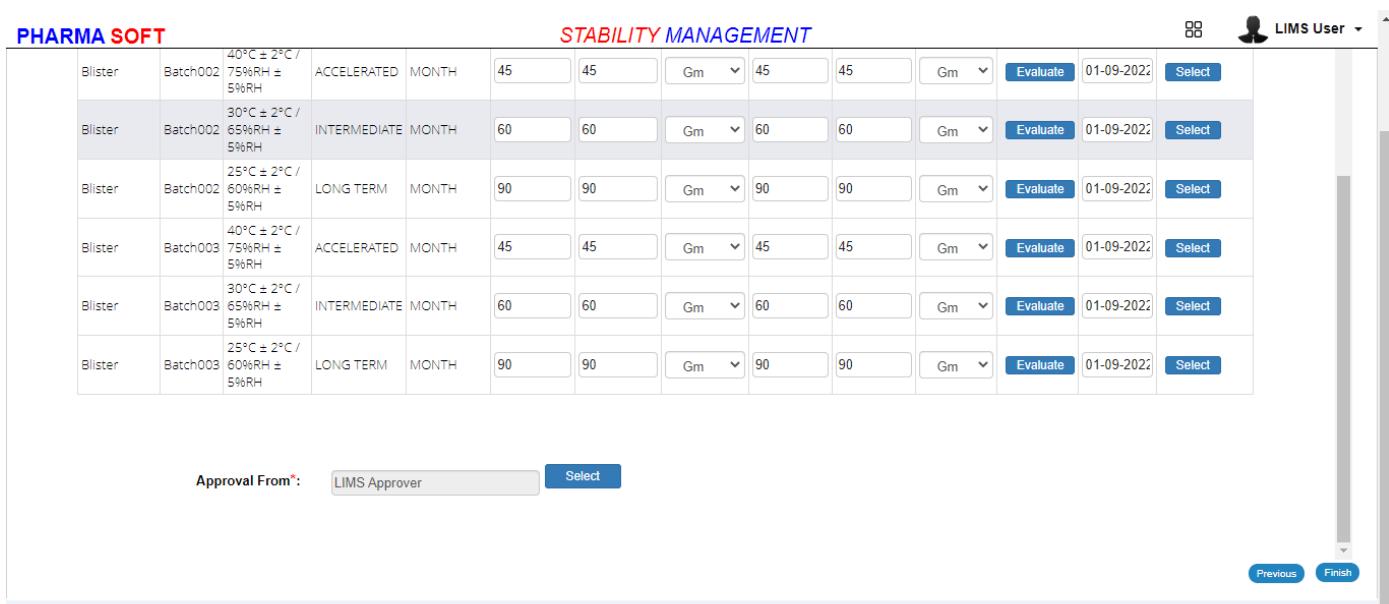

The screenshot displays a table of stability test records. Each row contains details such as Blister type, Batch number, Temperature/RH conditions, Acceleration level, Duration, and various data points (e.g., 45, Gm, Evaluate, 01-09-2022). To the right of each row is a 'Select' button.

| Blister | Batch | Condition | Acceleration | Duration | Value 1 | Value 2 | Unit | Value 4 | Value 5 | Value 6 | Value 7 | Evaluate | Date | Select |
|---------|----------|---------------------------|--------------|----------|---------|---------|------|---------|---------|---------|----------|------------|--------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select | |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select | |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select | |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select | |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select | |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select | |

At the bottom left is an 'Approval From*' field containing 'LIMS Approver' with a 'Select' button next to it. At the bottom right are 'Previous' and 'Finish' buttons.

LIMS 2.0

All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

107.Click on Finish

SSNo : PSS-LIMS-SS-107

PHARMA SOFT **STABILITY MANAGEMENT** LIMS User ▾

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|--------------|-------|----|----|----|----|----|----|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | | | | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | | | | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | | | | Gm | Evaluate | 01-09-2022 | Select |

Validate E-Signature

E-Signature Password*:

Submit **Cancel**

Approval From*: **Select**

Previous **Finish**

LIMS 2.0 All © rights Reserved PharmaSoftSol

108.Enter E-Signature Password

SSNo : PSS-LIMS-SS-108

PHARMA SOFT **STABILITY MANAGEMENT** LIMS User ▾

| | | | | | | | | | | | | | |
|---------|----------|---------------------------|--------------|-------|----|----|----|----|----|----|----------|------------|--------|
| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | | | | | | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | | | | | | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | | | | | | Gm | Evaluate | 01-09-2022 | Select |

Validate E-Signature

E-Signature Password*:

Submit **Cancel**

Approval From*: **Select**

Previous **Finish**

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  PHARMA SOFT SOL <small>COMMITTED TO PAPERLESS COMPLIANCE</small> | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

109.Click on Submit

SSNo : PSS-LIMS-SS-109

PHARMA SOFT **STABILITY MANAGEMENT** LIMS User ▾

| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
|---------|----------|---------------------------|--------------|-------|----|----|----|----|----|----|----------|------------|--------|
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |

Approval From*:

Saving...

LIMS 2.0 All © rights Reserved PharmaSoftSol

110.Click on OK button

SSNo : PSS-LIMS-SS-110

PHARMA SOFT **STABILITY MANAGEMENT** LIMS User ▾

| Blister | Batch002 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | 45 | Gm | 45 | 45 | Gm | Evaluate | 01-09-2022 | Select |
|---------|----------|---------------------------|--------------|-------|----|----|----|----|----|----|----------|------------|--------|
| Blister | Batch002 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | 60 | Gm | 60 | 60 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch002 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | 90 | Gm | 90 | 90 | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 40°C ± 2°C / 75%RH ± 5%RH | ACCELERATED | MONTH | 45 | | Gm | | | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 30°C ± 2°C / 65%RH ± 5%RH | INTERMEDIATE | MONTH | 60 | | Gm | | | Gm | Evaluate | 01-09-2022 | Select |
| Blister | Batch003 | 25°C ± 2°C / 60%RH ± 5%RH | LONG TERM | MONTH | 90 | | Gm | | | Gm | Evaluate | 01-09-2022 | Select |

Success
Submitted successfully.


Approval From*:

LIMS 2.0 All © rights Reserved PharmaSoftSol

| | | |
|--|-------------------------|----------------|
|  | Test Case Name | Create Loading |
| | Test Case Number | LIMS-SM-011 |
| | Actual Result | Pass |

111.Click on User Name

SSNo : PSS-LIMS-SS-111

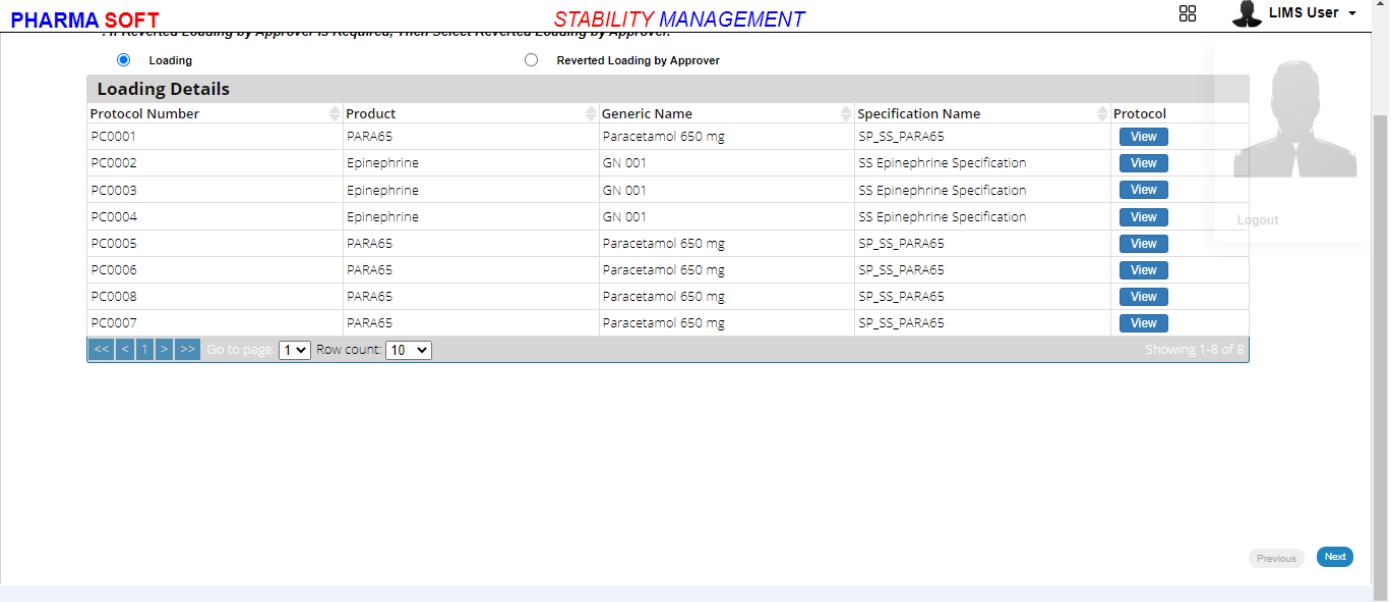


The screenshot shows a table titled "Loading Details" with the following data:

| Protocol Number | Product | Generic Name | Specification Name | Protocol |
|-----------------|-------------|--------------------|------------------------------|----------------------|
| PC0001 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0002 | Epinephrine | GN 001 | SS Epinephrine Specification | View |
| PC0003 | Epinephrine | GN 001 | SS Epinephrine Specification | View |
| PC0004 | Epinephrine | GN 001 | SS Epinephrine Specification | View |
| PC0005 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0006 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0008 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |
| PC0007 | PARA65 | Paracetamol 650 mg | SP_SS_PARA65 | View |

Navigation and status: << | < | > | >> | Go to page: 1 | Row count: 10 | Showing 1-8 of 8 | Previous | Next | LIMS User | Logout | All rights Reserved PharmaSoftSol | LIMS 2.0

112.Click on Logout

SSNo : PSS-LIMS-SS-112

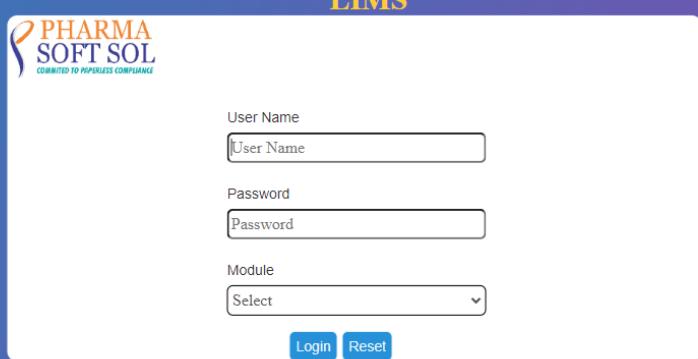

The screenshot shows the LIMS login interface with the following fields:

- User Name:
- Password:
- Module:
- Buttons: and